

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

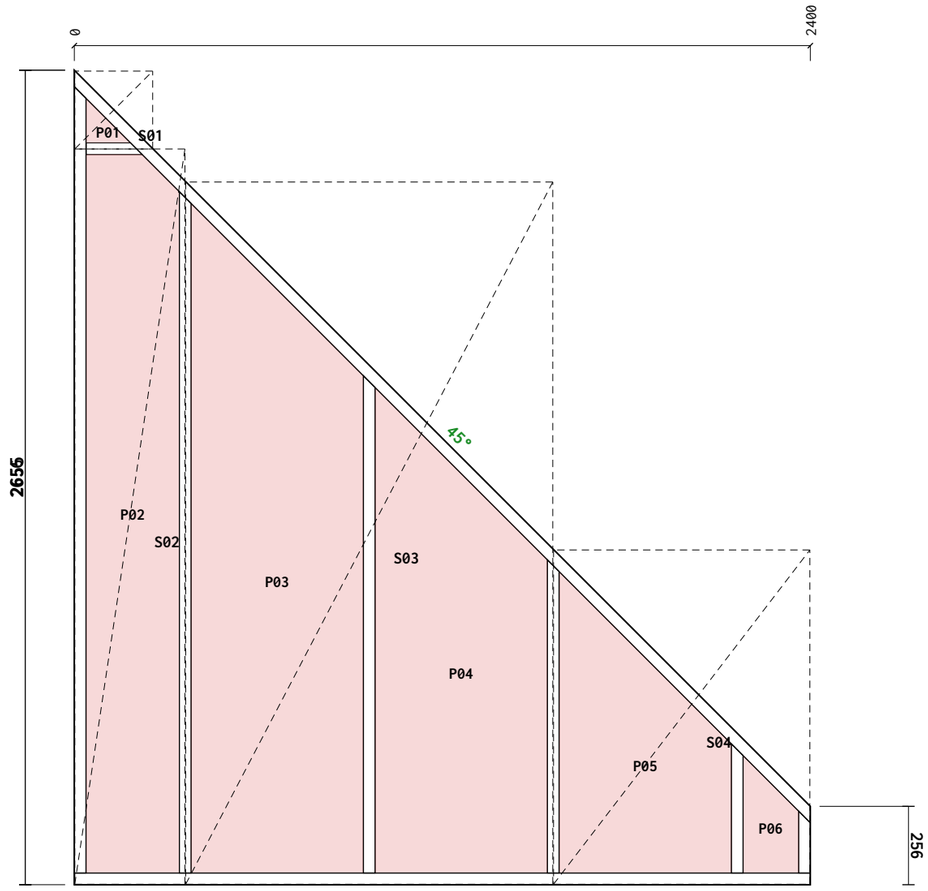



Breather bot overlap: 150mm

Breather R overlap: 150mm

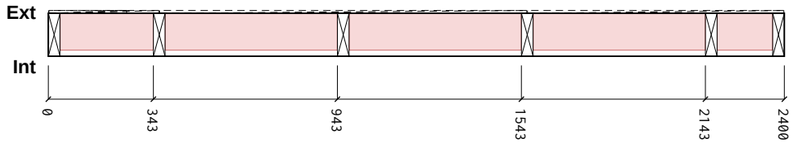


## Section A-A

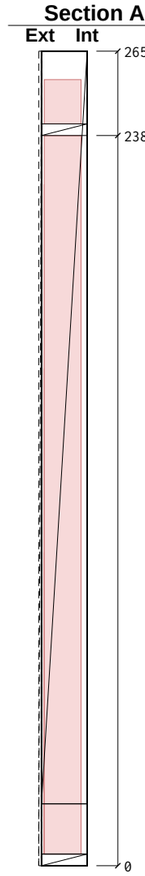


## Cut List

| Item | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|
| BR1 Bottom Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| TR1 Top Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| ES1 End Stud | 38×140 C16 | 2564 | 0 | 45.0 | 1 |
| ES2 End Stud | 38×140 C16 | 202 | 0 | 45.0 | 1 |
| VS1 Vertical Stud | 38×140 C16 | 2221 | 0 | 45.0 | 1 |
| VS2 Vertical Stud | 38×140 C16 | 1621 | 0 | 45.0 | 1 |
| VS3 Vertical Stud | 38×140 C16 | 1021 | 0 | 45.0 | 1 |
| VS4 Vertical Stud | 38×140 C16 | 421 | 0 | 45.0 | 1 |
| NG1 Noggin | 38×140 C16 | 182 | 0 | 0 | 1 |

**Total: 9 pcs / 13.03 m**

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 254 | 254 | **S01** |
| OSB 9mm | 359 | 2397 | **S02** |
| OSB 9mm | 1197 | 2289 | **S03** |
| OSB 9mm | 836 | 1090 | **S04** |
| PIR 120mm | 145 | 144 | **P01** |
| PIR 120mm | 304 | 2342 | **P02** |
| PIR 120mm | 561 | 2182 | **P03** |
| PIR 120mm | 561 | 1582 | **P04** |
| PIR 120mm | 561 | 982 | **P05** |
| PIR 120mm | 180 | 382 | **P06** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**




Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**

| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX1** | | Drawing No: **P4-MF-GB-EX1** | |
| Panel L×H×T: **2400×2655×149** | | Weight: **410 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

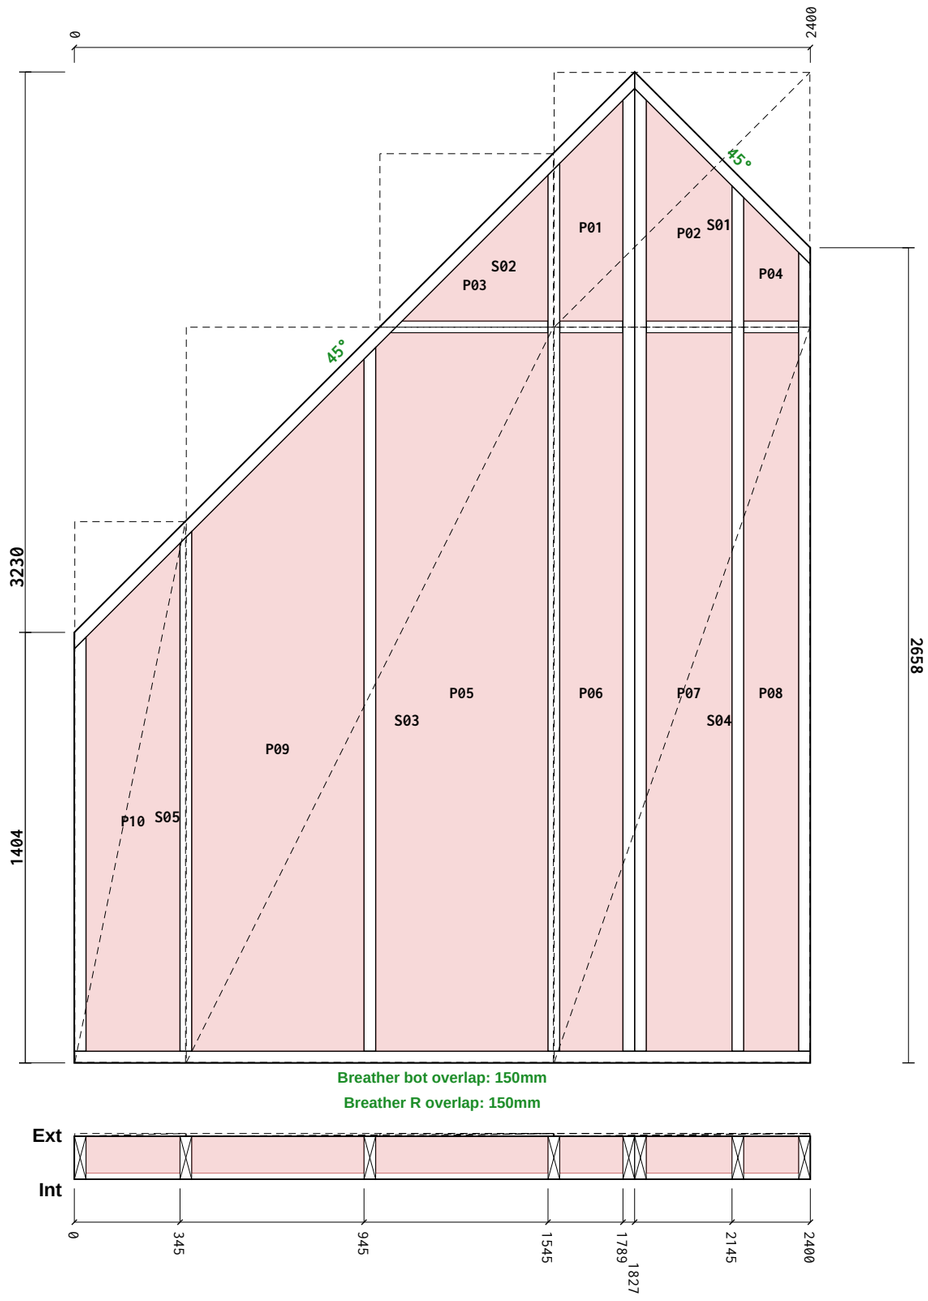

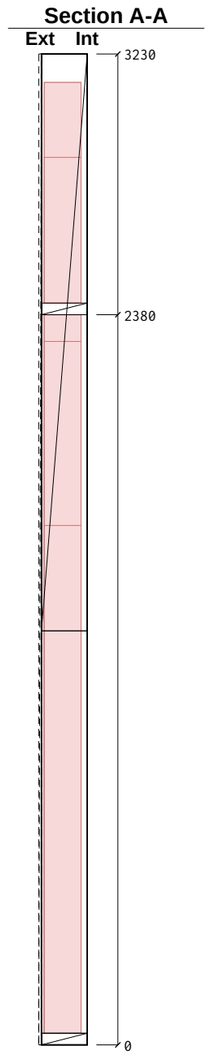
## Cut List

| Item | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|
| BR1 Bottom Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| TR1 Top Rail | 38×140 C16 | 1827 | 0 | 0 | 1 |
| TR2 Top Rail | 38×140 C16 | 573 | 0 | 0 | 1 |
| ES1 End Stud | 38×140 C16 | 1350 | 0 | -45.0 | 1 |
| ES2 End Stud | 38×140 C16 | 2604 | 0 | 45.0 | 1 |
| VS1 Vertical Stud | 38×140 C16 | 3139 | 0 | 45.0 | 1 |
| VS2 Vertical Stud | 38×140 C16 | 3139 | 0 | -45.0 | 1 |
| VS3 Vertical Stud | 38×140 C16 | 2894 | 0 | -45.0 | 1 |
| VS4 Vertical Stud | 38×140 C16 | 2821 | 0 | 45.0 | 1 |
| VS5 Vertical Stud | 38×140 C16 | 2294 | 0 | -45.0 | 1 |
| VS6 Vertical Stud | 38×140 C16 | 1694 | 0 | -45.0 | 1 |
| NG1 Noggin | 38×140 C16 | 513 | 0 | 0 | 1 |
| NG2 Noggin | 38×140 C16 | 278 | 0 | 0 | 1 |
| NG3 Noggin | 38×140 C16 | 204 | 0 | 0 | 1 |
| NG4 Noggin | 38×140 C16 | 177 | 0 | 0 | 1 |

**Total: 15 pcs / 25.91 m**

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 834 | 830 | **S01** |
| OSB 9mm | 566 | 566 | **S02** |
| OSB 9mm | 1197 | 2397 | **S03** |
| OSB 9mm | 834 | 2397 | **S04** |
| OSB 9mm | 361 | 1763 | **S05** |
| PIR 120mm | 205 | 719 | **P01** |
| PIR 120mm | 279 | 719 | **P02** |
| PIR 120mm | 475 | 475 | **P03** |
| PIR 120mm | 178 | 402 | **P04** |
| PIR 120mm | 561 | 2342 | **P05** |
| PIR 120mm | 205 | 2342 | **P06** |
| PIR 120mm | 279 | 2342 | **P07** |
| PIR 120mm | 178 | 2342 | **P08** |
| PIR 120mm | 561 | 2255 | **P09** |
| PIR 120mm | 306 | 1655 | **P10** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**



Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**


| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX2** | | Drawing No: **P4-MF-GB-EX2** | |
| Panel L×H×T: **2400×3230×149** | | Weight: **334 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

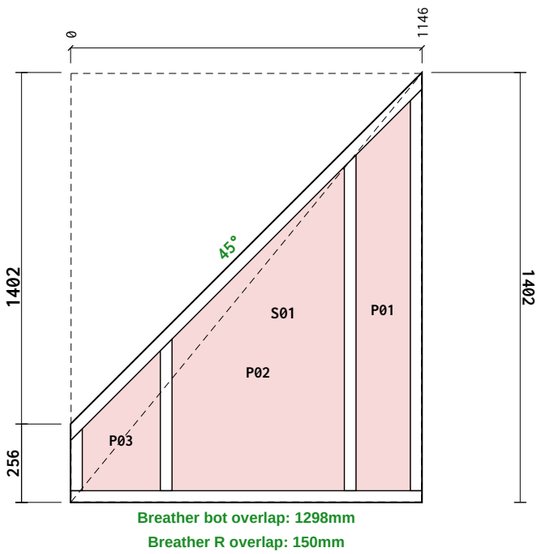


**Breather bot overlap: 1298mm**

**Breather R overlap: 150mm**

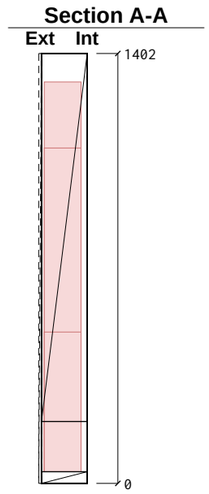

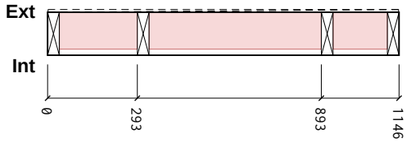
## Cut List

| Item | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|
| BR1 Bottom Rail | 38×140 C16 | 1146 | 0 | 0 | 1 |
| TR1 Top Rail | 38×140 C16 | 1146 | 0 | 0 | 1 |
| ES1 End Stud | 38×140 C16 | 202 | 0 | -45.0 | 1 |
| ES2 End Stud | 38×140 C16 | 1310 | 0 | -45.0 | 1 |
| VS1 Vertical Stud | 38×140 C16 | 1094 | 0 | -45.0 | 1 |
| VS2 Vertical Stud | 38×140 C16 | 494 | 0 | -45.0 | 1 |
| **Total: 6 pcs / 5.39 m** | | | | | |

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 1143 | 1397 | **S01** |
| PIR 120mm | 176 | 1271 | **P01** |
| PIR 120mm | 561 | 1055 | **P02** |
| PIR 120mm | 254 | 455 | **P03** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**



Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**


| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX3** | | Drawing No: **P4-MF-GB-EX3** | |
| Panel L×H×T: **1146×1402×149** | | Weight: **103 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

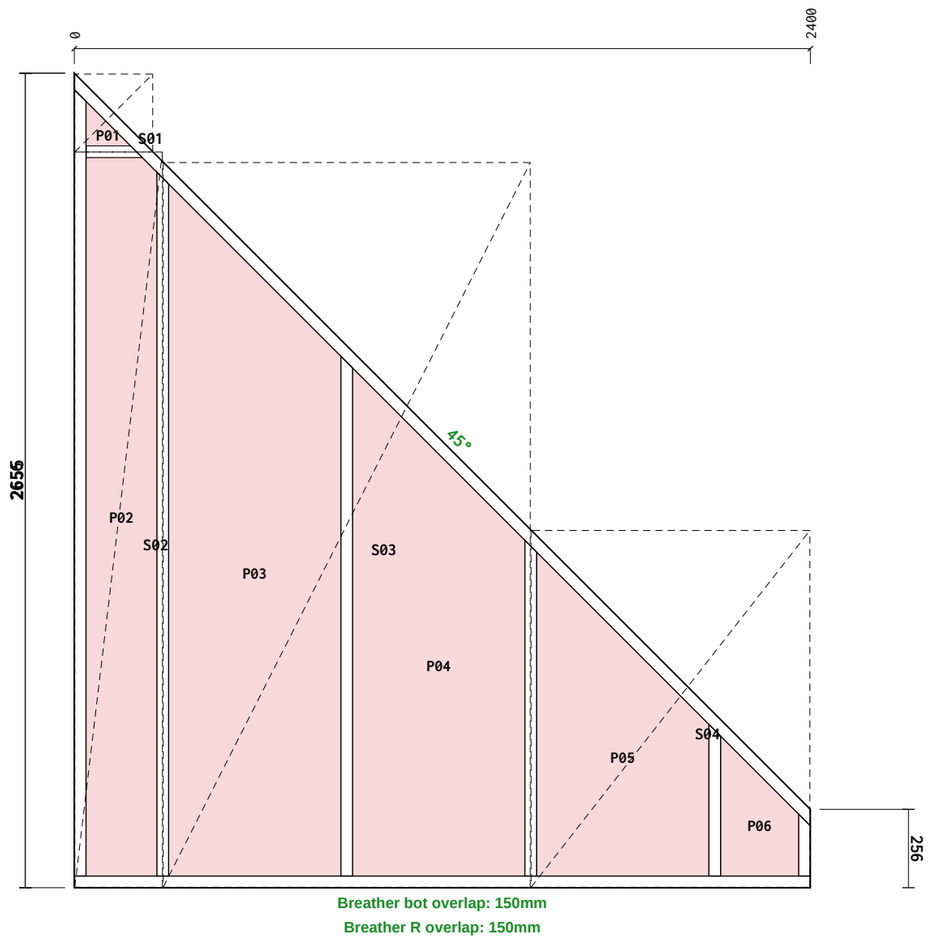


Breather bot overlap: 150mm

Breather R overlap: 150mm

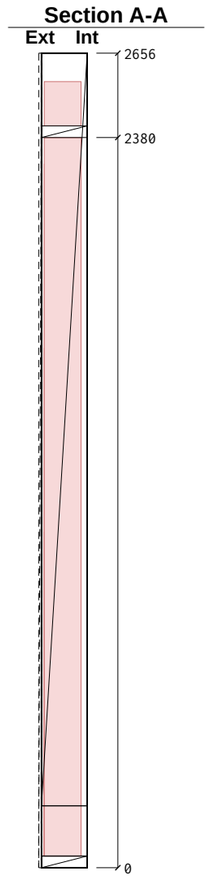

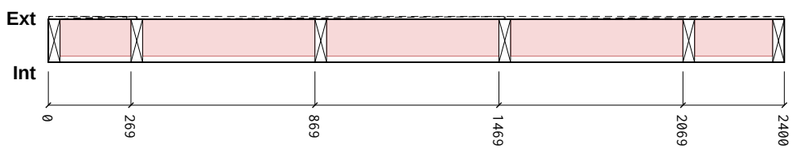
## Cut List

| Item | | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|---|
| BR1 | Bottom Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| TR1 | Top Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| ES1 | End Stud | 38×140 C16 | 2564 | 0 | 45.0 | 1 |
| ES2 | End Stud | 38×140 C16 | 202 | 0 | 45.0 | 1 |
| VS1 | Vertical Stud | 38×140 C16 | 2294 | 0 | 45.0 | 1 |
| VS2 | Vertical Stud | 38×140 C16 | 1694 | 0 | 45.0 | 1 |
| VS3 | Vertical Stud | 38×140 C16 | 1094 | 0 | 45.0 | 1 |
| VS4 | Vertical Stud | 38×140 C16 | 494 | 0 | 45.0 | 1 |
| NG1 | Noggin | 38×140 C16 | 182 | 0 | 0 | 1 |

**Total: 9 pcs / 13.32 m**

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 254 | 254 | **S01** |
| OSB 9mm | 286 | 2397 | **S02** |
| OSB 9mm | 1197 | 2363 | **S03** |
| OSB 9mm | 909 | 1163 | **S04** |
| PIR 120mm | 145 | 144 | **P01** |
| PIR 120mm | 230 | 2342 | **P02** |
| PIR 120mm | 561 | 2255 | **P03** |
| PIR 120mm | 561 | 1655 | **P04** |
| PIR 120mm | 561 | 1055 | **P05** |
| PIR 120mm | 254 | 455 | **P06** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**




Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**

| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX4** | | Drawing No: **P4-MF-GB-EX4** | |
| Panel L×H×T: **2400×2655×149** | | Weight: **411 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

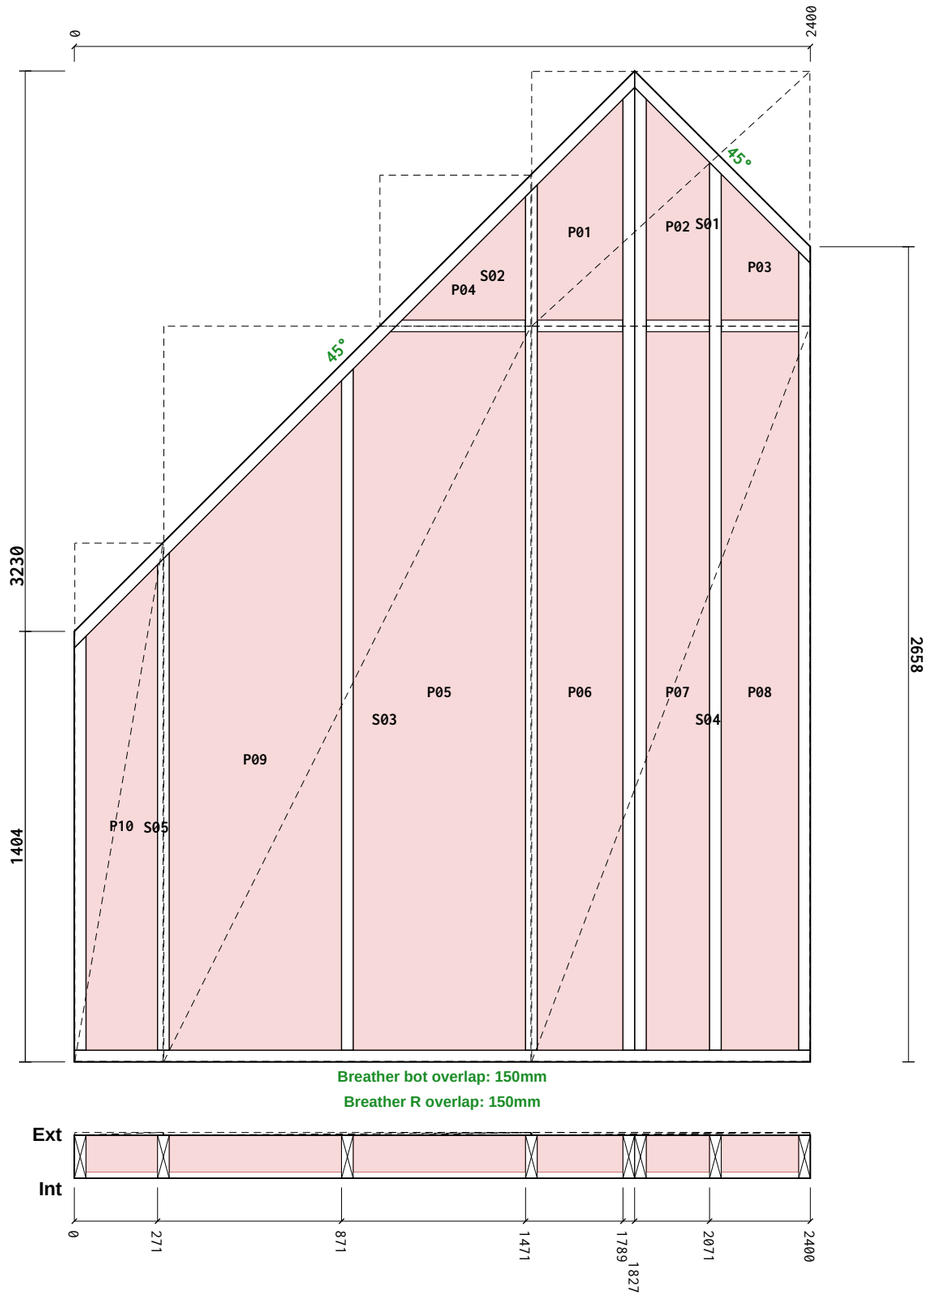

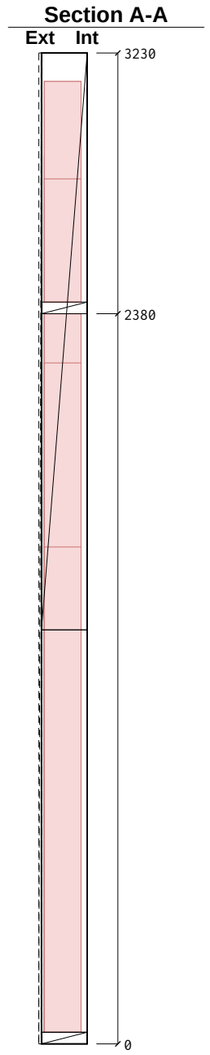
## Cut List

| Item | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|
| BR1 Bottom Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| TR1 Top Rail | 38×140 C16 | 1827 | 0 | 0 | 1 |
| TR2 Top Rail | 38×140 C16 | 573 | 0 | 0 | 1 |
| ES1 End Stud | 38×140 C16 | 1350 | 0 | -45.0 | 1 |
| ES2 End Stud | 38×140 C16 | 2604 | 0 | 45.0 | 1 |
| VS1 Vertical Stud | 38×140 C16 | 3139 | 0 | 45.0 | 1 |
| VS2 Vertical Stud | 38×140 C16 | 3139 | 0 | -45.0 | 1 |
| VS3 Vertical Stud | 38×140 C16 | 2894 | 0 | 45.0 | 1 |
| VS4 Vertical Stud | 38×140 C16 | 2821 | 0 | -45.0 | 1 |
| VS5 Vertical Stud | 38×140 C16 | 2221 | 0 | -45.0 | 1 |
| VS6 Vertical Stud | 38×140 C16 | 1621 | 0 | -45.0 | 1 |
| NG1 Noggin | 38×140 C16 | 440 | 0 | 0 | 1 |
| NG2 Noggin | 38×140 C16 | 278 | 0 | 0 | 1 |
| NG3 Noggin | 38×140 C16 | 251 | 0 | 0 | 1 |
| NG4 Noggin | 38×140 C16 | 204 | 0 | 0 | 1 |

**Total: 15 pcs / 25.76 m**

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 907 | 830 | **S01** |
| OSB 9mm | 492 | 492 | **S02** |
| OSB 9mm | 1197 | 2397 | **S03** |
| OSB 9mm | 907 | 2397 | **S04** |
| OSB 9mm | 288 | 1690 | **S05** |
| PIR 120mm | 279 | 719 | **P01** |
| PIR 120mm | 205 | 719 | **P02** |
| PIR 120mm | 252 | 475 | **P03** |
| PIR 120mm | 402 | 402 | **P04** |
| PIR 120mm | 561 | 2342 | **P05** |
| PIR 120mm | 279 | 2342 | **P06** |
| PIR 120mm | 205 | 2342 | **P07** |
| PIR 120mm | 252 | 2342 | **P08** |
| PIR 120mm | 561 | 2182 | **P09** |
| PIR 120mm | 232 | 1582 | **P10** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**



Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**


| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX5** | | Drawing No: **P4-MF-GB-EX5** | |
| Panel L×H×T: **2400×3230×149** | | Weight: **333 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

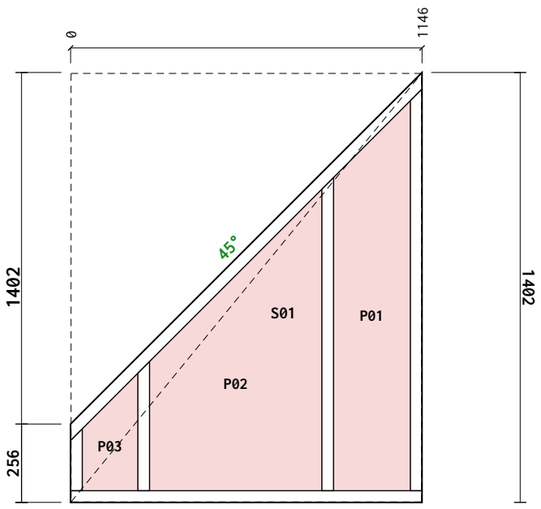


**Breather bot overlap: 1298mm**

**Breather R overlap: 150mm**

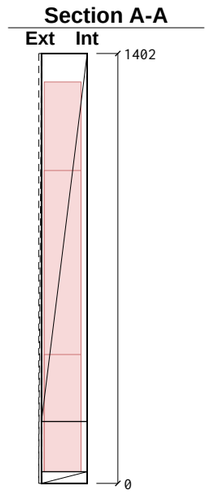





## Cut List

| Item | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|
| BR1 Bottom Rail | 38×140 C16 | 1146 | 0 | 0 | 1 |
| TR1 Top Rail | 38×140 C16 | 1146 | 0 | 0 | 1 |
| ES1 End Stud | 38×140 C16 | 202 | 0 | -45.0 | 1 |
| ES2 End Stud | 38×140 C16 | 1310 | 0 | -45.0 | 1 |
| VS1 Vertical Stud | 38×140 C16 | 1021 | 0 | -45.0 | 1 |
| VS2 Vertical Stud | 38×140 C16 | 421 | 0 | -45.0 | 1 |
| **Total: 6 pcs / 5.25 m** | | | | | |

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 1143 | 1397 | **S01** |
| PIR 120mm | 250 | 1271 | **P01** |
| PIR 120mm | 561 | 982 | **P02** |
| PIR 120mm | 180 | 382 | **P03** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**





Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**

| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX6** | | Drawing No: **P4-MF-GB-EX6** | |
| Panel L×H×T: **1146×1402×149** | | Weight: **103 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

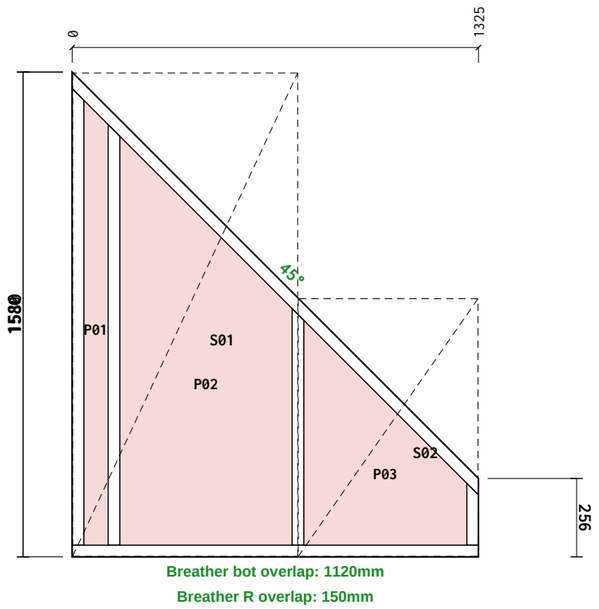

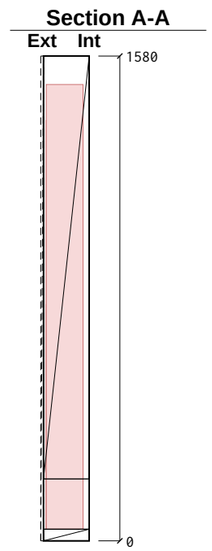
## Cut List
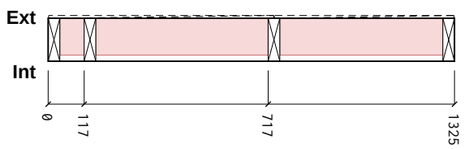
| Item | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|
| BR1 Bottom Rail | 38×140 C16 | 1325 | 0 | 0 | 1 |
| TR1 Top Rail | 38×140 C16 | 1325 | 0 | 0 | 1 |
| ES1 End Stud | 38×140 C16 | 1489 | 0 | 45.0 | 1 |
| ES2 End Stud | 38×140 C16 | 202 | 0 | 45.0 | 1 |
| VS1 Vertical Stud | 38×140 C16 | 1371 | 0 | 45.0 | 1 |
| VS2 Vertical Stud | 38×140 C16 | 771 | 0 | 45.0 | 1 |
| **Total: 6 pcs / 6.48 m** | | | | | |

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 734 | 1576 | **S01** |
| OSB 9mm | 586 | 840 | **S02** |
| PIR 120mm | 78 | 1450 | **P01** |
| PIR 120mm | 561 | 1332 | **P02** |
| PIR 120mm | 531 | 732 | **P03** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**



Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**


| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX7** | | Drawing No: **P4-MF-GB-EX7** | |
| Panel L×H×T: **1325×1580×149** | | Weight: **133 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

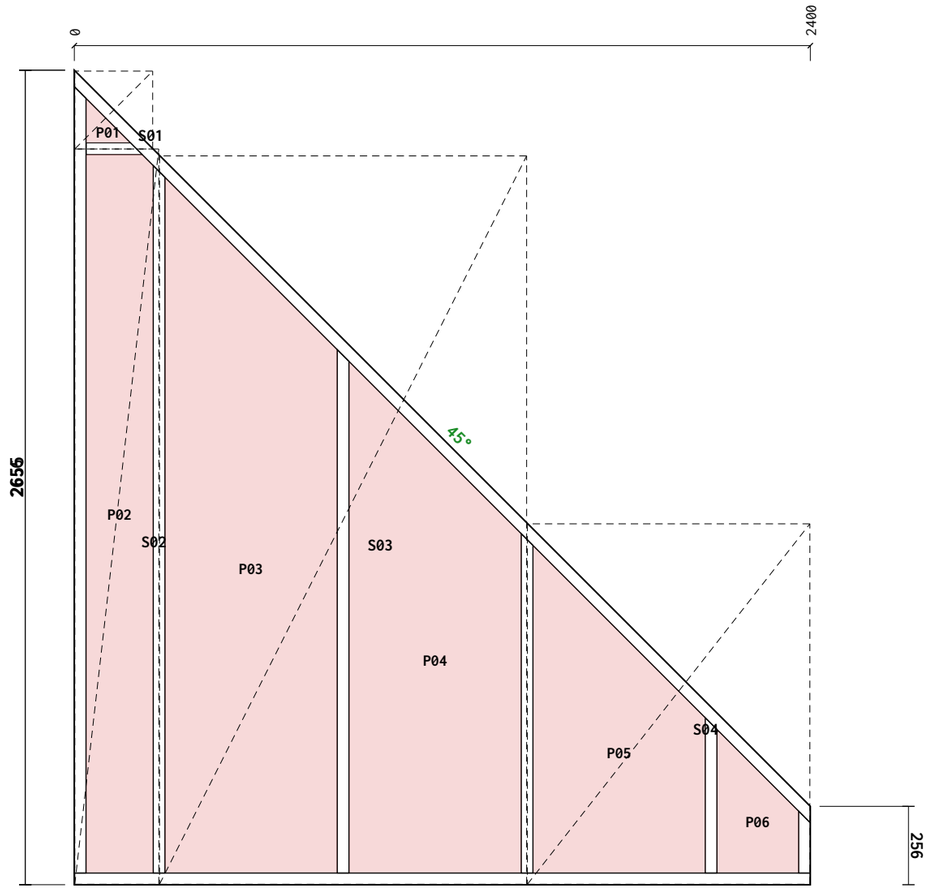


Breather bot overlap: 150mm

Breather R overlap: 150mm

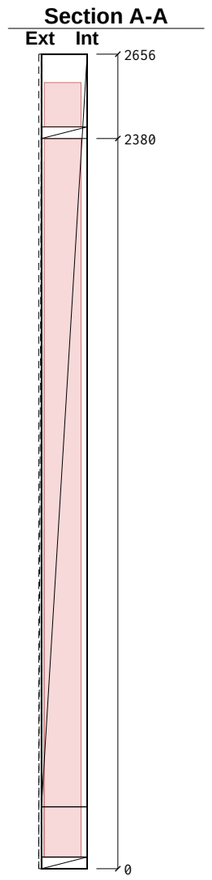

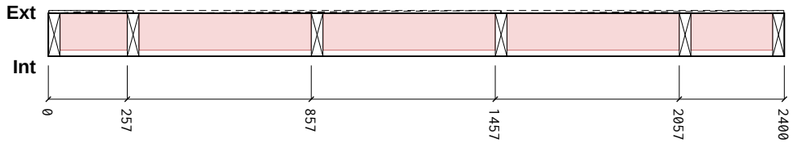
## Cut List

| Item | | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|---|
| BR1 | Bottom Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| TR1 | Top Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| ES1 | End Stud | 38×140 C16 | 2564 | 0 | 45.0 | 1 |
| ES2 | End Stud | 38×140 C16 | 202 | 0 | 45.0 | 1 |
| VS1 | Vertical Stud | 38×140 C16 | 2306 | 0 | 45.0 | 1 |
| VS2 | Vertical Stud | 38×140 C16 | 1706 | 0 | 45.0 | 1 |
| VS3 | Vertical Stud | 38×140 C16 | 1106 | 0 | 45.0 | 1 |
| VS4 | Vertical Stud | 38×140 C16 | 506 | 0 | 45.0 | 1 |
| NG1 | Noggin | 38×140 C16 | 182 | 0 | 0 | 1 |

**Total: 9 pcs / 13.37 m**

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 254 | 254 | **S01** |
| OSB 9mm | 274 | 2397 | **S02** |
| OSB 9mm | 1197 | 2375 | **S03** |
| OSB 9mm | 921 | 1175 | **S04** |
| PIR 120mm | 145 | 144 | **P01** |
| PIR 120mm | 218 | 2342 | **P02** |
| PIR 120mm | 561 | 2267 | **P03** |
| PIR 120mm | 561 | 1667 | **P04** |
| PIR 120mm | 561 | 1067 | **P05** |
| PIR 120mm | 266 | 467 | **P06** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**




Revisions (Rev · Date · Note):
C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction

| | | | |
|---|---|---|---|
| Date: 2026-10-11 | Scale: 1:20 | Drawn: TS | Checked: |
| Project Name: MP Adams Plot 4, Eckington | | | |
| Site: Eckington | | Client: MP Adams | |
| Title: Panel Fabrication — 38 x 140 C16 CLS | | | |
| Project Number: P4 | | Revision: C04 | |
| Panel No: GB-EX8 | | Drawing No: P4-MF-GB-EX8 | |
| Panel L×H×T: 2400×2655×149 | | Weight: 411 kg | |
| Status: CONSTRUCTION | | Sheet: 1 / 1 | |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

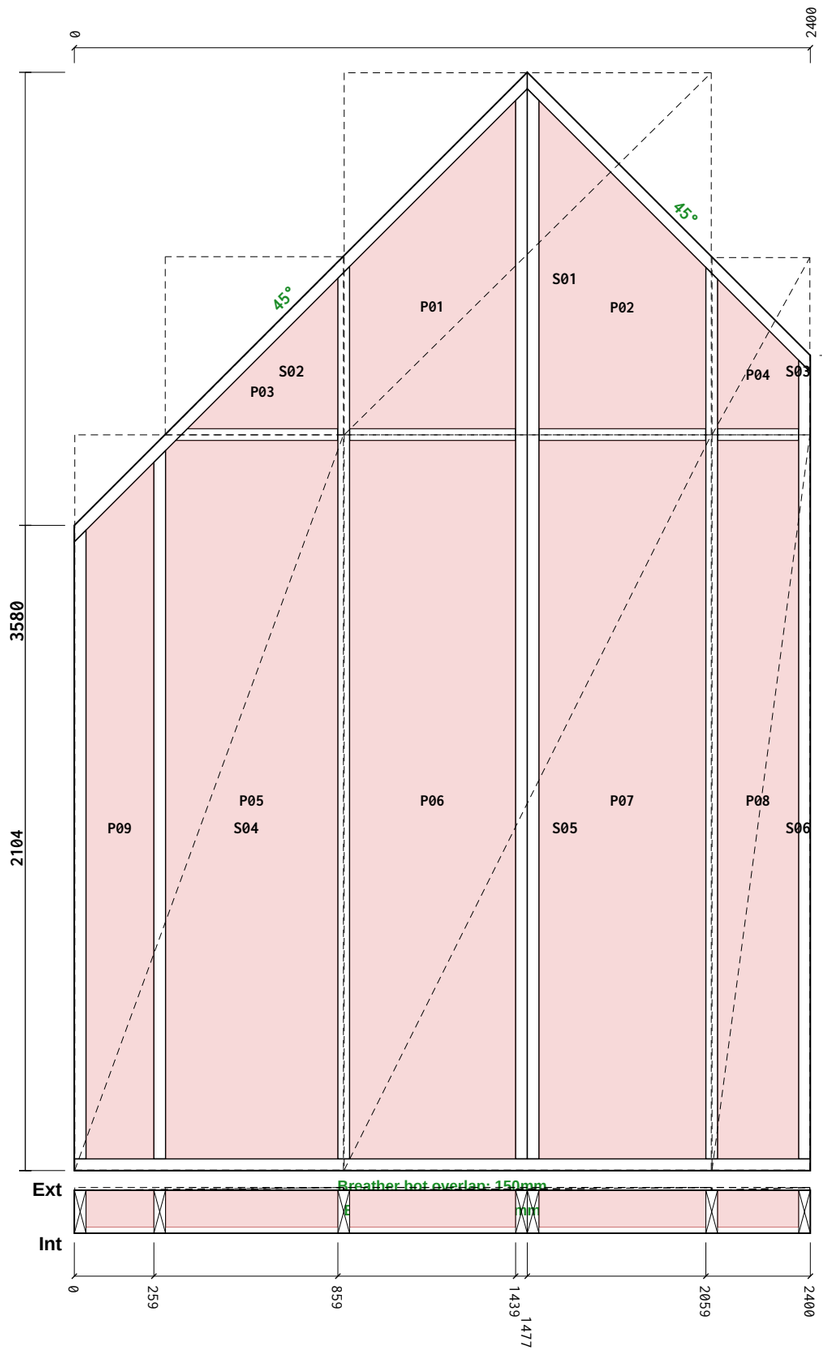

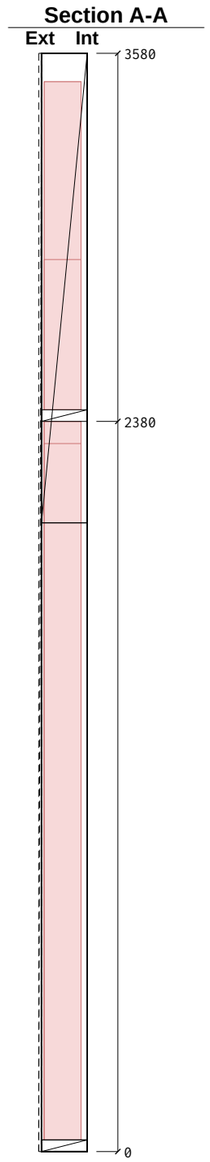
## Cut List

| Item | | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|---|
| BR1 | Bottom Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| TR1 | Top Rail | 38×140 C16 | 1477 | 0 | 0 | 1 |
| TR2 | Top Rail | 38×140 C16 | 923 | 0 | 0 | 1 |
| ES1 | End Stud | 38×140 C16 | 2050 | 0 | -45.0 | 1 |
| ES2 | End Stud | 38×140 C16 | 2604 | 0 | 45.0 | 1 |
| VS1 | Vertical Stud | 38×140 C16 | 3489 | 0 | 45.0 | 1 |
| VS2 | Vertical Stud | 38×140 C16 | 3489 | 0 | -45.0 | 1 |
| VS3 | Vertical Stud | 38×140 C16 | 2909 | 0 | -45.0 | 1 |
| VS4 | Vertical Stud | 38×140 C16 | 2906 | 0 | 45.0 | 1 |
| VS5 | Vertical Stud | 38×140 C16 | 2309 | 0 | -45.0 | 1 |
| NG1 | Noggin | 38×140 C16 | 542 | 0 | 0 | 1 |
| NG2 | Noggin | 38×140 C16 | 540 | 0 | 0 | 1 |
| NG3 | Noggin | 38×140 C16 | 528 | 0 | 0 | 1 |
| NG4 | Noggin | 38×140 C16 | 263 | 0 | 0 | 1 |

**Total: 14 pcs / 26.43 m**

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 1197 | 1181 | **S01** |
| OSB 9mm | 581 | 581 | **S02** |
| OSB 9mm | 319 | 578 | **S03** |
| OSB 9mm | 876 | 2397 | **S04** |
| OSB 9mm | 1197 | 2397 | **S05** |
| OSB 9mm | 319 | 2397 | **S06** |
| PIR 120mm | 541 | 1069 | **P01** |
| PIR 120mm | 543 | 1069 | **P02** |
| PIR 120mm | 490 | 490 | **P03** |
| PIR 120mm | 264 | 487 | **P04** |
| PIR 120mm | 561 | 2342 | **P05** |
| PIR 120mm | 541 | 2342 | **P06** |
| PIR 120mm | 543 | 2342 | **P07** |
| PIR 120mm | 264 | 2342 | **P08** |
| PIR 120mm | 220 | 2270 | **P09** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**



Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**


| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX9** | | Drawing No: **P4-MF-GB-EX9** | |
| Panel L×H×T: **2400×3580×149** | | Weight: **309 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

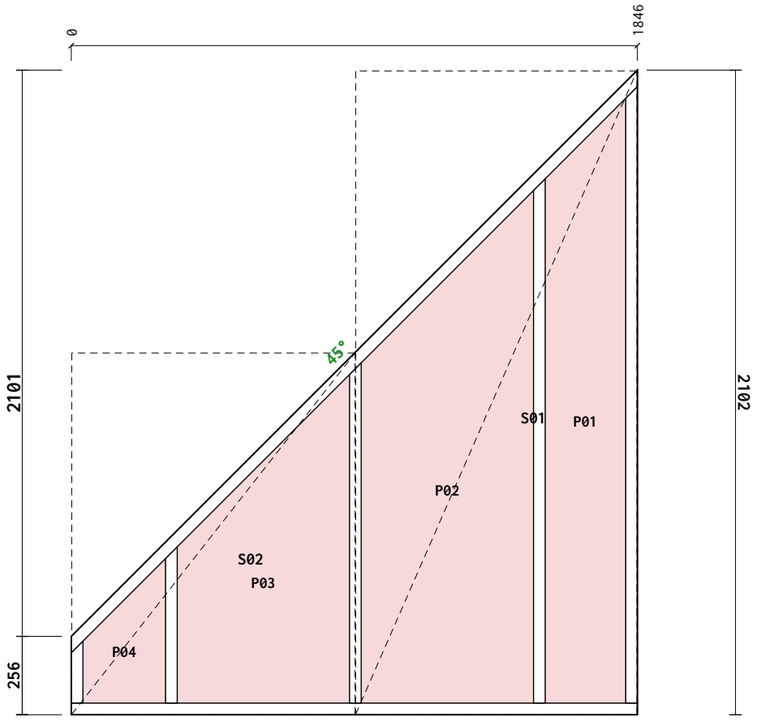


Breather bot overlap: 599mm

Breather R overlap: 150mm

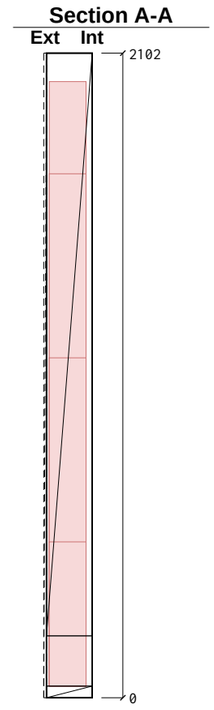

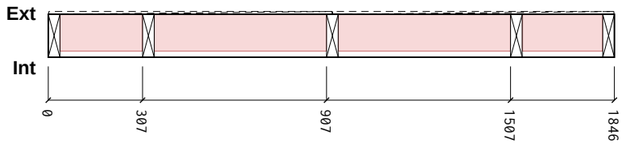
## Cut List

| Item | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|
| BR1 Bottom Rail | 38×140 C16 | 1846 | 0 | 0 | 1 |
| TR1 Top Rail | 38×140 C16 | 1846 | 0 | 0 | 1 |
| ES1 End Stud | 38×140 C16 | 202 | 0 | -45.0 | 1 |
| ES2 End Stud | 38×140 C16 | 2010 | 0 | -45.0 | 1 |
| VS1 Vertical Stud | 38×140 C16 | 1709 | 0 | -45.0 | 1 |
| VS2 Vertical Stud | 38×140 C16 | 1109 | 0 | -45.0 | 1 |
| VS3 Vertical Stud | 38×140 C16 | 509 | 0 | -45.0 | 1 |

**Total: 7 pcs / 9.23 m**

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 917 | 2097 | **S01** |
| OSB 9mm | 924 | 1178 | **S02** |
| PIR 120mm | 262 | 1971 | **P01** |
| PIR 120mm | 561 | 1670 | **P02** |
| PIR 120mm | 561 | 1070 | **P03** |
| PIR 120mm | 268 | 470 | **P04** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**



Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**


| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX10** | | Drawing No: **P4-MF-GB-EX10** | |
| Panel L×H×T: **1846×2101×149** | | Weight: **248 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

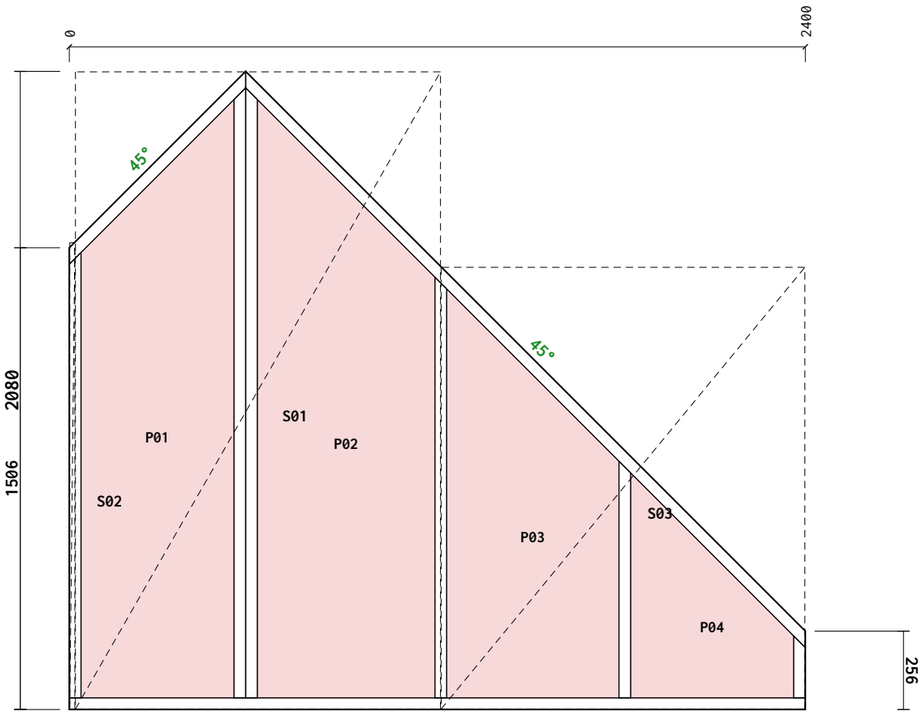


**Breather bot overlap: 620mm**

**Breather R overlap: 150mm**

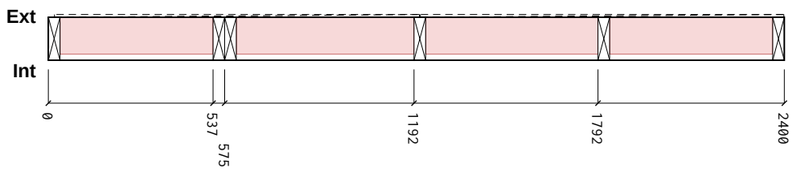

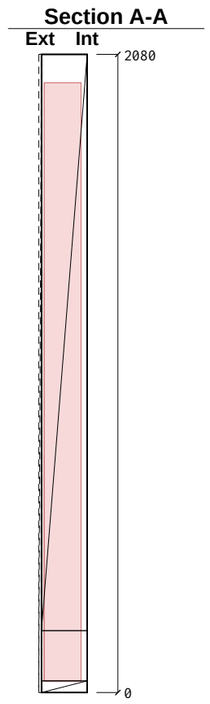
## Cut List

| Item | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|
| BR1 Bottom Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| TR1 Top Rail | 38×140 C16 | 1825 | 0 | 0 | 1 |
| TR2 Top Rail | 38×140 C16 | 575 | 0 | 0 | 1 |
| ES1 End Stud | 38×140 C16 | 1452 | 0 | -45.0 | 1 |
| ES2 End Stud | 38×140 C16 | 202 | 0 | 45.0 | 1 |
| VS1 Vertical Stud | 38×140 C16 | 1989 | 0 | 45.0 | 1 |
| VS2 Vertical Stud | 38×140 C16 | 1989 | 0 | -45.0 | 1 |
| VS3 Vertical Stud | 38×140 C16 | 1371 | 0 | 45.0 | 1 |
| VS4 Vertical Stud | 38×140 C16 | 771 | 0 | 45.0 | 1 |

**Total: 9 pcs / 12.57 m**

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 1190 | 2078 | **S01** |
| OSB 9mm | 16 | 1520 | **S02** |
| OSB 9mm | 1186 | 1440 | **S03** |
| PIR 120mm | 498 | 1950 | **P01** |
| PIR 120mm | 578 | 1950 | **P02** |
| PIR 120mm | 561 | 1332 | **P03** |
| PIR 120mm | 531 | 732 | **P04** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**





Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**

| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX11** | | Drawing No: **P4-MF-GB-EX11** | |
| Panel L×H×T: **2400×2080×149** | | Weight: **282 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

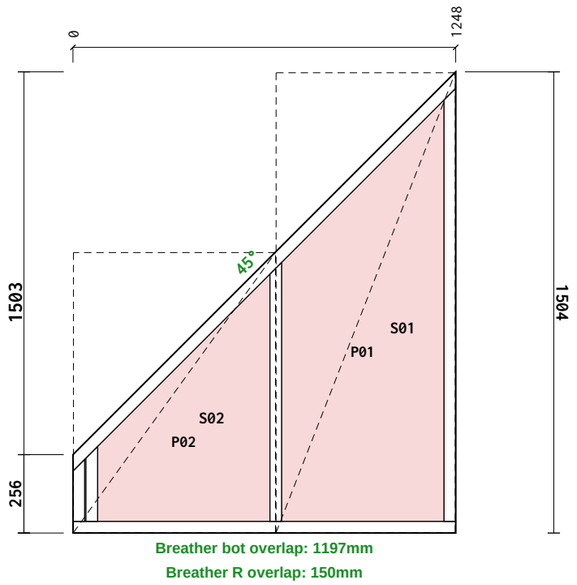

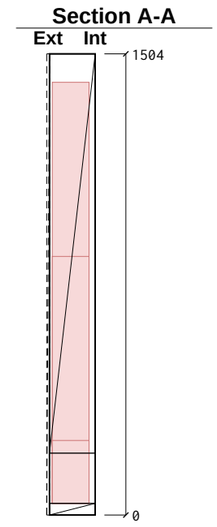
## Cut List
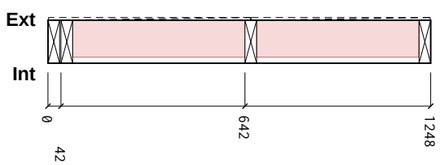
| Item | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|
| BR1 Bottom Rail | 38×140 C16 | 1248 | 0 | 0 | 1 |
| TR1 Top Rail | 38×140 C16 | 1248 | 0 | 0 | 1 |
| ES1 End Stud | 38×140 C16 | 202 | 0 | -45.0 | 1 |
| ES2 End Stud | 38×140 C16 | 1412 | 0 | -45.0 | 1 |
| VS1 Vertical Stud | 38×140 C16 | 844 | 0 | -45.0 | 1 |
| VS2 Vertical Stud | 38×140 C16 | 244 | 0 | -45.0 | 1 |

**Total: 6 pcs / 5.20 m**

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 584 | 1499 | **S01** |
| OSB 9mm | 659 | 913 | **S02** |
| PIR 120mm | 529 | 1373 | **P01** |
| PIR 120mm | 561 | 805 | **P02** |
| PIR 120mm | 3 | 205 | **P03** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**



Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**


| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX12** | | Drawing No: **P4-MF-GB-EX12** | |
| Panel L×H×T: **1248×1503×149** | | Weight: **117 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

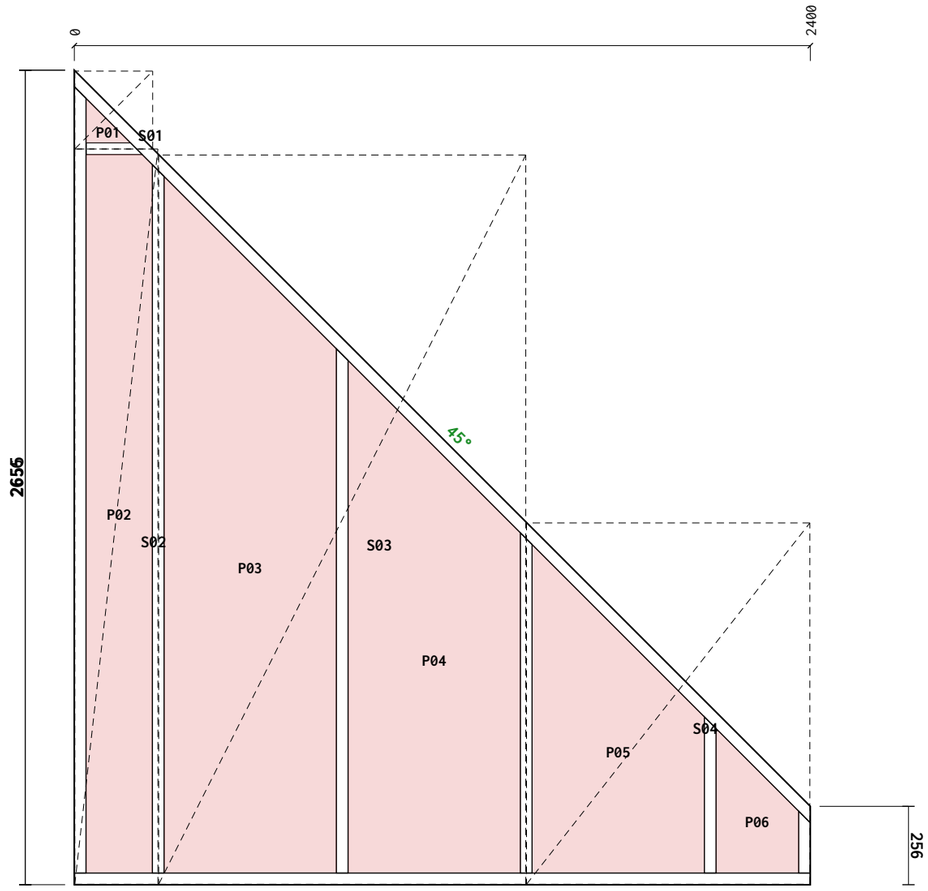


Breather bot overlap: 150mm

Breather R overlap: 150mm

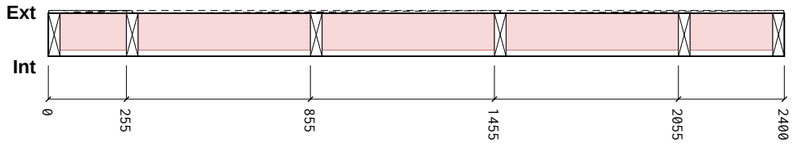

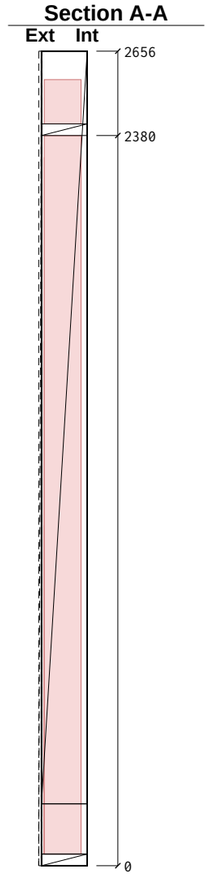
## Cut List

| Item | | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|---|
| BR1 | Bottom Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| TR1 | Top Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| ES1 | End Stud | 38×140 C16 | 2564 | 0 | 45.0 | 1 |
| ES2 | End Stud | 38×140 C16 | 202 | 0 | 45.0 | 1 |
| VS1 | Vertical Stud | 38×140 C16 | 2309 | 0 | 45.0 | 1 |
| VS2 | Vertical Stud | 38×140 C16 | 1709 | 0 | 45.0 | 1 |
| VS3 | Vertical Stud | 38×140 C16 | 1109 | 0 | 45.0 | 1 |
| VS4 | Vertical Stud | 38×140 C16 | 509 | 0 | 45.0 | 1 |
| NG1 | Noggin | 38×140 C16 | 182 | 0 | 0 | 1 |

**Total: 9 pcs / 13.38 m**

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 254 | 254 | **S01** |
| OSB 9mm | 271 | 2397 | **S02** |
| OSB 9mm | 1197 | 2377 | **S03** |
| OSB 9mm | 924 | 1178 | **S04** |
| PIR 120mm | 145 | 144 | **P01** |
| PIR 120mm | 216 | 2342 | **P02** |
| PIR 120mm | 561 | 2270 | **P03** |
| PIR 120mm | 561 | 1670 | **P04** |
| PIR 120mm | 561 | 1070 | **P05** |
| PIR 120mm | 268 | 470 | **P06** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**




Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**

| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX13** | | Drawing No: **P4-MF-GB-EX13** | |
| Panel L×H×T: **2400×2655×149** | | Weight: **411 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

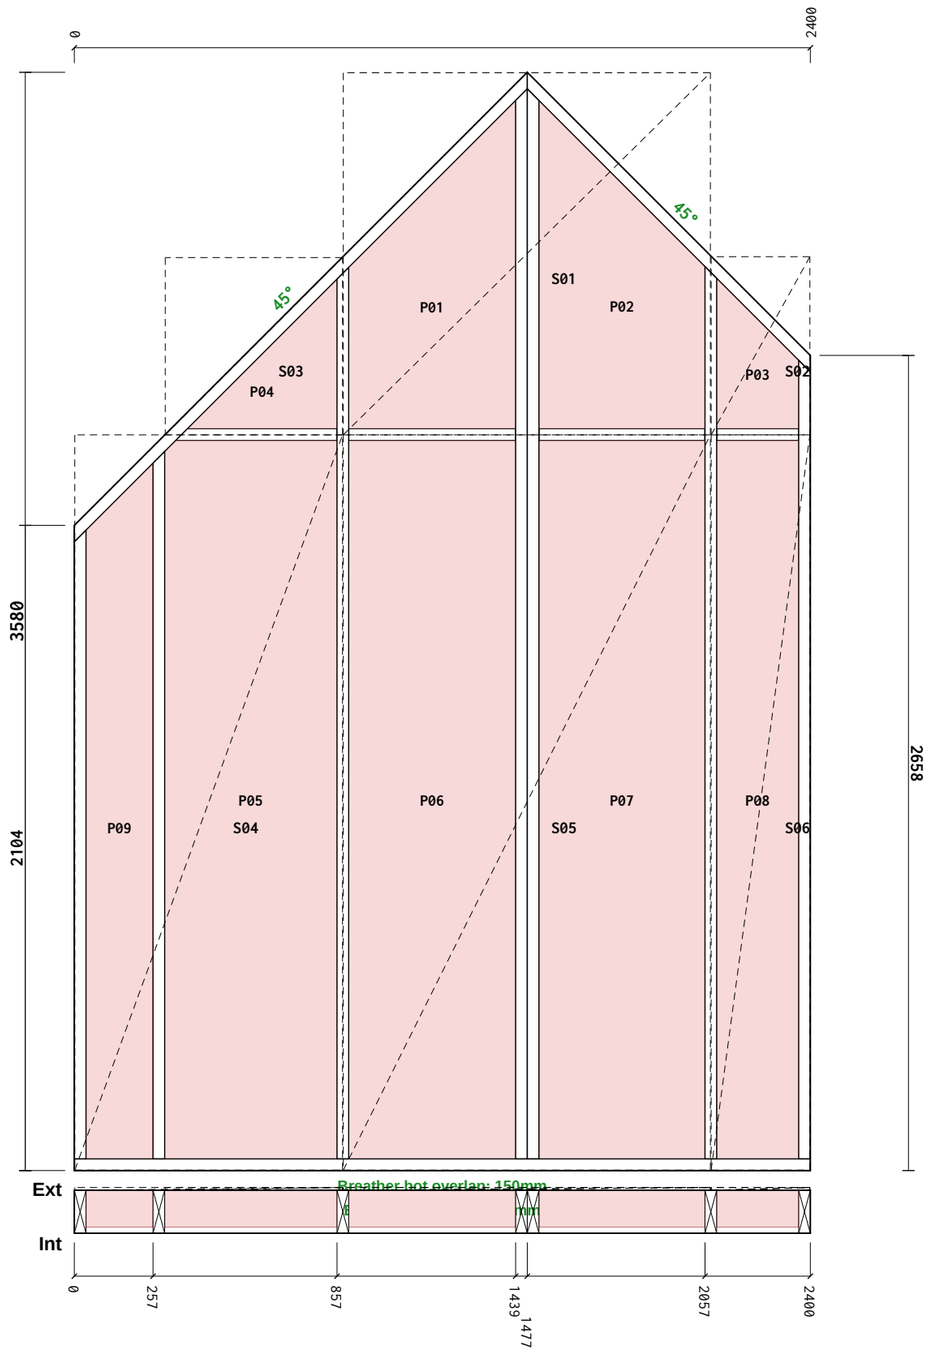

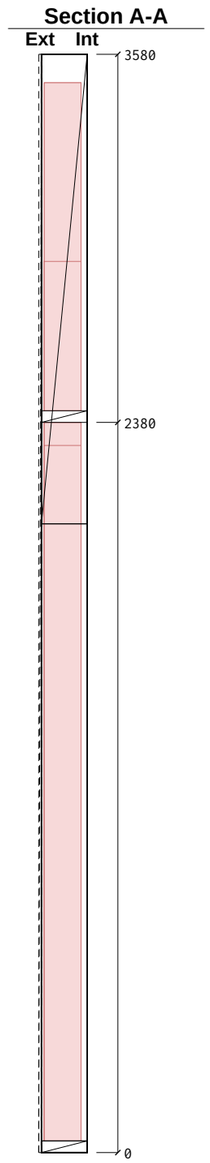
## Cut List

| Item | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|
| BR1 Bottom Rail | 38×140 C16 | 2400 | 0 | 0 | 1 |
| TR1 Top Rail | 38×140 C16 | 1477 | 0 | 0 | 1 |
| TR2 Top Rail | 38×140 C16 | 923 | 0 | 0 | 1 |
| ES1 End Stud | 38×140 C16 | 2050 | 0 | -45.0 | 1 |
| ES2 End Stud | 38×140 C16 | 2604 | 0 | 45.0 | 1 |
| VS1 Vertical Stud | 38×140 C16 | 3489 | 0 | 45.0 | 1 |
| VS2 Vertical Stud | 38×140 C16 | 3489 | 0 | -45.0 | 1 |
| VS3 Vertical Stud | 38×140 C16 | 2909 | 0 | 45.0 | 1 |
| VS4 Vertical Stud | 38×140 C16 | 2906 | 0 | -45.0 | 1 |
| VS5 Vertical Stud | 38×140 C16 | 2306 | 0 | -45.0 | 1 |
| NG1 Noggin | 38×140 C16 | 542 | 0 | 0 | 1 |
| NG2 Noggin | 38×140 C16 | 540 | 0 | 0 | 1 |
| NG3 Noggin | 38×140 C16 | 525 | 0 | 0 | 1 |
| NG4 Noggin | 38×140 C16 | 265 | 0 | 0 | 1 |

**Total: 14 pcs / 26.43 m**

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 1197 | 1181 | **S01** |
| OSB 9mm | 322 | 581 | **S02** |
| OSB 9mm | 578 | 578 | **S03** |
| OSB 9mm | 873 | 2397 | **S04** |
| OSB 9mm | 1197 | 2397 | **S05** |
| OSB 9mm | 322 | 2397 | **S06** |
| PIR 120mm | 543 | 1069 | **P01** |
| PIR 120mm | 541 | 1069 | **P02** |
| PIR 120mm | 266 | 490 | **P03** |
| PIR 120mm | 487 | 487 | **P04** |
| PIR 120mm | 561 | 2342 | **P05** |
| PIR 120mm | 543 | 2342 | **P06** |
| PIR 120mm | 541 | 2342 | **P07** |
| PIR 120mm | 266 | 2342 | **P08** |
| PIR 120mm | 218 | 2267 | **P09** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


**KEY PLAN**



Revisions (Rev · Date · Note):
**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**


| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX14** | | Drawing No: **P4-MF-GB-EX14** | |
| Panel L×H×T: **2400×3580×149** | | Weight: **309 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

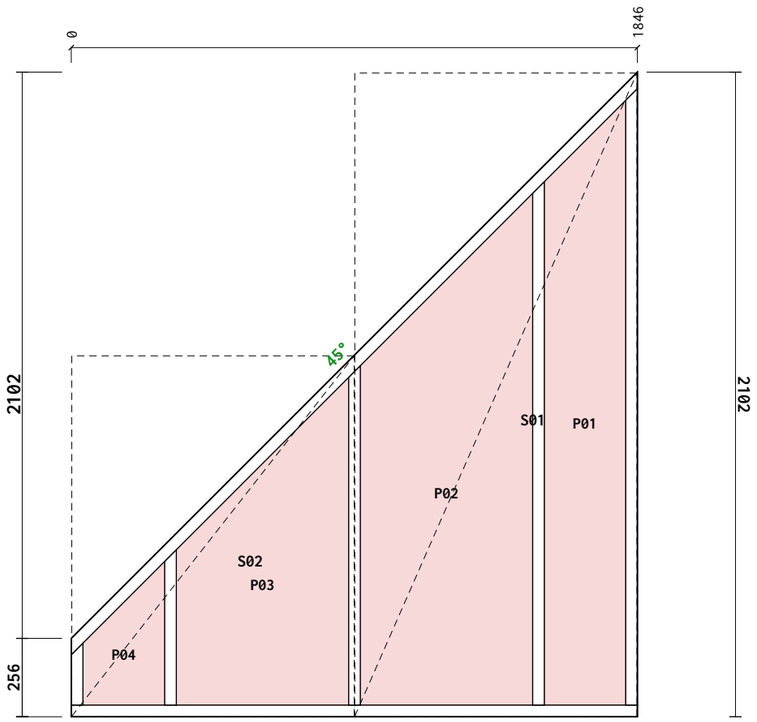


Breather bot overlap: 598mm

Breather R overlap: 150mm

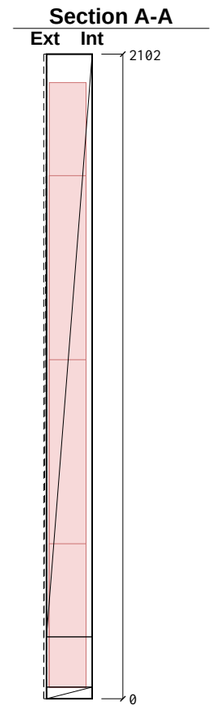

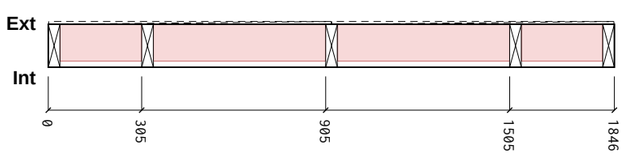
## Cut List

| Item | Section | Len | Bot° | Top° | Qty |
|---|---|---|---|---|---|
| BR1 Bottom Rail | 38×140 C16 | 1846 | 0 | 0 | 1 |
| TR1 Top Rail | 38×140 C16 | 1846 | 0 | 0 | 1 |
| ES1 End Stud | 38×140 C16 | 202 | 0 | -45.0 | 1 |
| ES2 End Stud | 38×140 C16 | 2010 | 0 | -45.0 | 1 |
| VS1 Vertical Stud | 38×140 C16 | 1706 | 0 | -45.0 | 1 |
| VS2 Vertical Stud | 38×140 C16 | 1106 | 0 | -45.0 | 1 |
| VS3 Vertical Stud | 38×140 C16 | 506 | 0 | -45.0 | 1 |

**Total: 7 pcs / 9.22 m**

## Sheathing & Insulation

| Material | W | H | Label |
|---|---|---|---|
| OSB 9mm | 920 | 2097 | **S01** |
| OSB 9mm | 921 | 1175 | **S02** |
| PIR 120mm | 264 | 1971 | **P01** |
| PIR 120mm | 561 | 1667 | **P02** |
| PIR 120mm | 561 | 1067 | **P03** |
| PIR 120mm | 266 | 467 | **P04** |

## General Notes:

**Frame Nailing:**
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


**Nailing:**
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

**KEY PLAN**



Revisions (Rev · Date · Note)

**C04 - Steel approved by the engineer: steel + steel timber drawings issued for construction**

| | | | |
|---|---|---|---|
| Date: **2026-10-11** | Scale: **1:20** | Drawn: **TS** | Checked: |
| Project Name: **MP Adams Plot 4, Eckington** | | | |
| Site: **Eckington** | | Client: **MP Adams** | |
| Title: **Panel Fabrication — 38 x 140 C16 CLS** | | | |
| Project Number: **P4** | | Revision: **C04** | |
| Panel No: **GB-EX15** | | Drawing No: **P4-MF-GB-EX15** | |
| Panel L×H×T: **1846×2102×149** | | Weight: **248 kg** | |
| Status: **CONSTRUCTION** | | Sheet: **1 / 1** | |