

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3352 ±5 (equal = square)

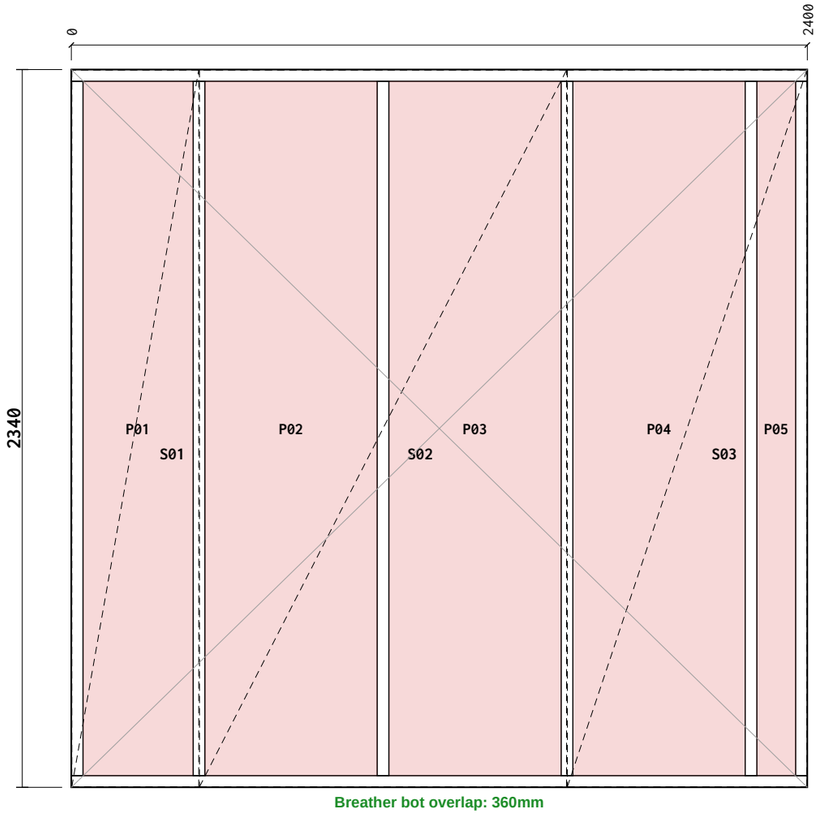


Breather bot overlap: 360mm

Breather R overlap: 150mm

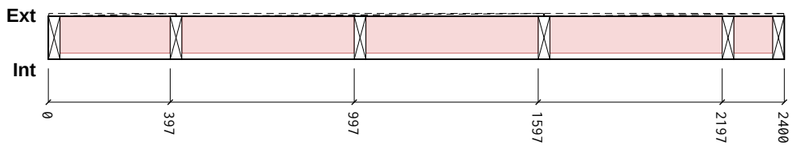

Section A-A

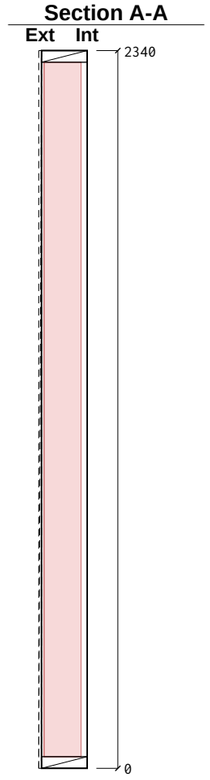

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	4

Total: 8 pcs / 18.38 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	414	2337	**S01**
OSB 9mm	1197	2337	**S02**
OSB 9mm	781	2337	**S03**
PIR 120mm	358	2264	**P01**
PIR 120mm	561	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	561	2264	**P04**
PIR 120mm	126	2264	**P05**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX1**		Drawing No: **P4-MF-FF-EX1**	
Panel L×H×T: **2400×2340×149**		Weight: **92 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)


Diag 3352 ±5 (equal = square)

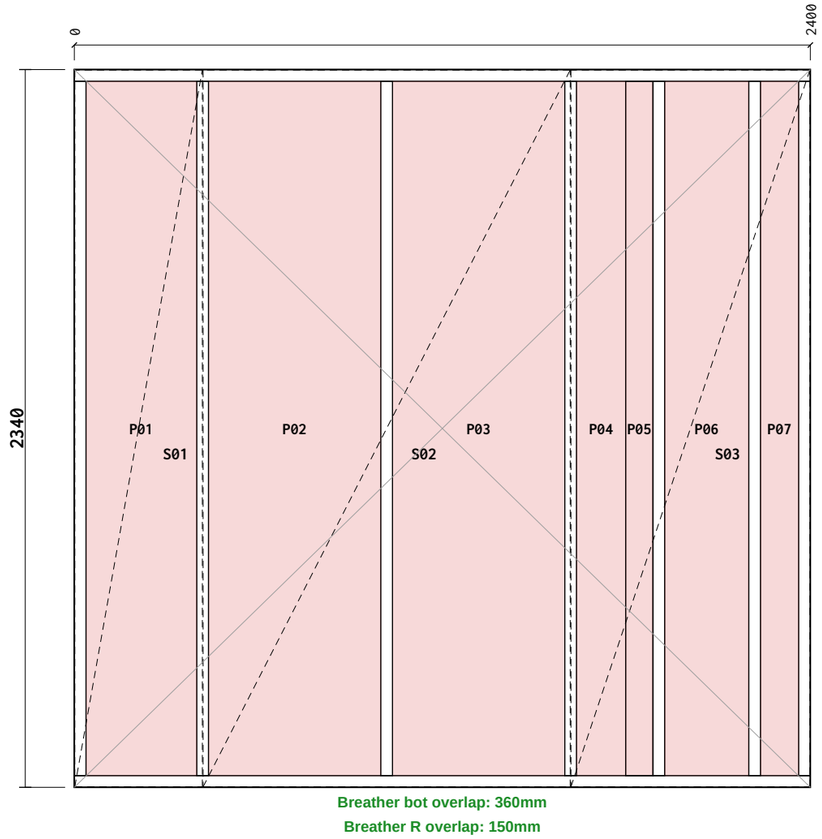

Breather bot overlap: 360mm

Breather R overlap: 150mm

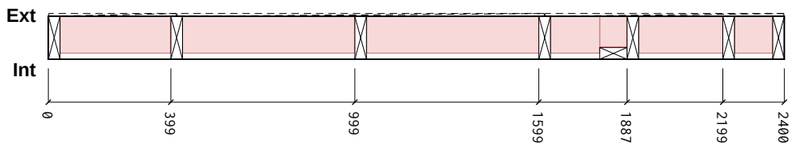

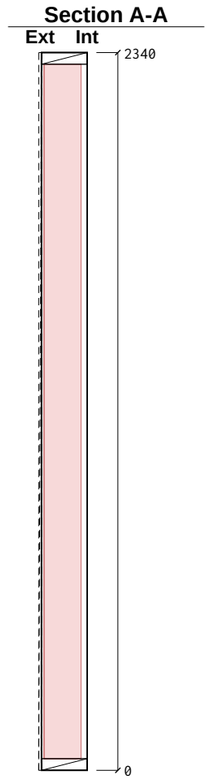

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	5
JS1 Junction Stud	38×89 C16	2264	0	0	1

Total: 10 pcs / 22.91 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	416	2337	**S01**
OSB 9mm	1197	2337	**S02**
OSB 9mm	779	2337	**S03**
PIR 120mm	360	2264	**P01**
PIR 120mm	561	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	160	2264	**P04**
PIR 100mm	89	2264	**P05**
PIR 120mm	273	2264	**P06**
PIR 120mm	124	2264	**P07**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name:	**MP Adams Plot 4, Eckington**		
Site: **Eckington**		Client: **MP Adams**	
Title:	**Panel Fabrication — 38 x 140 C16 CLS**		
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX2**		Drawing No: **P4-MF-FF-EX2**	
Panel L×H×T: **2400×2340×149**		Weight: **100 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2901 ±5 (equal = square)

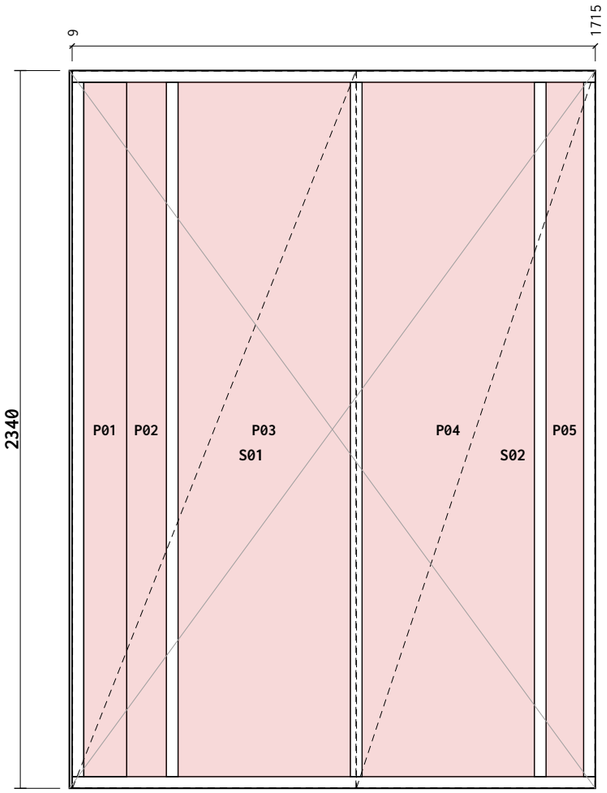


Breather bot overlap: 360mm

Breather R overlap: 150mm

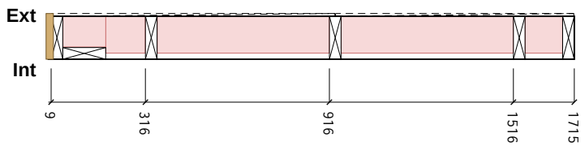

Section A-A

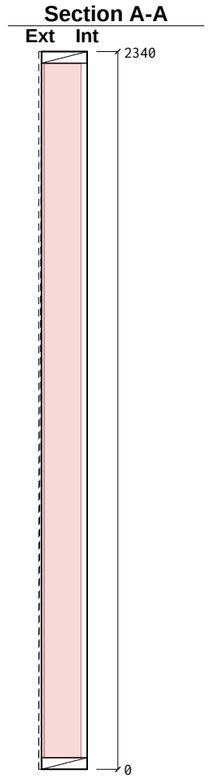

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1706	0	0	1
TR1 Top Rail	38×140 C16	1706	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	3
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 8 pcs / 17.00 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	924	2337	**S01**
OSB 9mm	777	2337	**S02**
PIR 100mm	140	2264	**P01**
PIR 120mm	129	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	561	2264	**P04**
PIR 120mm	122	2264	**P05**
OSB End Cap 9mm	146	2337	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX3**		Drawing No: **P4-MF-FF-EX3**	
Panel L×H×T: **1715×2340×149**		Weight: **76 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)


Diag 2543 ±5 (equal = square)

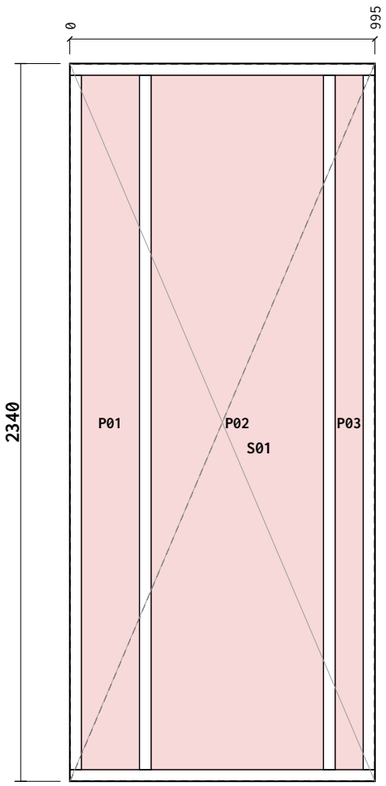

Breather bot overlap: 360mm

Breather R overlap: 150mm

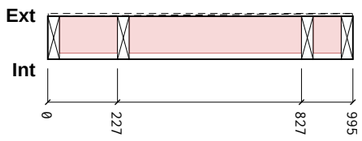

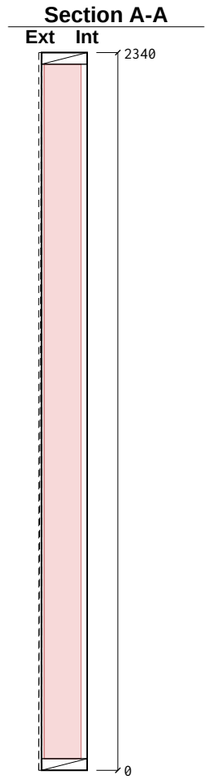

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	995	0	0	1
TR1 Top Rail	38×140 C16	995	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	2

Total: 6 pcs / 11.05 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	992	2337	**S01**
PIR 120mm	188	2264	**P01**
PIR 120mm	561	2264	**P02**
PIR 120mm	91	2264	**P03**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX4**		Drawing No: **P4-MF-FF-EX4**	
Panel L×H×T: **995×2340×149**		Weight: **45 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3352 ±5 (equal = square)

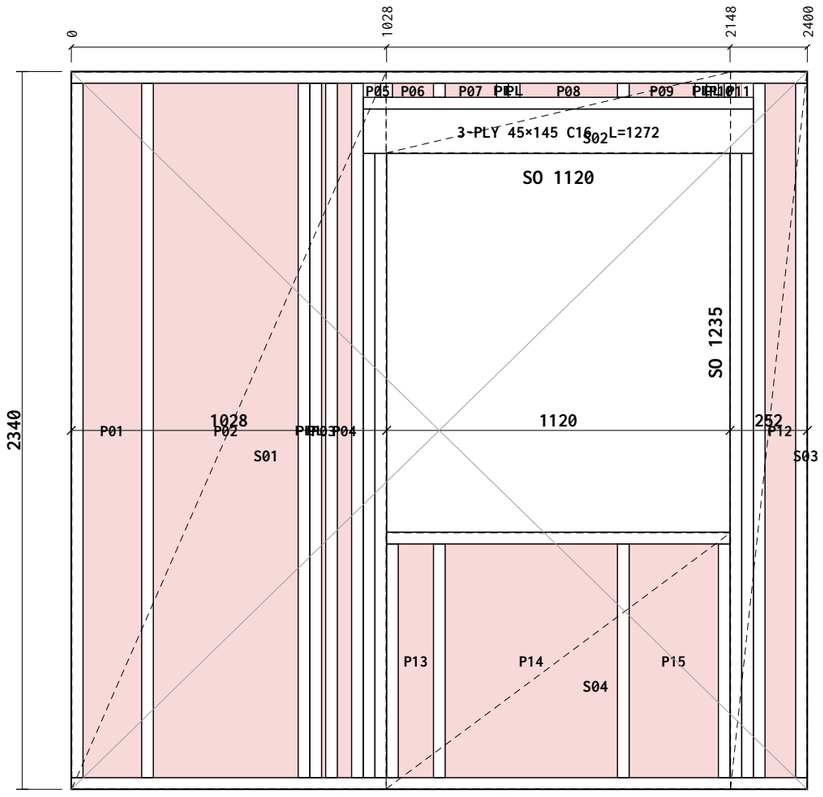


Breather bot overlap: 360mm

Breather R overlap: 150mm

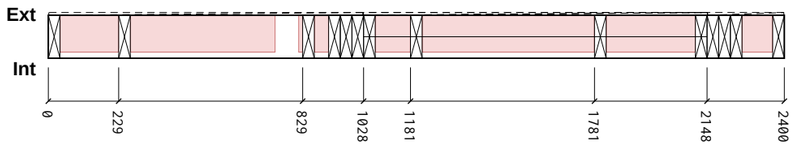

Section A-A

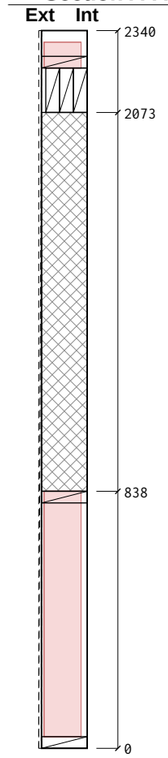

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	1272	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2035	0	0	4
SP1 Sill Plate	38×140 C16	1120	0	0	1
LP1 Lintel Ply	1272×45 C16	1272	0	0	3
SS1 Sill Support	38×140 C16	762	0	0	2
OS1 OSB Support	38×140 C16	46	0	0	2
VS1 Vertical Stud	38×140 C16	2264	0	0	2
VS2 Vertical Stud	38×140 C16	762	0	0	2
VS3 Vertical Stud	38×140 C16	46	0	0	2

Total: 25 pcs / 35.96 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1025	2337	**S01**
OSB 9mm	1123	264	**S02**
OSB 9mm	249	2337	**S03**
OSB 9mm	1123	835	**S04**
PIR 120mm	190	2264	**P01**
PIR 120mm	472	2264	**P02**
PIR 120mm	12	2264	**P03**
PIR 120mm	45	2264	**P04**
PIR 120mm	18	46	**P05**
PIR 120mm	133	46	**P06**
PIR 120mm	167	46	**P07**
PIR 120mm	317	46	**P08**
PIR 120mm	214	46	**P09**
PIR 120mm	18	46	**P10**
PIR 120mm	18	46	**P11**
PIR 120mm	98	2264	**P12**
PIR 120mm	114	762	**P13**
PIR 120mm	561	762	**P14**
PIR 120mm	290	762	**P15**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX5**		Drawing No: **P4-MF-FF-EX5**	
Panel L×H×T: **2400×2340×149**		Weight: **116 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2393 ±5 (equal = square)

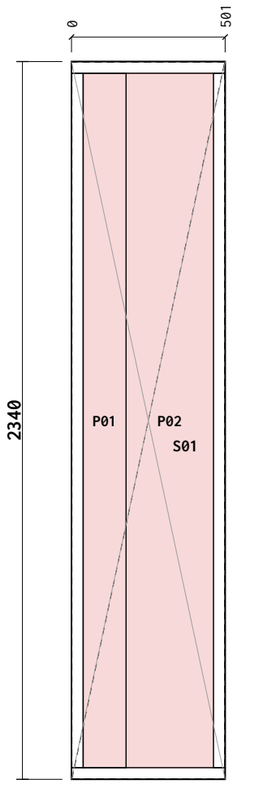


Breather bot overlap: 360mm

Breather R overlap: 150mm



Section A-A

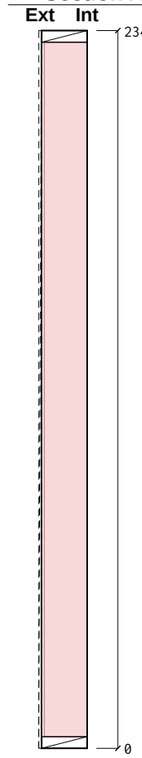

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	501	0	0	1
TR1 Top Rail	38×140 C16	501	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 5 pcs / 7.79 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	498	2337	**S01**
PIR 100mm	140	2264	**P01**
PIR 120mm	285	2264	**P02**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX6**		Drawing No: **P4-MF-FF-EX6**	
Panel L×H×T: **501×2340×149**		Weight: **28 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2432 ±5 (equal = square)

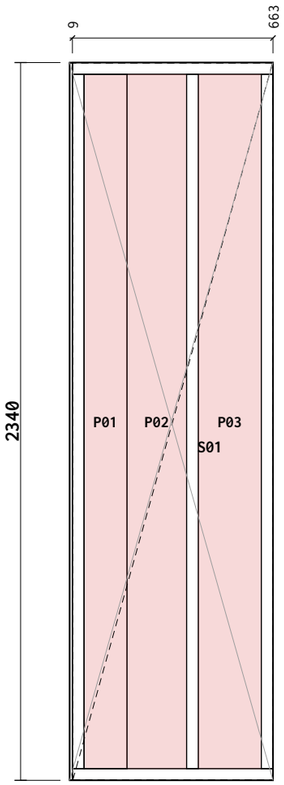


Breather bot overlap: 360mm

Breather R overlap: 150mm



Section A-A

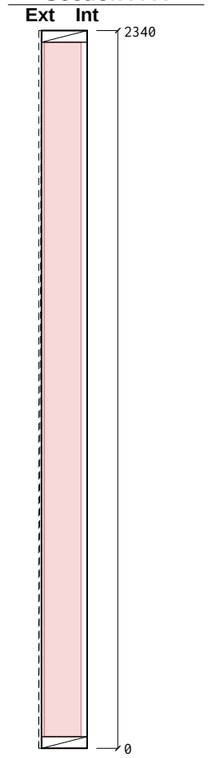

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	654	0	0	1
TR1 Top Rail	38×140 C16	654	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	1
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 6 pcs / 10.36 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	651	2337	**S01**
PIR 100mm	140	2264	**P01**
PIR 120mm	194	2264	**P02**
PIR 120mm	205	2264	**P03**
OSB End Cap 9mm	146	2337	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX7**		Drawing No: **P4-MF-FF-EX7**	
Panel L×H×T: **663×2340×149**		Weight: **38 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3090 ±5 (equal = square)

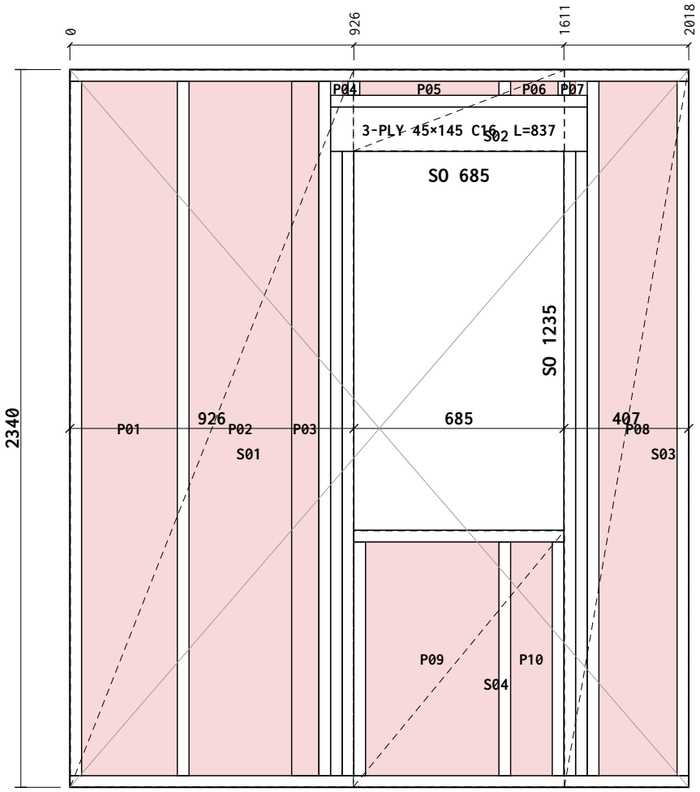


Breather bot overlap: 360mm

Breather R overlap: 150mm

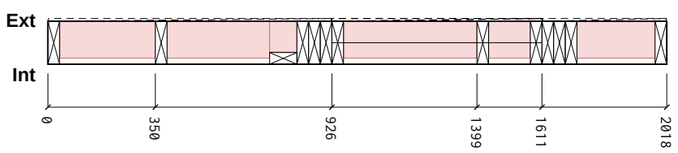

Section A-A

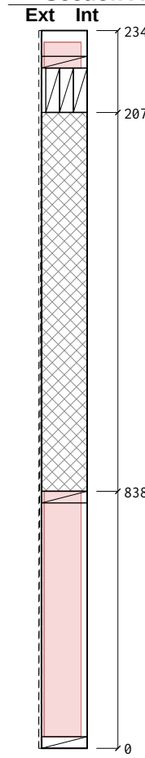

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2018	0	0	1
TR1 Top Rail	38×140 C16	2018	0	0	1
TR2 Top Rail	38×140 C16	837	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2035	0	0	4
SP1 Sill Plate	38×140 C16	685	0	0	1
LP1 Lintel Ply	837×45 C16	837	0	0	3
SS1 Sill Support	38×140 C16	762	0	0	2
OS1 OSB Support	38×140 C16	46	0	0	2
VS1 Vertical Stud	38×140 C16	2264	0	0	1
VS2 Vertical Stud	38×140 C16	762	0	0	1
VS3 Vertical Stud	38×140 C16	46	0	0	1
JS1 Junction Stud	38×89 C16	2264	0	0	1

Total: 23 pcs / 32.22 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	923	2337	**S01**
OSB 9mm	688	264	**S02**
OSB 9mm	404	2337	**S03**
OSB 9mm	688	835	**S04**
PIR 120mm	311	2264	**P01**
PIR 120mm	334	2264	**P02**
PIR 100mm	88	2264	**P03**
PIR 120mm	18	46	**P04**
PIR 120mm	453	46	**P05**
PIR 120mm	154	46	**P06**
PIR 120mm	18	46	**P07**
PIR 120mm	254	2264	**P08**
PIR 120mm	434	762	**P09**
PIR 120mm	135	762	**P10**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: 2026-10-11	Scale: 1:20	Drawn: TS	Checked:
Project Name: MP Adams Plot 4, Eckington			
Site: Eckington		Client: MP Adams	
Title: Panel Fabrication — 38 x 140 C16 CLS			
Project Number: P4		Revision: C03	
Panel No: FF-EX8		Drawing No: P4-MF-FF-EX8	
Panel L×H×T: 2018×2340×149		Weight: 104 kg	
Status: CONSTRUCTION		Sheet: 1 / 1	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2779 ±5 (equal = square)

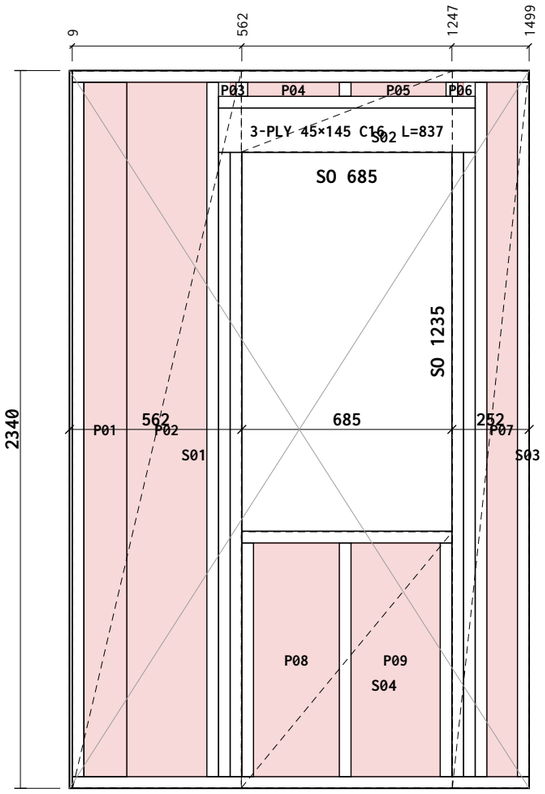


Breather bot overlap: 360mm

Breather R overlap: 150mm

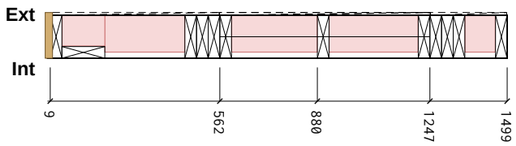

Section A-A

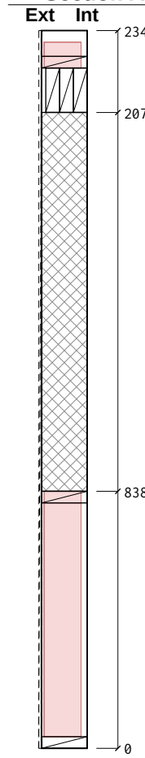

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1490	0	0	1
TR1 Top Rail	38×140 C16	1490	0	0	1
TR2 Top Rail	38×140 C16	837	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2035	0	0	4
SP1 Sill Plate	38×140 C16	685	0	0	1
LP1 Lintel Ply	837×45 C16	837	0	0	3
SS1 Sill Support	38×140 C16	762	0	0	2
OS1 OSB Support	38×140 C16	46	0	0	2
VS1 Vertical Stud	38×140 C16	762	0	0	1
VS2 Vertical Stud	38×140 C16	46	0	0	1
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 22 pcs / 28.90 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	550	2337	**S01**
OSB 9mm	688	264	**S02**
OSB 9mm	249	2337	**S03**
OSB 9mm	688	835	**S04**
PIR 100mm	139	2264	**P01**
PIR 120mm	260	2264	**P02**
PIR 120mm	18	46	**P03**
PIR 120mm	298	46	**P04**
PIR 120mm	309	46	**P05**
PIR 120mm	18	46	**P06**
PIR 120mm	98	2264	**P07**
PIR 120mm	279	762	**P08**
PIR 120mm	290	762	**P09**
OSB End Cap 9mm	146	2337	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name:	**MP Adams Plot 4, Eckington**		
Site: **Eckington**		Client: **MP Adams**	
Title:	**Panel Fabrication — 38 x 140 C16 CLS**		
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX9**		Drawing No: **P4-MF-FF-EX9**	
Panel L×H×T: **1499×2340×149**		Weight: **89 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2433 ±5 (equal = square)

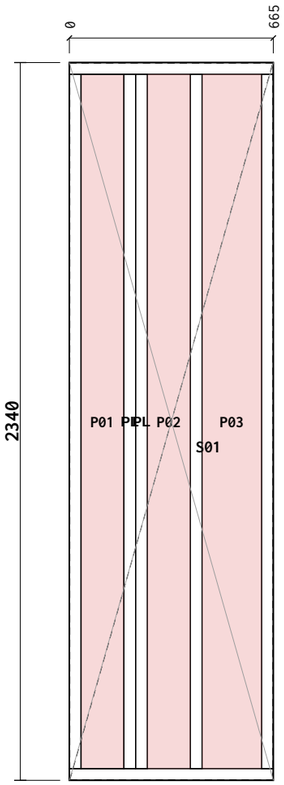


Breather bot overlap: 360mm

Breather R overlap: 150mm



Section A-A

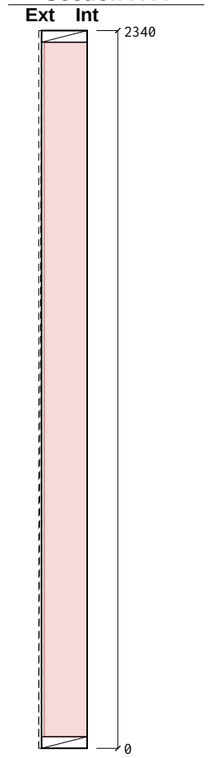

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	665	0	0	1
TR1 Top Rail	38×140 C16	665	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	1
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 6 pcs / 10.39 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	662	2337	**S01**
PIR 100mm	139	2264	**P01**
PIR 120mm	140	2264	**P02**
PIR 120mm	193	2264	**P03**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX10**		Drawing No: **P4-MF-FF-EX10**	
Panel L×H×T: **665×2340×149**		Weight: **36 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2644 ±5 (equal = square)

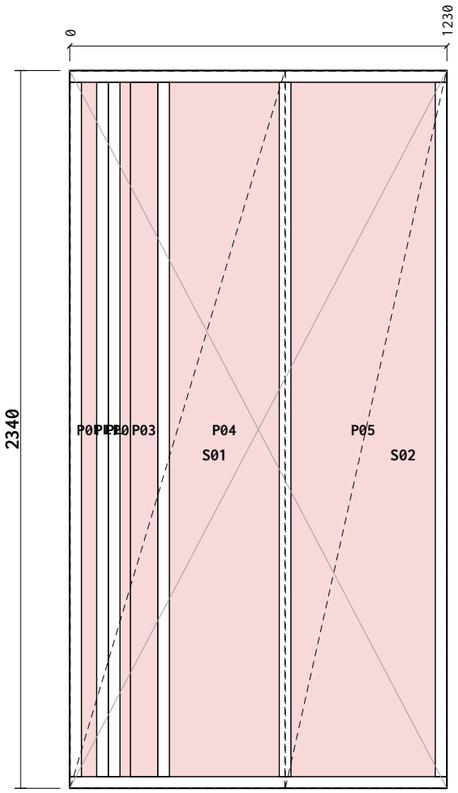


Breather bot overlap: 360mm

Breather R overlap: 150mm

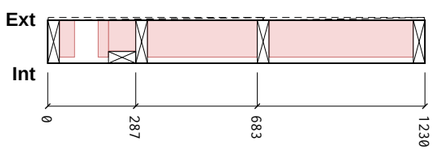

Section A-A

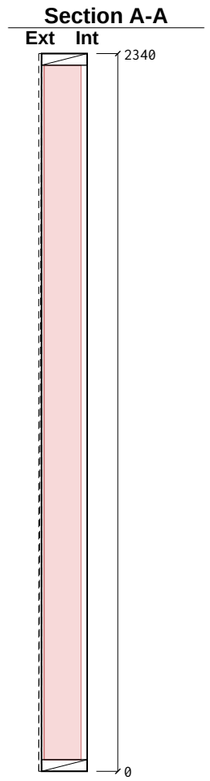

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1230	0	0	1
TR1 Top Rail	38×140 C16	1230	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	2
JS1 Junction Stud	38×89 C16	2264	0	0	1

Total: 7 pcs / 13.78 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	700	2337	**S01**
OSB 9mm	525	2337	**S02**
PIR 120mm	49	2264	**P01**
PIR 120mm	34	2264	**P02**
PIR 100mm	88	2264	**P03**
PIR 120mm	357	2264	**P04**
PIR 120mm	470	2264	**P05**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX11**		Drawing No: **P4-MF-FF-EX11**	
Panel L×H×T: **1230×2340×149**		Weight: **54 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2672 ±5 (equal = square)

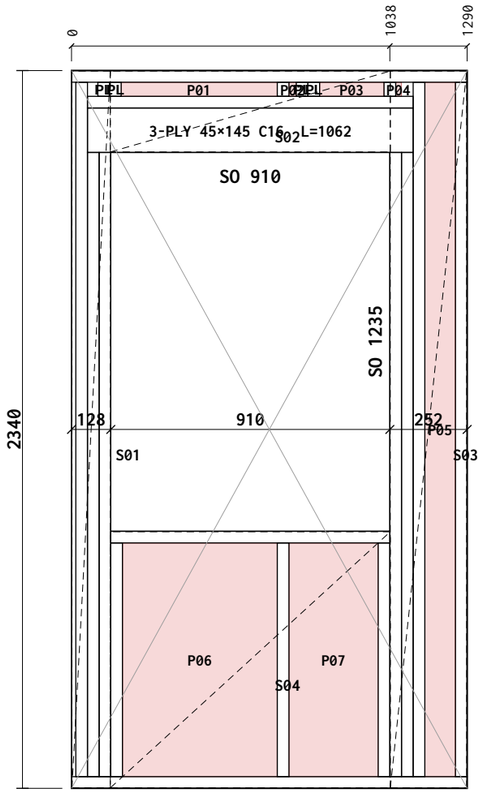


Breather bot overlap: 360mm

Breather R overlap: 150mm

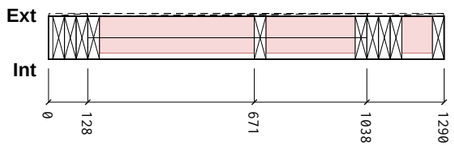

Section A-A

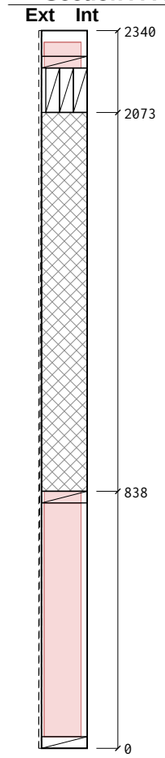

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1290	0	0	1
TR1 Top Rail	38×140 C16	1290	0	0	1
TR2 Top Rail	38×140 C16	1062	0	0	1
ES1 End Stud	38×140 C16	46	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2035	0	0	4
SP1 Sill Plate	38×140 C16	910	0	0	1
LP1 Lintel Ply	1062×45 C16	1062	0	0	3
SS1 Sill Support	38×140 C16	762	0	0	2
OS1 OSB Support	38×140 C16	46	0	0	1
VS1 Vertical Stud	38×140 C16	762	0	0	1

Total: 19 pcs / 25.05 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	125	2337	**S01**
OSB 9mm	913	264	**S02**
OSB 9mm	249	2337	**S03**
OSB 9mm	913	835	**S04**
PIR 120mm	508	46	**P01**
PIR 120mm	23	46	**P02**
PIR 120mm	209	46	**P03**
PIR 120mm	18	46	**P04**
PIR 120mm	99	2264	**P05**
PIR 120mm	504	762	**P06**
PIR 120mm	290	762	**P07**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX12**		Drawing No: **P4-MF-FF-EX12**	
Panel L×H×T: **1290×2340×149**		Weight: **72 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2676 ±5 (equal = square)

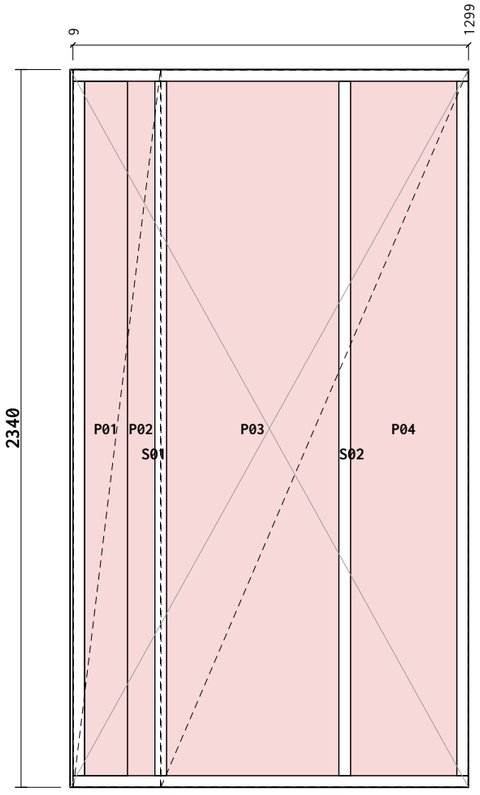


Breather bot overlap: 360mm

Breather R overlap: 150mm

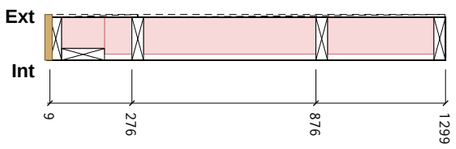

Section A-A

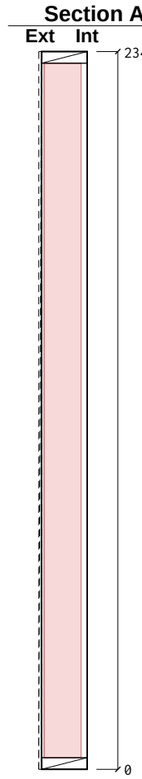

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1290	0	0	1
TR1 Top Rail	38×140 C16	1290	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	2
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 7 pcs / 13.90 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	284	2337	**S01**
OSB 9mm	1001	2337	**S02**
PIR 100mm	140	2264	**P01**
PIR 120mm	89	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	346	2264	**P04**
OSB End Cap 9mm	146	2337	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX13**		Drawing No: **P4-MF-FF-EX13**	
Panel L×H×T: **1299×2340×149**		Weight: **60 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3352 ±5 (equal = square)

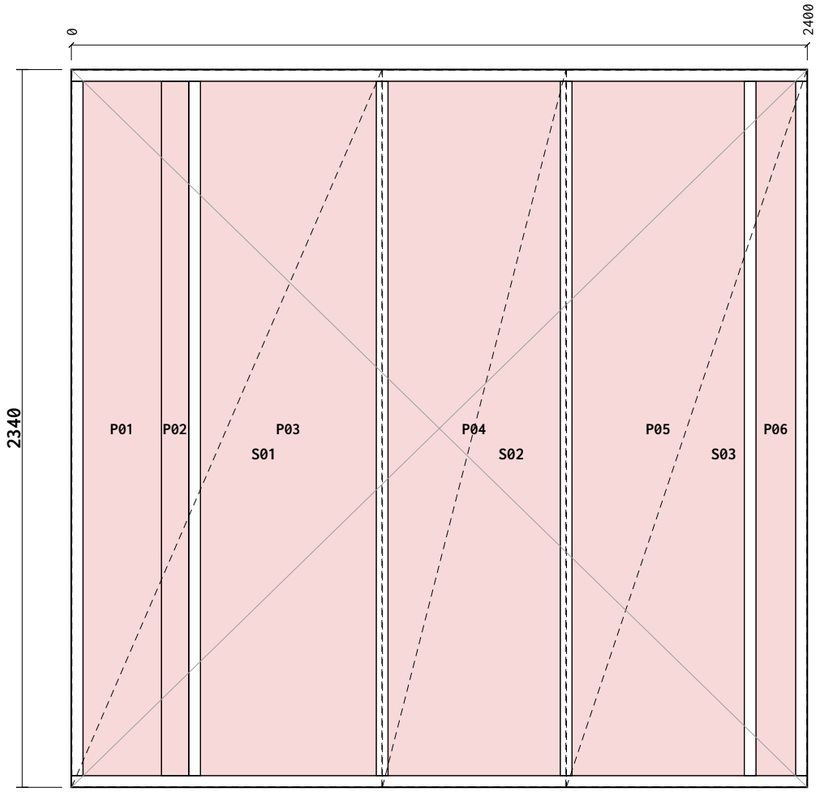


Breather bot overlap: 360mm

Breather R overlap: 150mm

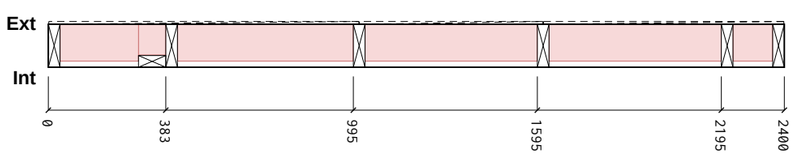

Section A-A

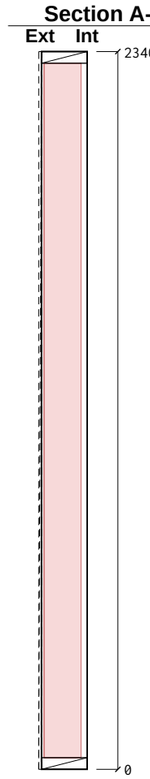

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	4
JS1 Junction Stud	38×89 C16	2264	0	0	1

Total: 9 pcs / 20.65 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1011	2337	**S01**
OSB 9mm	598	2337	**S02**
OSB 9mm	784	2337	**S03**
PIR 120mm	255	2264	**P01**
PIR 100mm	89	2264	**P02**
PIR 120mm	573	2264	**P03**
PIR 120mm	561	2264	**P04**
PIR 120mm	561	2264	**P05**
PIR 120mm	128	2264	**P06**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX14**		Drawing No: **P4-MF-FF-EX14**	
Panel L×H×T: **2400×2340×149**		Weight: **96 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3352 ±5 (equal = square)

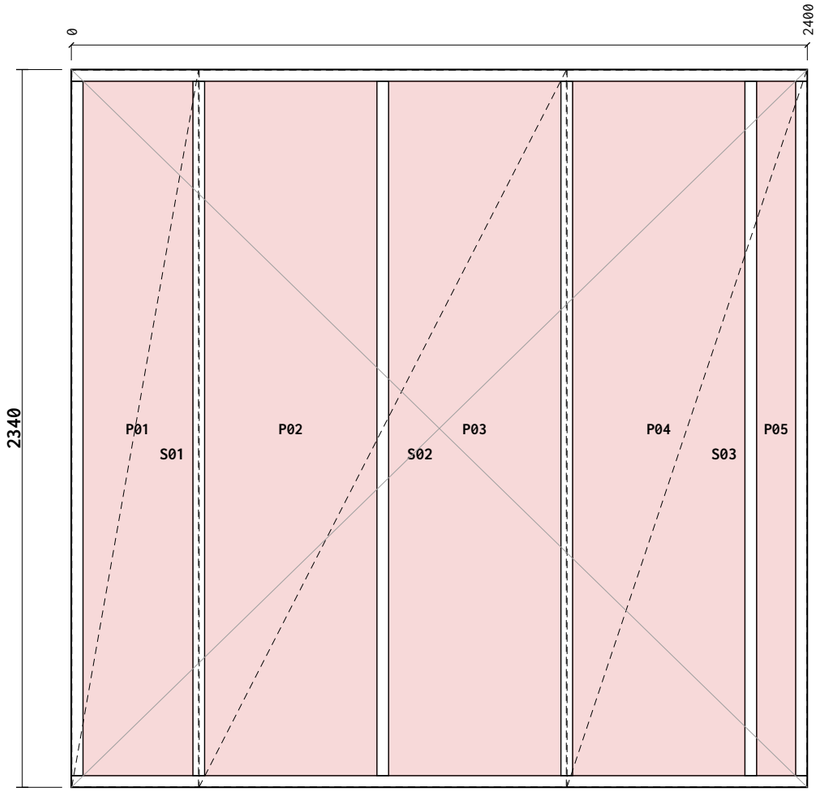


Breather bot overlap: 360mm

Breather R overlap: 150mm

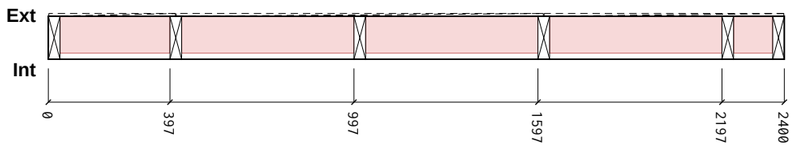

Section A-A

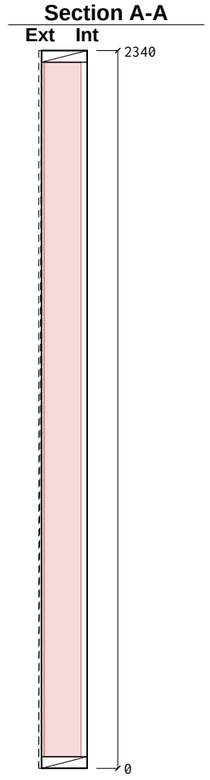

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	4

Total: 8 pcs / 18.38 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	413	2337	**S01**
OSB 9mm	1197	2337	**S02**
OSB 9mm	782	2337	**S03**
PIR 120mm	358	2264	**P01**
PIR 120mm	561	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	561	2264	**P04**
PIR 120mm	126	2264	**P05**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX15**		Drawing No: **P4-MF-FF-EX15**	
Panel L×H×T: **2400×2340×149**		Weight: **92 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2901 ±5 (equal = square)

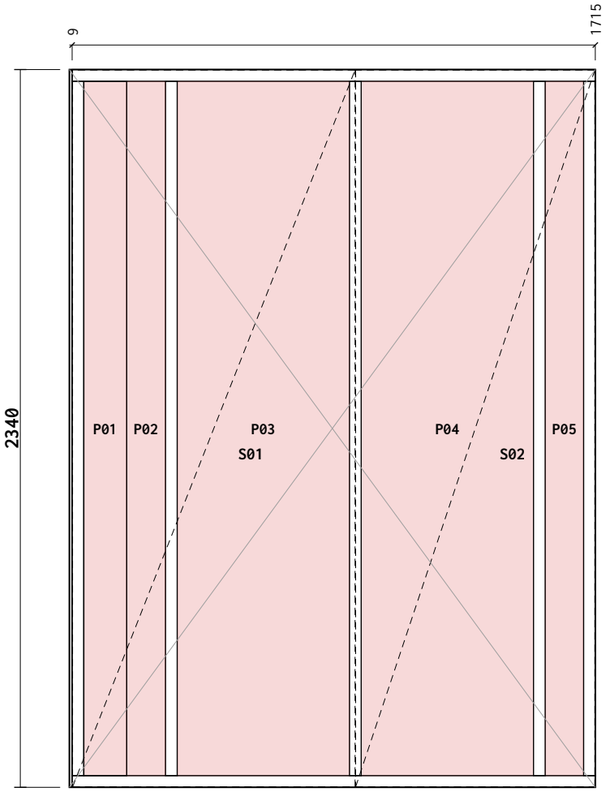


Breather bot overlap: 360mm

Breather R overlap: 150mm

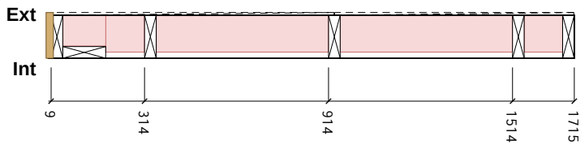

Section A-A

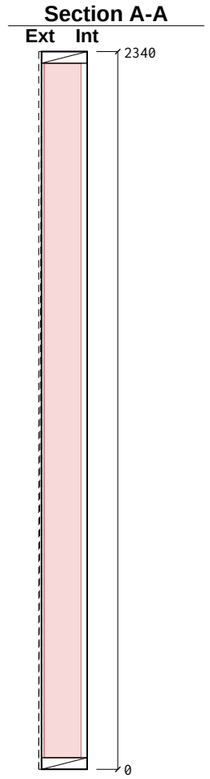

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1706	0	0	1
TR1 Top Rail	38×140 C16	1706	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	3
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 8 pcs / 17.00 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	921	2337	**S01**
OSB 9mm	780	2337	**S02**
PIR 100mm	140	2264	**P01**
PIR 120mm	126	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	561	2264	**P04**
PIR 120mm	124	2264	**P05**
OSB End Cap 9mm	146	2337	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX16**		Drawing No: **P4-MF-FF-EX16**	
Panel L×H×T: **1715×2340×149**		Weight: **76 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2524 ±5 (equal = square)

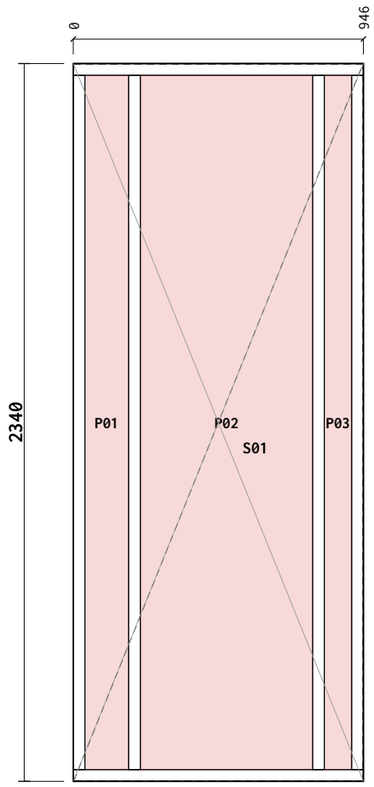


Breather bot overlap: 360mm

Breather R overlap: 150mm

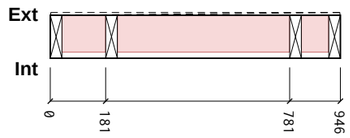

Section A-A

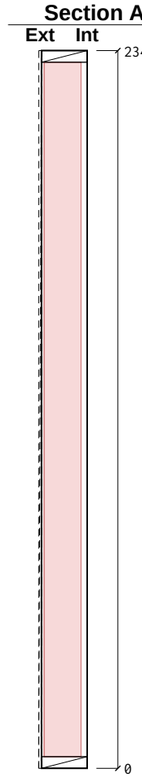

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	946	0	0	1
TR1 Top Rail	38×140 C16	946	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	2

Total: 6 pcs / 10.95 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	943	2337	**S01**
PIR 120mm	142	2264	**P01**
PIR 120mm	561	2264	**P02**
PIR 120mm	88	2264	**P03**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX17**		Drawing No: **P4-MF-FF-EX17**	
Panel L×H×T: **946×2340×149**		Weight: **44 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3352 ±5 (equal = square)

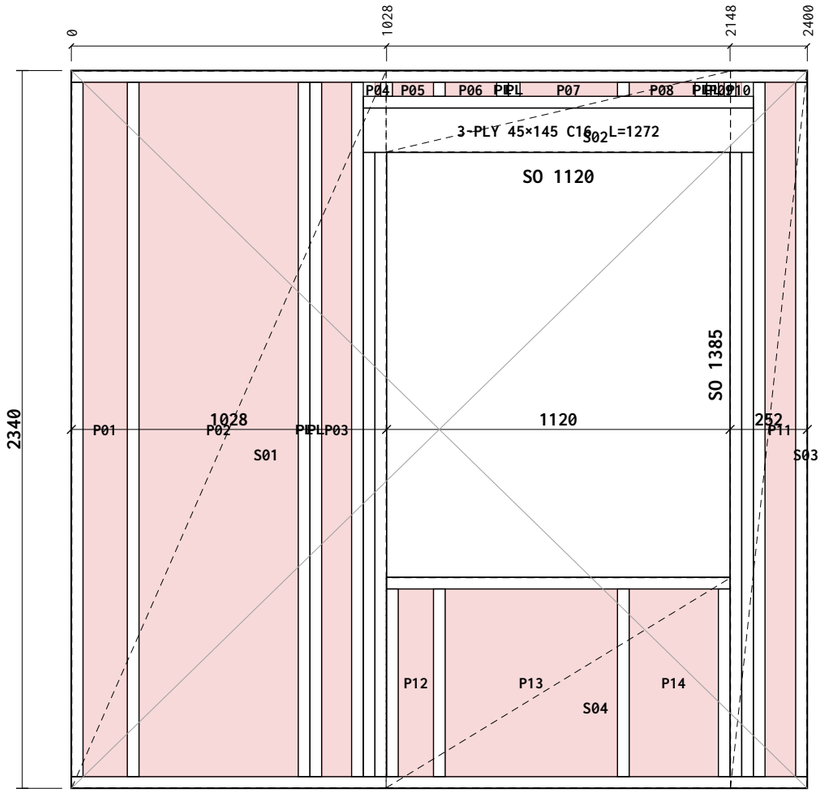


Breather bot overlap: 360mm

Breather R overlap: 150mm

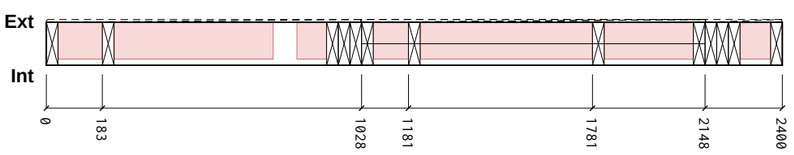

Section A-A

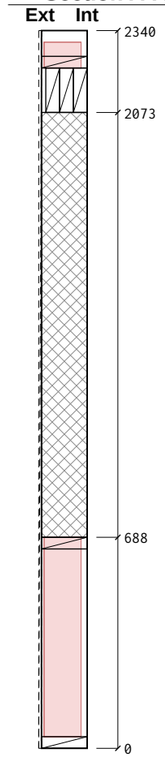

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	1272	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2035	0	0	4
SP1 Sill Plate	38×140 C16	1120	0	0	1
LP1 Lintel Ply	1272×45 C16	1272	0	0	3
SS1 Sill Support	38×140 C16	612	0	0	2
OS1 OSB Support	38×140 C16	46	0	0	2
VS1 Vertical Stud	38×140 C16	2264	0	0	1
VS2 Vertical Stud	38×140 C16	612	0	0	2
VS3 Vertical Stud	38×140 C16	46	0	0	2

Total: 24 pcs / 33.10 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1025	2337	**S01**
OSB 9mm	1123	264	**S02**
OSB 9mm	249	2337	**S03**
OSB 9mm	1123	685	**S04**
PIR 120mm	144	2264	**P01**
PIR 120mm	518	2264	**P02**
PIR 120mm	96	2264	**P03**
PIR 120mm	18	46	**P04**
PIR 120mm	133	46	**P05**
PIR 120mm	167	46	**P06**
PIR 120mm	317	46	**P07**
PIR 120mm	214	46	**P08**
PIR 120mm	18	46	**P09**
PIR 120mm	18	46	**P10**
PIR 120mm	99	2264	**P11**
PIR 120mm	114	612	**P12**
PIR 120mm	561	612	**P13**
PIR 120mm	290	612	**P14**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX18**		Drawing No: **P4-MF-FF-EX18**	
Panel L×H×T: **2400×2340×149**		Weight: **109 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2651 ±5 (equal = square)

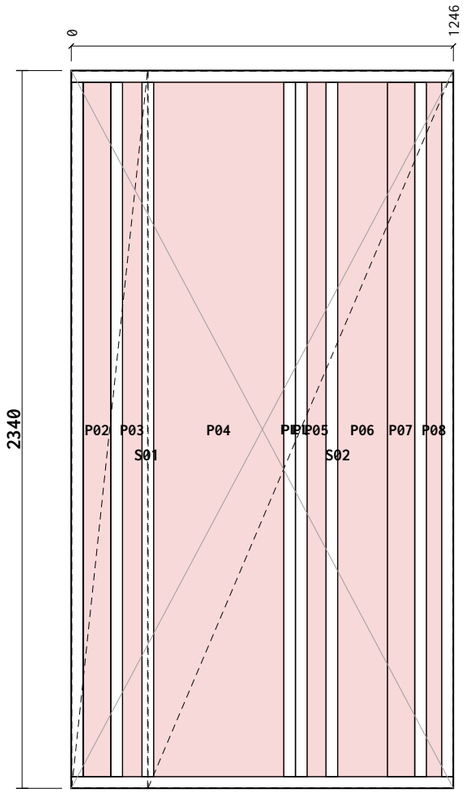


Breather bot overlap: 360mm

Breather R overlap: 150mm

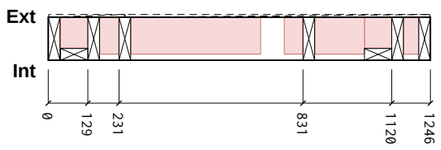

Section A-A

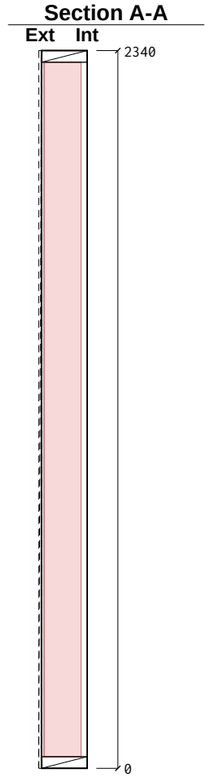

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1246	0	0	1
TR1 Top Rail	38×140 C16	1246	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	4
JS1 Junction Stud	38×89 C16	2264	0	0	2

Total: 10 pcs / 20.60 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	247	2337	**S01**
OSB 9mm	994	2337	**S02**
PIR 120mm	1	2264	**P01**
PIR 100mm	88	2264	**P02**
PIR 120mm	63	2264	**P03**
PIR 120mm	423	2264	**P04**
PIR 120mm	61	2264	**P05**
PIR 120mm	162	2264	**P06**
PIR 100mm	89	2264	**P07**
PIR 120mm	49	2264	**P08**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)


Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX19**		Drawing No: **P4-MF-FF-EX19**	
Panel L×H×T: **1246×2340×149**		Weight: **67 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

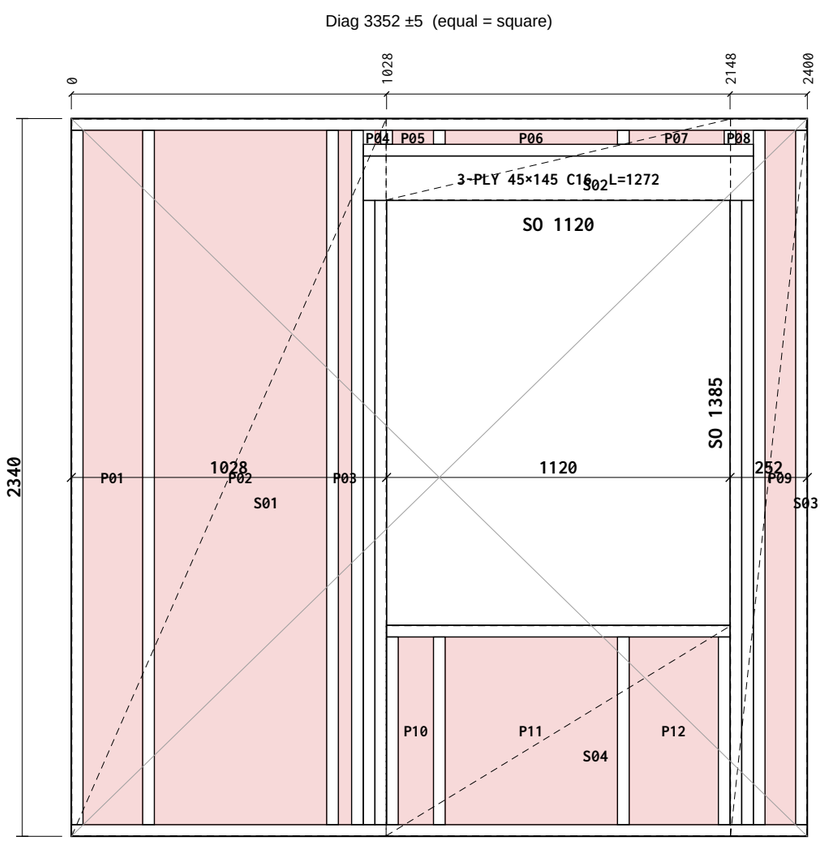

Breather bot overlap: 360mm

Breather R overlap: 150mm

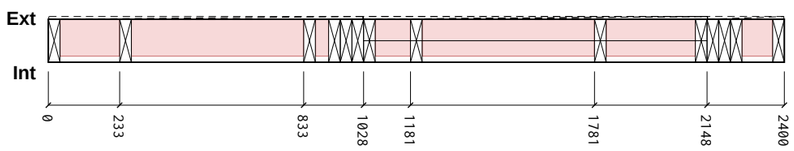

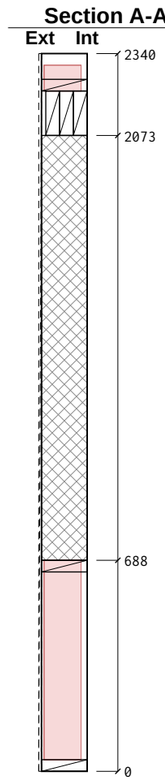

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	1272	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2035	0	0	4
SP1 Sill Plate	38×140 C16	1120	0	0	1
LP1 Lintel Ply	1272×45 C16	1272	0	0	3
SS1 Sill Support	38×140 C16	612	0	0	2
OS1 OSB Support	38×140 C16	46	0	0	2
VS1 Vertical Stud	38×140 C16	2264	0	0	2
VS2 Vertical Stud	38×140 C16	612	0	0	2
VS3 Vertical Stud	38×140 C16	46	0	0	2

Total: 25 pcs / 35.36 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1025	2337	**S01**
OSB 9mm	1123	264	**S02**
OSB 9mm	249	2337	**S03**
OSB 9mm	1123	685	**S04**
PIR 120mm	194	2264	**P01**
PIR 120mm	561	2264	**P02**
PIR 120mm	42	2264	**P03**
PIR 120mm	18	46	**P04**
PIR 120mm	133	46	**P05**
PIR 120mm	561	46	**P06**
PIR 120mm	309	46	**P07**
PIR 120mm	18	46	**P08**
PIR 120mm	99	2264	**P09**
PIR 120mm	114	612	**P10**
PIR 120mm	561	612	**P11**
PIR 120mm	290	612	**P12**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)


Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX20**		Drawing No: **P4-MF-FF-EX20**	
Panel L×H×T: **2400×2340×149**		Weight: **114 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

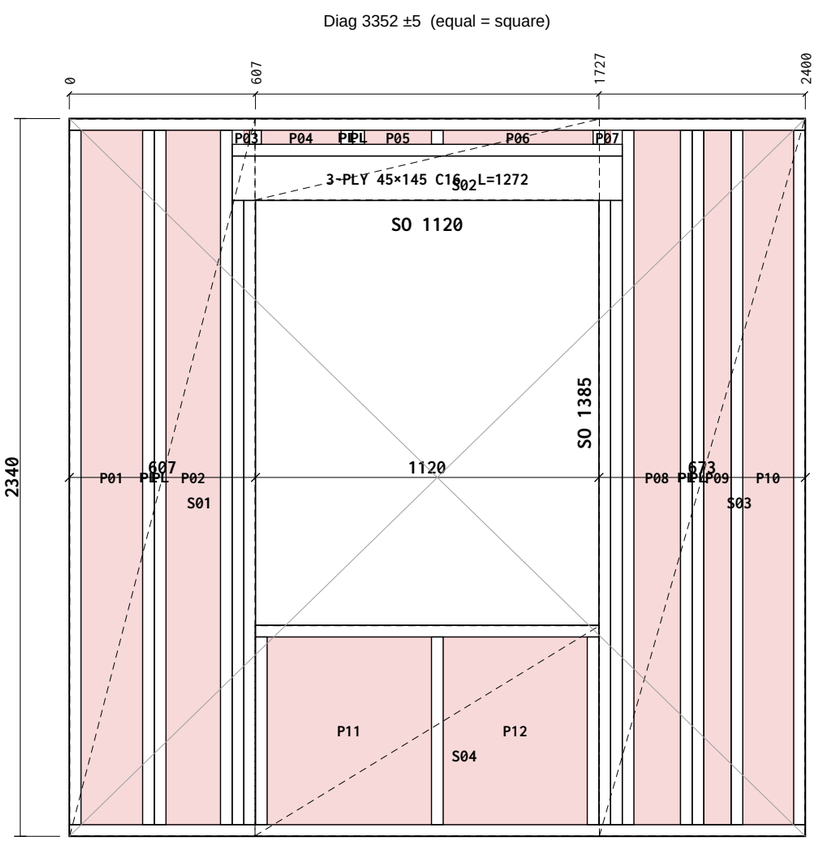

Breather bot overlap: 360mm

Breather R overlap: 150mm

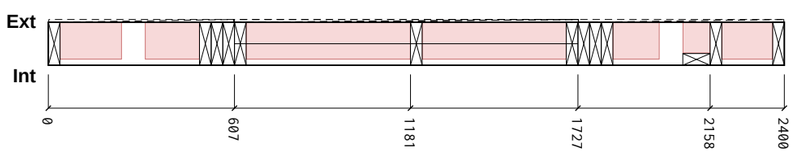

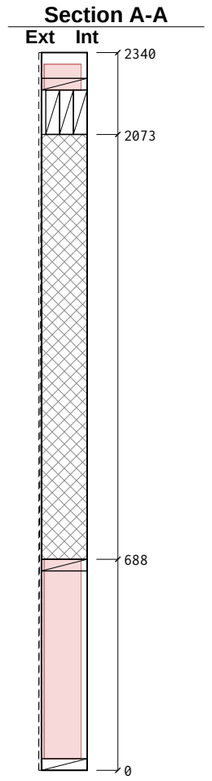

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	1272	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2035	0	0	4
SP1 Sill Plate	38×140 C16	1120	0	0	1
LP1 Lintel Ply	1272×45 C16	1272	0	0	3
SS1 Sill Support	38×140 C16	612	0	0	2
OS1 OSB Support	38×140 C16	46	0	0	2
VS1 Vertical Stud	38×140 C16	2264	0	0	1
VS2 Vertical Stud	38×140 C16	612	0	0	1
VS3 Vertical Stud	38×140 C16	46	0	0	1
JS1 Junction Stud	38×89 C16	2264	0	0	1

Total: 23 pcs / 34.71 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	604	2337	**S01**
OSB 9mm	1123	264	**S02**
OSB 9mm	670	2337	**S03**
OSB 9mm	1123	685	**S04**
PIR 120mm	200	2264	**P01**
PIR 120mm	176	2264	**P02**
PIR 120mm	18	46	**P03**
PIR 120mm	259	46	**P04**
PIR 120mm	218	46	**P05**
PIR 120mm	488	46	**P06**
PIR 120mm	18	46	**P07**
PIR 120mm	151	2264	**P08**
PIR 100mm	88	2264	**P09**
PIR 120mm	165	2264	**P10**
PIR 120mm	535	612	**P11**
PIR 120mm	469	612	**P12**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX21**		Drawing No: **P4-MF-FF-EX21**	
Panel L×H×T: **2400×2340×149**		Weight: **110 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2978 ±5 (equal = square)

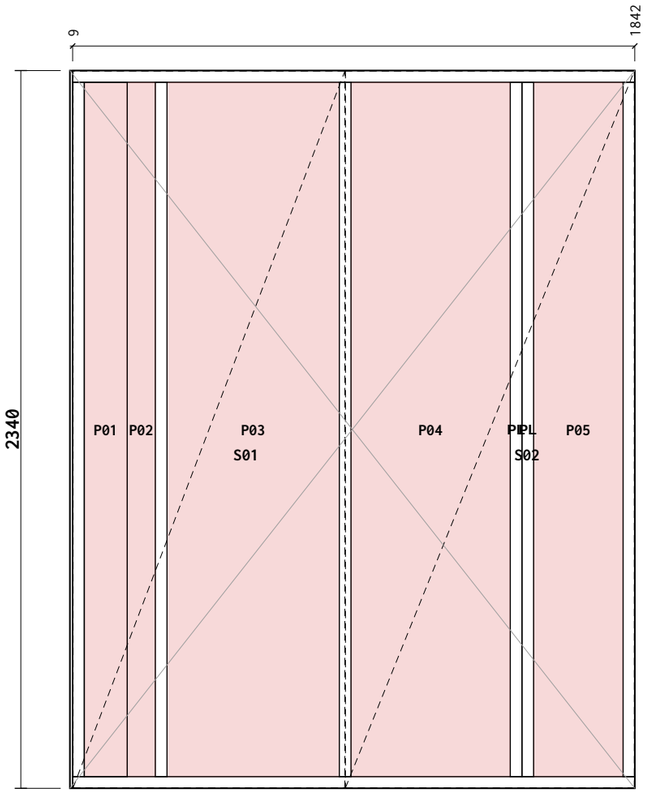


Breather bot overlap: 360mm

Breather R overlap: 150mm

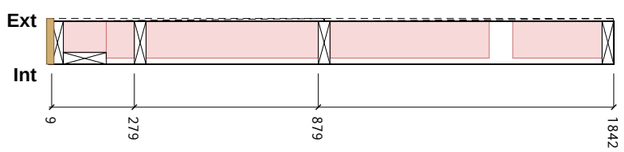

Section A-A

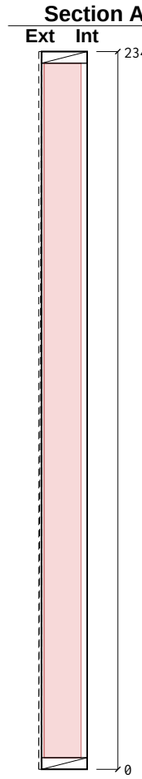

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1833	0	0	1
TR1 Top Rail	38×140 C16	1833	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	2
JS1 Junction Stud	38×140 C16	2264	0	0	1
Total: 7 pcs / 14.99 m					

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	886	2337	**S01**
OSB 9mm	942	2337	**S02**
PIR 100mm	140	2264	**P01**
PIR 120mm	91	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	518	2264	**P04**
PIR 120mm	291	2264	**P05**
OSB End Cap 9mm	146	2337	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name:	**MP Adams Plot 4, Eckington**		
Site: **Eckington**		Client: **MP Adams**	
Title:	**Panel Fabrication — 38 x 140 C16 CLS**		
Project Number: **P4**		Revision: **C03**	
Panel No: **FF-EX22**		Drawing No: **P4-MF-FF-EX22**	
Panel L×H×T: **1842×2340×149**		Weight: **74 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	