

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2403 ±5 (equal = square)

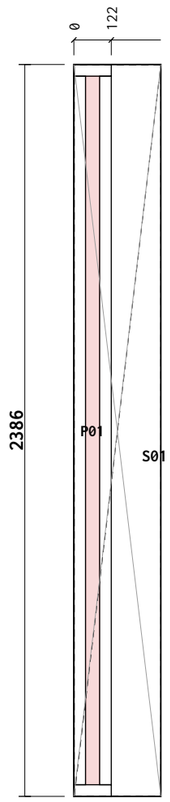


Breather bot overlap: 314mm

Breather R overlap: 150mm



Section A-A

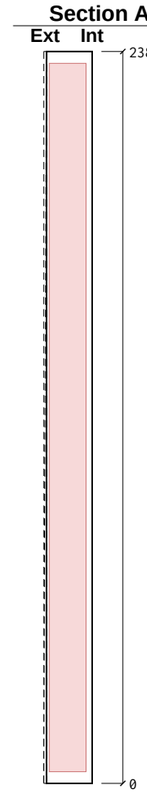

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	122	0	0	1
TR1 Top Rail	38×140 C16	122	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1

Total: 4 pcs / 4.86 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	282	2383	**S01**
PIR 120mm	45	2310	**P01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX1**		Drawing No: **P4-MF-GF-EX1**	
Panel L×H×T: **283×2386×149**		Weight: **15 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3391 ±5 (equal = square)

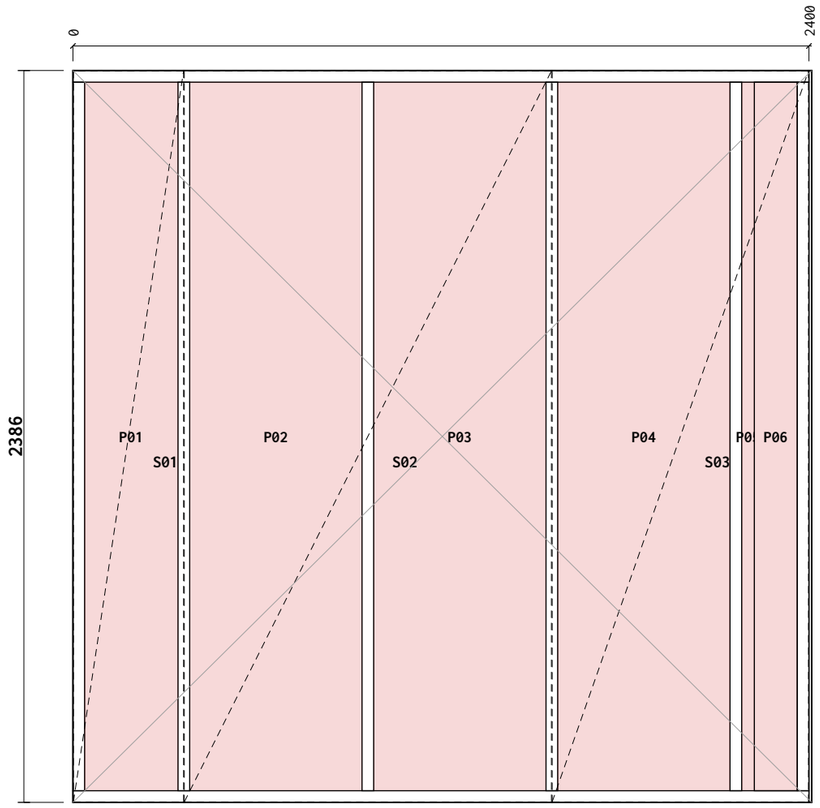


Breather bot overlap: 314mm

Breather R overlap: 150mm

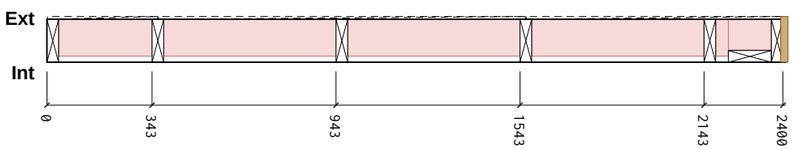

Section A-A

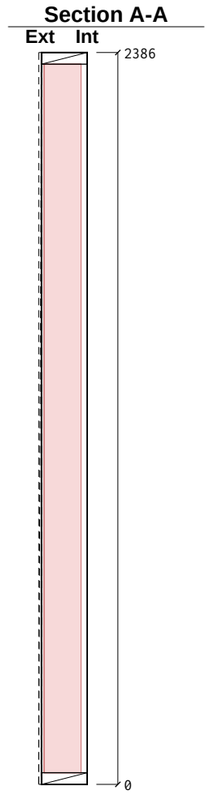

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	4
JS1 Junction Stud	38×140 C16	2310	0	0	1

Total: 9 pcs / 20.97 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	359	2383	**S01**
OSB 9mm	1197	2383	**S02**
OSB 9mm	836	2383	**S03**
PIR 120mm	304	2310	**P01**
PIR 120mm	561	2310	**P02**
PIR 120mm	561	2310	**P03**
PIR 120mm	561	2310	**P04**
PIR 120mm	41	2310	**P05**
PIR 100mm	140	2310	**P06**
OSB End Cap 9mm	146	2383	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name:	**MP Adams Plot 4, Eckington**		
Site: **Eckington**		Client: **MP Adams**	
Title:	**Panel Fabrication — 38 x 140 C16 CLS**		
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX2**		Drawing No: **P4-MF-GF-EX2**	
Panel L×H×T: **2409×2386×149**		Weight: **101 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3384 ±5 (equal = square)

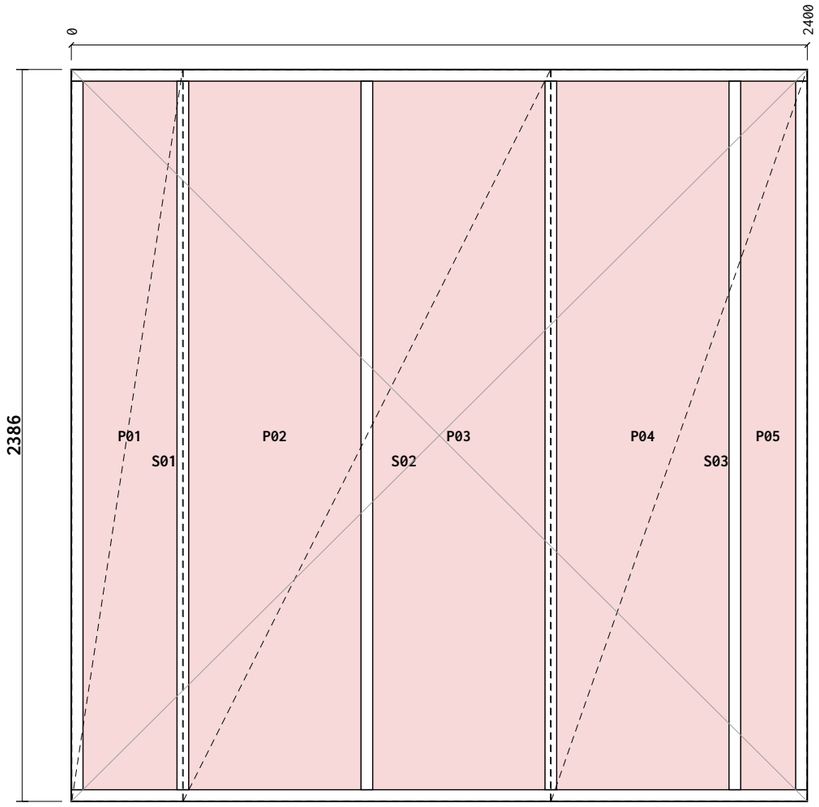


Breather bot overlap: 314mm

Breather R overlap: 150mm

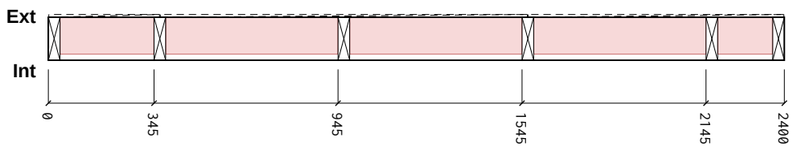

Section A-A

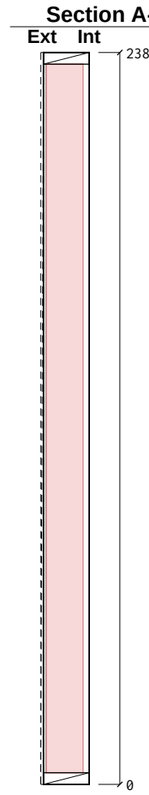

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	4

Total: 8 pcs / 18.66 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	361	2383	**S01**
OSB 9mm	1197	2383	**S02**
OSB 9mm	834	2383	**S03**
PIR 120mm	306	2310	**P01**
PIR 120mm	561	2310	**P02**
PIR 120mm	561	2310	**P03**
PIR 120mm	561	2310	**P04**
PIR 120mm	178	2310	**P05**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note): **C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)**

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX3**		Drawing No: **P4-MF-GF-EX3**	
Panel L×H×T: **2400×2386×149**		Weight: **94 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2651 ±5 (equal = square)

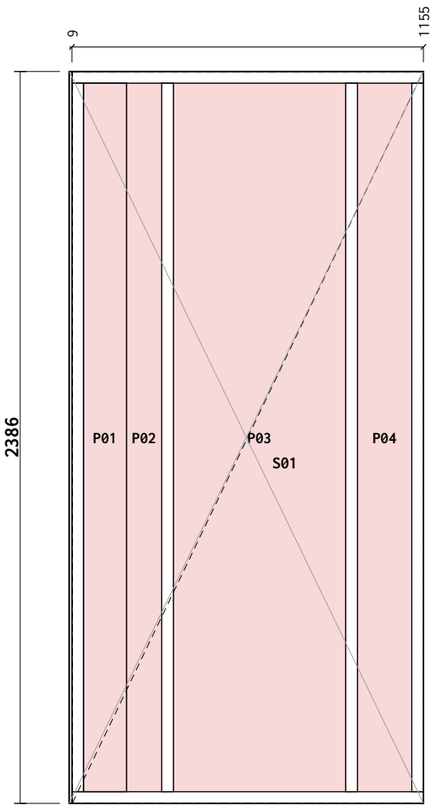


Breather bot overlap: 314mm

Breather R overlap: 150mm

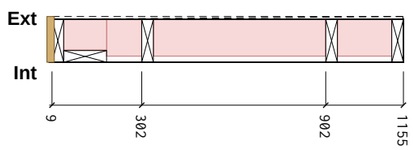

Section A-A

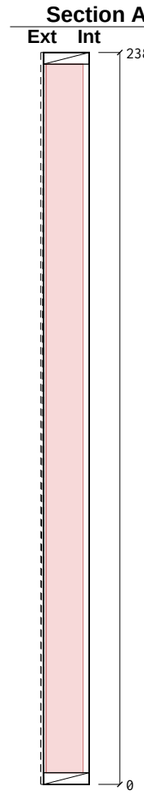

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1146	0	0	1
TR1 Top Rail	38×140 C16	1146	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	2
JS1 Junction Stud	38×140 C16	2310	0	0	1

Total: 7 pcs / 13.84 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1143	2383	**S01**
PIR 100mm	140	2310	**P01**
PIR 120mm	114	2310	**P02**
PIR 120mm	561	2310	**P03**
PIR 120mm	176	2310	**P04**
OSB End Cap 9mm	146	2383	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name:	**MP Adams Plot 4, Eckington**		
Site: **Eckington**		Client: **MP Adams**	
Title:	**Panel Fabrication — 38 x 140 C16 CLS**		
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX4**		Drawing No: **P4-MF-GF-EX4**	
Panel L×H×T: **1155×2386×149**		Weight: **57 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3384 ±5 (equal = square)

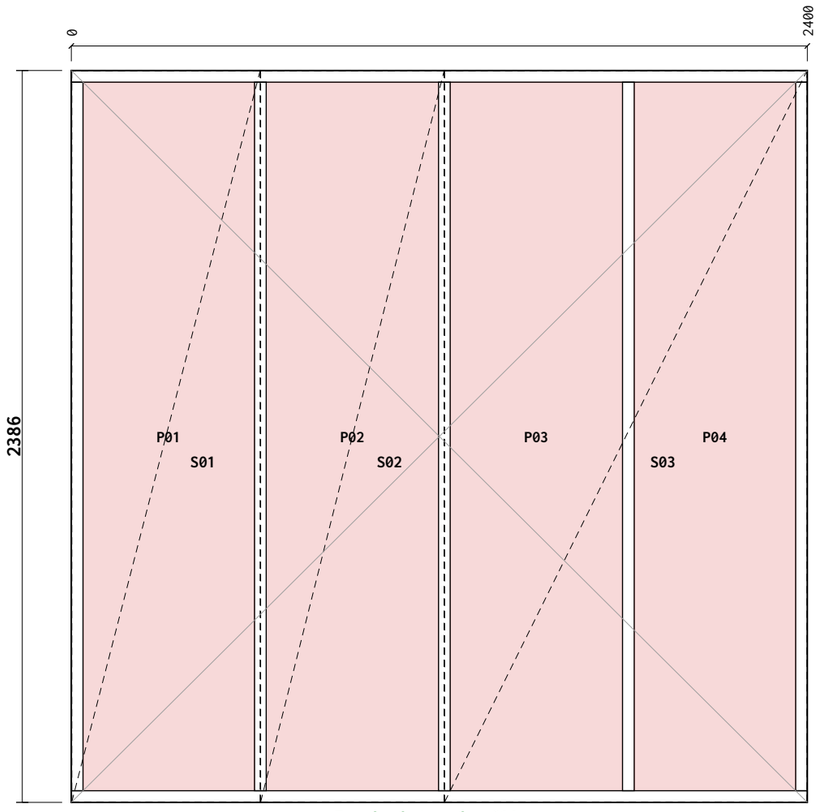


Breather bot overlap: 314mm

Breather R overlap: 150mm

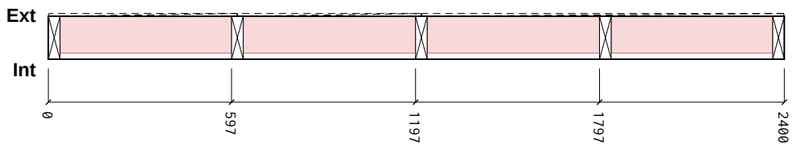

Section A-A

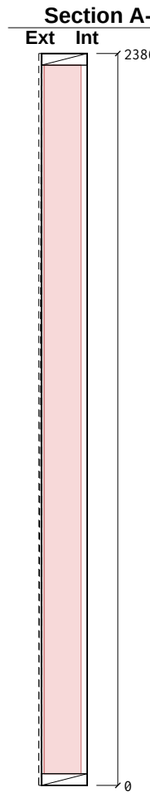

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	3

Total: 7 pcs / 16.35 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	614	2383	**S01**
OSB 9mm	598	2383	**S02**
OSB 9mm	1181	2383	**S03**
PIR 120mm	558	2310	**P01**
PIR 120mm	561	2310	**P02**
PIR 120mm	561	2310	**P03**
PIR 120mm	526	2310	**P04**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX5**		Drawing No: **P4-MF-GF-EX5**	
Panel L×H×T: **2400×2386×149**		Weight: **89 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3384 ±5 (equal = square)

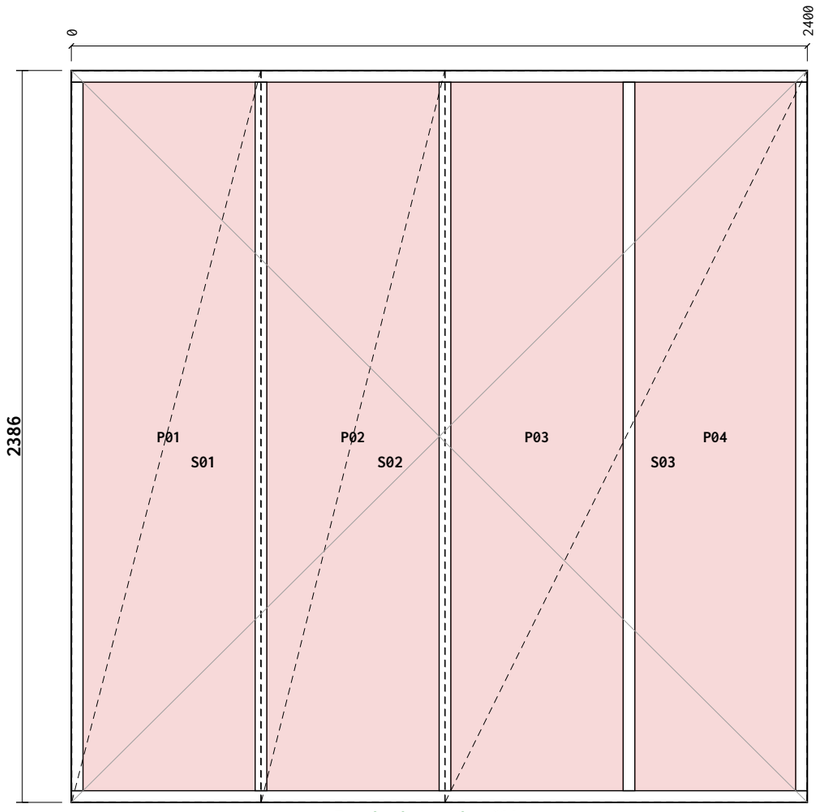


Breather bot overlap: 314mm

Breather R overlap: 150mm

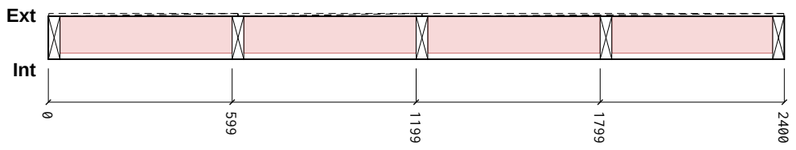

Section A-A

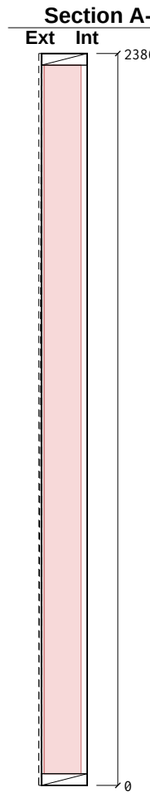

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	3

Total: 7 pcs / 16.35 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	616	2383	**S01**
OSB 9mm	598	2383	**S02**
OSB 9mm	1179	2383	**S03**
PIR 120mm	560	2310	**P01**
PIR 120mm	561	2310	**P02**
PIR 120mm	561	2310	**P03**
PIR 120mm	524	2310	**P04**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX6**		Drawing No: **P4-MF-GF-EX6**	
Panel L×H×T: **2400×2386×149**		Weight: **89 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)


Diag 2613 ±5 (equal = square)

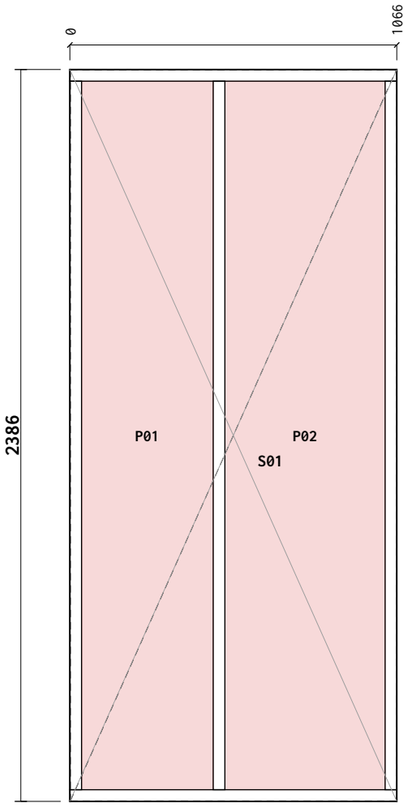

Breather bot overlap: 314mm

Breather R overlap: 150mm

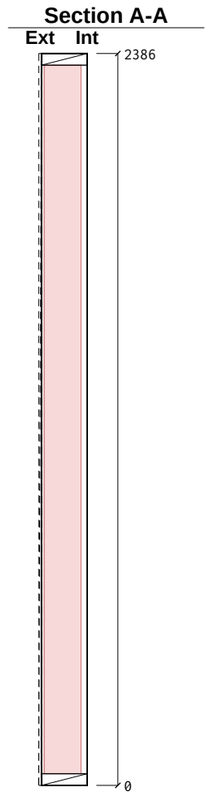

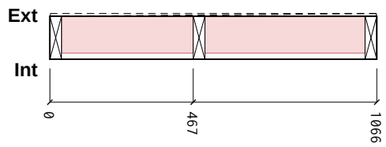

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1066	0	0	1
TR1 Top Rail	38×140 C16	1066	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	1

Total: 5 pcs / 9.06 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1063	2383	**S01**
PIR 120mm	428	2310	**P01**
PIR 120mm	522	2310	**P02**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)


Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX7**		Drawing No: **P4-MF-GF-EX7**	
Panel L×H×T: **1066×2386×149**		Weight: **43 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

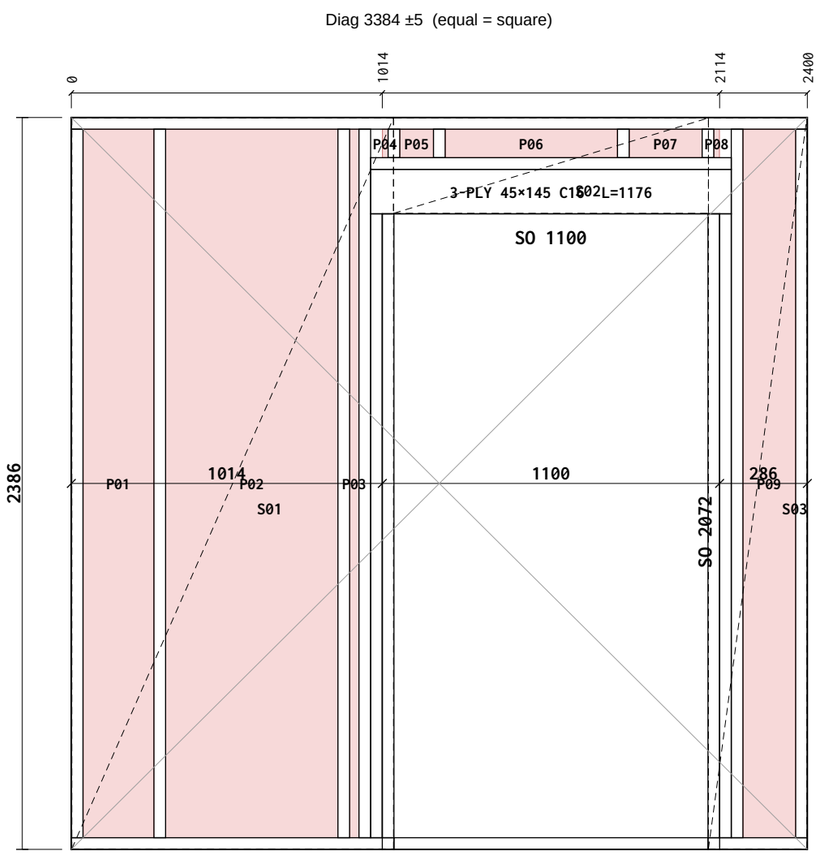

Breather bot overlap: 314mm

Breather R overlap: 150mm

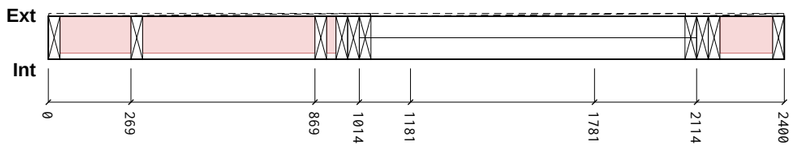

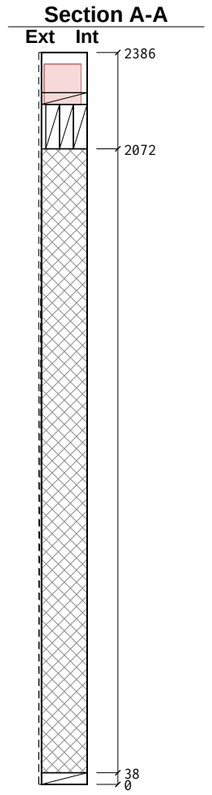

Cut List

Item		Section	Len	Bot°	Top°	Qty
BR1	Bottom Rail	38×140 C16	1052	0	0	1
BR2	Bottom Rail	38×140 C16	1024	0	0	1
BR3	Bottom Rail	38×140 C16	324	0	0	1
TR1	Top Rail	38×140 C16	2400	0	0	1
TR2	Top Rail	38×140 C16	1176	0	0	1
ES1	End Stud	38×140 C16	2310	0	0	1
ES2	End Stud	38×140 C16	2310	0	0	1
KS1	Vertical Stud	38×140 C16	2310	0	0	2
CS1	Cripple Stud	38×140 C16	2034	0	0	4
LP1	Lintel Ply	1176×45 C16	1176	0	0	3
OS1	OSB Support	38×140 C16	93	0	0	2
VS1	Vertical Stud	38×140 C16	2310	0	0	2
VS2	Vertical Stud	38×140 C16	93	0	0	2

Total: 22 pcs / 31.87 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1049	2383	**S01**
OSB 9mm	1027	311	**S02**
OSB 9mm	321	2383	**S03**
PIR 120mm	230	2310	**P01**
PIR 120mm	561	2310	**P02**
PIR 120mm	29	2310	**P03**
PIR 120mm	18	93	**P04**
PIR 120mm	109	93	**P05**
PIR 120mm	561	93	**P06**
PIR 120mm	237	93	**P07**
PIR 120mm	18	93	**P08**
PIR 120mm	170	2310	**P09**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN

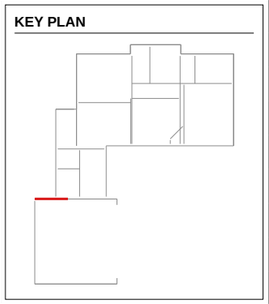


Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX8**		Drawing No: **P4-MF-GF-EX8**	
Panel L×H×T: **2400×2386×149**		Weight: **103 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)


Diag 3384 ±5 (equal = square)

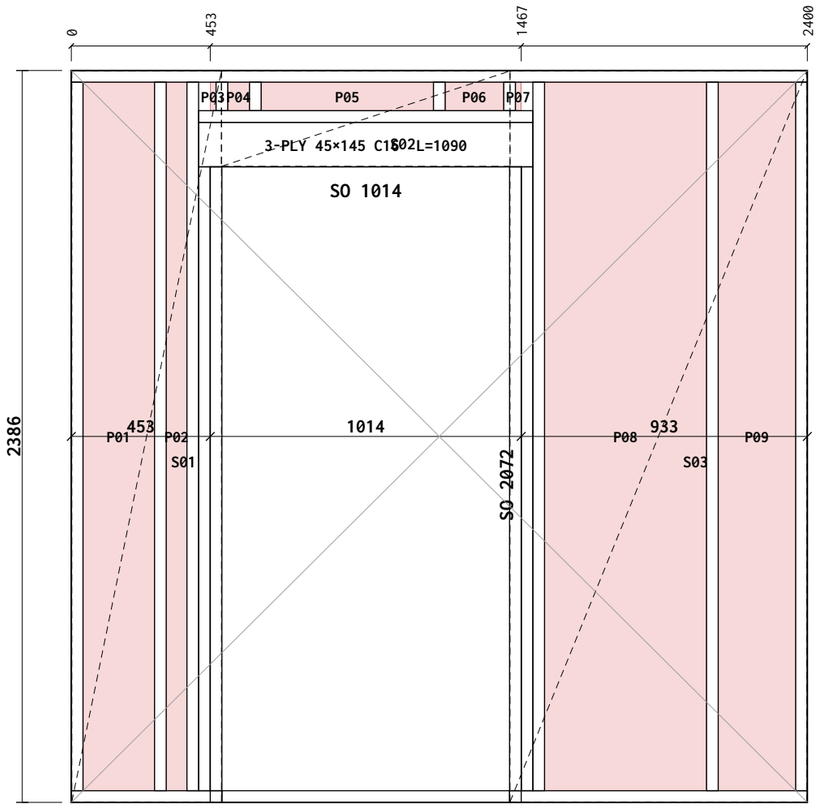

Breather bot overlap: 314mm

Breather R overlap: 150mm

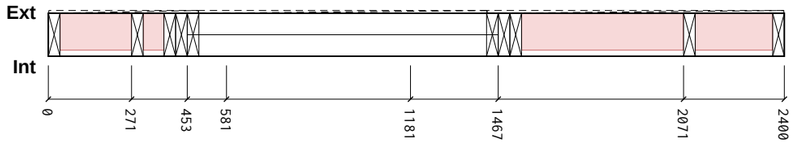

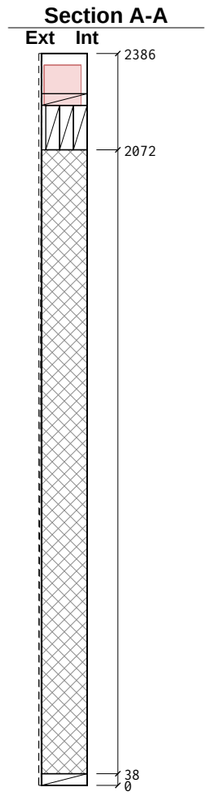

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	971	0	0	1
BR2 Bottom Rail	38×140 C16	938	0	0	1
BR3 Bottom Rail	38×140 C16	491	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	1090	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
LP1 Lintel Ply	1090×45 C16	1090	0	0	3
OS1 OSB Support	38×140 C16	93	0	0	2
VS1 Vertical Stud	38×140 C16	2310	0	0	2
VS2 Vertical Stud	38×140 C16	93	0	0	2

Total: 22 pcs / 31.53 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	488	2383	**S01**
OSB 9mm	941	311	**S02**
OSB 9mm	968	2383	**S03**
PIR 120mm	232	2310	**P01**
PIR 120mm	66	2310	**P02**
PIR 120mm	18	93	**P03**
PIR 120mm	70	93	**P04**
PIR 120mm	561	93	**P05**
PIR 120mm	190	93	**P06**
PIR 120mm	18	93	**P07**
PIR 120mm	527	2310	**P08**
PIR 120mm	252	2310	**P09**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX9**		Drawing No: **P4-MF-GF-EX9**	
Panel L×H×T: **2400×2386×149**		Weight: **104 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2651 ±5 (equal = square)

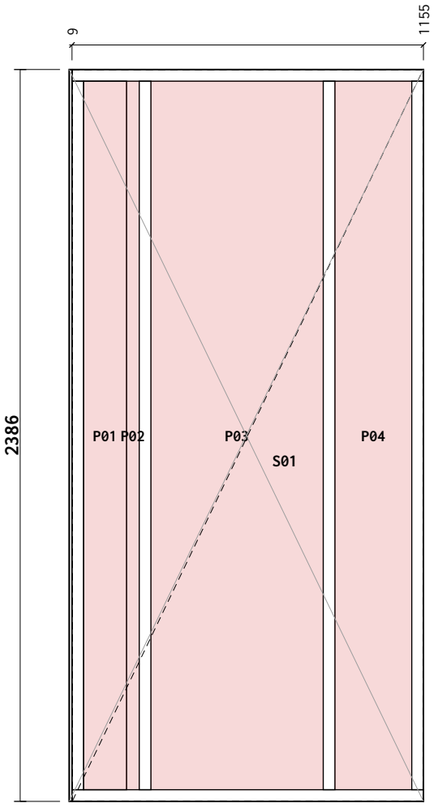


Breather bot overlap: 314mm

Breather R overlap: 150mm



Section A-A

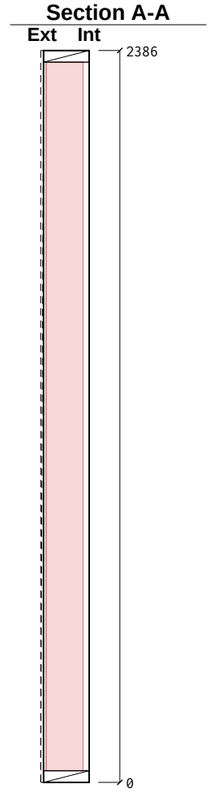

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1146	0	0	1
TR1 Top Rail	38×140 C16	1146	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	2
JS1 Junction Stud	38×140 C16	2310	0	0	1

Total: 7 pcs / 13.84 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1143	2383	**S01**
PIR 100mm	140	2310	**P01**
PIR 120mm	41	2310	**P02**
PIR 120mm	561	2310	**P03**
PIR 120mm	250	2310	**P04**
OSB End Cap 9mm	146	2383	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX10**		Drawing No: **P4-MF-GF-EX10**	
Panel L×H×T: **1155×2386×149**		Weight: **57 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2403 ±5 (equal = square)

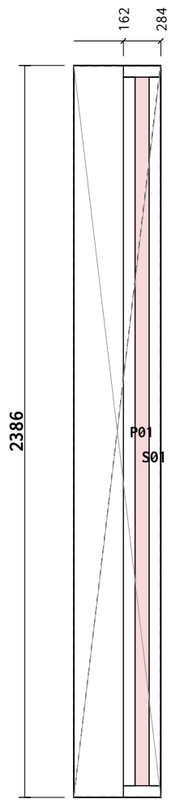


Breather bot overlap: 314mm

Breather R overlap: 150mm



Section A-A

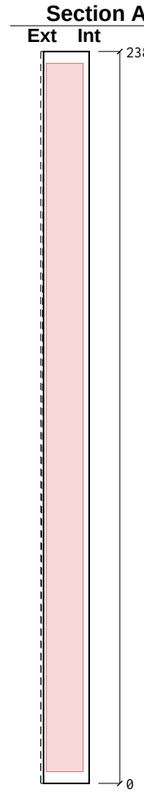

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	122	0	0	1
TR1 Top Rail	38×140 C16	122	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1

Total: 4 pcs / 4.86 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	282	2383	**S01**
PIR 120mm	45	2310	**P01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX11**		Drawing No: **P4-MF-GF-EX11**	
Panel L×H×T: **283×2386×149**		Weight: **15 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3384 ±5 (equal = square)

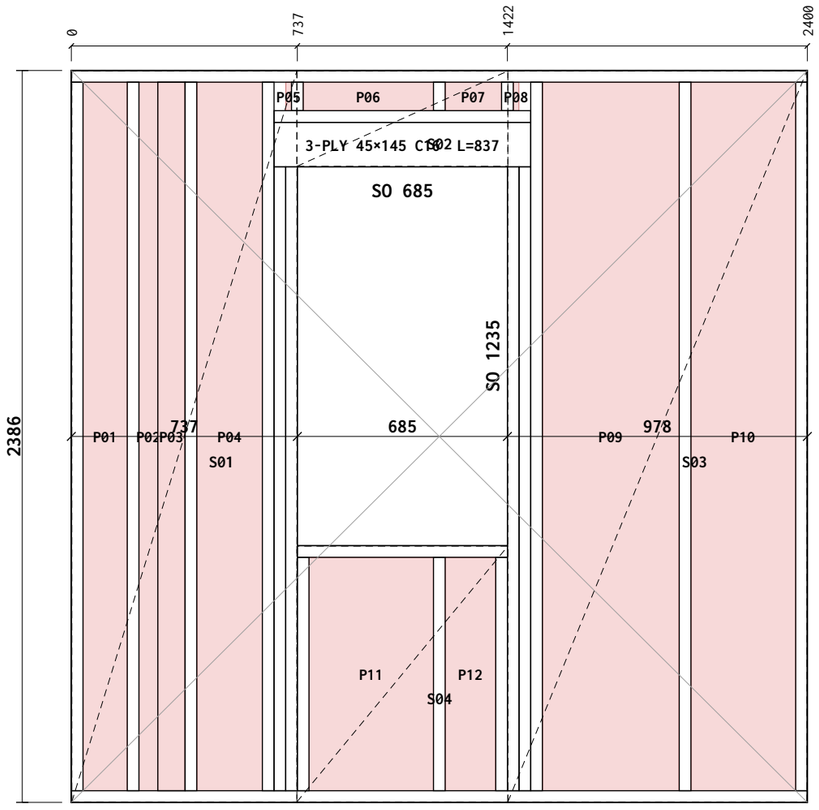


Breather bot overlap: 314mm

Breather R overlap: 150mm

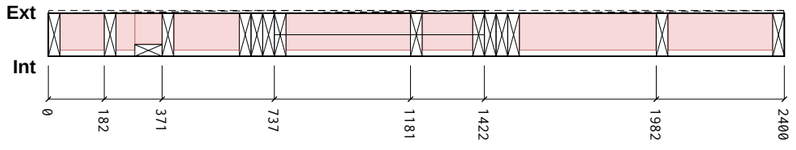

Section A-A

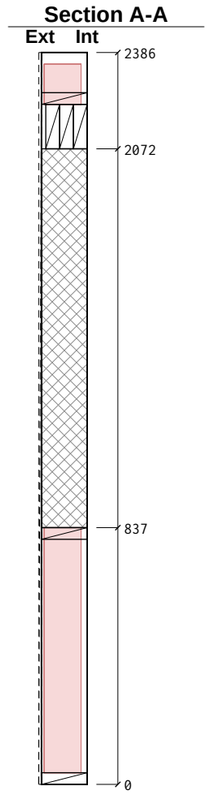

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	837	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
SP1 Sill Plate	38×140 C16	685	0	0	1
LP1 Lintel Ply	837×45 C16	837	0	0	3
SS1 Sill Support	38×140 C16	761	0	0	2
OS1 OSB Support	38×140 C16	93	0	0	2
VS1 Vertical Stud	38×140 C16	2310	0	0	3
VS2 Vertical Stud	38×140 C16	761	0	0	1
VS3 Vertical Stud	38×140 C16	93	0	0	1
JS1 Junction Stud	38×89 C16	2310	0	0	1

Total: 25 pcs / 38.01 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	734	2383	**S01**
OSB 9mm	688	311	**S02**
OSB 9mm	975	2383	**S03**
OSB 9mm	688	834	**S04**
PIR 120mm	143	2310	**P01**
PIR 120mm	61	2310	**P02**
PIR 100mm	88	2310	**P03**
PIR 120mm	213	2310	**P04**
PIR 120mm	18	93	**P05**
PIR 120mm	424	93	**P06**
PIR 120mm	183	93	**P07**
PIR 120mm	18	93	**P08**
PIR 120mm	445	2310	**P09**
PIR 120mm	341	2310	**P10**
PIR 120mm	405	760	**P11**
PIR 120mm	164	760	**P12**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX12**		Drawing No: **P4-MF-GF-EX12**	
Panel L×H×T: **2400×2386×149**		Weight: **125 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3384 ±5 (equal = square)

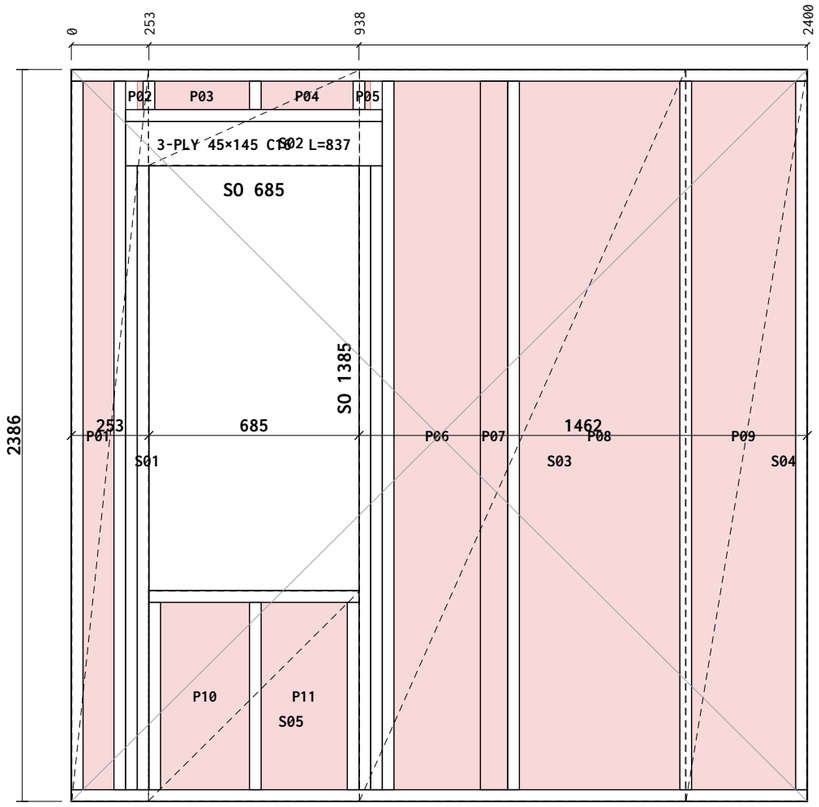


Breather bot overlap: 314mm

Breather R overlap: 150mm

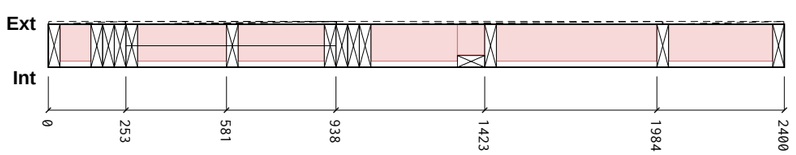

Section A-A

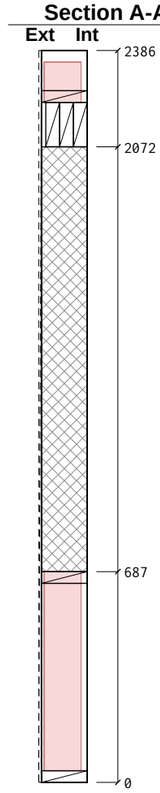

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	837	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
SP1 Sill Plate	38×140 C16	685	0	0	1
LP1 Lintel Ply	837×45 C16	837	0	0	3
SS1 Sill Support	38×140 C16	611	0	0	2
OS1 OSB Support	38×140 C16	93	0	0	2
VS1 Vertical Stud	38×140 C16	2310	0	0	2
VS2 Vertical Stud	38×140 C16	611	0	0	1
VS3 Vertical Stud	38×140 C16	93	0	0	1
JS1 Junction Stud	38×89 C16	2310	0	0	1

Total: 24 pcs / 35.25 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	250	2383	**S01**
OSB 9mm	688	311	**S02**
OSB 9mm	1063	2383	**S03**
OSB 9mm	394	2383	**S04**
OSB 9mm	688	684	**S05**
PIR 120mm	99	2310	**P01**
PIR 120mm	18	93	**P02**
PIR 120mm	308	93	**P03**
PIR 120mm	299	93	**P04**
PIR 120mm	18	93	**P05**
PIR 120mm	281	2310	**P06**
PIR 100mm	88	2310	**P07**
PIR 120mm	522	2310	**P08**
PIR 120mm	339	2310	**P09**
PIR 120mm	289	610	**P10**
PIR 120mm	280	610	**P11**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN





Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX13**		Drawing No: **P4-MF-GF-EX13**	
Panel L×H×T: **2400×2386×149**		Weight: **119 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

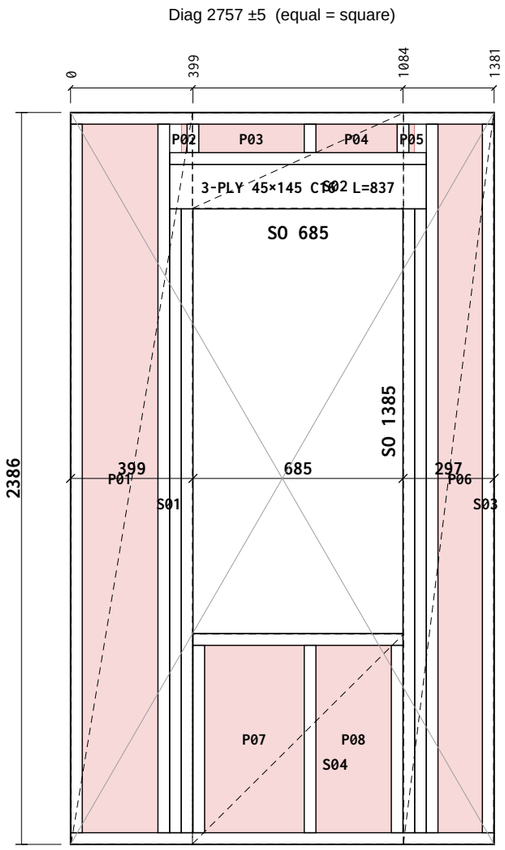

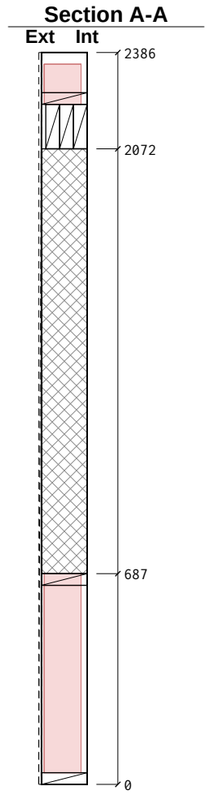

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1381	0	0	1
TR1 Top Rail	38×140 C16	1381	0	0	1
TR2 Top Rail	38×140 C16	837	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
SP1 Sill Plate	38×140 C16	685	0	0	1
LP1 Lintel Ply	837×45 C16	837	0	0	3
SS1 Sill Support	38×140 C16	611	0	0	2
OS1 OSB Support	38×140 C16	93	0	0	2
VS1 Vertical Stud	38×140 C16	611	0	0	1
VS2 Vertical Stud	38×140 C16	93	0	0	1

Total: 21 pcs / 26.28 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	396	2383	**S01**
OSB 9mm	688	311	**S02**
OSB 9mm	294	2383	**S03**
OSB 9mm	688	684	**S04**
PIR 120mm	246	2310	**P01**
PIR 120mm	18	93	**P02**
PIR 120mm	343	93	**P03**
PIR 120mm	264	93	**P04**
PIR 120mm	18	93	**P05**
PIR 120mm	144	2310	**P06**
PIR 120mm	324	610	**P07**
PIR 120mm	245	610	**P08**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX14**		Drawing No: **P4-MF-GF-EX14**	
Panel L×H×T: **1381×2386×149**		Weight: **78 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2900 ±5 (equal = square)

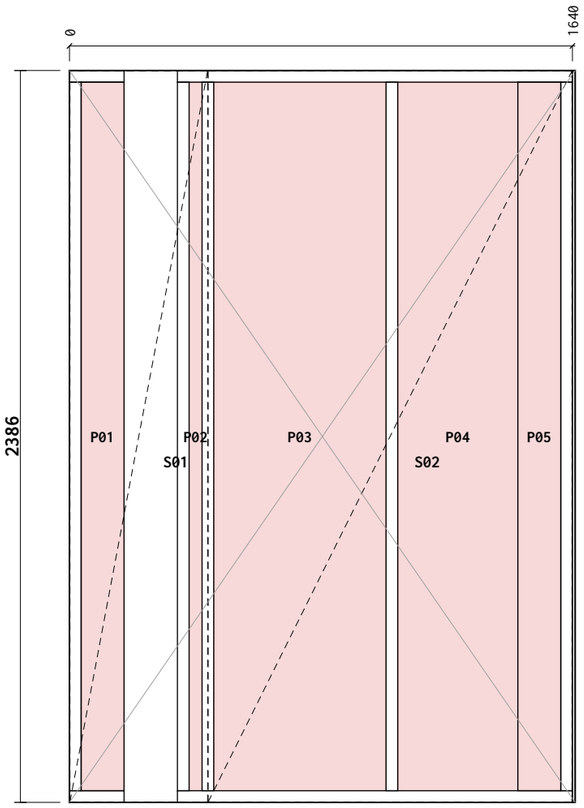


Breather bot overlap: 314mm

Breather R overlap: 150mm

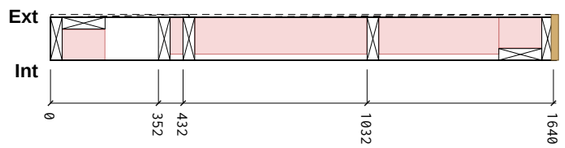

Section A-A

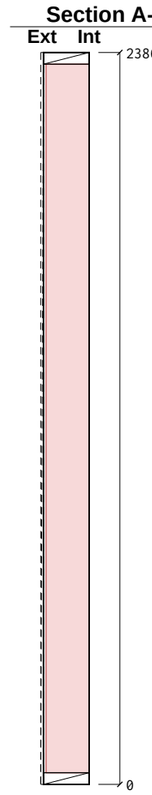

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1288	0	0	1
BR2 Bottom Rail	38×140 C16	178	0	0	1
TR1 Top Rail	38×140 C16	1288	0	0	1
TR2 Top Rail	38×140 C16	178	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	3
JS1 Junction Stud	38×140 C16	2310	0	0	2

Total: 11 pcs / 19.10 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	449	2383	**S01**
OSB 9mm	1186	2383	**S02**
PIR 100mm	139	2310	**P01**
PIR 120mm	41	2310	**P02**
PIR 120mm	561	2310	**P03**
PIR 120mm	391	2310	**P04**
PIR 100mm	140	2310	**P05**
OSB End Cap 9mm	146	2383	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX15**		Drawing No: **P4-MF-GF-EX15**	
Panel L×H×T: **1649×2386×149**		Weight: **78 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3403 ±5 (equal = square)

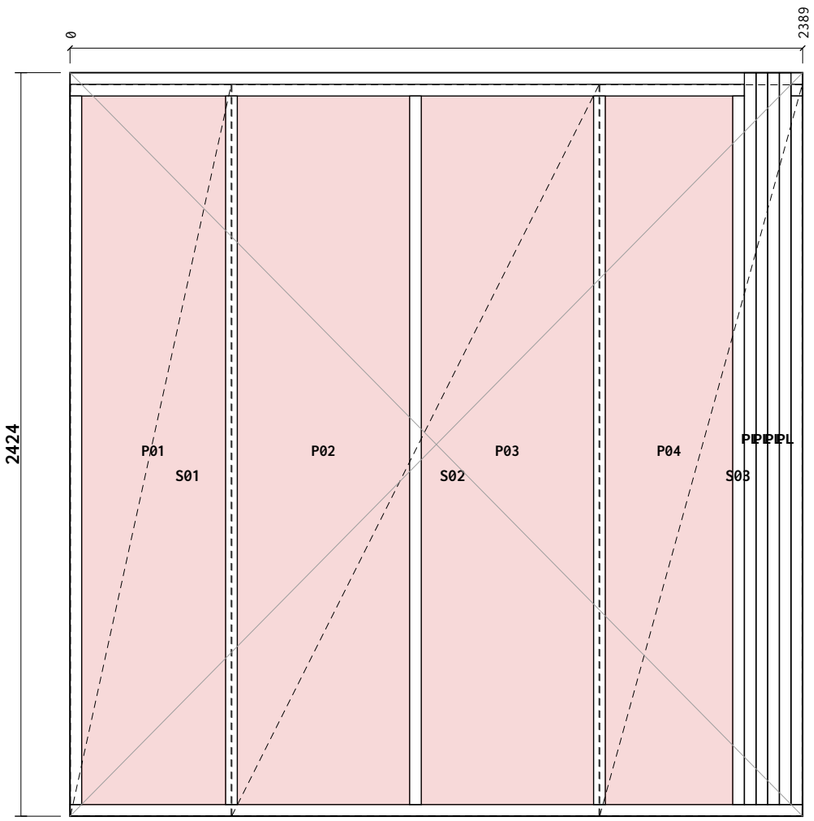


Breather bot overlap: 276mm

Breather R overlap: 150mm

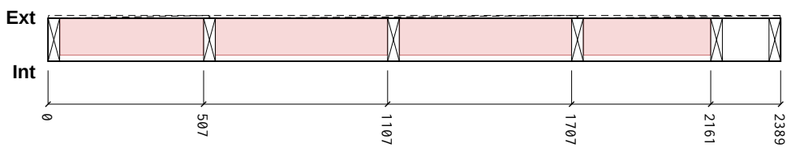

Section A-A

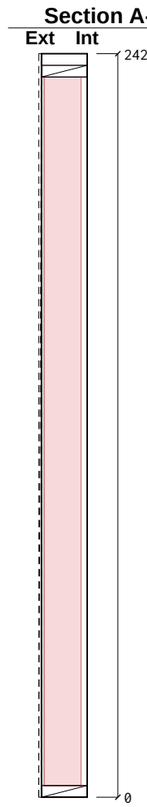

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2389	0	0	1
TR1 Top Rail	38×140 C16	2199	0	0	1
TR2 Top Rail	38×140 C16	38	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
CS1 Cripple Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	3

Total: 9 pcs / 18.49 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	524	2383	**S01**
OSB 9mm	1197	2383	**S02**
OSB 9mm	660	2383	**S03**
PIR 120mm	468	2310	**P01**
PIR 120mm	561	2310	**P02**
PIR 120mm	561	2310	**P03**
PIR 120mm	415	2310	**P04**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX16**		Drawing No: **P4-MF-GF-EX16**	
Panel L×H×T: **2389×2424×149**		Weight: **92 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2877 ±5 (equal = square)

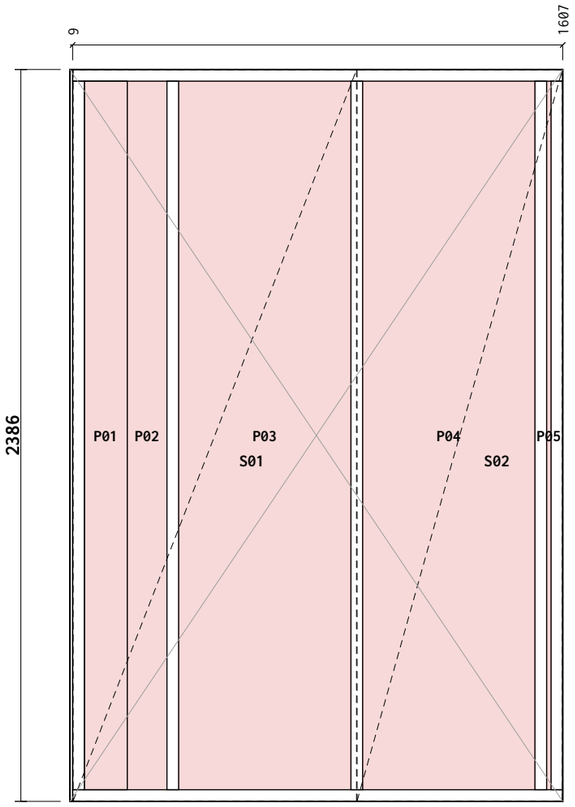


Breather bot overlap: 314mm

Breather R overlap: 150mm

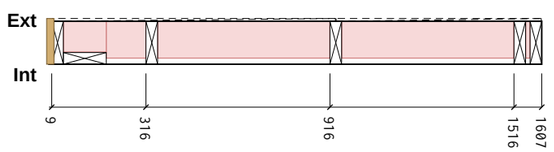

Section A-A

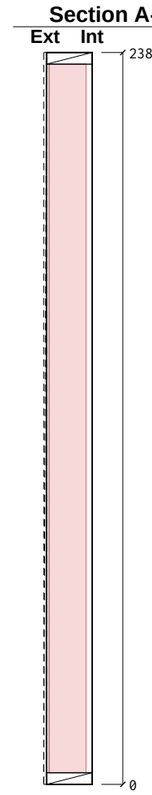

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1598	0	0	1
TR1 Top Rail	38×140 C16	1598	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	3
JS1 Junction Stud	38×140 C16	2310	0	0	1

Total: 8 pcs / 17.06 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	924	2383	**S01**
OSB 9mm	669	2383	**S02**
PIR 100mm	140	2310	**P01**
PIR 120mm	129	2310	**P02**
PIR 120mm	561	2310	**P03**
PIR 120mm	561	2310	**P04**
PIR 120mm	14	2310	**P05**
OSB End Cap 9mm	146	2383	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)


Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name:	**MP Adams Plot 4, Eckington**		
Site: **Eckington**		Client: **MP Adams**	
Title:	**Panel Fabrication — 38 x 140 C16 CLS**		
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX17**		Drawing No: **P4-MF-GF-EX17**	
Panel L×H×T: **1607×2386×149**		Weight: **74 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)
Internal face OSB sent loose - see GA


Diag 2585 ±5 (equal = square)

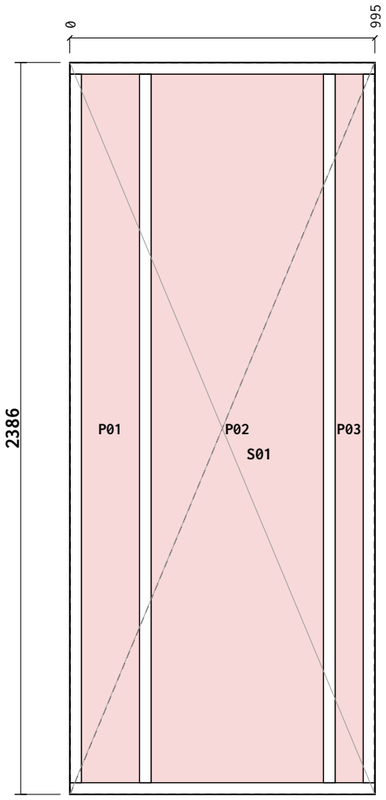

Breather bot overlap: 314mm
Breather R overlap: 150mm

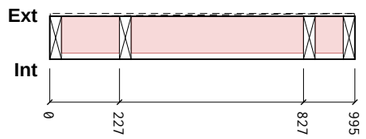

Section A-A

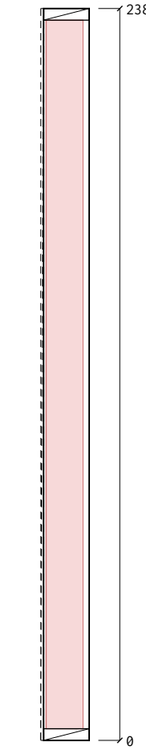

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	995	0	0	1
TR1 Top Rail	38×140 C16	995	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	2

Total: 6 pcs / 11.23 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	992	2383	**S01**
PIR 120mm	188	2310	**P01**
PIR 120mm	561	2310	**P02**
PIR 120mm	91	2310	**P03**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm

Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX18**		Drawing No: **P4-MF-GF-EX18**	
Panel L×H×T: **995×2386×149**		Weight: **46 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)
Internal face OSB sent loose - see GA

Diag 3384 ±5 (equal = square)

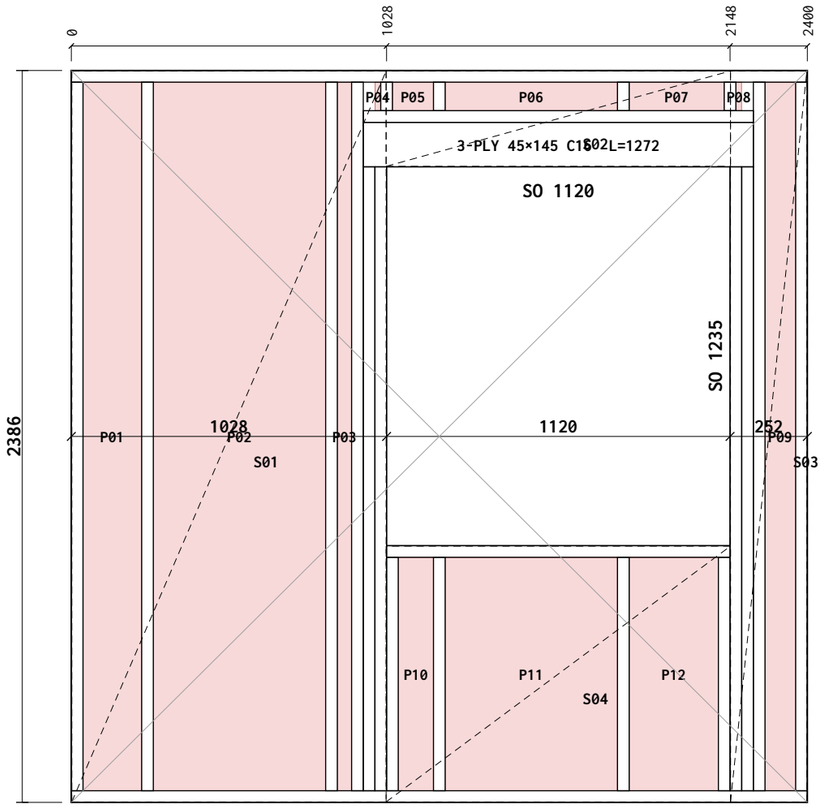


Breather bot overlap: 314mm

Breather R overlap: 150mm

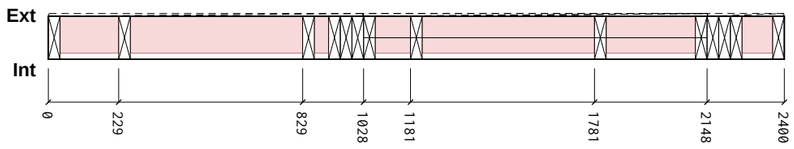

Section A-A

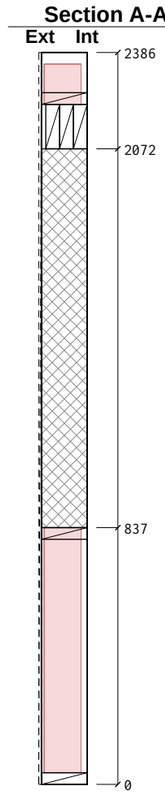

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	1272	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
SP1 Sill Plate	38×140 C16	1120	0	0	1
LP1 Lintel Ply	1272×45 C16	1272	0	0	3
SS1 Sill Support	38×140 C16	761	0	0	2
OS1 OSB Support	38×140 C16	93	0	0	2
VS1 Vertical Stud	38×140 C16	2310	0	0	2
VS2 Vertical Stud	38×140 C16	761	0	0	2
VS3 Vertical Stud	38×140 C16	93	0	0	2

Total: 25 pcs / 36.42 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1025	2383	**S01**
OSB 9mm	1123	311	**S02**
OSB 9mm	249	2383	**S03**
OSB 9mm	1123	834	**S04**
PIR 120mm	190	2310	**P01**
PIR 120mm	561	2310	**P02**
PIR 120mm	45	2310	**P03**
PIR 120mm	18	93	**P04**
PIR 120mm	133	93	**P05**
PIR 120mm	561	93	**P06**
PIR 120mm	309	93	**P07**
PIR 120mm	18	93	**P08**
PIR 120mm	98	2310	**P09**
PIR 120mm	114	760	**P10**
PIR 120mm	561	760	**P11**
PIR 120mm	290	760	**P12**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)


Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX19**		Drawing No: **P4-MF-GF-EX19**	
Panel L×H×T: **2400×2386×149**		Weight: **119 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)
Internal face OSB sent loose - see GA


Diag 2438 ±5 (equal = square)

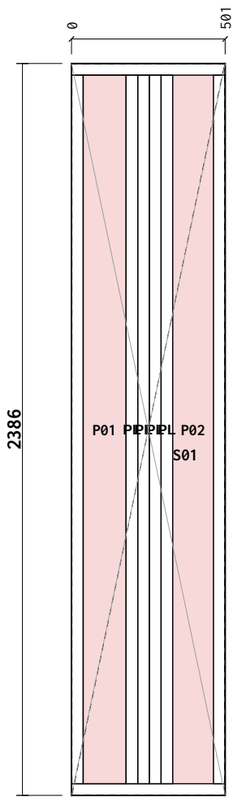

Breather bot overlap: 314mm
Breather R overlap: 150mm



Section A-A

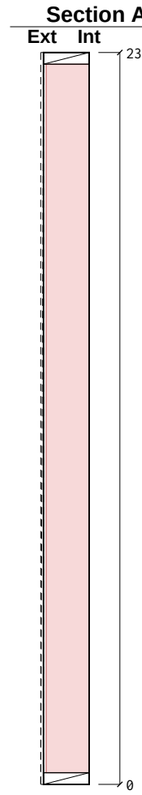

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	501	0	0	1
TR1 Top Rail	38×140 C16	501	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
JS1 Junction Stud	38×140 C16	2310	0	0	1

Total: 5 pcs / 7.93 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	498	2383	**S01**
PIR 100mm	139	2310	**P01**
PIR 120mm	132	2310	**P02**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX20**		Drawing No: **P4-MF-GF-EX20**	
Panel L×H×T: **501×2386×149**		Weight: **27 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2476 ±5 (equal = square)

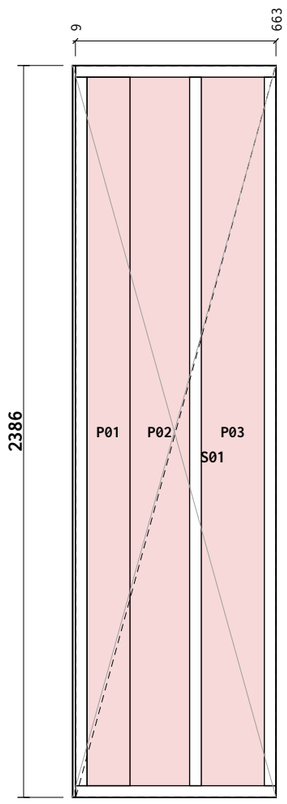


Breather bot overlap: 314mm

Breather R overlap: 150mm



Section A-A

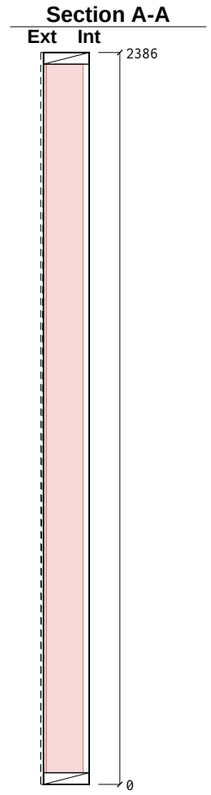

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	654	0	0	1
TR1 Top Rail	38×140 C16	654	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	1
JS1 Junction Stud	38×140 C16	2310	0	0	1

Total: 6 pcs / 10.55 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	651	2383	**S01**
PIR 100mm	140	2310	**P01**
PIR 120mm	194	2310	**P02**
PIR 120mm	205	2310	**P03**
OSB End Cap 9mm	146	2383	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):


C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name:	**MP Adams Plot 4, Eckington**		
Site: **Eckington**		Client: **MP Adams**	
Title:	**Panel Fabrication — 38 x 140 C16 CLS**		
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX21**		Drawing No: **P4-MF-GF-EX21**	
Panel L×H×T: **663×2386×149**		Weight: **39 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)


Diag 4252 ±5 (equal = square)

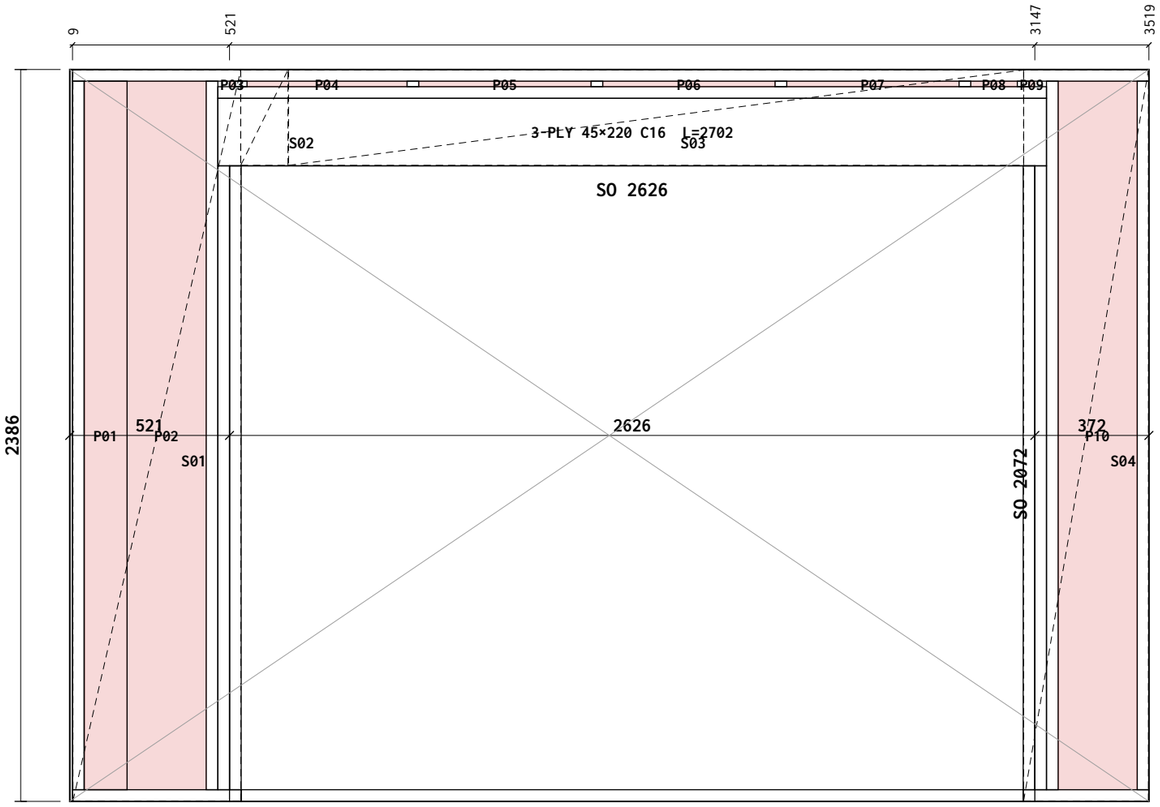

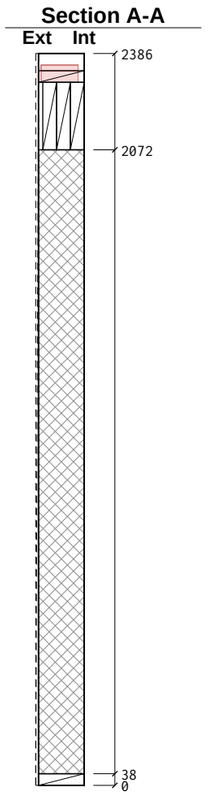

Breather bot overlap: 314mm

Breather R overlap: 150mm

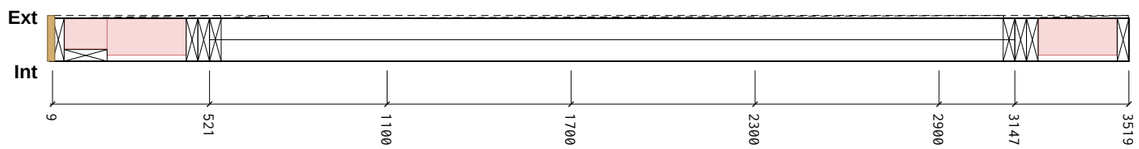

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2550	0	0	1
BR2 Bottom Rail	38×140 C16	550	0	0	1
BR3 Bottom Rail	38×140 C16	410	0	0	1
TR1 Top Rail	38×140 C16	3510	0	0	1
TR2 Top Rail	38×140 C16	2702	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
LP1 Lintel Ply	2702×45 C16	2702	0	0	3
OS1 OSB Support	38×140 C16	18	0	0	2
VS1 Vertical Stud	38×140 C16	18	0	0	4
JS1 Junction Stud	38×140 C16	2310	0	0	1

Total: 23 pcs / 37.62 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	547	2383	**S01**
OSB 9mm	154	311	**S02**
OSB 9mm	2397	311	**S03**
OSB 9mm	407	2383	**S04**
PIR 100mm	139	2310	**P01**
PIR 120mm	257	2310	**P02**
PIR 120mm	18	18	**P03**
PIR 120mm	521	18	**P04**
PIR 120mm	561	18	**P05**
PIR 120mm	561	18	**P06**
PIR 120mm	561	18	**P07**
PIR 120mm	151	18	**P08**
PIR 120mm	18	18	**P09**
PIR 120mm	256	2310	**P10**
OSB End Cap 9mm	146	2383	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX22**		Drawing No: **P4-MF-GF-EX22**	
Panel L×H×T: **3519×2386×149**		Weight: **125 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2477 ±5 (equal = square)

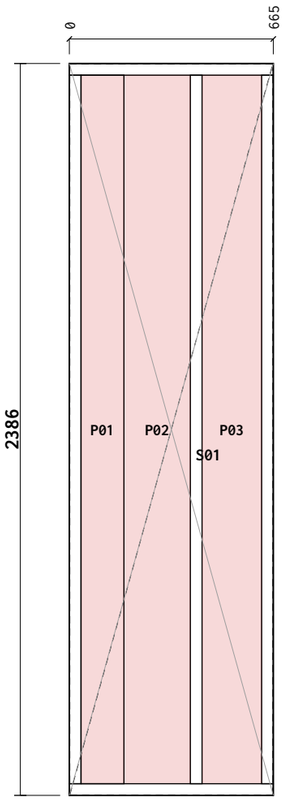


Breather bot overlap: 314mm

Breather R overlap: 150mm



Section A-A

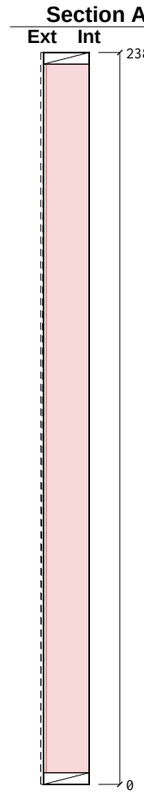

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	665	0	0	1
TR1 Top Rail	38×140 C16	665	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	1
JS1 Junction Stud	38×140 C16	2310	0	0	1

Total: 6 pcs / 10.57 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	662	2383	**S01**
PIR 100mm	140	2310	**P01**
PIR 120mm	216	2310	**P02**
PIR 120mm	193	2310	**P03**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX23**		Drawing No: **P4-MF-GF-EX23**	
Panel L×H×T: **665×2386×149**		Weight: **37 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)


Diag 2421 ±5 (equal = square)

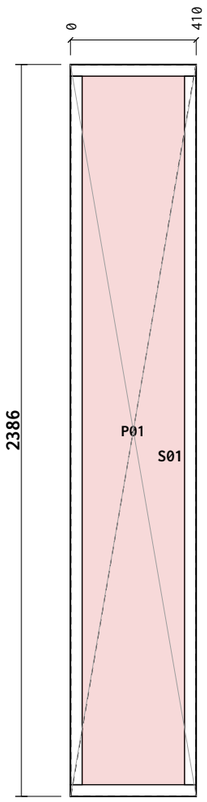

Breather bot overlap: 314mm

Breather R overlap: 150mm



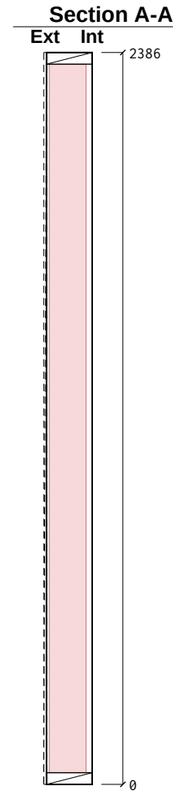

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	410	0	0	1
TR1 Top Rail	38×140 C16	410	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1

Total: 4 pcs / 5.44 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	407	2383	**S01**
PIR 120mm	333	2310	**P01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX24**		Drawing No: **P4-MF-GF-EX24**	
Panel L×H×T: **410×2386×149**		Weight: **21 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 4163 ±5 (equal = square)

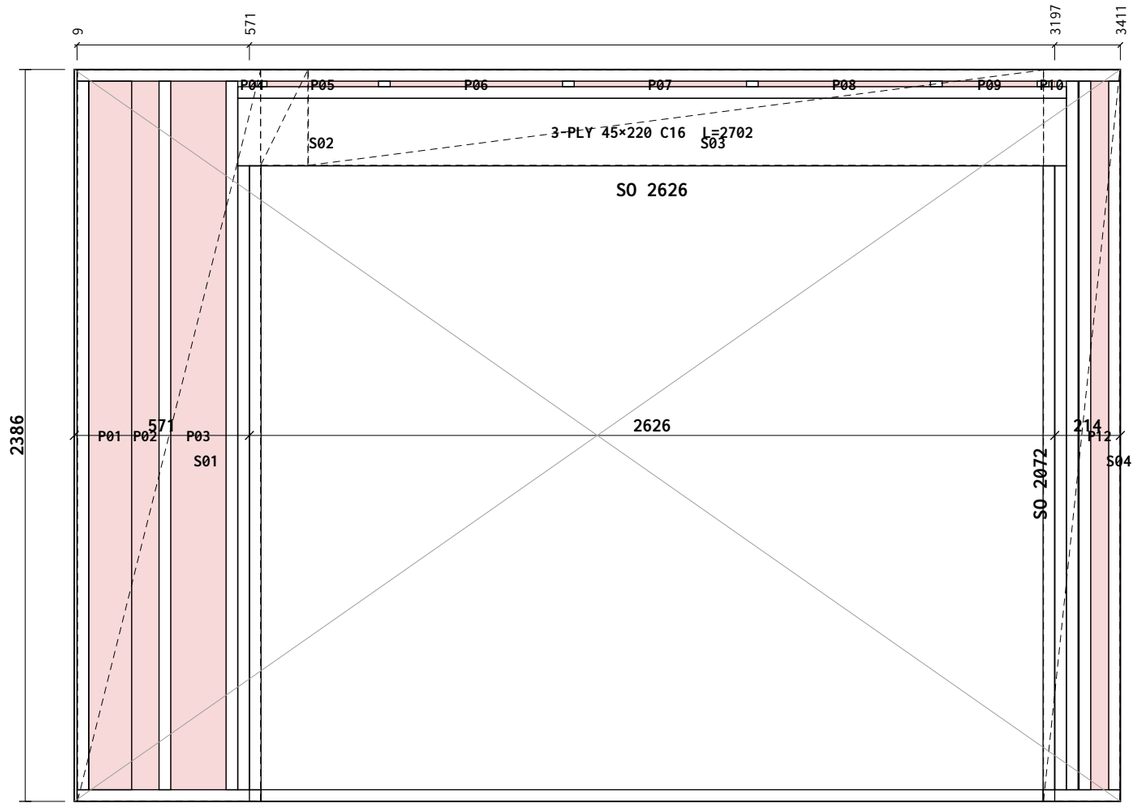


Breather bot overlap: 314mm

Breather R overlap: 150mm

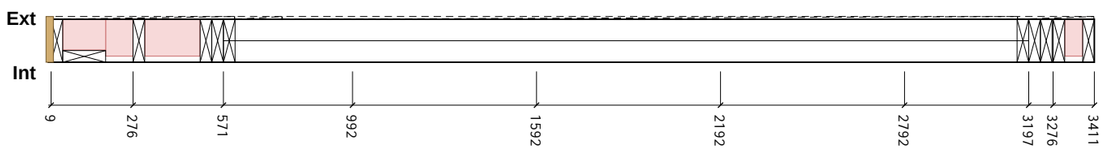

Section A-A

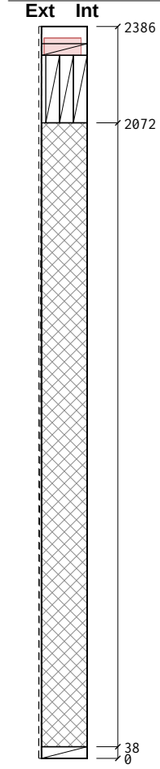

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2550	0	0	1
BR2 Bottom Rail	38×140 C16	600	0	0	1
BR3 Bottom Rail	38×140 C16	252	0	0	1
TR1 Top Rail	38×140 C16	3402	0	0	1
TR2 Top Rail	38×140 C16	2702	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
LP1 Lintel Ply	2702×45 C16	2702	0	0	3
OS1 OSB Support	38×140 C16	18	0	0	2
VS1 Vertical Stud	38×140 C16	2310	0	0	2
VS2 Vertical Stud	38×140 C16	18	0	0	4
JS1 Junction Stud	38×140 C16	2310	0	0	1

Total: 25 pcs / 42.03 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	597	2383	**S01**
OSB 9mm	154	311	**S02**
OSB 9mm	2397	311	**S03**
OSB 9mm	249	2383	**S04**
PIR 100mm	140	2310	**P01**
PIR 120mm	89	2310	**P02**
PIR 120mm	179	2310	**P03**
PIR 120mm	18	18	**P04**
PIR 120mm	363	18	**P05**
PIR 120mm	561	18	**P06**
PIR 120mm	561	18	**P07**
PIR 120mm	561	18	**P08**
PIR 120mm	309	18	**P09**
PIR 120mm	18	18	**P10**
PIR 120mm	2	2310	**P11**
PIR 120mm	58	2310	**P12**
OSB End Cap 9mm	146	2383	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm

Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX25**		Drawing No: **P4-MF-GF-EX25**	
Panel L×H×T: **3411×2386×149**		Weight: **131 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3384 ±5 (equal = square)

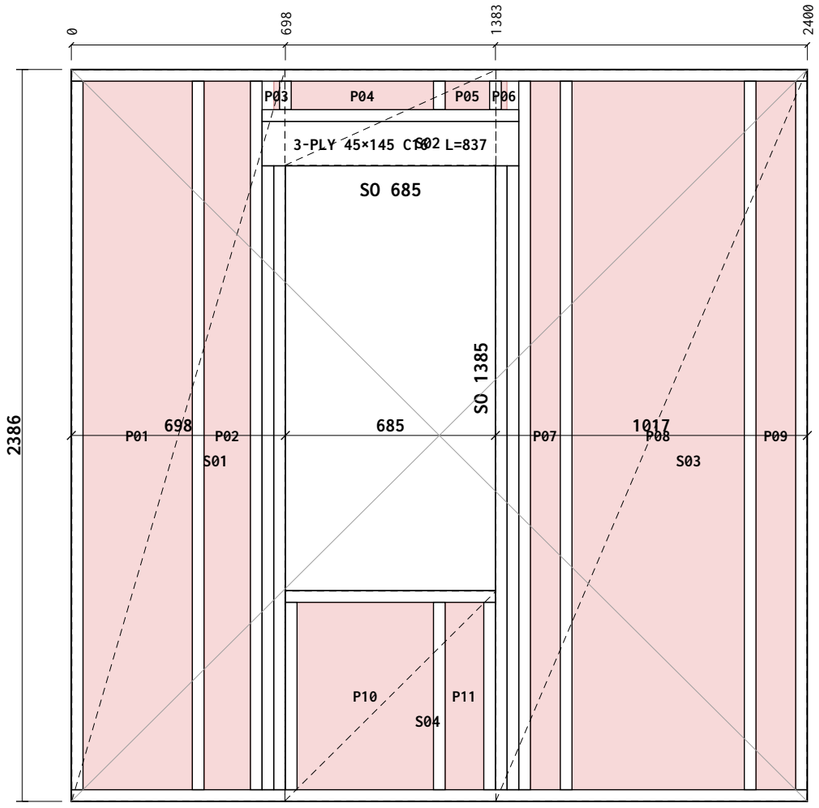


Breather bot overlap: 314mm

Breather R overlap: 150mm

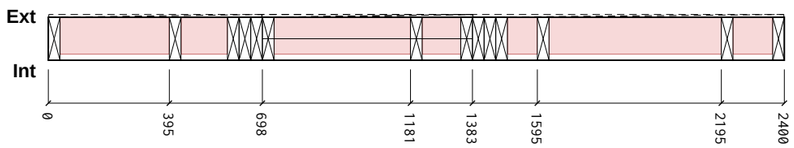

Section A-A

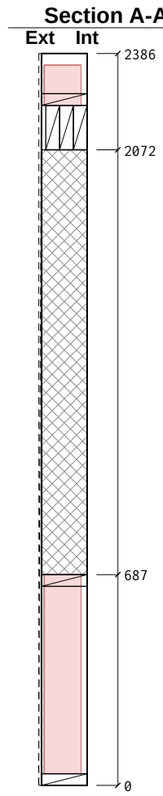

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	837	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
SP1 Sill Plate	38×140 C16	685	0	0	1
LP1 Lintel Ply	837×45 C16	837	0	0	3
SS1 Sill Support	38×140 C16	611	0	0	2
OS1 OSB Support	38×140 C16	93	0	0	2
VS1 Vertical Stud	38×140 C16	2310	0	0	3
VS2 Vertical Stud	38×140 C16	611	0	0	1
VS3 Vertical Stud	38×140 C16	93	0	0	1

Total: 24 pcs / 35.25 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	695	2383	**S01**
OSB 9mm	688	311	**S02**
OSB 9mm	1014	2383	**S03**
OSB 9mm	688	684	**S04**
PIR 120mm	356	2310	**P01**
PIR 120mm	150	2310	**P02**
PIR 120mm	18	93	**P03**
PIR 120mm	463	93	**P04**
PIR 120mm	144	93	**P05**
PIR 120mm	18	93	**P06**
PIR 120mm	96	2310	**P07**
PIR 120mm	561	2310	**P08**
PIR 120mm	128	2310	**P09**
PIR 120mm	444	610	**P10**
PIR 120mm	125	610	**P11**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX26**		Drawing No: **P4-MF-GF-EX26**	
Panel L×H×T: **2400×2386×149**		Weight: **120 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3121 ±5 (equal = square)

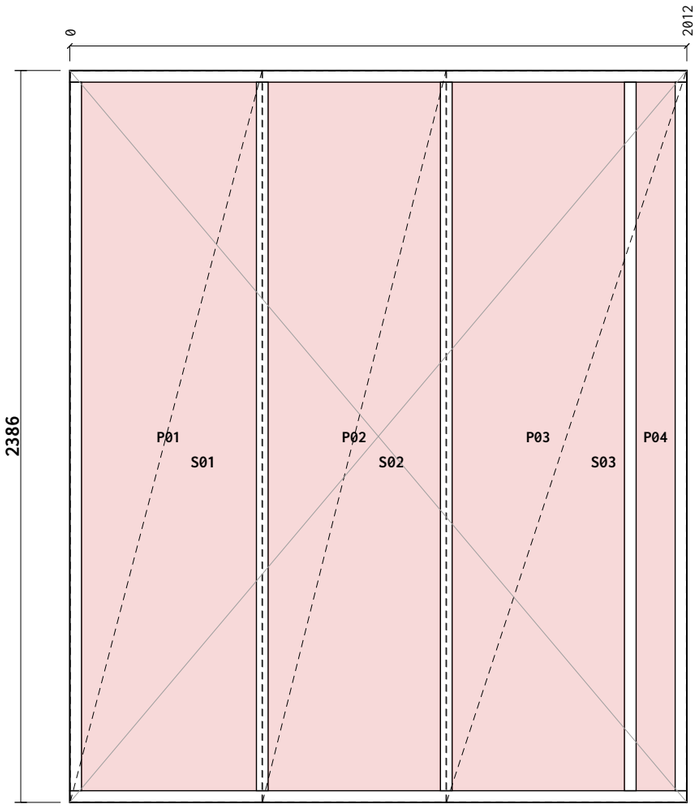


Breather bot overlap: 314mm

Breather R overlap: 150mm

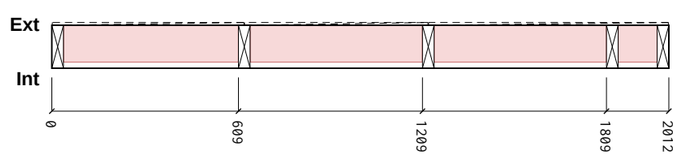

Section A-A

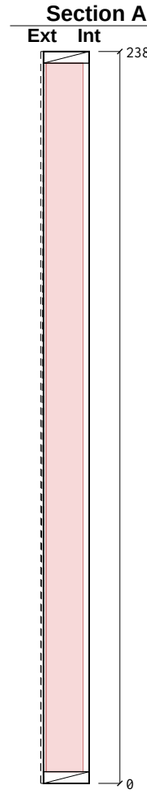

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2012	0	0	1
TR1 Top Rail	38×140 C16	2012	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	3

Total: 7 pcs / 15.57 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	625	2383	**S01**
OSB 9mm	598	2383	**S02**
OSB 9mm	782	2383	**S03**
PIR 120mm	570	2310	**P01**
PIR 120mm	561	2310	**P02**
PIR 120mm	561	2310	**P03**
PIR 120mm	126	2310	**P04**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX27**		Drawing No: **P4-MF-GF-EX27**	
Panel L×H×T: **2012×2386×149**		Weight: **79 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3181 ±5 (equal = square)

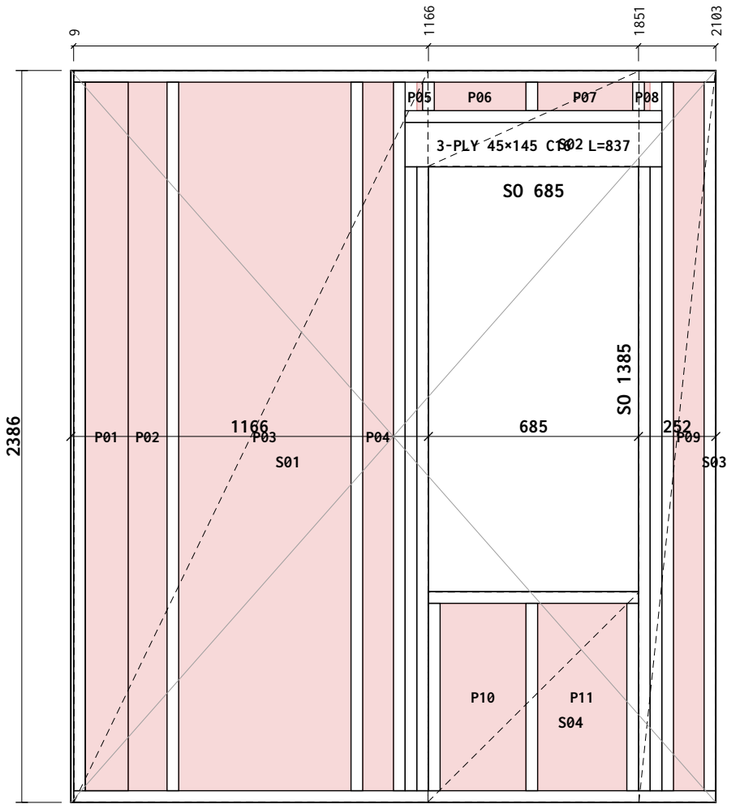


Breather bot overlap: 314mm

Breather R overlap: 150mm

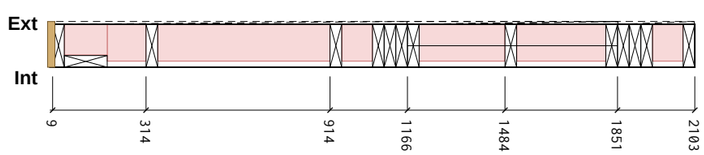

Section A-A

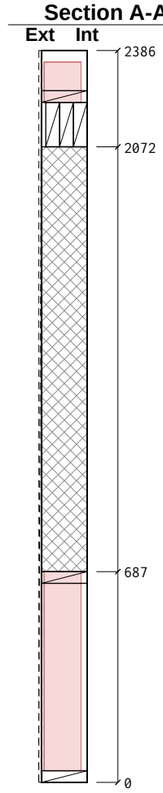

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2094	0	0	1
TR1 Top Rail	38×140 C16	2094	0	0	1
TR2 Top Rail	38×140 C16	837	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
SP1 Sill Plate	38×140 C16	685	0	0	1
LP1 Lintel Ply	837×45 C16	837	0	0	3
SS1 Sill Support	38×140 C16	611	0	0	2
OS1 OSB Support	38×140 C16	93	0	0	2
VS1 Vertical Stud	38×140 C16	2310	0	0	2
VS2 Vertical Stud	38×140 C16	611	0	0	1
VS3 Vertical Stud	38×140 C16	93	0	0	1
JS1 Junction Stud	38×140 C16	2310	0	0	1

Total: 24 pcs / 34.64 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1154	2383	**S01**
OSB 9mm	688	311	**S02**
OSB 9mm	249	2383	**S03**
OSB 9mm	688	684	**S04**
PIR 100mm	140	2310	**P01**
PIR 120mm	126	2310	**P02**
PIR 120mm	561	2310	**P03**
PIR 120mm	99	2310	**P04**
PIR 120mm	18	93	**P05**
PIR 120mm	298	93	**P06**
PIR 120mm	309	93	**P07**
PIR 120mm	18	93	**P08**
PIR 120mm	98	2310	**P09**
PIR 120mm	279	610	**P10**
PIR 120mm	290	610	**P11**
OSB End Cap 9mm	146	2383	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)


Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX28**		Drawing No: **P4-MF-GF-EX28**	
Panel L×H×T: **2103×2386×149**		Weight: **114 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)
Internal face OSB sent loose - see GA


Diag 2567 ±5 (equal = square)

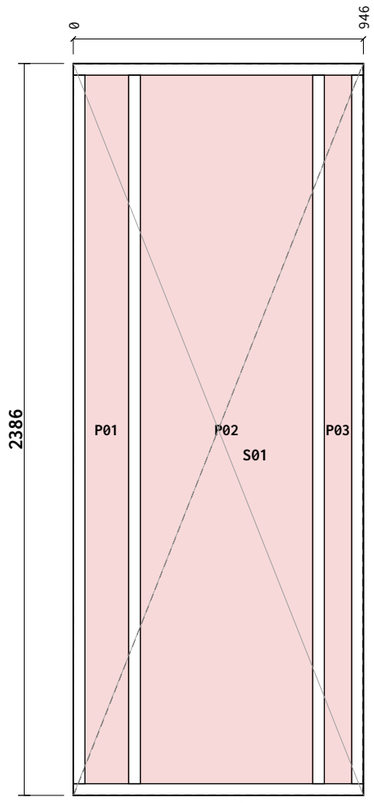

Breather bot overlap: 314mm
Breather R overlap: 150mm

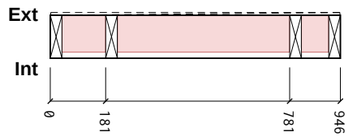

Section A-A

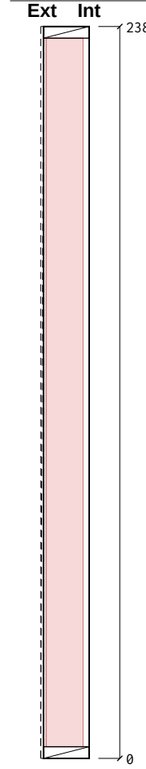

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	946	0	0	1
TR1 Top Rail	38×140 C16	946	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	2

Total: 6 pcs / 11.13 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	943	2383	**S01**
PIR 120mm	142	2310	**P01**
PIR 120mm	561	2310	**P02**
PIR 120mm	88	2310	**P03**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)


Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX29**		Drawing No: **P4-MF-GF-EX29**	
Panel L×H×T: **946×2386×149**		Weight: **45 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)
Internal face OSB sent loose - see GA


Diag 3384 ±5 (equal = square)

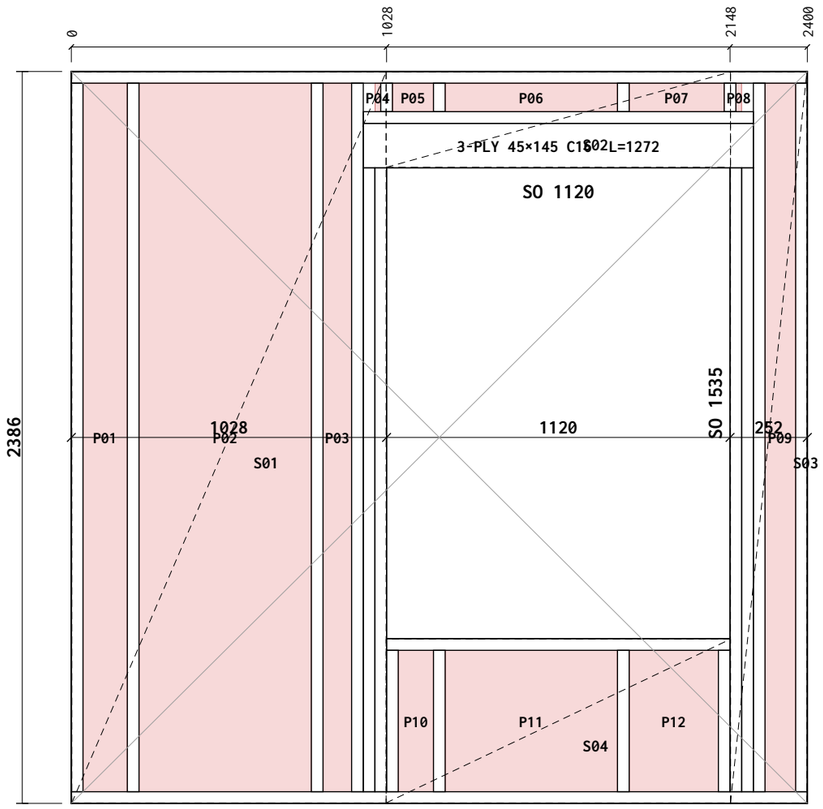

Breather bot overlap: 314mm
Breather R overlap: 150mm

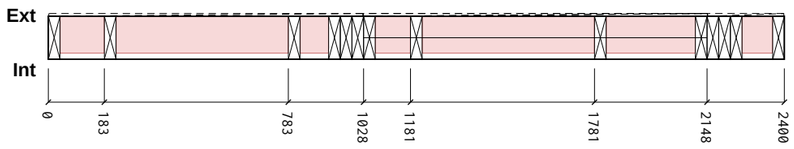

Section A-A

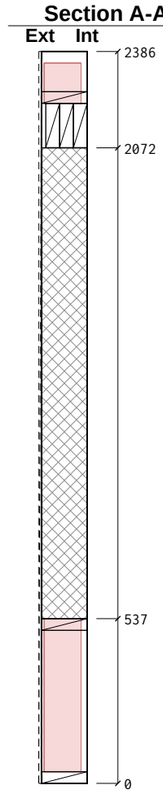

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	1272	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
SP1 Sill Plate	38×140 C16	1120	0	0	1
LP1 Lintel Ply	1272×45 C16	1272	0	0	3
SS1 Sill Support	38×140 C16	461	0	0	2
OS1 OSB Support	38×140 C16	93	0	0	2
VS1 Vertical Stud	38×140 C16	2310	0	0	2
VS2 Vertical Stud	38×140 C16	461	0	0	2
VS3 Vertical Stud	38×140 C16	93	0	0	2

Total: 25 pcs / 35.22 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1025	2383	**S01**
OSB 9mm	1123	311	**S02**
OSB 9mm	249	2383	**S03**
OSB 9mm	1123	534	**S04**
PIR 120mm	144	2310	**P01**
PIR 120mm	561	2310	**P02**
PIR 120mm	92	2310	**P03**
PIR 120mm	18	93	**P04**
PIR 120mm	133	93	**P05**
PIR 120mm	561	93	**P06**
PIR 120mm	309	93	**P07**
PIR 120mm	18	93	**P08**
PIR 120mm	99	2310	**P09**
PIR 120mm	114	460	**P10**
PIR 120mm	561	460	**P11**
PIR 120mm	290	460	**P12**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)


Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX30**		Drawing No: **P4-MF-GF-EX30**	
Panel L×H×T: **2400×2386×149**		Weight: **113 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)
Internal face OSB sent loose - see GA


Diag 2503 ±5 (equal = square)

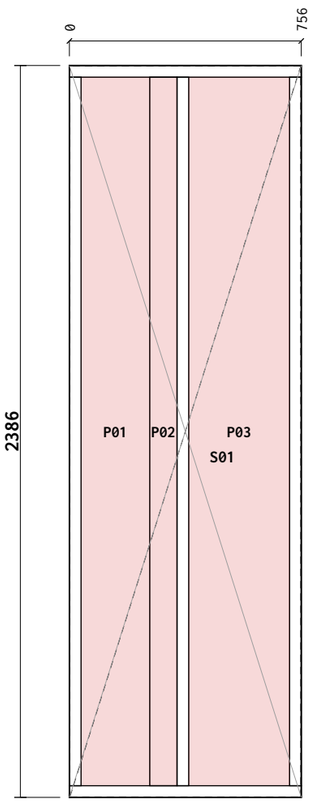

Breather bot overlap: 314mm
Breather R overlap: 150mm



Section A-A

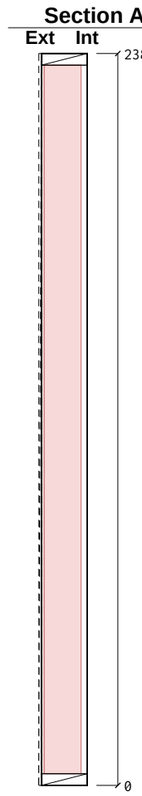

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	756	0	0	1
TR1 Top Rail	38×140 C16	756	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	1
JS1 Junction Stud	38×89 C16	2310	0	0	1

Total: 6 pcs / 10.75 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	753	2383	**S01**
PIR 120mm	223	2310	**P01**
PIR 100mm	89	2310	**P02**
PIR 120mm	328	2310	**P03**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name:	**MP Adams Plot 4, Eckington**		
Site: **Eckington**		Client: **MP Adams**	
Title:	**Panel Fabrication — 38 x 140 C16 CLS**		
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX31**		Drawing No: **P4-MF-GF-EX31**	
Panel L×H×T: **756×2386×149**		Weight: **38 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3493 ±5 (equal = square)

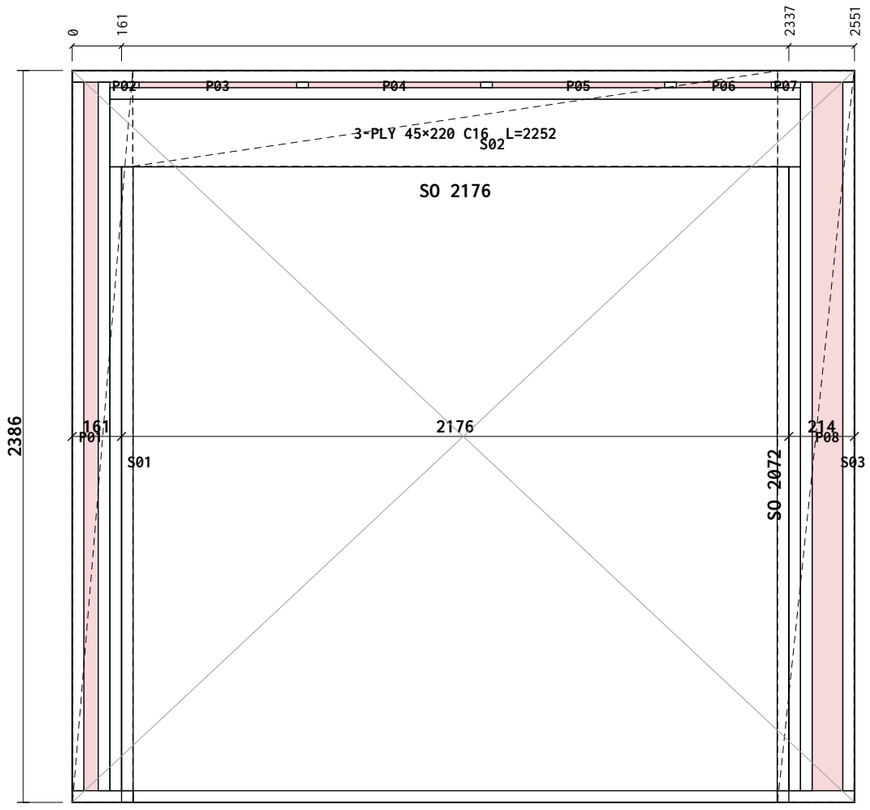


Breather bot overlap: 314mm

Breather R overlap: 150mm

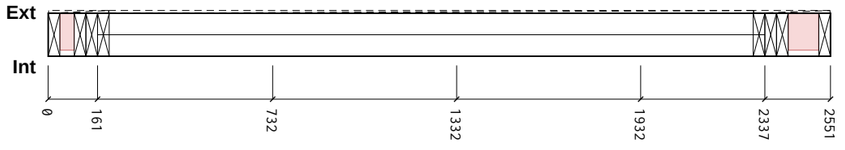

Section A-A

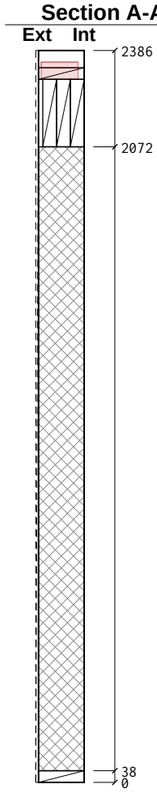

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2100	0	0	1
BR2 Bottom Rail	38×140 C16	252	0	0	1
BR3 Bottom Rail	38×140 C16	199	0	0	1
TR1 Top Rail	38×140 C16	2551	0	0	1
TR2 Top Rail	38×140 C16	2252	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
LP1 Lintel Ply	2252×45 C16	2252	0	0	3
OS1 OSB Support	38×140 C16	18	0	0	2
VS1 Vertical Stud	38×140 C16	18	0	0	3

Total: 21 pcs / 31.58 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	196	2383	**S01**
OSB 9mm	2103	311	**S02**
OSB 9mm	249	2383	**S03**
PIR 120mm	46	2310	**P01**
PIR 120mm	18	18	**P02**
PIR 120mm	513	18	**P03**
PIR 120mm	561	18	**P04**
PIR 120mm	561	18	**P05**
PIR 120mm	309	18	**P06**
PIR 120mm	18	18	**P07**
PIR 120mm	98	2310	**P08**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX32**		Drawing No: **P4-MF-GF-EX32**	
Panel L×H×T: **2551×2386×149**		Weight: **95 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2460 ±5 (equal = square)

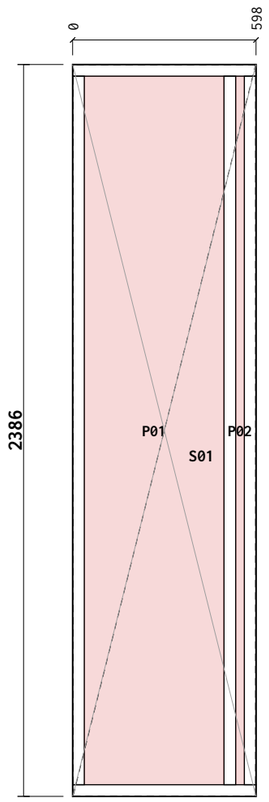


Breather bot overlap: 314mm

Breather R overlap: 150mm



Section A-A

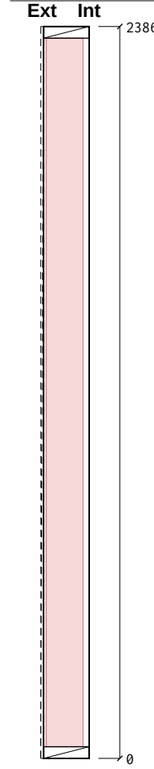

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	598	0	0	1
TR1 Top Rail	38×140 C16	598	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	1

Total: 5 pcs / 8.13 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	595	2383	**S01**
PIR 120mm	455	2310	**P01**
PIR 120mm	27	2310	**P02**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX33**		Drawing No: **P4-MF-GF-EX33**	
Panel L×H×T: **598×2386×149**		Weight: **31 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3090 ±5 (equal = square)

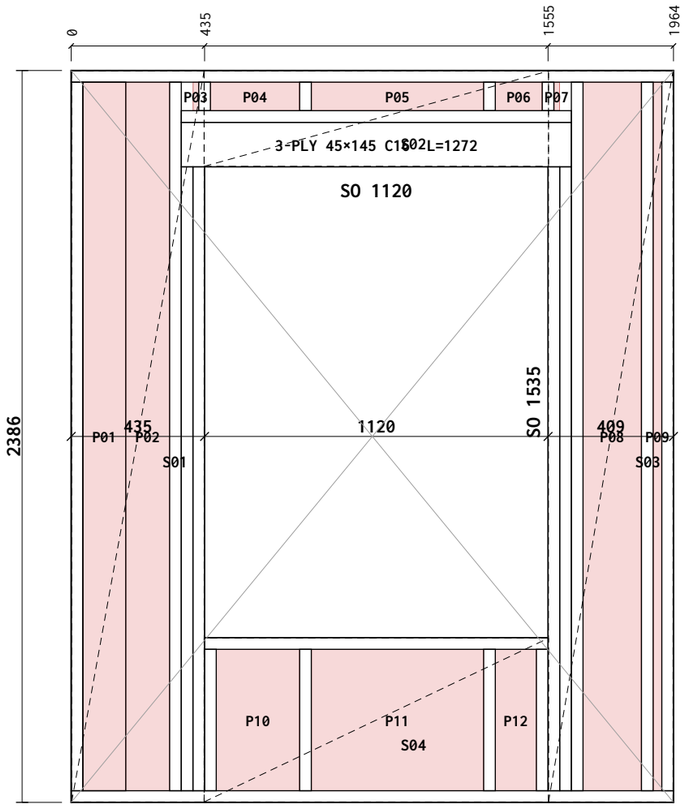


Breather bot overlap: 314mm

Breather R overlap: 150mm

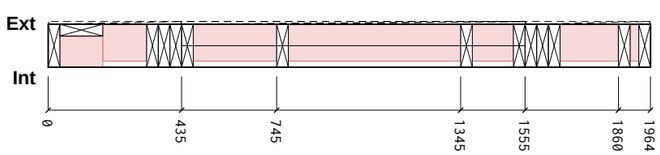

Section A-A

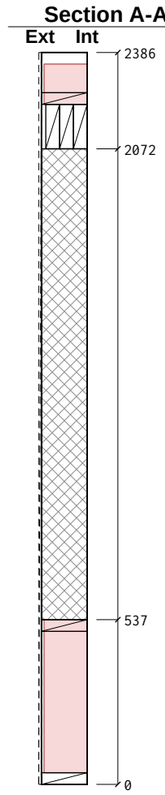

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1964	0	0	1
TR1 Top Rail	38×140 C16	1964	0	0	1
TR2 Top Rail	38×140 C16	1272	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
SP1 Sill Plate	38×140 C16	1120	0	0	1
LP1 Lintel Ply	1272×45 C16	1272	0	0	3
SS1 Sill Support	38×140 C16	461	0	0	2
OS1 OSB Support	38×140 C16	93	0	0	2
VS1 Vertical Stud	38×140 C16	2310	0	0	1
VS2 Vertical Stud	38×140 C16	461	0	0	2
VS3 Vertical Stud	38×140 C16	93	0	0	2
JS1 Junction Stud	38×140 C16	2310	0	0	1

Total: 25 pcs / 34.35 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	432	2383	**S01**
OSB 9mm	1123	311	**S02**
OSB 9mm	406	2383	**S03**
OSB 9mm	1123	534	**S04**
PIR 100mm	139	2310	**P01**
PIR 120mm	143	2310	**P02**
PIR 120mm	18	93	**P03**
PIR 120mm	290	93	**P04**
PIR 120mm	561	93	**P05**
PIR 120mm	152	93	**P06**
PIR 120mm	18	93	**P07**
PIR 120mm	189	2310	**P08**
PIR 120mm	27	2310	**P09**
PIR 120mm	271	460	**P10**
PIR 120mm	561	460	**P11**
PIR 120mm	133	460	**P12**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX34**		Drawing No: **P4-MF-GF-EX34**	
Panel L×H×T: **1964×2386×149**		Weight: **102 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2659 ±5 (equal = square)

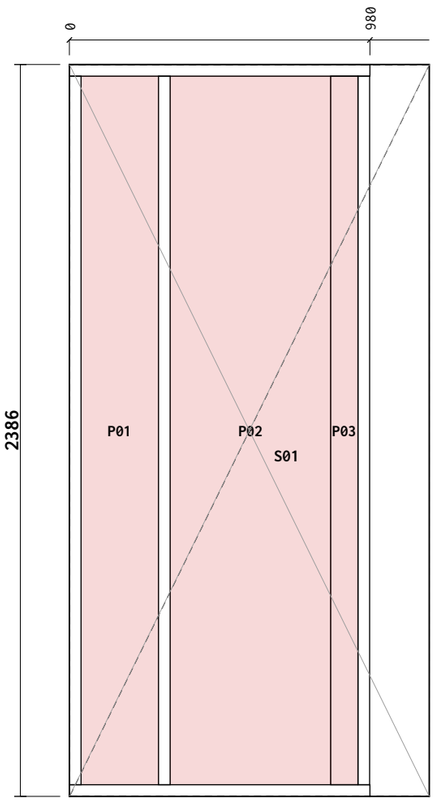


Breather bot overlap: 314mm

Breather R overlap: 150mm

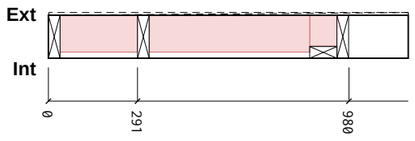

Section A-A

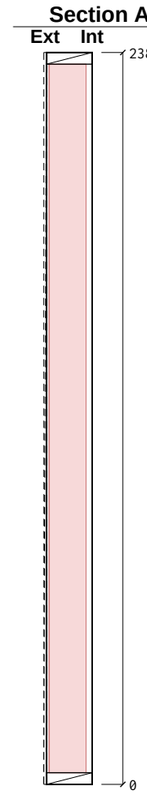

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	980	0	0	1
TR1 Top Rail	38×140 C16	980	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	1
JS1 Junction Stud	38×89 C16	2310	0	0	1

Total: 6 pcs / 11.20 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1172	2383	**S01**
PIR 120mm	252	2310	**P01**
PIR 120mm	523	2310	**P02**
PIR 100mm	89	2310	**P03**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name:	**MP Adams Plot 4, Eckington**		
Site: **Eckington**		Client: **MP Adams**	
Title:	**Panel Fabrication — 38 x 140 C16 CLS**		
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX35**		Drawing No: **P4-MF-GF-EX35**	
Panel L×H×T: **1174×2386×149**		Weight: **47 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2879 ±5 (equal = square)

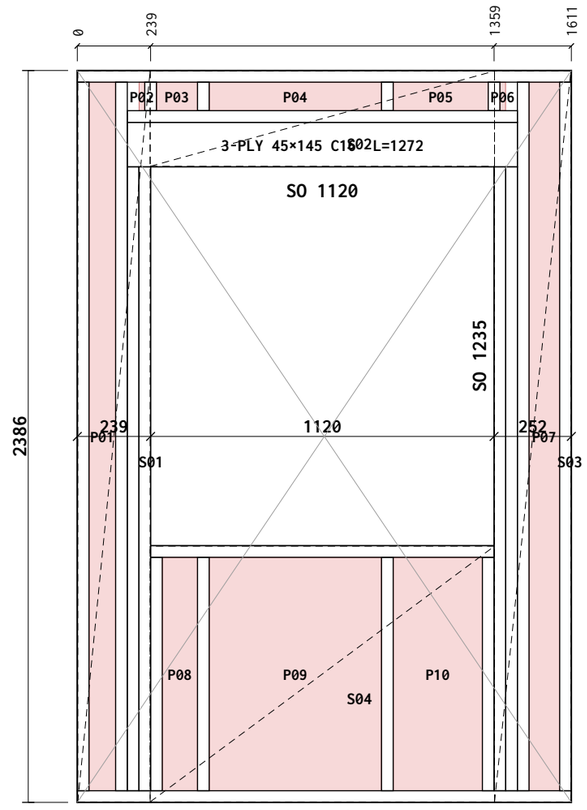


Breather bot overlap: 314mm

Breather R overlap: 150mm

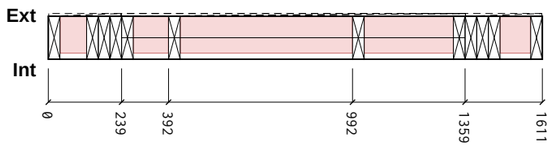

Section A-A

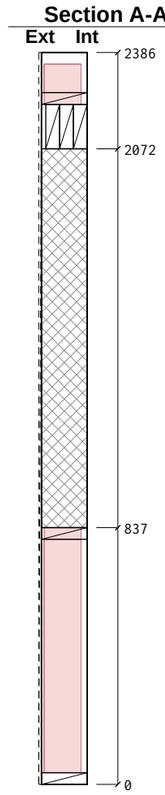

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1611	0	0	1
TR1 Top Rail	38×140 C16	1611	0	0	1
TR2 Top Rail	38×140 C16	1272	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
KS1 Vertical Stud	38×140 C16	2310	0	0	2
CS1 Cripple Stud	38×140 C16	2034	0	0	4
SP1 Sill Plate	38×140 C16	1120	0	0	1
LP1 Lintel Ply	1272×45 C16	1272	0	0	3
SS1 Sill Support	38×140 C16	761	0	0	2
OS1 OSB Support	38×140 C16	93	0	0	2
VS1 Vertical Stud	38×140 C16	761	0	0	2
VS2 Vertical Stud	38×140 C16	93	0	0	2

Total: 23 pcs / 30.22 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	236	2383	**S01**
OSB 9mm	1123	311	**S02**
OSB 9mm	249	2383	**S03**
OSB 9mm	1123	834	**S04**
PIR 120mm	86	2310	**P01**
PIR 120mm	18	93	**P02**
PIR 120mm	133	93	**P03**
PIR 120mm	561	93	**P04**
PIR 120mm	309	93	**P05**
PIR 120mm	18	93	**P06**
PIR 120mm	99	2310	**P07**
PIR 120mm	114	760	**P08**
PIR 120mm	561	760	**P09**
PIR 120mm	290	760	**P10**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX36**		Drawing No: **P4-MF-GF-EX36**	
Panel L×H×T: **1611×2386×149**		Weight: **88 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2541 ±5 (equal = square)

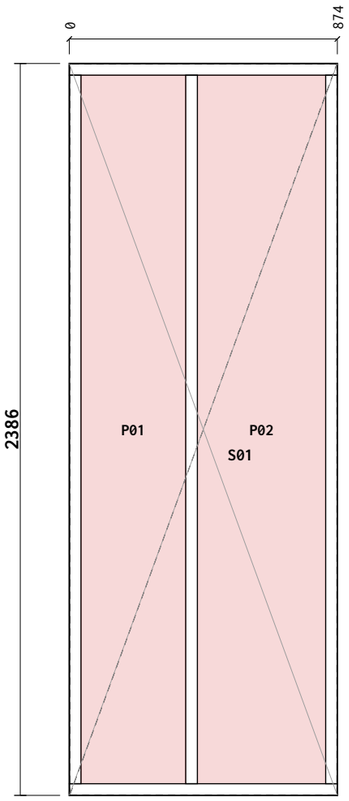


Breather bot overlap: 314mm

Breather R overlap: 150mm

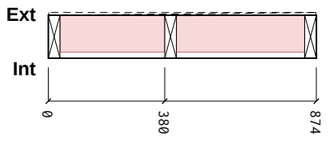

Section A-A

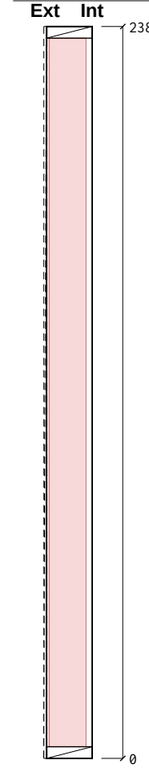

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	874	0	0	1
TR1 Top Rail	38×140 C16	874	0	0	1
ES1 End Stud	38×140 C16	2310	0	0	1
ES2 End Stud	38×140 C16	2310	0	0	1
VS1 Vertical Stud	38×140 C16	2310	0	0	1

Total: 5 pcs / 8.68 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	871	2383	**S01**
PIR 120mm	341	2310	**P01**
PIR 120mm	417	2310	**P02**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note)

C03 - FF windows coursed; steel + GP1 portal; steel drawings (ST)

Date: **2026-10-11**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C03**	
Panel No: **GF-EX37**		Drawing No: **P4-MF-GF-EX37**	
Panel L×H×T: **874×2386×149**		Weight: **38 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	