
A3

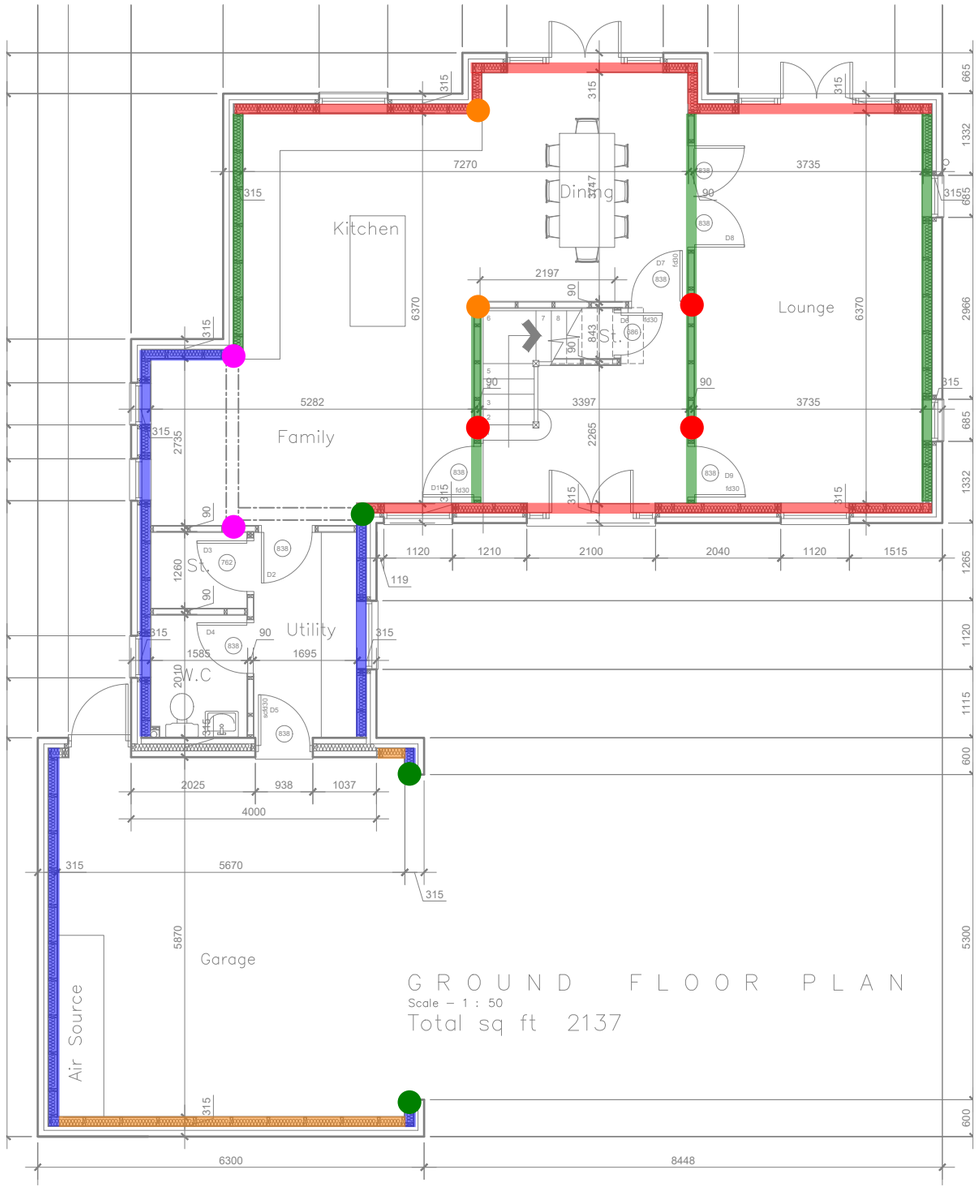

Key:

- Line load: DL UDL = 10kN/m; IL UDL = 7.5kN/m; (Refer to Note 3 regarding loads over openings below)
- Line load: DL UDL = 5kN/m; IL UDL = 7.5kN/m; (Refer to Note 3 regarding loads over openings below)
- Line load: DL UDL = 5kN/m; IL UDL = 2.5kN/m; (Refer to Note 3 regarding loads over openings below)
- Line load: DL UDL = 2.5kN/m; (Refer to Note 3 regarding loads over openings below)
- Point load: DL = 5kN, IL = 10kN
- Point load: DL = 30kN, IL = 10kN
- Point load: DL = 15kN, IL = 10kN
- Point load: DL = 2.5kN, IL = 5kN

Load Mark-up

Notes:

1. All loads are characteristic loads calculated in accordance with BS EN 1990 and BS EN 1991.
2. For set out of support locations refer to architects drawings and timber frame suppliers drawing.
3. Where UDLs span over an opening below, the UDL should be converted to a point load either side of the opening.
4. Loads do not account for masonry cladding (except where supported off steel corner frame) or ground floor beam and block floor loads. Masonry cladding and beam and block floor loads by others.
5. Layout shown is indicative. Refer to architects drawings for latest layouts.

Plot 4
Load Mark-up

Eckington - Plot 3 & 4 (26-431)
26 May 2026 | For Information | JF
26-431-S-0012_P01

skyhooks engineering