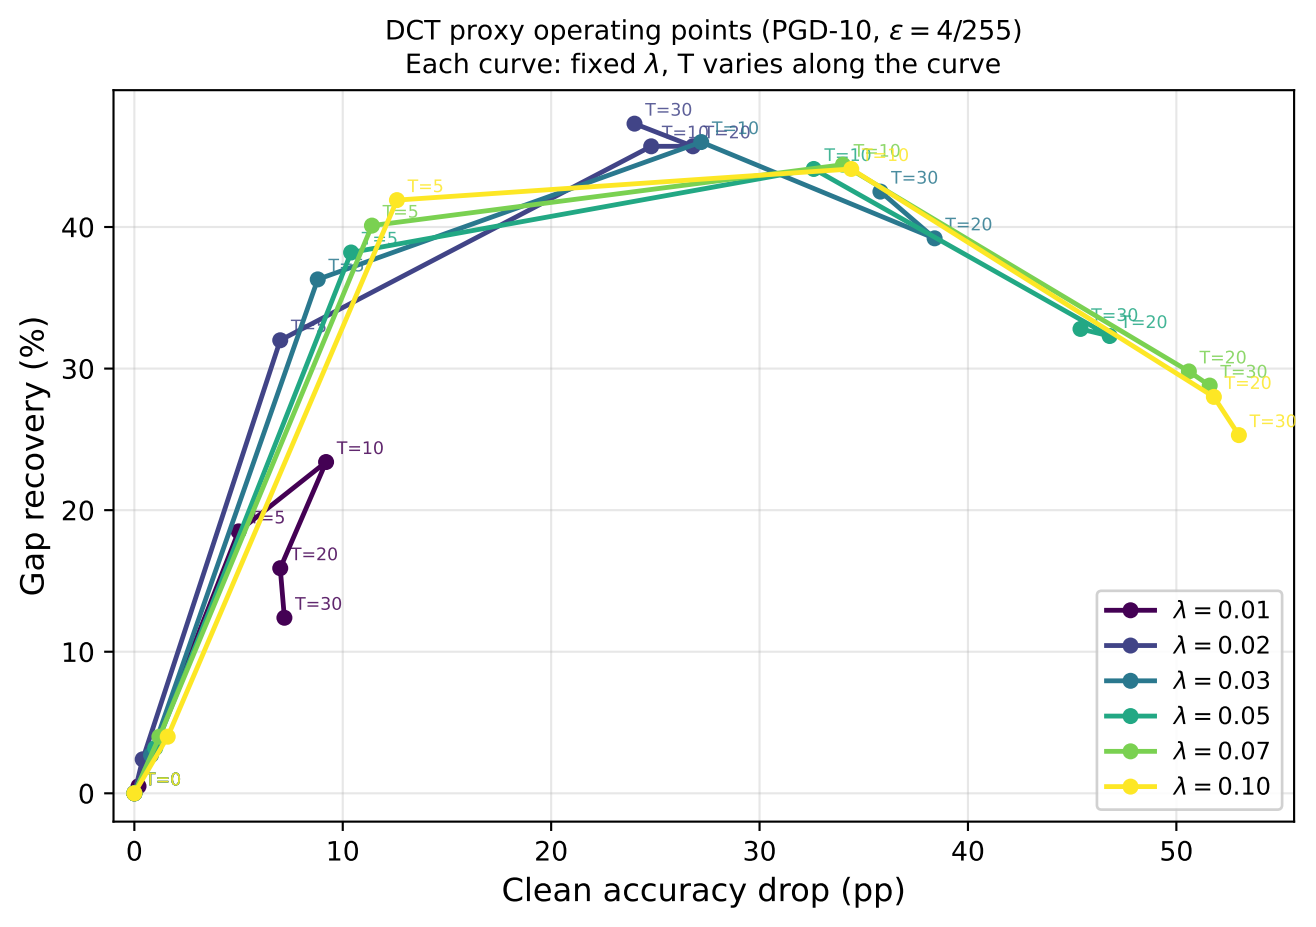
DCT proxy operating points (PGD-10, $\varepsilon = 4/255$)
Each curve: fixed λ, T varies along the curve
Gap recovery (%)
Clean accuracy drop (pp)
0
10
20
30
40
50
$\lambda = 0.01$
$\lambda = 0.02$
$\lambda = 0.03$
$\lambda = 0.05$
$\lambda = 0.07$
$\lambda = 0.10$
T=0
T=5
T=10
T=20
T=30