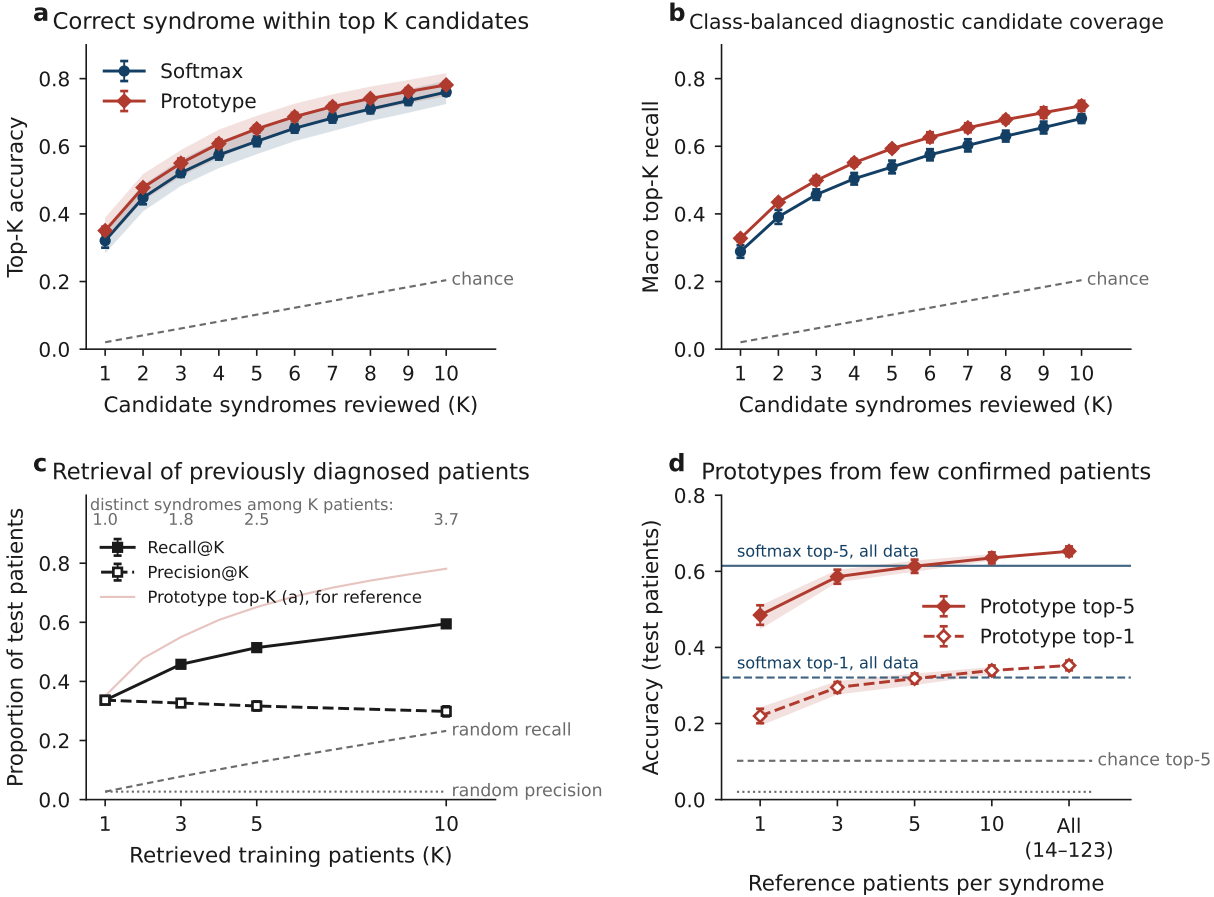
a
Correct syndrome within top K candidates
Softmax
Prototype
Top-K accuracy
0.0
0.2
0.4
0.6
0.8
chance
1 2 3 4 5 6 7 8 9 10
Candidate syndromes reviewed (K)
b
Class-balanced diagnostic candidate coverage
Macro top-K recall
0.0
0.2
0.4
0.6
0.8
chance
1 2 3 4 5 6 7 8 9 10
Candidate syndromes reviewed (K)
c
Retrieval of previously diagnosed patients
distinct syndromes among K patients:
1.0 1.8 2.5 3.7
Recall@K
Precision@K
Prototype top-K (a), for reference
Proportion of test patients
0.0
0.2
0.4
0.6
0.8
random recall
random precision
1 3 5 10
Retrieved training patients (K)
d
Prototypes from few confirmed patients
softmax top-5, all data
softmax top-1, all data
Prototype top-5
Prototype top-1
chance top-5
Accuracy (test patients)
0.0
0.2
0.4
0.6
0.8
1 3 5 10 All (14–123)
Reference patients per syndrome