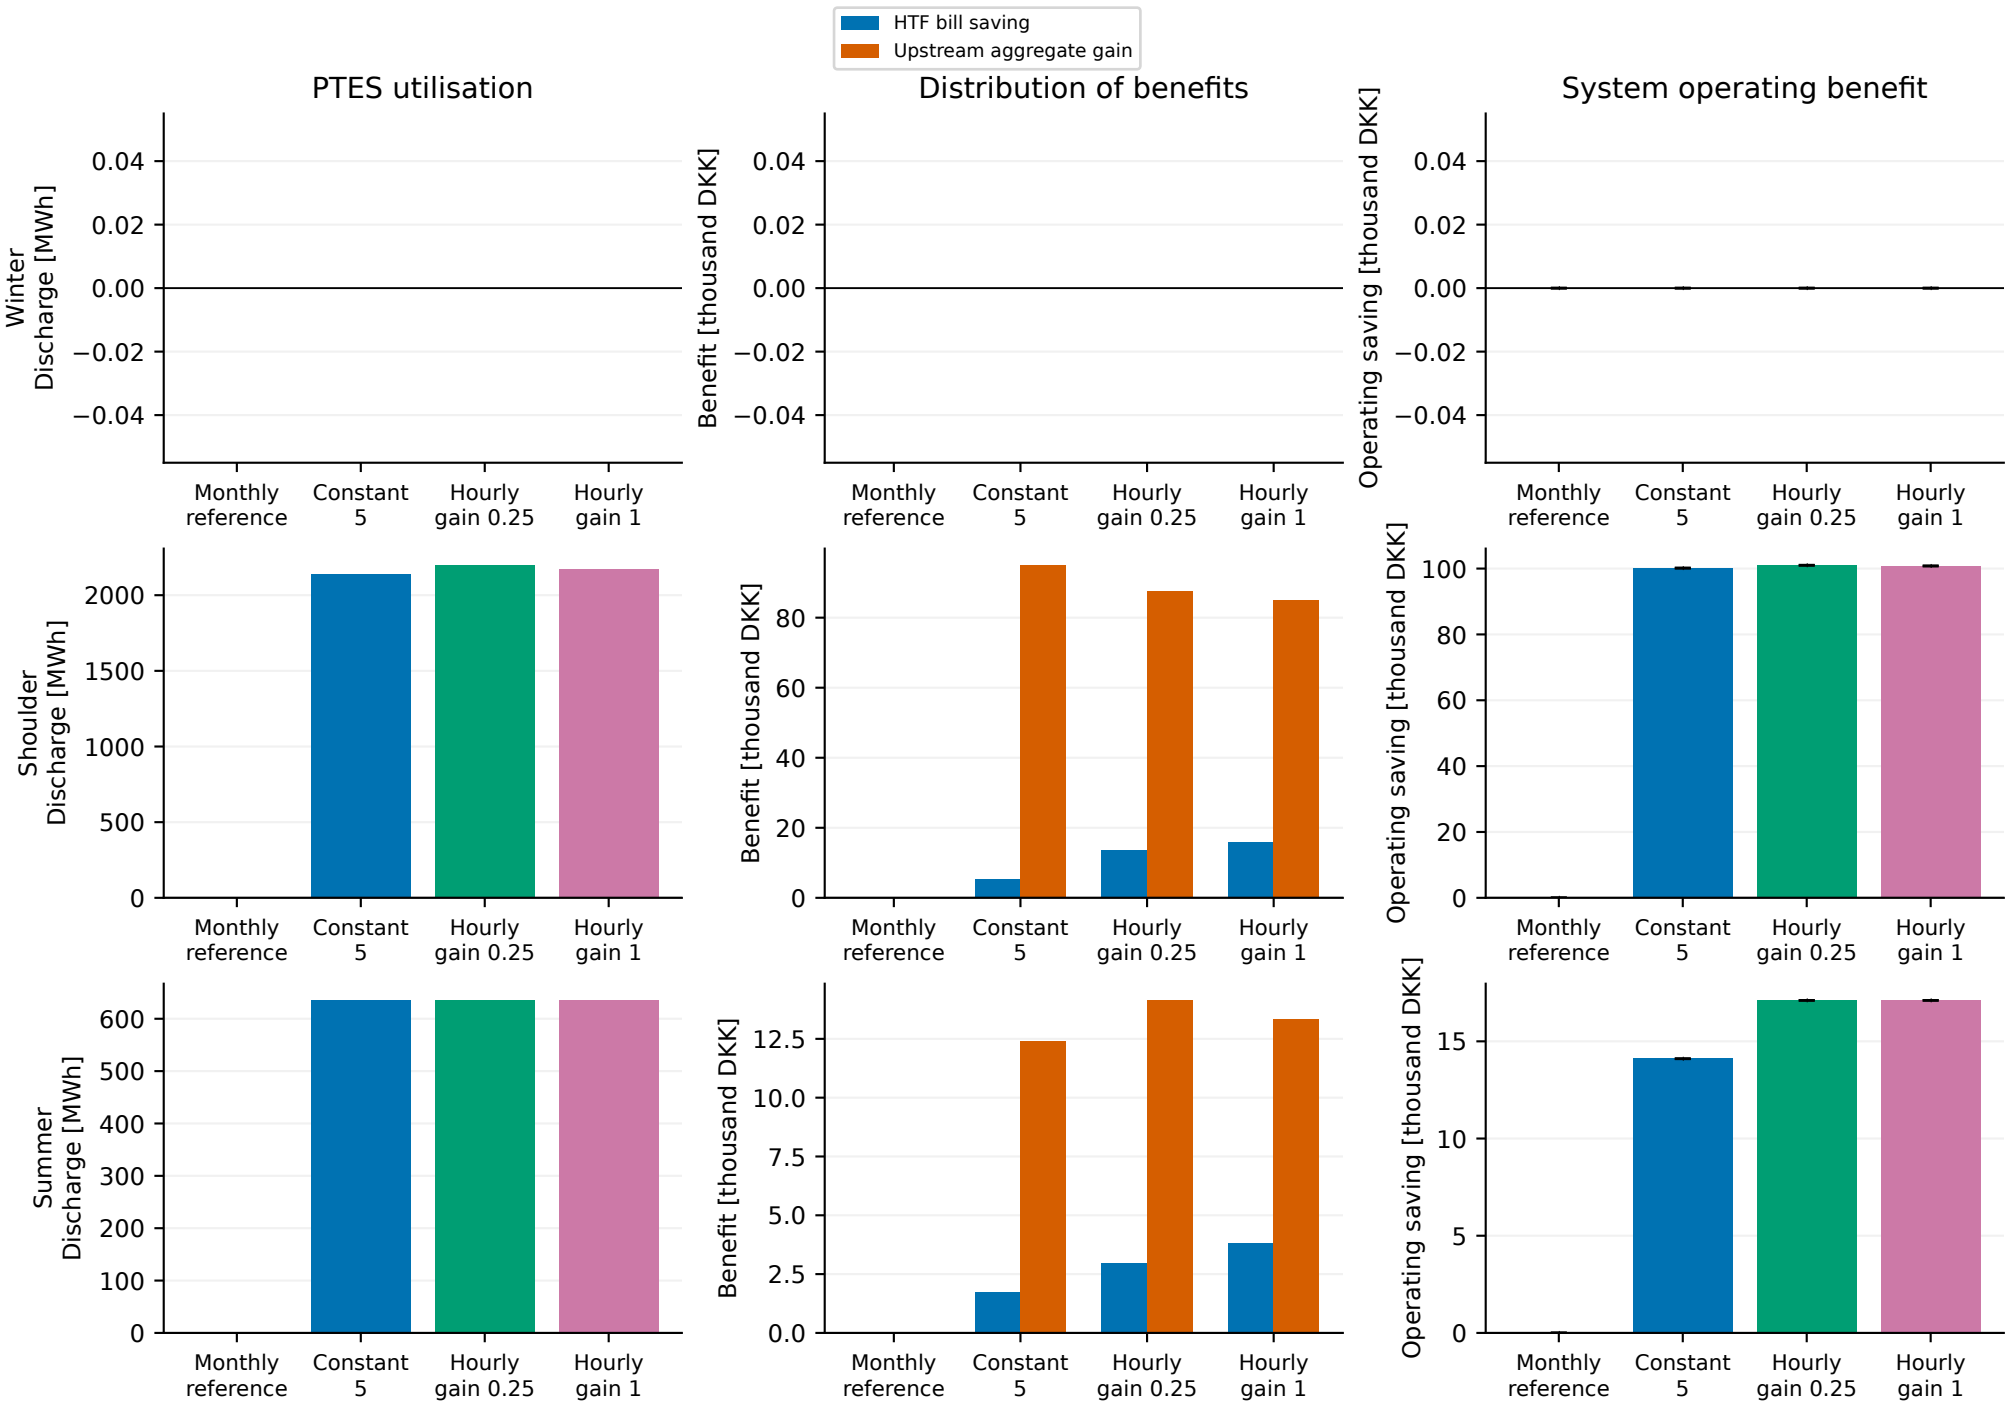
2024 representative weeks · 30 MW charging/discharging
Hourly discount: 0–10 DKK/MWh, mean 5; assumed pumping: 0.005 per flow
HTF bill saving
Upstream aggregate gain
PTES utilisation
Distribution of benefits
System operating benefit
Winter Discharge [MWh]
Shoulder Discharge [MWh]
Summer Discharge [MWh]
Benefit [thousand DKK]
Operating saving [thousand DKK]
Monthly reference
Constant 5
Hourly gain 0.25
Hourly gain 1