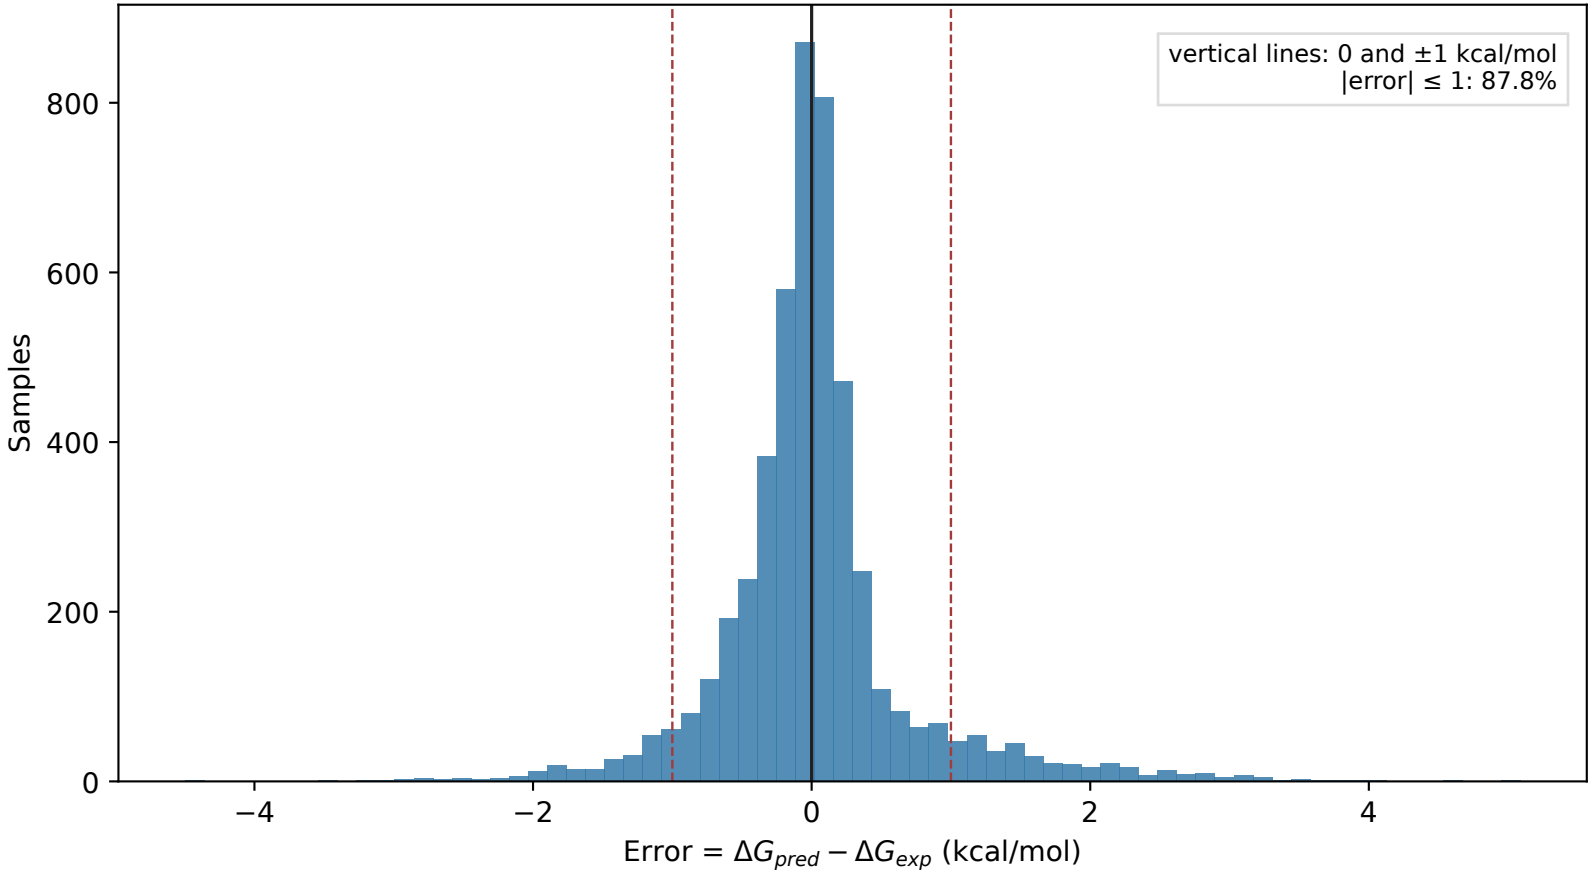
Full error distribution | mean signed error = 0.0210 kcal/mol
vertical lines: 0 and ±1 kcal/mol
|error| ≤ 1: 87.8%
Samples
0
200
400
600
800
−4
−2
0
2
4
Error = $\Delta G_{pred} - \Delta G_{exp}$ (kcal/mol)