

Report No.:

Test Time: 2025/11/3 9:56:39

LUMINAIRE PHOTOMETRIC TEST REPORT

Luminaire Property

Manufacturer: 0

Luminaire Type: 134 12W 4000K WH

Lamp Type:

Luminous Width: 0 mm

Luminous Length: 0 mm

Luminous Height: 0 mm

Voltage(V): 219.60 V

Current(A): 0.1080 A

Power(W): 12.77 W

Power Factor: 0.5360

Lamp Luminous Flux: 970.67

Photometric Results

CIE Class: Direct

Luminaire Luminous Flux: 970.6673 lm

Downward Ratio: 100.00%

Luminaire Efficacy Rating(LER): 76.01 lm/W

Beam Angle(50%) C0-180,C90-270: 70.2,67.8

Field Angle(10%) C0-180,C90-270: 135.3,122.6

S/MH C0-180,C90-270: 1.019,0.975

Max. Intensity: 594.61 cd

Max.Intensity Angle: C=0 Gamma=2

Upward Ratio: 0.00%


Efficacy: 100.00%

Center Intensity: 589.38 cd


Effective Luminous Flux: 902.59 lm

ERP(φ use)(120deg): 854.15 lm

Picture of Luminaire



Luminous Intensity Distribution Curve

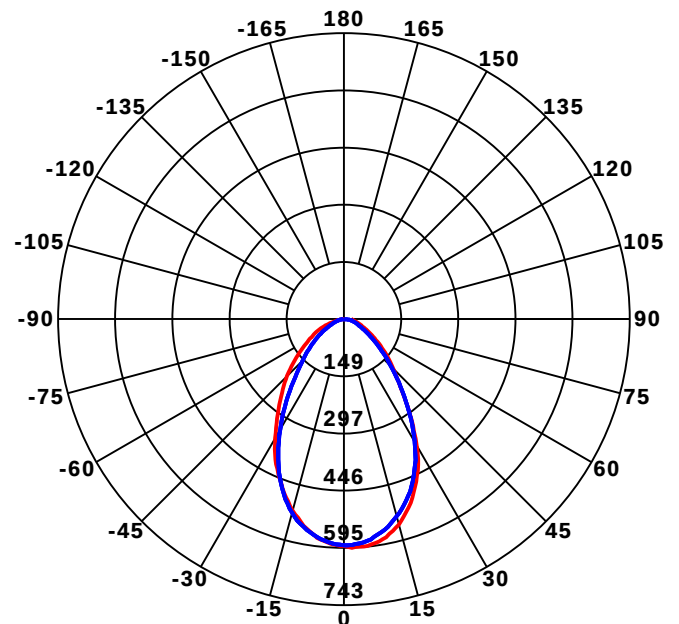

Beam Angle(50%) C0-180,C90-270: 70.2 deg,67.8 deg

Average Beam Angle:69.0 deg

C0-180 — C90-270

C Range: 0 - 360 Deg

C Interval: 45.0 Deg

Test Speed: High

Temperature: 25

Operators:

Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg

G Interval: 1.0 Deg

Test System: Huipu CPM-2000B Goniophotometer

Humidity: 65



Test Distance: 6.25 m

Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

Luminous Intensity Distribution Curve

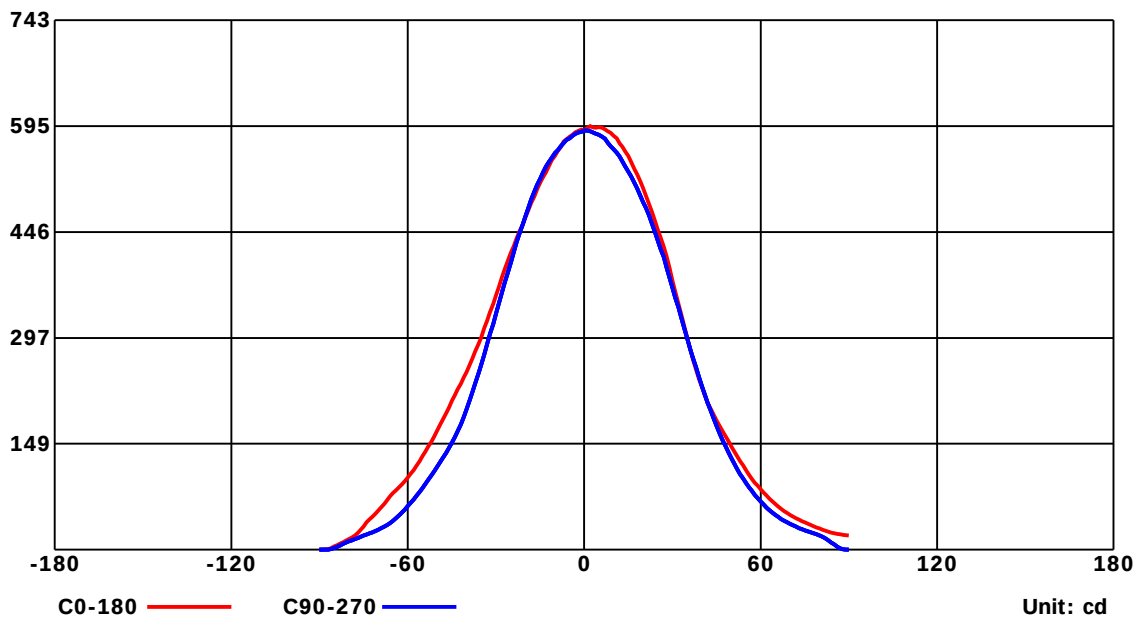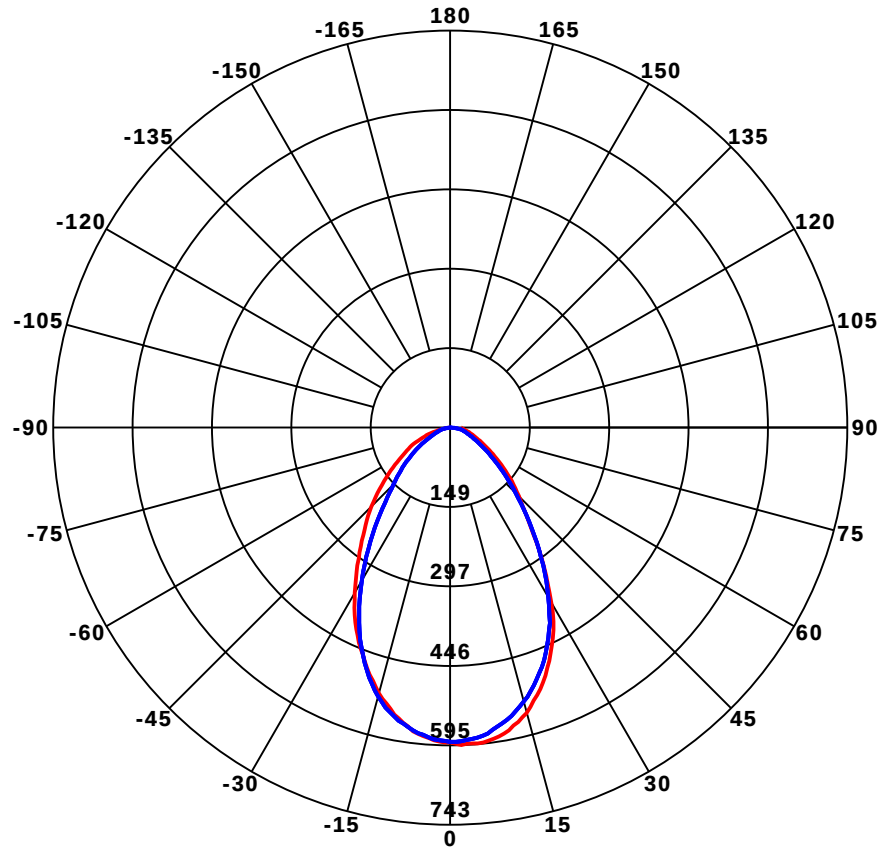


C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

Luminous Intensity Distribution Curve

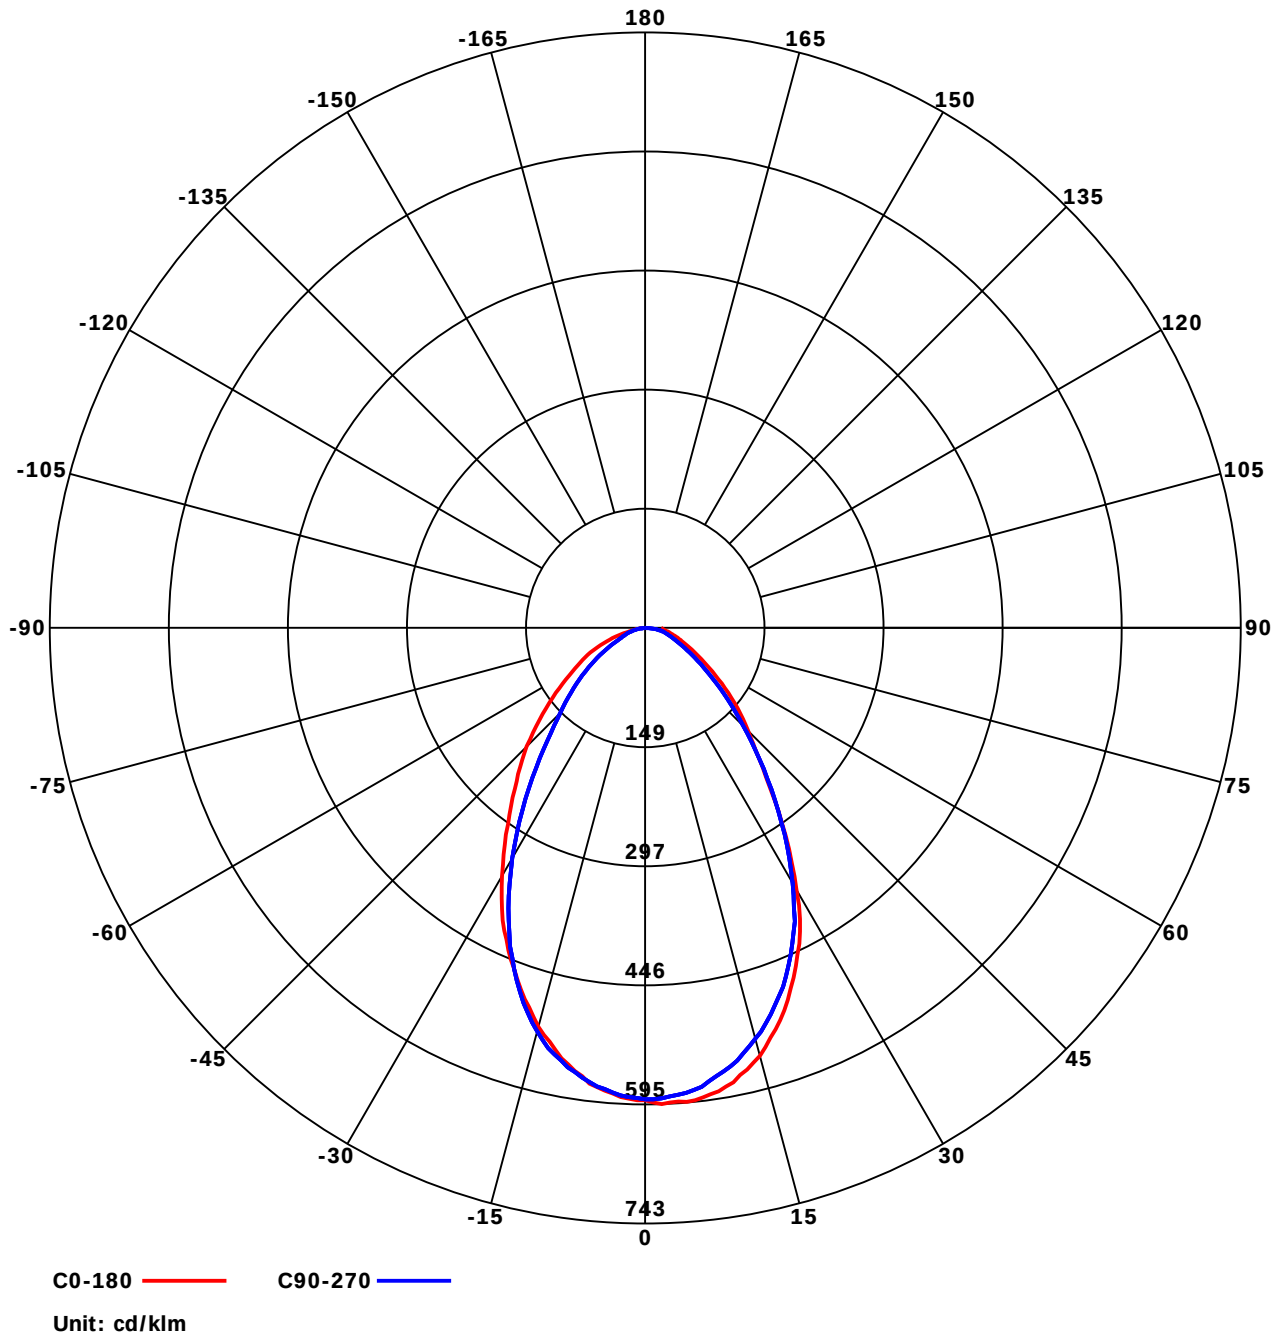

C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:


Report No.:

Test Time: 2025/11/3 9:56:39

UTILIZATION FACTORS TABLE

RHOCC	80			70			50			30			10			0
RHOW	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR	COEFFICIENTS OF UTILIZATION FOR RHOFC=20															
0	1.17	1.17	1.17	1.15	1.15	1.15	1.10	1.10	1.10	1.05	1.05	1.05	1.01	1.01	1.01	0.99
1	1.08	1.06	1.05	1.06	1.05	1.03	1.02	1.01	0.99	0.97	0.95	0.94	0.90	0.89	0.87	0.82
2	0.95	0.93	0.92	0.94	0.92	0.90	0.91	0.88	0.86	0.87	0.84	0.82	0.82	0.79	0.76	0.71
3	0.84	0.82	0.80	0.84	0.81	0.79	0.82	0.78	0.75	0.79	0.75	0.72	0.75	0.71	0.67	0.63
4	0.75	0.73	0.71	0.75	0.72	0.70	0.74	0.70	0.67	0.72	0.67	0.63	0.69	0.64	0.60	0.56
5	0.68	0.65	0.64	0.68	0.64	0.62	0.67	0.63	0.60	0.65	0.61	0.57	0.63	0.58	0.53	0.50
6	0.61	0.59	0.57	0.61	0.58	0.56	0.61	0.57	0.54	0.60	0.55	0.51	0.59	0.53	0.48	0.45
7	0.56	0.53	0.52	0.56	0.53	0.51	0.56	0.52	0.49	0.55	0.50	0.46	0.54	0.48	0.44	0.41
8	0.51	0.49	0.47	0.51	0.48	0.46	0.52	0.47	0.44	0.51	0.46	0.42	0.51	0.45	0.40	0.37
9	0.47	0.45	0.43	0.47	0.44	0.43	0.48	0.44	0.41	0.48	0.43	0.39	0.47	0.41	0.37	0.34
10	0.43	0.41	0.40	0.44	0.41	0.39	0.44	0.40	0.38	0.45	0.39	0.36	0.44	0.38	0.34	0.31

LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

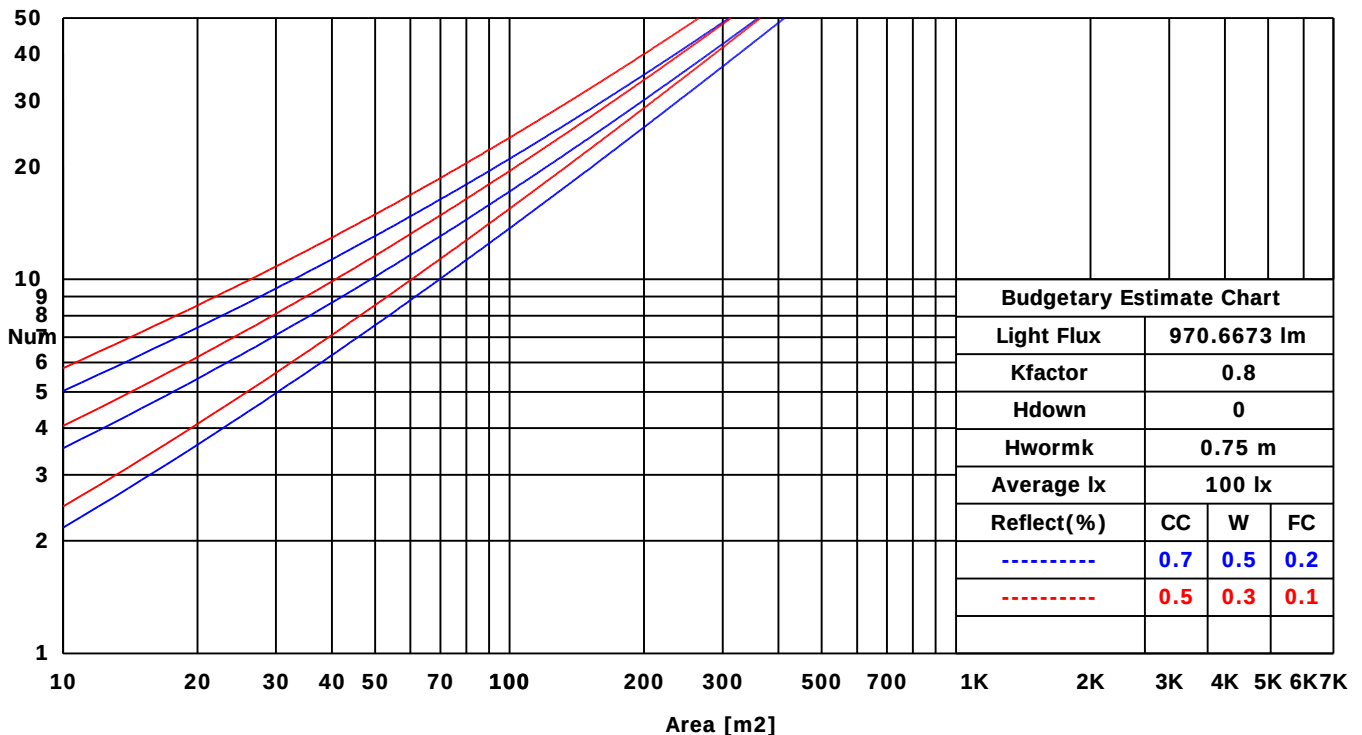


C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

ISOCANDELA DIAGRAM (RECTANGULAR)

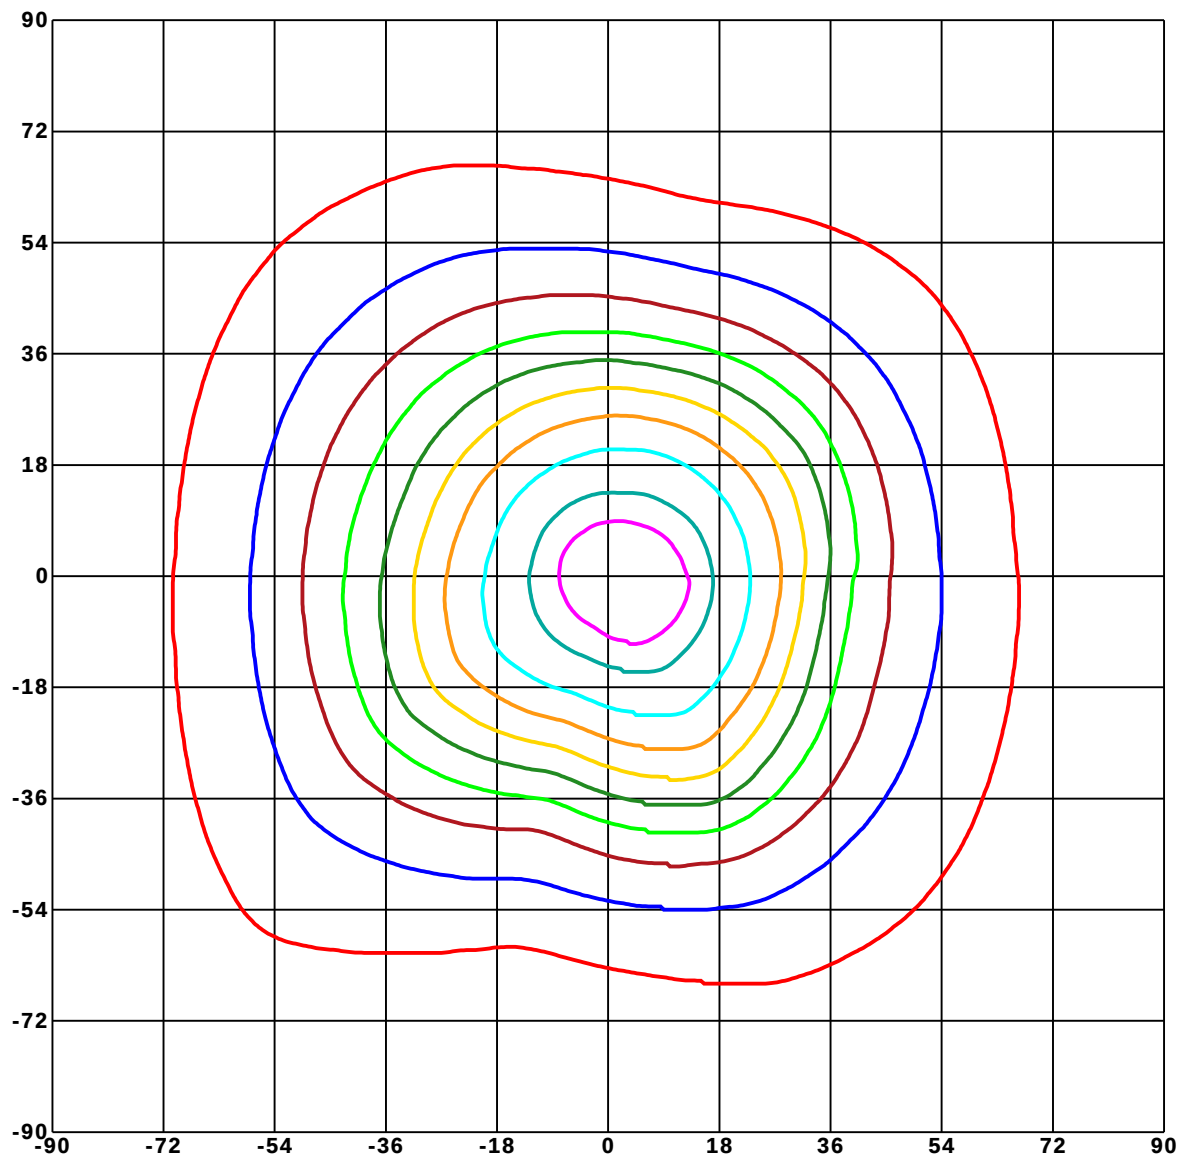

Unit of intensity:cd I_{max}(100%): 594.609 cd

564.879(95%I_{max})
535.148(90%I_{max})
475.688(80%I_{max})
416.227(70%I_{max})
356.766(60%I_{max})

297.305(50%I_{max})
237.844(40%I_{max})
178.383(30%I_{max})
118.922(20%I_{max})
59.461(10%I_{max})


C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

ISOCANDELA DIAGRAM (SPHERE)

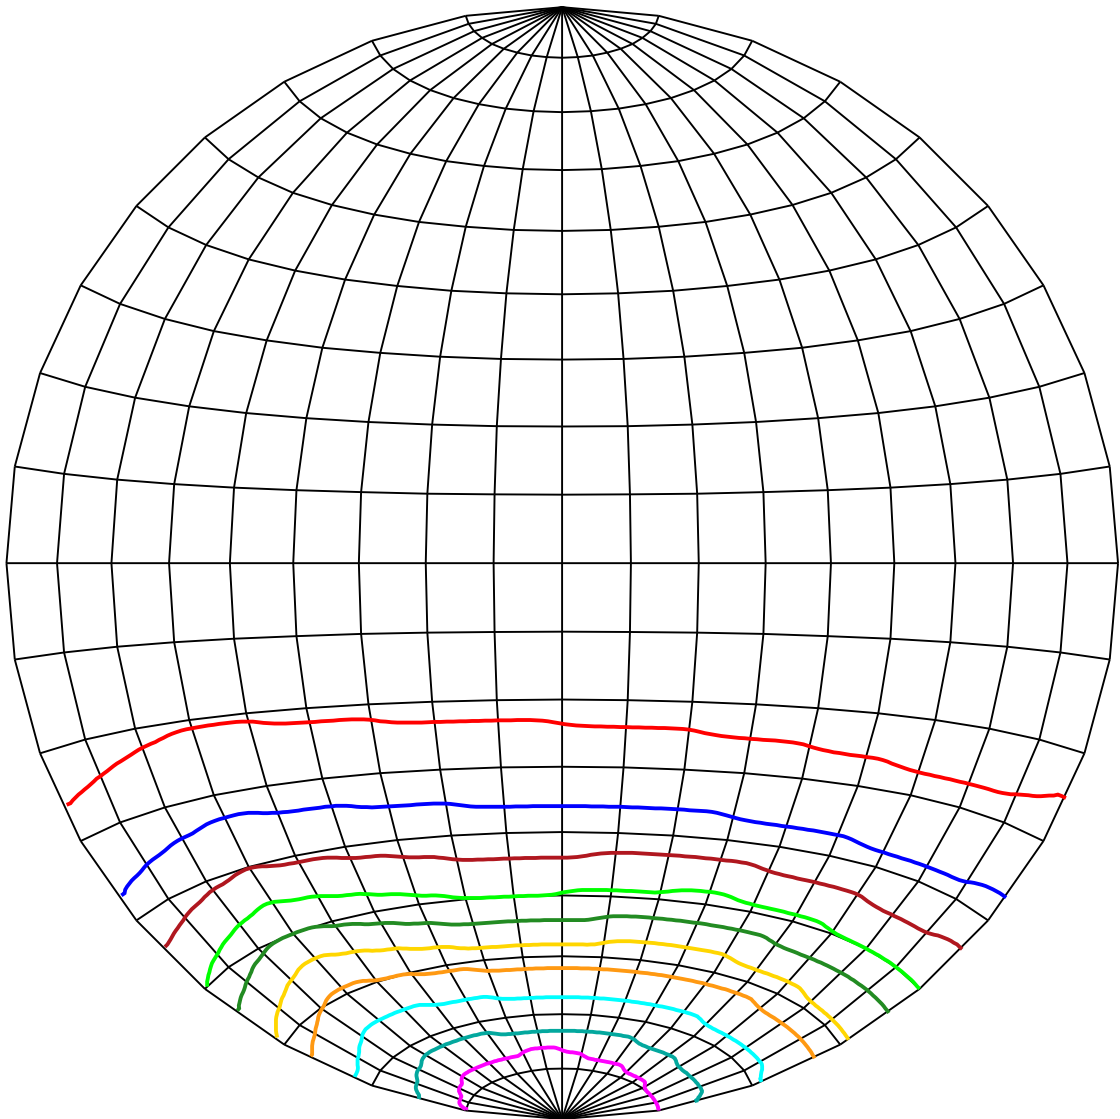

Unit of intensity:cd Imax(100%): 594.609 cd

— 564.879(95%Imax)
— 535.148(90%Imax)
— 475.688(80%Imax)
— 416.227(70%Imax)
— 356.766(60%Imax)

— 297.305(50%Imax)
— 237.844(40%Imax)
— 178.383(30%Imax)
— 118.922(20%Imax)
— 59.461(10%Imax)


C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

ISOLX DIAGRAM

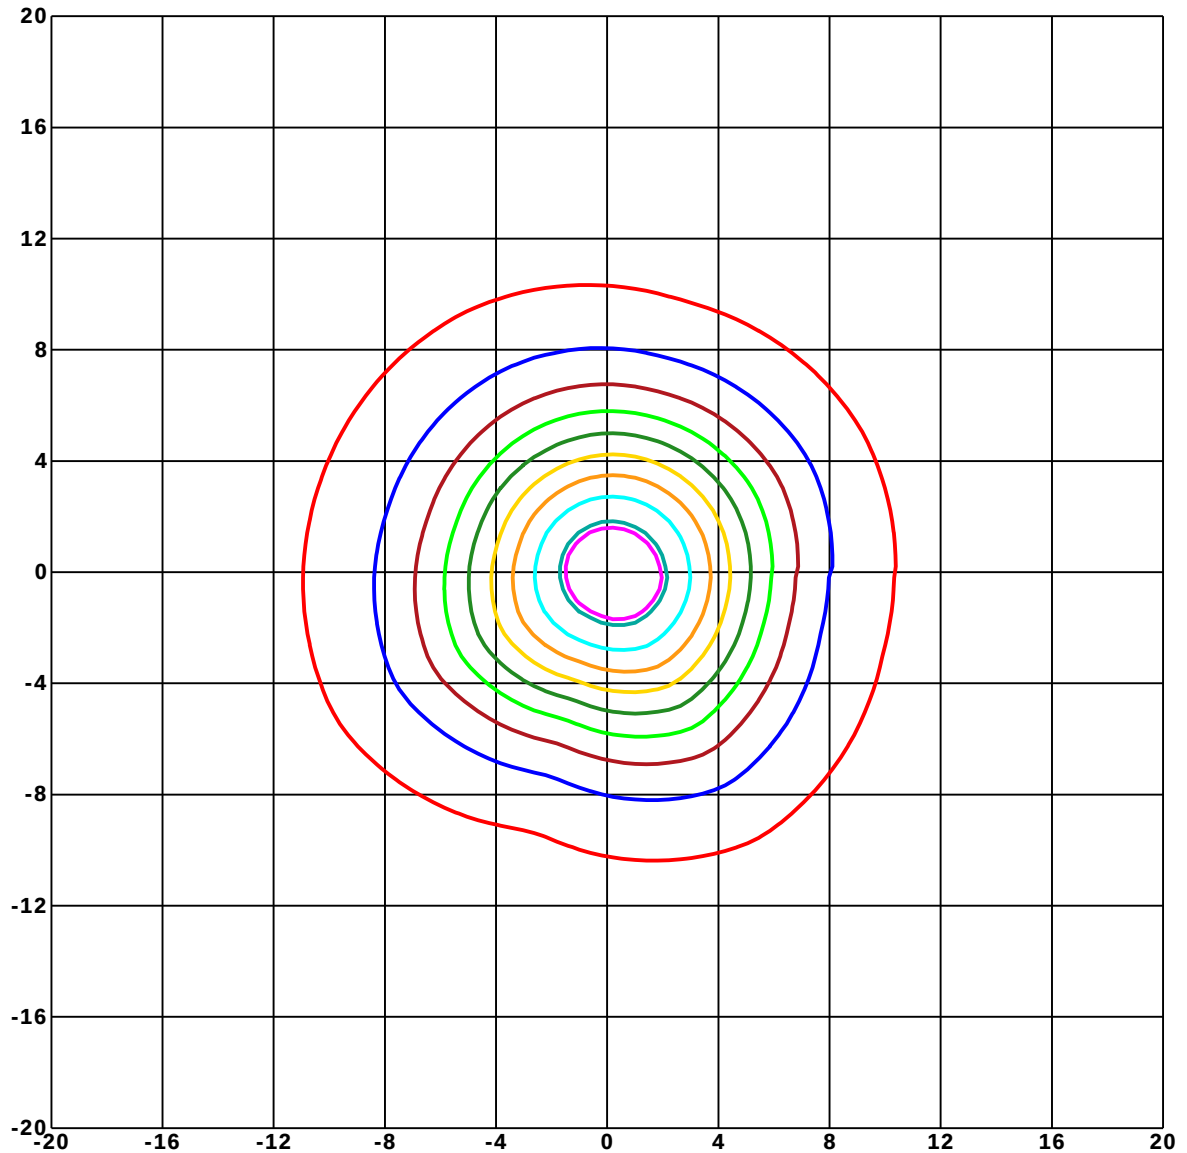

Unit of illumination:lx Height of plane:10.0(m)/32.81(ft)

5.46(92%Emax)	2.968(50%Emax)
5.342(90%Emax)	2.374(40%Emax)
4.748(80%Emax)	1.781(30%Emax)
4.155(70%Emax)	1.187(20%Emax)
3.561(60%Emax)	0.594(10%Emax)


C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

UTILIZATION FACTOR DIAGRAM (ROAD)

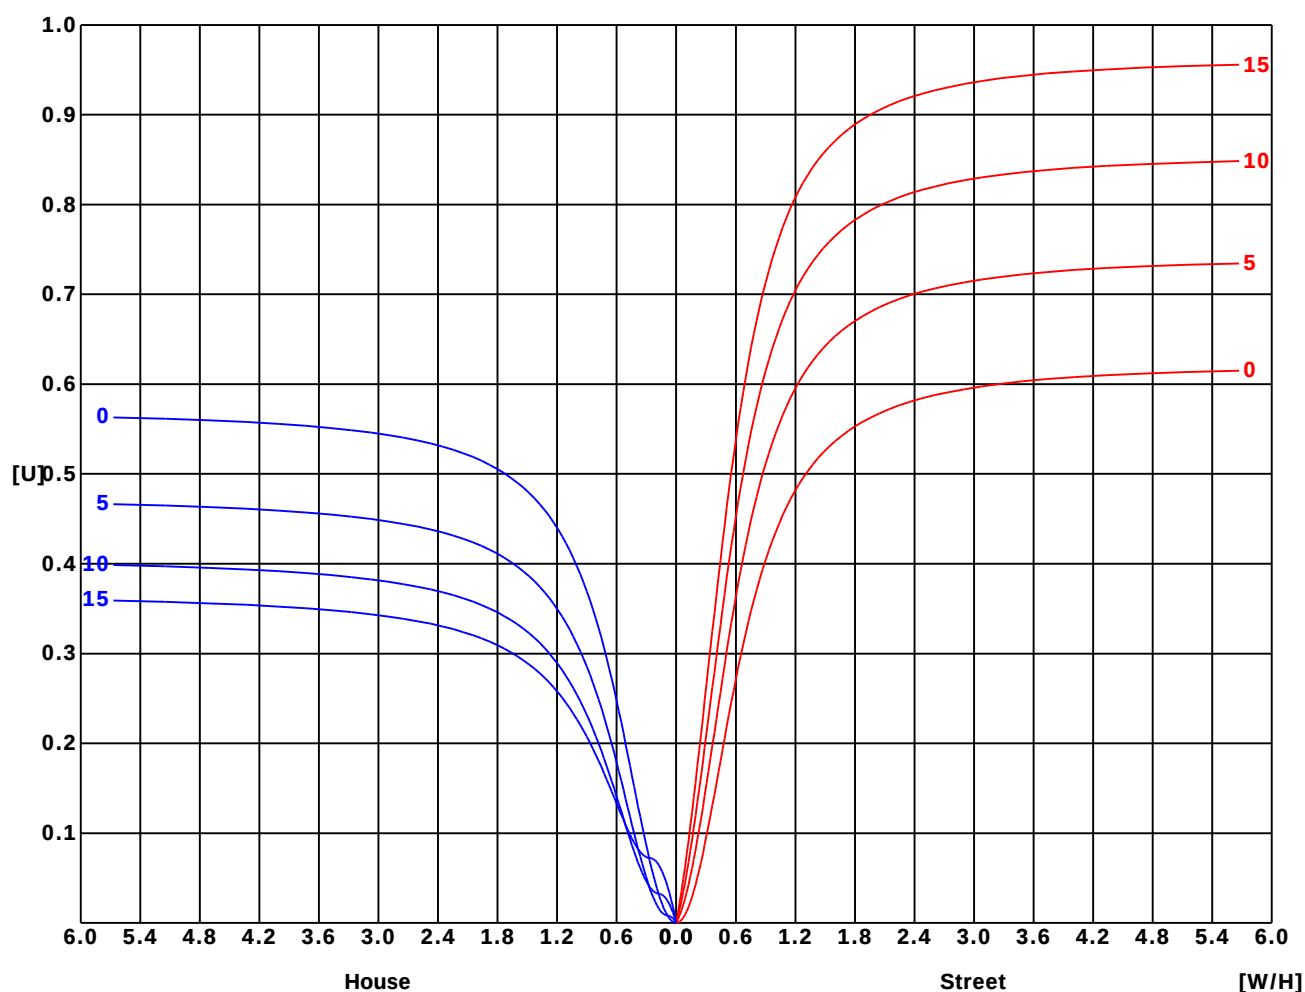


C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

LX-DISTANCE DIAGRAM

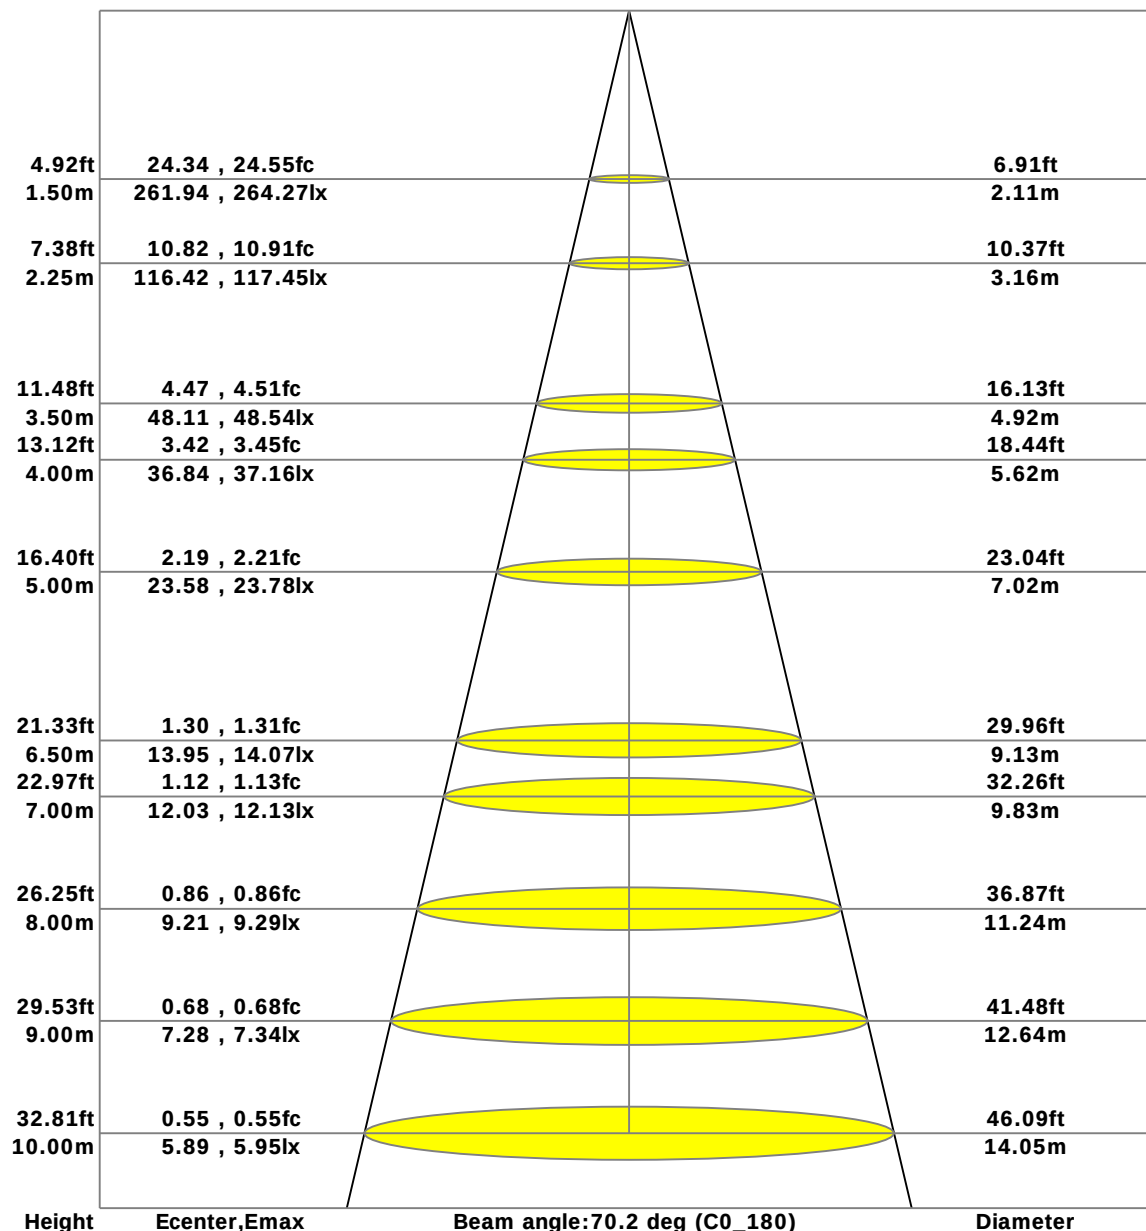


C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

BUG Class

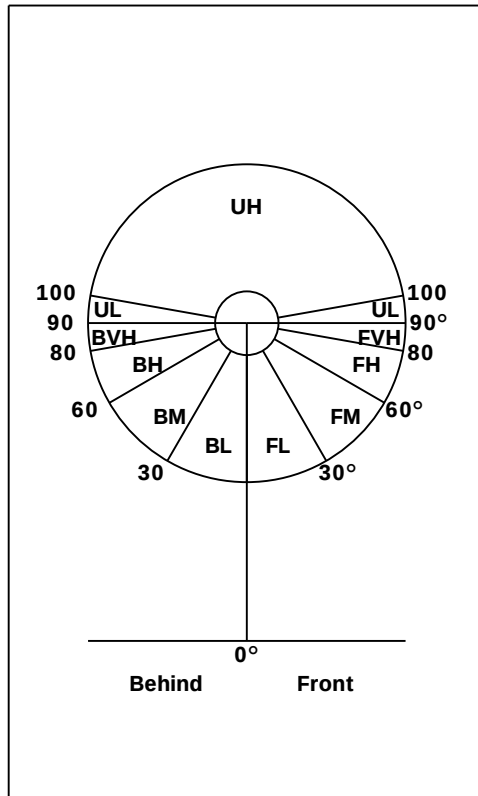

Zonal	Light Flux(lm)	Light Flux(%)
Front	476.1	49.1
FL (0°-30°)	201.4	20.7
FM (30°-60°)	219.4	22.6
FH (60°-80°)	49.3	5.1
FVH (80°-90°)	6.0	0.6

Behind	494.5	50.9
BL (0°-30°)	202.8	20.9
BM (30°-60°)	230.6	23.8
BH (60°-80°)	53.8	5.5
BVH (80°-90°)	7.4	0.8

Above	0.0	0.0
UL (90°-100°)	0.0	0.0
UH (100°-180°)	0.0	0.0

Limit Light	NA	NA
-------------	----	----

BUG Class(TM-15-07)	
Asymmetric Lighting Fixtures (Type I , II , III , IV)	B1 U0 G0
Symmetrical Lighting Fixtures (Type V , Area Light)	B1 U0 G0


C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

LCS 图

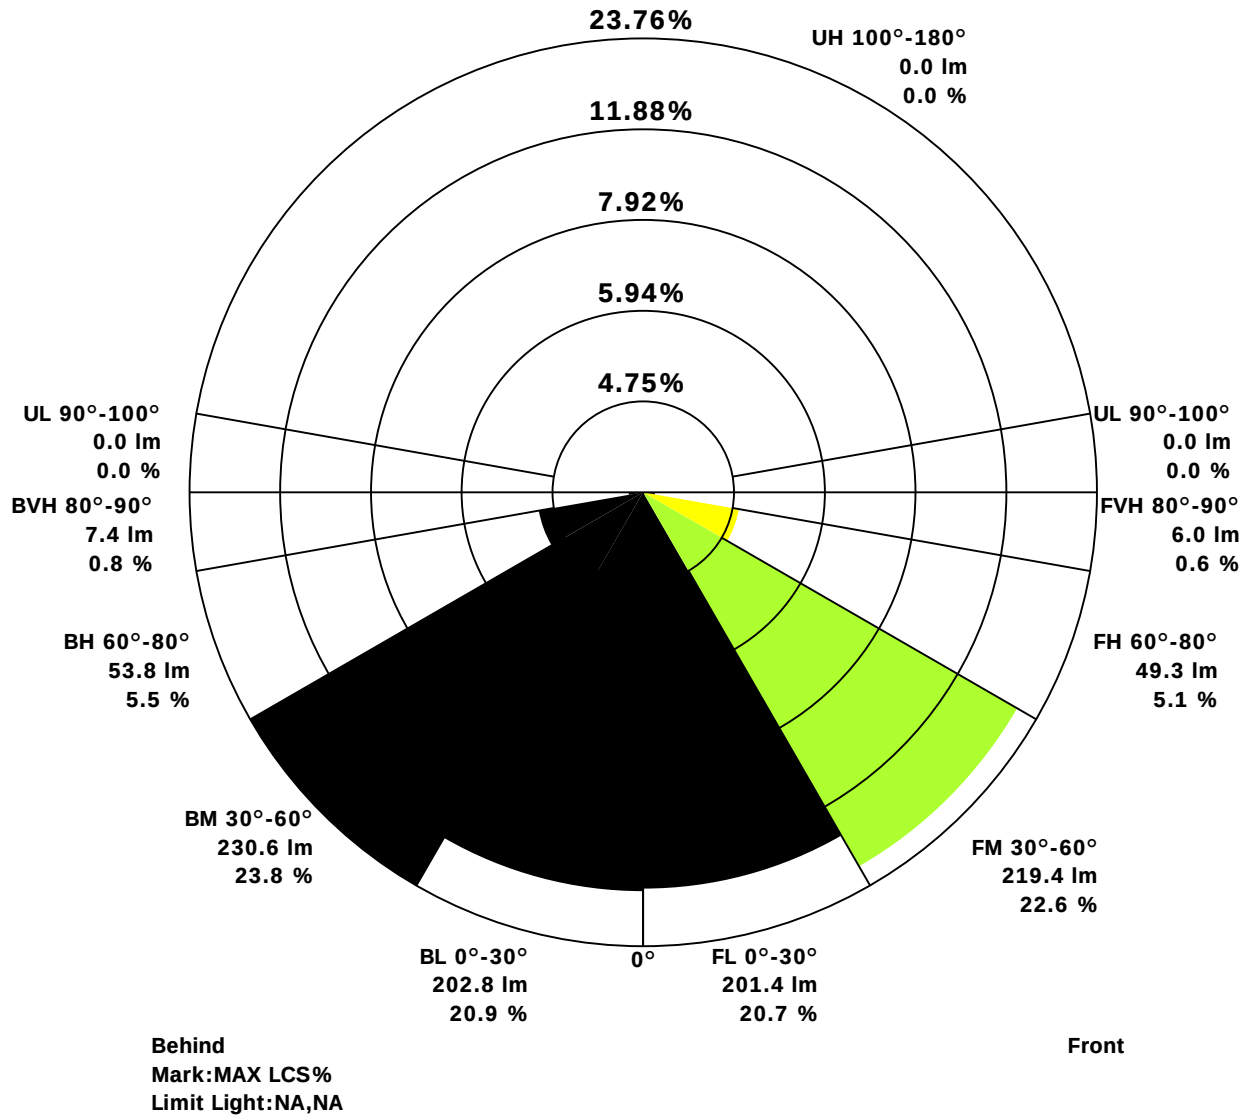

C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

UGR(Unified Glare Rating) TABLE

RHOCC		70	70	50	50	30	70	70	50	50	30
RHOW		50	30	50	30	30	50	30	50	30	30
RHOF		20	20	20	20	20	20	20	20	20	20
Room Size X Y		Viewed Endwise					Viewed Crosswise				
2H	2H	17.48	18.03	17.43	18.23	18.50	17.04	17.59	16.99	17.79	18.05
	3H	17.20	17.71	17.21	17.94	18.25	16.79	17.30	16.80	17.53	17.84
	4H	17.03	17.51	17.07	17.76	18.09	16.63	17.11	16.67	17.36	17.69
	6H	16.84	17.30	16.91	17.56	17.92	16.44	16.90	16.52	17.17	17.52
	8H	16.74	17.18	16.83	17.46	17.83	16.34	16.78	16.43	17.06	17.43
	12H	16.64	17.06	16.75	17.35	17.74	16.24	16.67	16.35	16.95	17.34
4H	2H	18.70	19.18	18.74	19.43	19.76	18.02	18.51	18.06	18.75	19.09
	3H	18.53	18.96	18.65	19.25	19.63	17.90	18.33	18.01	18.61	19.00
	4H	18.40	18.79	18.55	19.10	19.52	17.79	18.18	17.94	18.49	18.91
	6H	18.23	18.59	18.43	18.91	19.37	17.64	18.00	17.84	18.33	18.78
	8H	18.13	18.47	18.36	18.81	19.28	17.55	17.89	17.78	18.23	18.70
	12H	18.03	18.33	18.27	18.69	19.18	17.45	17.76	17.70	18.11	18.61
8H	4H	19.29	19.73	19.38	20.00	20.38	18.34	18.78	18.43	19.06	19.43
	6H	19.18	19.46	19.46	19.83	20.34	18.30	18.58	18.57	18.94	19.45
	8H	19.12	19.37	19.42	19.74	20.28	18.26	18.51	18.56	18.88	19.42
	12H	19.03	19.25	19.35	19.63	20.19	18.20	18.42	18.53	18.81	19.37
12H	4H	19.62	19.93	19.87	20.28	20.77	18.37	18.68	18.62	19.03	19.52
	6H	19.63	19.88	19.93	20.26	20.79	18.37	18.62	18.67	19.00	19.53

C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

ZONAL LUMINOUS FLUX TABLE-2

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	φ zonal	φ total	%lum	%lamp
10	581.2	570.8	562.1	556.7	553.0	553.4	556.8	575.5	10	55.0	55.0	5.7	5.7
20	507.9	501.2	488.4	473.4	466.9	488.6	468.4	519.8	20	149.1	204.1	21.0	21.0
30	377.5	389.9	367.9	362.0	357.5	393.4	331.6	428.5	30	200.0	404.1	41.6	41.6
40	228.3	255.2	230.0	248.2	249.6	281.5	197.2	300.7	40	193.9	598.1	61.6	61.6
50	145.0	143.6	128.6	159.6	167.1	180.2	116.6	172.2	50	151.6	749.7	77.2	77.2
60	84.8	78.8	67.5	96.4	101.4	113.6	61.1	98.2	60	104.5	854.1	88.0	88.0
70	48.7	43.7	36.1	57.6	55.0	68.7	28.1	55.2	70	66.0	920.2	94.8	94.8
80	29.6	23.3	19.9	16.1	14.8	31.3	11.8	30.5	80	37.1	957.3	98.6	98.6
90	19.8	12.7	0.0	0.0	0.0	0.9	0.0	18.3	90	13.4	970.7	100.0	100.0

Conical surface Flux(90deg) : 679.9 lm

%lum = 70.0%

%lamp = 70.0%

Conical surface Flux(120deg) : 854.1 lm

%lum = 88.0%

%lamp = 88.0%


C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

SPACE ISOLX DIAGRAM

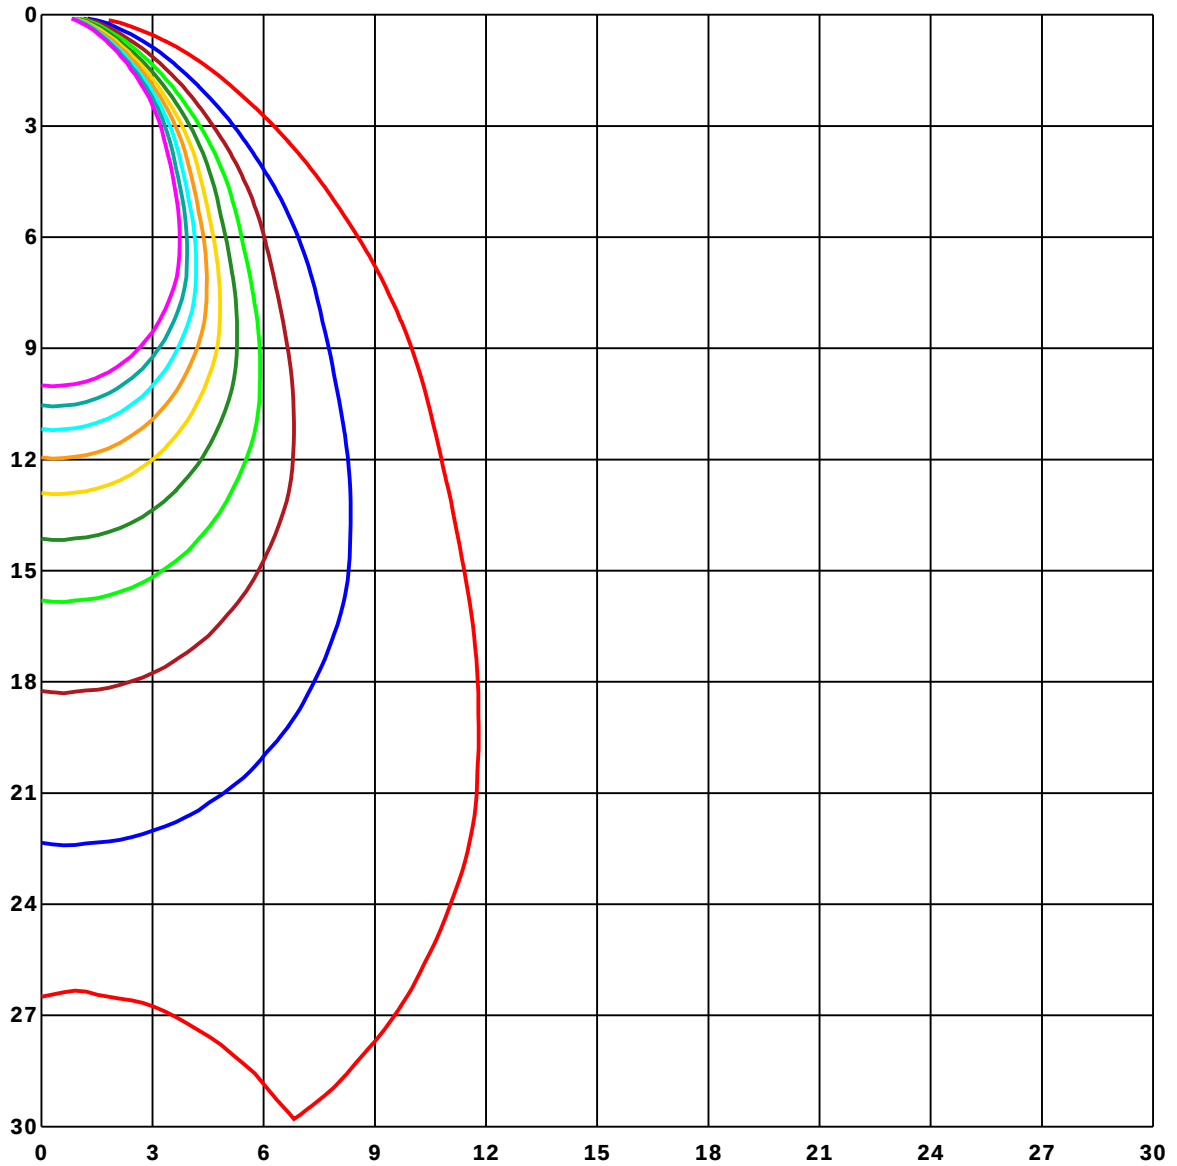

Unit of illumination:lx

5.903
5.313
4.723
4.132
3.542

2.952
2.361
1.771
1.181
0.59

C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature: 25
Operators:
Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-2000B Goniophotometer
Humidity: 65
Test Distance: 6.25 m
Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

LUMINOUS DISTRIBUTION INTENSITY DATA

Gamma/C	C0	C45	C90	C135	C180	C225	C270	C315	C360	
G0	589.38	587.27	588.24	587.81	589.38	587.27	588.24	587.81	589.38	
G1	592.11	587.5	588.32	586.64	589.65	585.43	586.68	589.22	592.11	
G2	594.61	586.64	587.38	585.2	587.85	584.26	585.63	589.8	594.61	
G3	592.81	586.8	585.43	583.98	586.05	582.5	584.06	589.92	592.81	
G4	592.62	585.82	584.02	580.43	582.62	580.74	581.05	589.77	592.62	
G5	593.52	585.27	582.46	577.5	579.61	576.99	577.46	587.66	593.52	
G6	592.46	584.06	579.88	574.14	576.37	573.63	575.23	587.27	592.46	
G7	590.27	582.11	577.11	570.82	572.89	568.52	570.94	584.65	590.27	
G8	587.66	579.96	571.21	565.86	564.84	563.87	566.41	581.76	587.66	
G9	585.35	575.66	566.52	562.58	560.04	558.98	561.02	577.73	585.35	
G10	581.21	570.78	562.07	556.72	553.01	553.36	556.84	575.51	581.21	
G11	577.46	566.72	557.3	550.59	547.11	547.07	550.12	569.8	577.46	
G12	570.23	561.8	551.95	544.38	538.44	541.88	544.1	565.63	570.23	
G13	565.35	555.98	544.65	537.07	529.96	535.35	538.01	560.31	565.35	
G14	558.83	548.63	537.66	528.44	523.28	529.1	529.84	554.02	558.83	
G15	552.89	541.99	530.66	520.82	515.39	523.52	521.09	549.38	552.89	
G16	544.22	536.02	524.02	511.48	505.63	516.25	512.03	544.41	544.22	
G17	534.49	528.01	515.31	502.27	495.23	508.98	501.95	537.7	534.49	
G18	526.64	519.57	506.8	492.34	487.11	503.55	492.11	532.34	526.64	
G19	517.58	509.61	497.54	482.85	477.07	496.84	479.96	526.45	517.58	
G20	507.89	501.17	488.36	473.36	466.88	488.55	468.4	519.77	507.89	
G21	497.15	491.13	479.88	463.52	455.94	479.96	456.21	511.76	497.15	
G22	484.8	480.55	469.14	453.87	446.88	471.99	443.44	503.71	484.8	
G23	474.06	469.96	457.73	442.81	437.03	463.24	431.41	495.2	474.06	
G24	462.15	460.39	446.17	431.25	425.74	453.83	417.23	487.03	462.15	
G25	449.57	449.34	434.41	419.96	416.56	445.16	402.93	478.13	449.57	
G26	438.36	438.01	421.99	409.02	405.82	434.41	389.22	468.71	438.36	
G27	425.2	425.98	411.02	398.67	393.87	424.84	374.92	460.86	425.2	
G28	411.33	414.3	395.59	387.07	381.91	415.51	360.39	450.0	411.33	
G29	395.78	401.64	381.56	375.27	369.1	403.95	345.94	439.18	395.78	
G30	377.54	389.88	367.85	361.95	357.46	393.36	331.56	428.52	377.54	
G31	361.68	377.27	353.44	349.77	344.73	384.02	316.48	418.05	361.68	
G32	344.88	364.88	339.69	337.7	333.44	371.29	302.93	405.16	344.88	
G33	329.57	351.21	325.0	326.37	321.37	359.84	288.59	392.97	329.57	
G34	313.75	338.01	310.78	314.06	311.25	349.18	273.87	380.9	313.75	
G35	297.93	324.61	296.64	303.13	298.59	338.24	260.47	368.09	297.93	
G36	282.73	309.69	282.42	290.66	288.71	326.56	247.23	355.16	282.73	

C Range: 0 - 360 Deg

C Interval: 45.0 Deg

Test Speed: High

Temperature: 25

Operators:

Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg

G Interval: 1.0 Deg

Test System: Huipu CPM-2000B Goniophotometer

Humidity: 65

Test Distance: 6.25 m

Remarks:

Report No.:

Test Time: 2025/11/3 9:56:39

LUMINOUS DISTRIBUTION INTENSITY DATA(Continue 1)

Gamma/C	C0	C45	C90	C135	C180	C225	C270	C315	C360	
G37	266.88	295.82	269.1	279.45	278.71	315.94	233.95	341.99	266.88	
G38	252.85	282.07	255.9	268.95	268.59	304.45	221.21	328.36	252.85	
G39	239.69	268.63	242.42	257.66	258.91	292.73	208.98	314.57	239.69	
G40	228.28	255.23	229.96	248.24	249.61	281.48	197.19	300.7	228.28	
G41	216.91	241.6	217.85	237.5	241.8	269.96	186.25	285.9	216.91	
G42	206.25	229.45	205.74	227.66	233.09	258.63	175.94	271.37	206.25	
G43	197.5	217.5	194.53	218.55	225.08	247.93	166.45	257.42	197.5	
G44	189.1	205.47	183.71	209.1	216.84	237.23	157.77	243.55	189.1	
G45	181.41	193.83	173.4	200.59	209.02	227.15	150.23	230.9	181.41	
G46	173.95	183.05	163.63	191.8	199.73	216.37	142.97	217.58	173.95	
G47	166.68	172.27	154.34	183.36	191.45	206.91	136.05	205.16	166.68	
G48	159.34	162.3	145.39	175.2	183.13	197.3	129.26	193.63	159.34	
G49	152.46	152.73	136.76	167.34	175.16	188.4	122.73	182.3	152.46	
G50	145.0	143.55	128.55	159.61	167.11	180.23	116.6	172.23	145.0	
G51	137.89	134.69	120.82	151.76	159.1	171.8	110.43	162.23	137.89	
G52	131.37	126.68	113.36	144.92	151.76	164.1	104.22	153.36	131.37	
G53	124.53	119.49	106.37	137.7	144.84	156.68	98.24	144.92	124.53	
G54	118.2	112.54	99.73	130.98	137.77	150.0	92.27	136.99	118.2	
G55	111.68	106.33	93.44	124.41	131.13	143.98	86.33	129.57	111.68	
G56	105.08	99.96	87.7	118.28	124.34	137.19	81.05	122.58	105.08	
G57	99.57	94.22	82.62	112.7	118.32	131.09	75.94	116.09	99.57	
G58	94.1	88.67	76.99	106.88	112.03	125.12	70.82	109.69	94.1	
G59	89.41	83.67	71.95	101.6	106.48	119.38	65.94	103.87	89.41	
G60	84.77	78.79	67.46	96.45	101.41	113.63	61.05	98.2	84.77	
G61	80.16	74.18	63.32	91.68	96.33	108.24	56.45	92.7	80.16	
G62	75.9	69.92	59.18	86.99	91.72	102.7	52.03	87.7	75.9	
G63	71.6	66.05	55.43	82.62	87.54	97.7	48.09	82.81	71.6	
G64	67.66	62.3	51.91	78.4	83.44	92.97	44.34	78.13	67.66	
G65	64.06	58.83	48.67	74.45	79.65	88.55	40.74	73.79	64.06	
G66	60.39	55.39	45.74	70.59	74.96	84.02	37.54	69.8	60.39	
G67	57.27	52.27	43.01	67.07	69.8	80.0	34.84	65.74	57.27	
G68	54.02	49.34	40.51	63.67	64.38	75.9	32.27	62.07	54.02	
G69	51.29	46.41	38.24	60.59	59.49	72.27	30.08	58.52	51.29	
G70	48.71	43.67	36.05	57.58	54.96	68.67	28.09	55.23	48.71	
G71	46.48	40.82	34.06	54.38	50.63	65.31	26.33	51.76	46.48	
G72	44.34	38.28	32.27	51.29	46.6	62.15	24.53	48.55	44.34	
G73	42.3	35.82	30.43	46.99	42.93	58.95	23.05	45.51	42.3	

C Range: 0 - 360 Deg

C Interval: 45.0 Deg

Test Speed: High

Temperature: 25

Operators:

Test Date: 2025/11/3 9:56:39

G Range: 0 - 90 Deg

G Interval: 1.0 Deg

Test System: Huipu CPM-2000B Goniophotometer

Humidity: 65

Test Distance: 6.25 m

Remarks:

