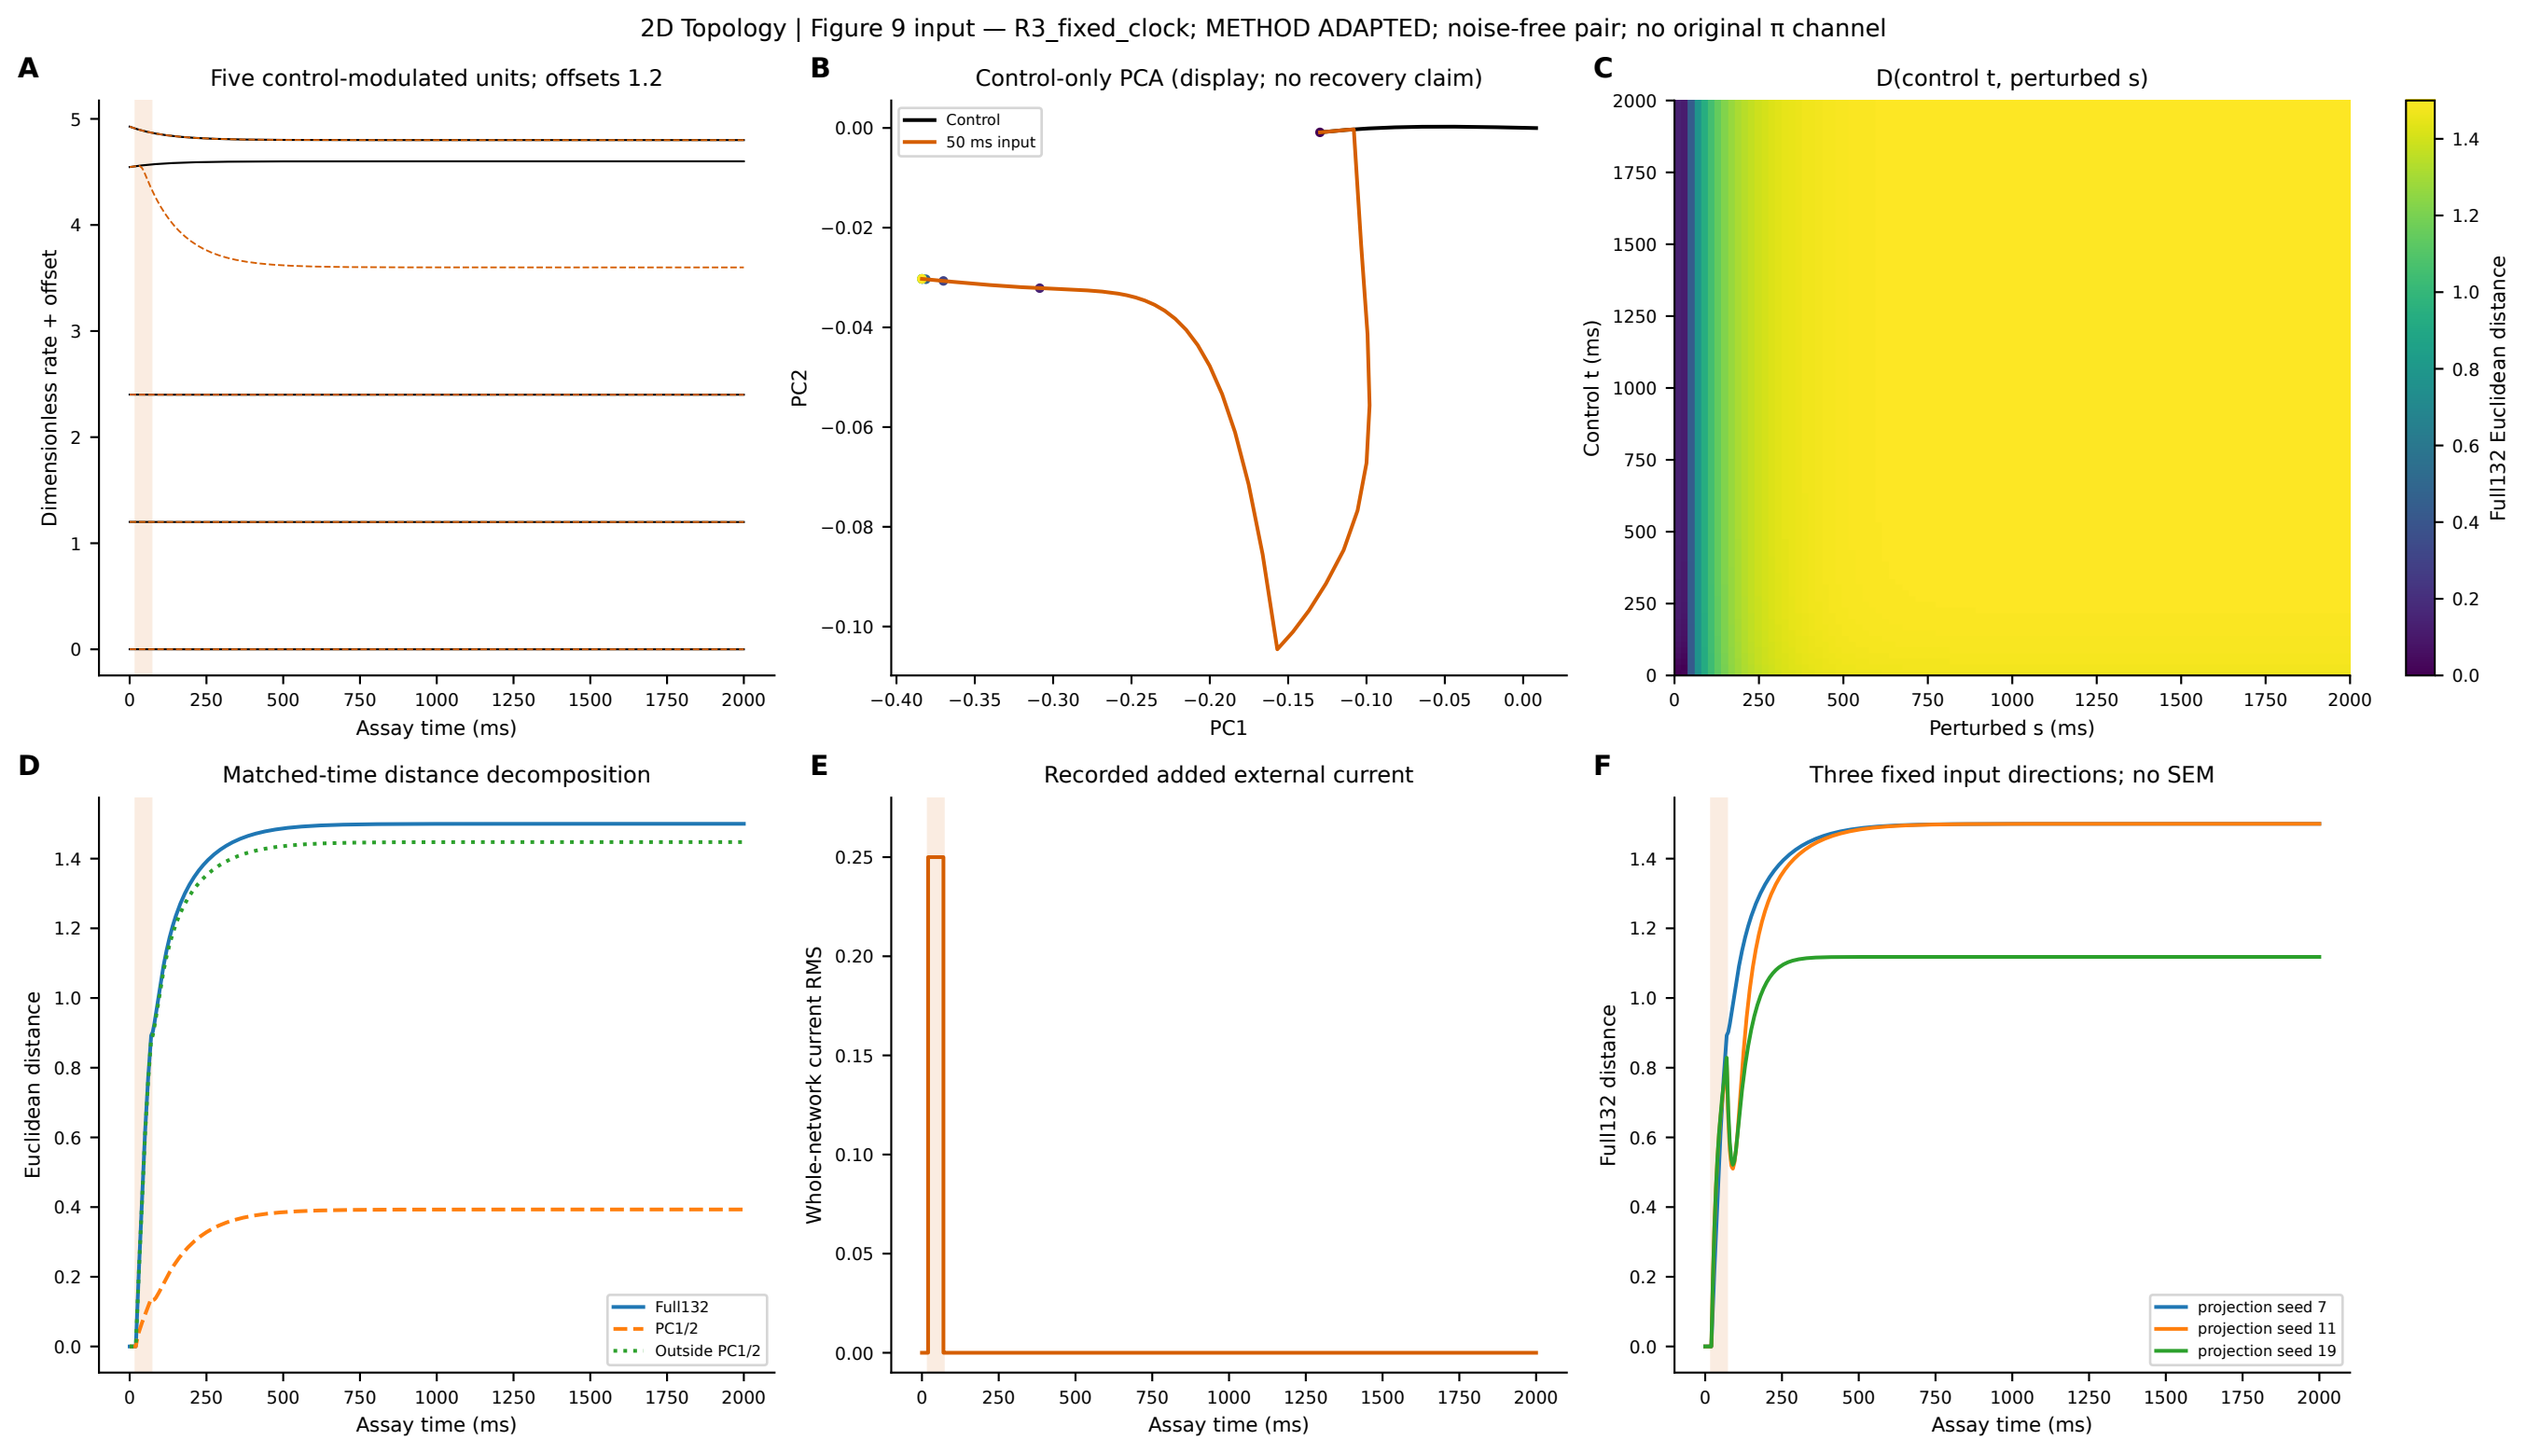
2D Topology | Figure 9 input — R3_fixed_clock; METHOD ADAPTED; noise-free pair; no original π channel
A
Five control-modulated units; offsets 1.2
Dimensionless rate + offset
Assay time (ms)
B
Control-only PCA (display; no recovery claim)
Control
50 ms input
PC2
PC1
C
D(control t, perturbed s)
Control t (ms)
Perturbed s (ms)
Full132 Euclidean distance
D
Matched-time distance decomposition
Euclidean distance
Full132
PC1/2
Outside PC1/2
Assay time (ms)
E
Recorded added external current
Whole-network current RMS
Assay time (ms)
F
Three fixed input directions; no SEM
Full132 distance
projection seed 7
projection seed 11
projection seed 19
Assay time (ms)