All 29 rate variables | E1 -> E2 -> E4 -> E5

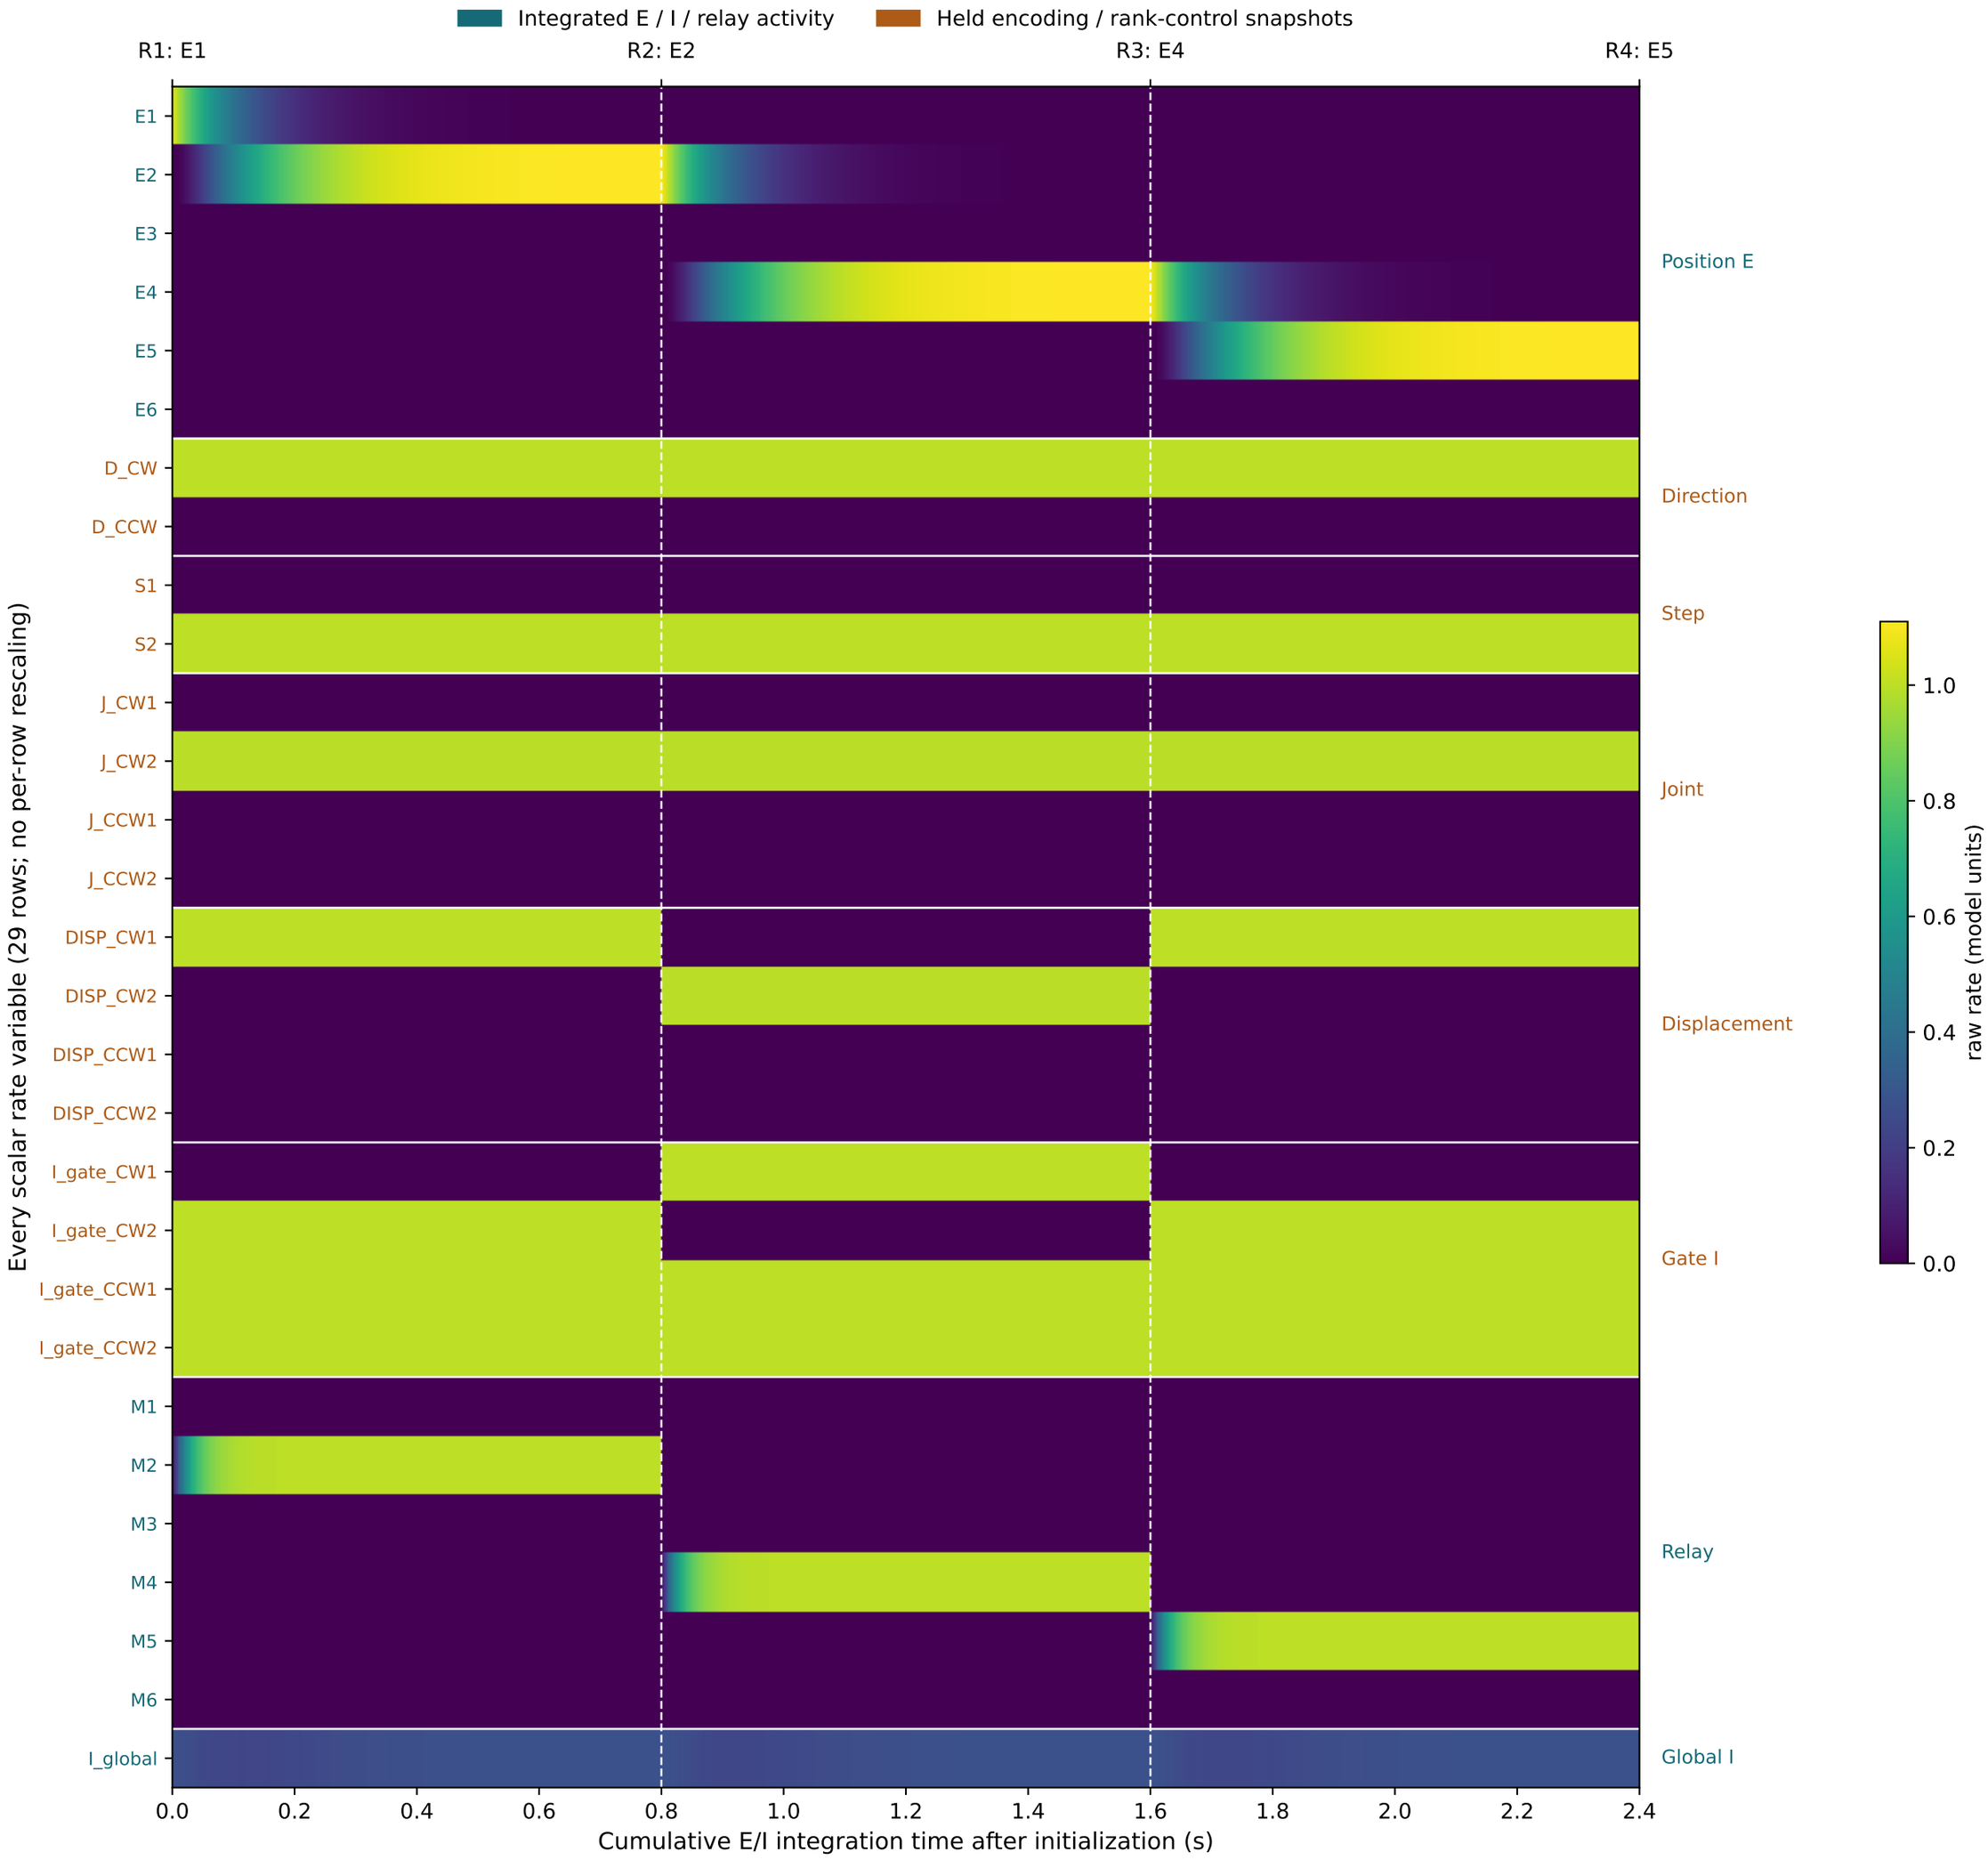

Time starts at the initialized E state. Control setup was not jointly sampled with E/I.
Held rows show their actual stored rates; no invented onset dynamics. Relays reset at switches.