Air Distribution System

Main | Chiller | Air | Electrical

Time selector for air system analytics and trend

Last Day | Trend: Efficiency (kW/CFM) | Zone Trend: Both

Air System Overview

Total Air Power
74.45 kW
Last update: 08/04/2569 14:58:47

Total Air Flow
16076.26 CFM
Sum of current airflow from AHU-1 to AHU-4

Avg Efficiency
0.0046 kW/CFM
Total power divided by total airflow

Air Energy Consumption
109.86 kWh
Delta from AHU sub-meters over selected range

AHU Status and Performance

AHU-1

Running Status	ON
Alarm	OK
Power	18.71 kW
Air Flow	3992.36 CFM
Supply Temp	23.00 °C
Return Temp	24.98 °C
Delta T	1.98 °C
Efficiency	0.0047 kW/CFM
Sub-Meter Energy	27.51 kWh

AHU-2

Running Status	ON
Alarm	OK
Power	18.75 kW
Air Flow	4035.13 CFM
Supply Temp	23.00 °C
Return Temp	24.76 °C
Delta T	1.76 °C
Efficiency	0.0046 kW/CFM
Sub-Meter Energy	27.42 kWh

AHU-3

Running Status	ON
Alarm	OK
Power	18.23 kW
Air Flow	4012.96 CFM
Supply Temp	23.00 °C
Return Temp	24.97 °C
Delta T	1.97 °C
Efficiency	0.0045 kW/CFM
Sub-Meter Energy	27.23 kWh

AHU-4

Running Status	ON
Alarm	OK
Power	18.76 kW
Air Flow	4035.81 CFM
Supply Temp	23.00 °C
Return Temp	24.76 °C
Delta T	1.76 °C
Efficiency	0.0046 kW/CFM
Sub-Meter Energy	27.70 kWh

Zone Environmental Averages

Floor 1

Avg Temp	**24.00 °C**
Avg Humidity	**58.20 %**
AHU On Count	**1**
AHU Alarm Count	**0**

Floor 2

Avg Temp	**24.00 °C**
Avg Humidity	**58.30 %**
AHU On Count	**1**
AHU Alarm Count	**0**

Floor 3

Avg Temp	**24.00 °C**
Avg Humidity	**58.10 %**
AHU On Count	**1**
AHU Alarm Count	**0**

Floor 4

Avg Temp	**24.00 °C**
Avg Humidity	**58.20 %**
AHU On Count	**1**
AHU Alarm Count	**0**

Zone Temperature and Humidity Trend

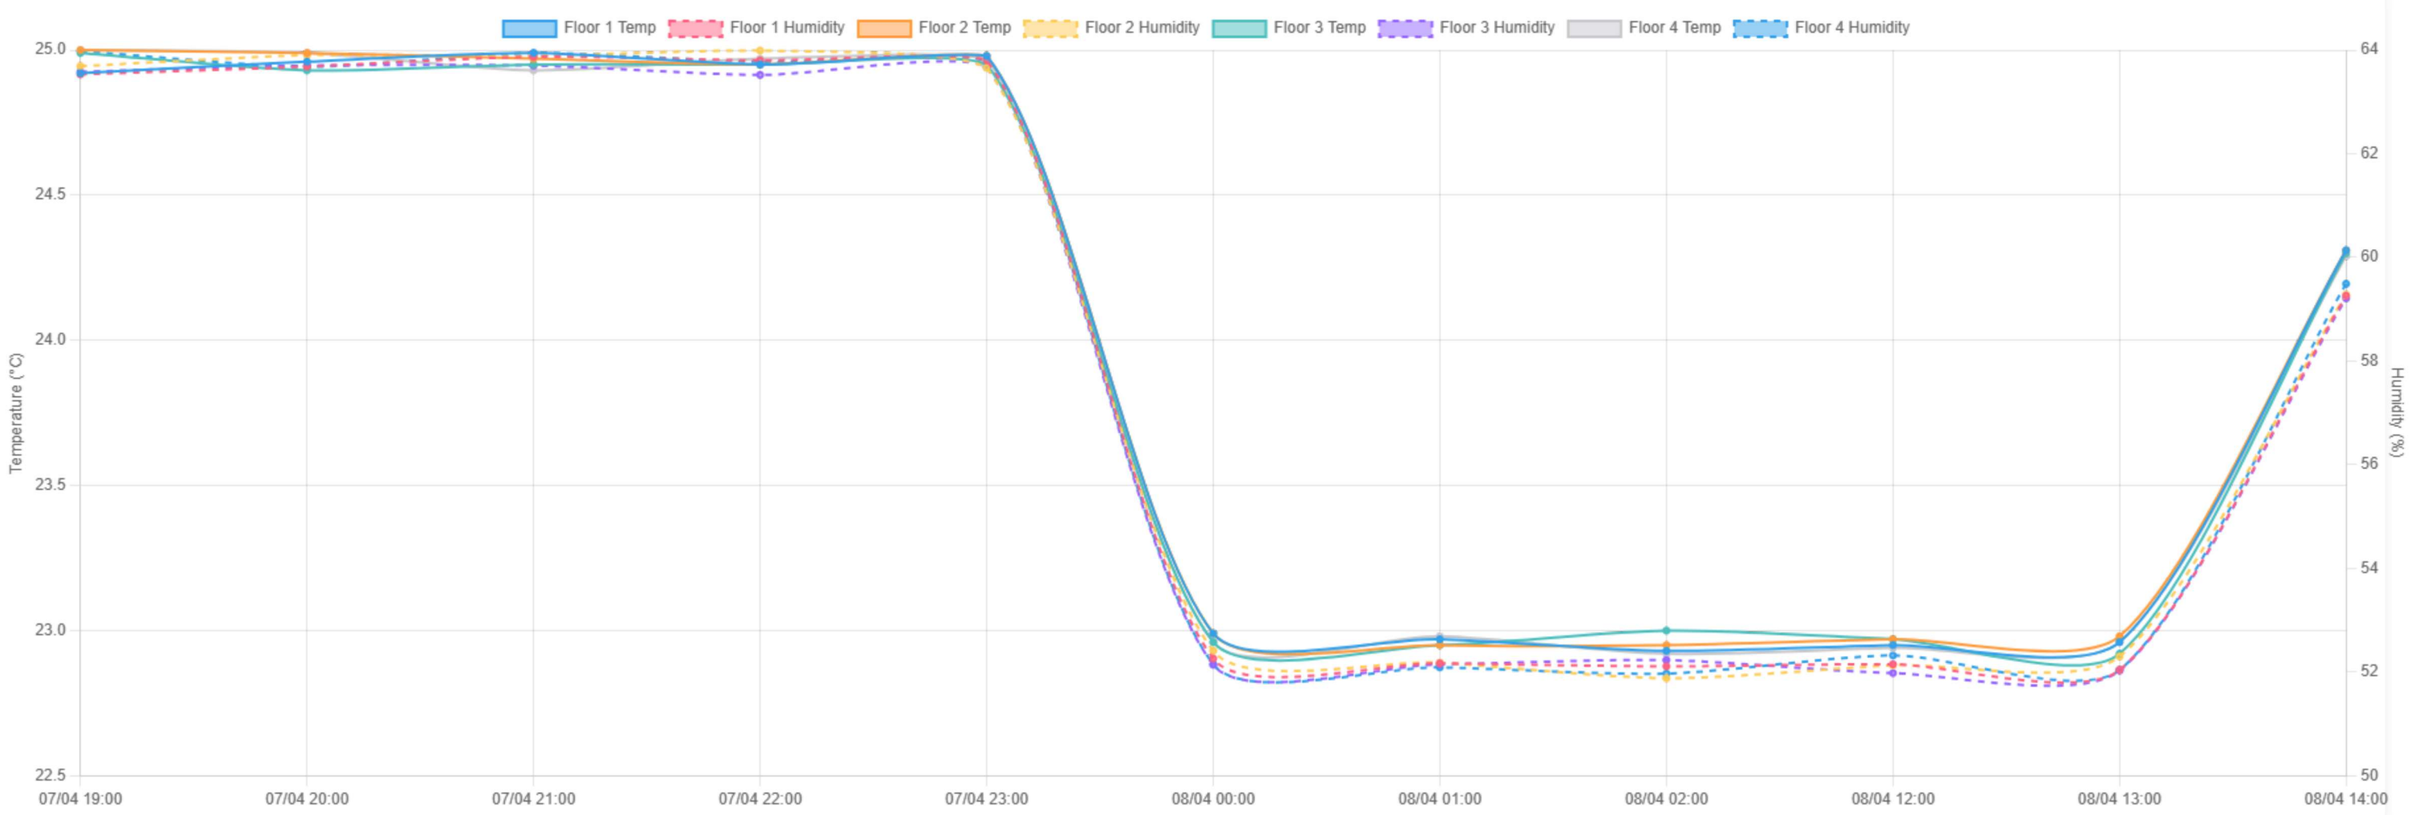
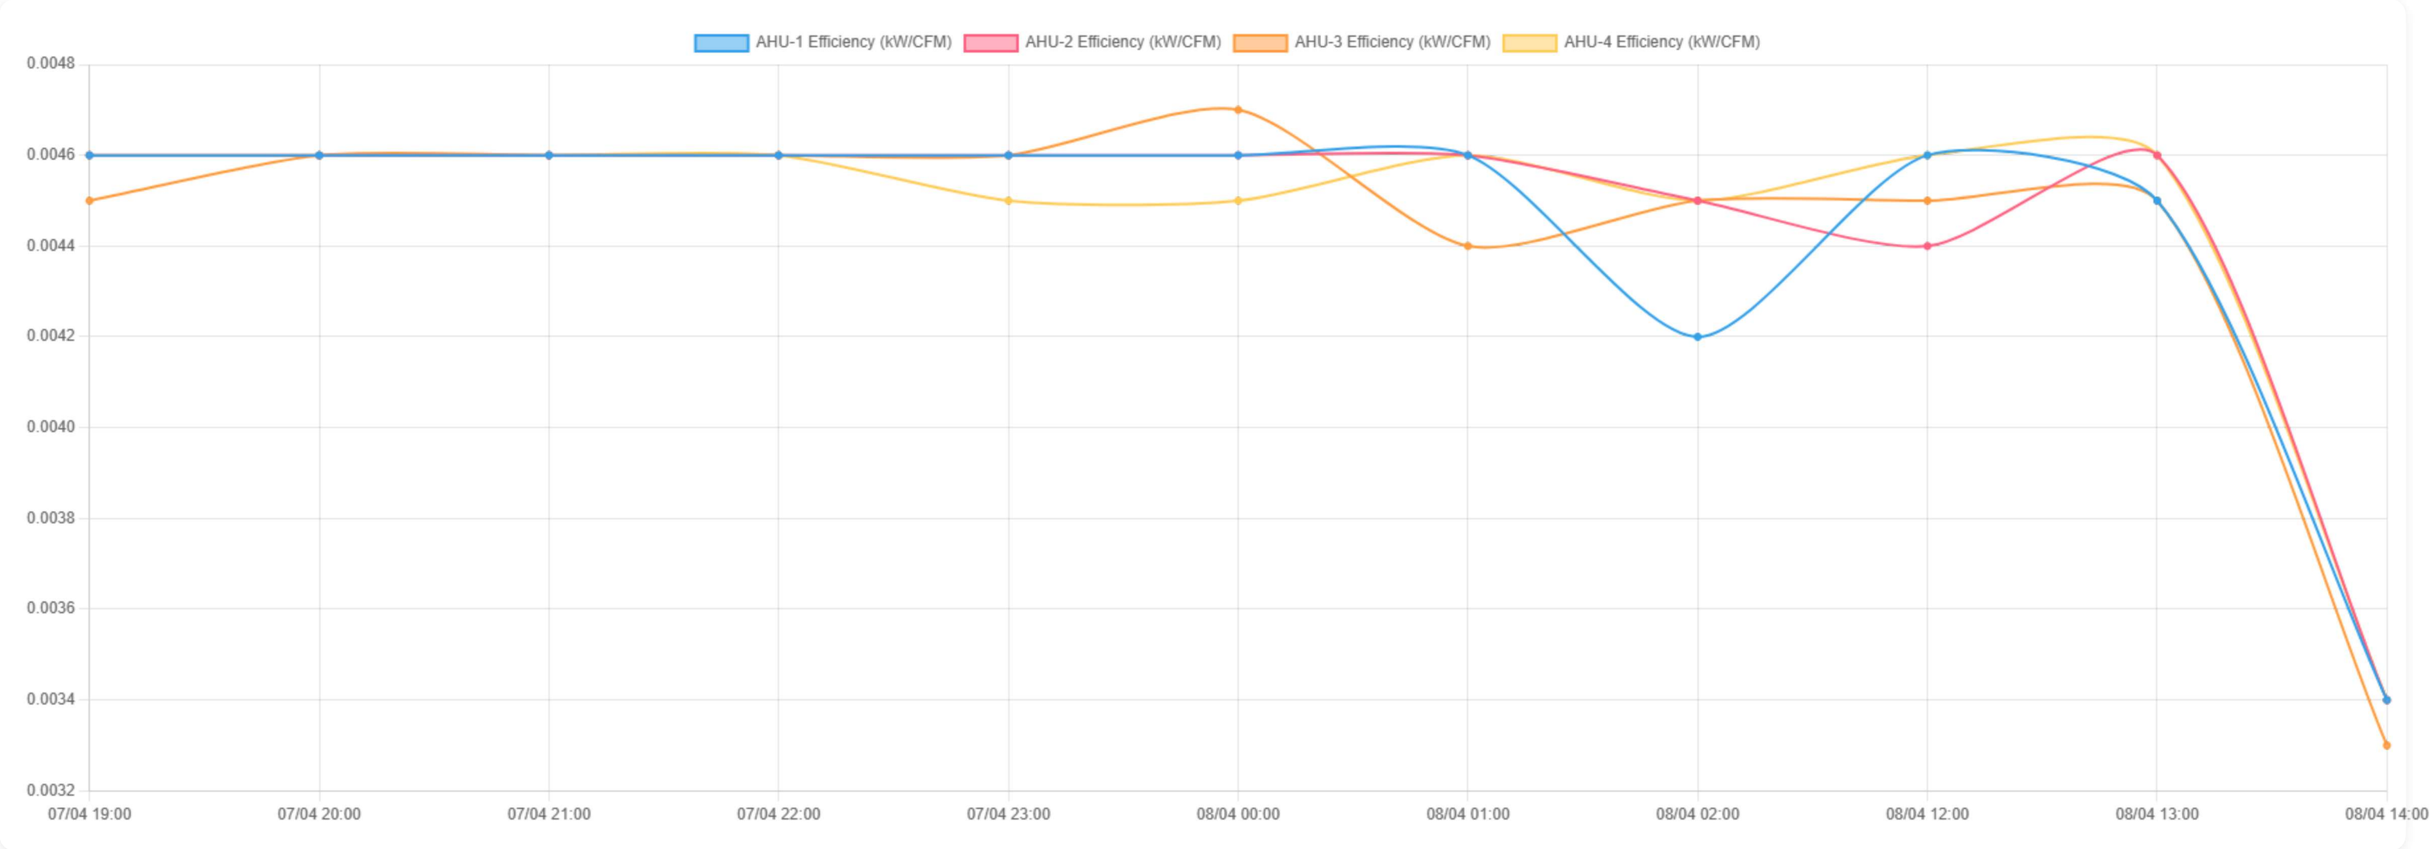
Air System Trend