Chiller Plant Management

Main | Chiller | Air | Electrical

Time selector for plant analytics and trend

Last Day | Trend: Efficiency (kW/RT)

Plant Overview

Total Chiller Power
769.98 kW
Last update: 08/04/2569 14:58:47

Total Cooling Load
1425.00 RT
Sum of current cooling output from CH-1 to CH-3

Plant Efficiency
0.54 kW/RT
Total power divided by total cooling load

Chiller Energy Consumption
977.24 kWh
Delta from chiller sub-meters over selected range

Chiller Status and Performance

CH-1		CH-2		CH-3	
Running Status	ON	Running Status	ON	Running Status	ON
Command	START	Command	START	Command	START
Alarm	OK	Alarm	OK	Alarm	OK
Power	254.60 kW	Power	258.40 kW	Power	256.98 kW
Cooling Rate	475.00 RT	Cooling Rate	475.00 RT	Cooling Rate	475.00 RT
Efficiency	0.54 kW/RT	Efficiency	0.54 kW/RT	Efficiency	0.54 kW/RT
% RLA	95.00 %	% RLA	95.00 %	% RLA	95.00 %
CHW Supply Temp	42.98 °F	CHW Supply Temp	42.98 °F	CHW Supply Temp	42.98 °F
CHW Return Temp	54.57 °F	CHW Return Temp	54.57 °F	CHW Return Temp	54.57 °F
Delta T	11.59 °F	Delta T	11.59 °F	Delta T	11.59 °F
Flow Rate	1173.66 GPM	Flow Rate	1185.30 GPM	Flow Rate	1189.22 GPM
Sat. Refrig Temp	35.04 °F	Sat. Refrig Temp	35.69 °F	Sat. Refrig Temp	36.60 °F
Approach Temp	2.65 °F	Approach Temp	1.98 °F	Approach Temp	2.33 °F
Sub-Meter Energy	709.44 kWh	Sub-Meter Energy	121.07 kWh	Sub-Meter Energy	146.73 kWh

Chiller Trend

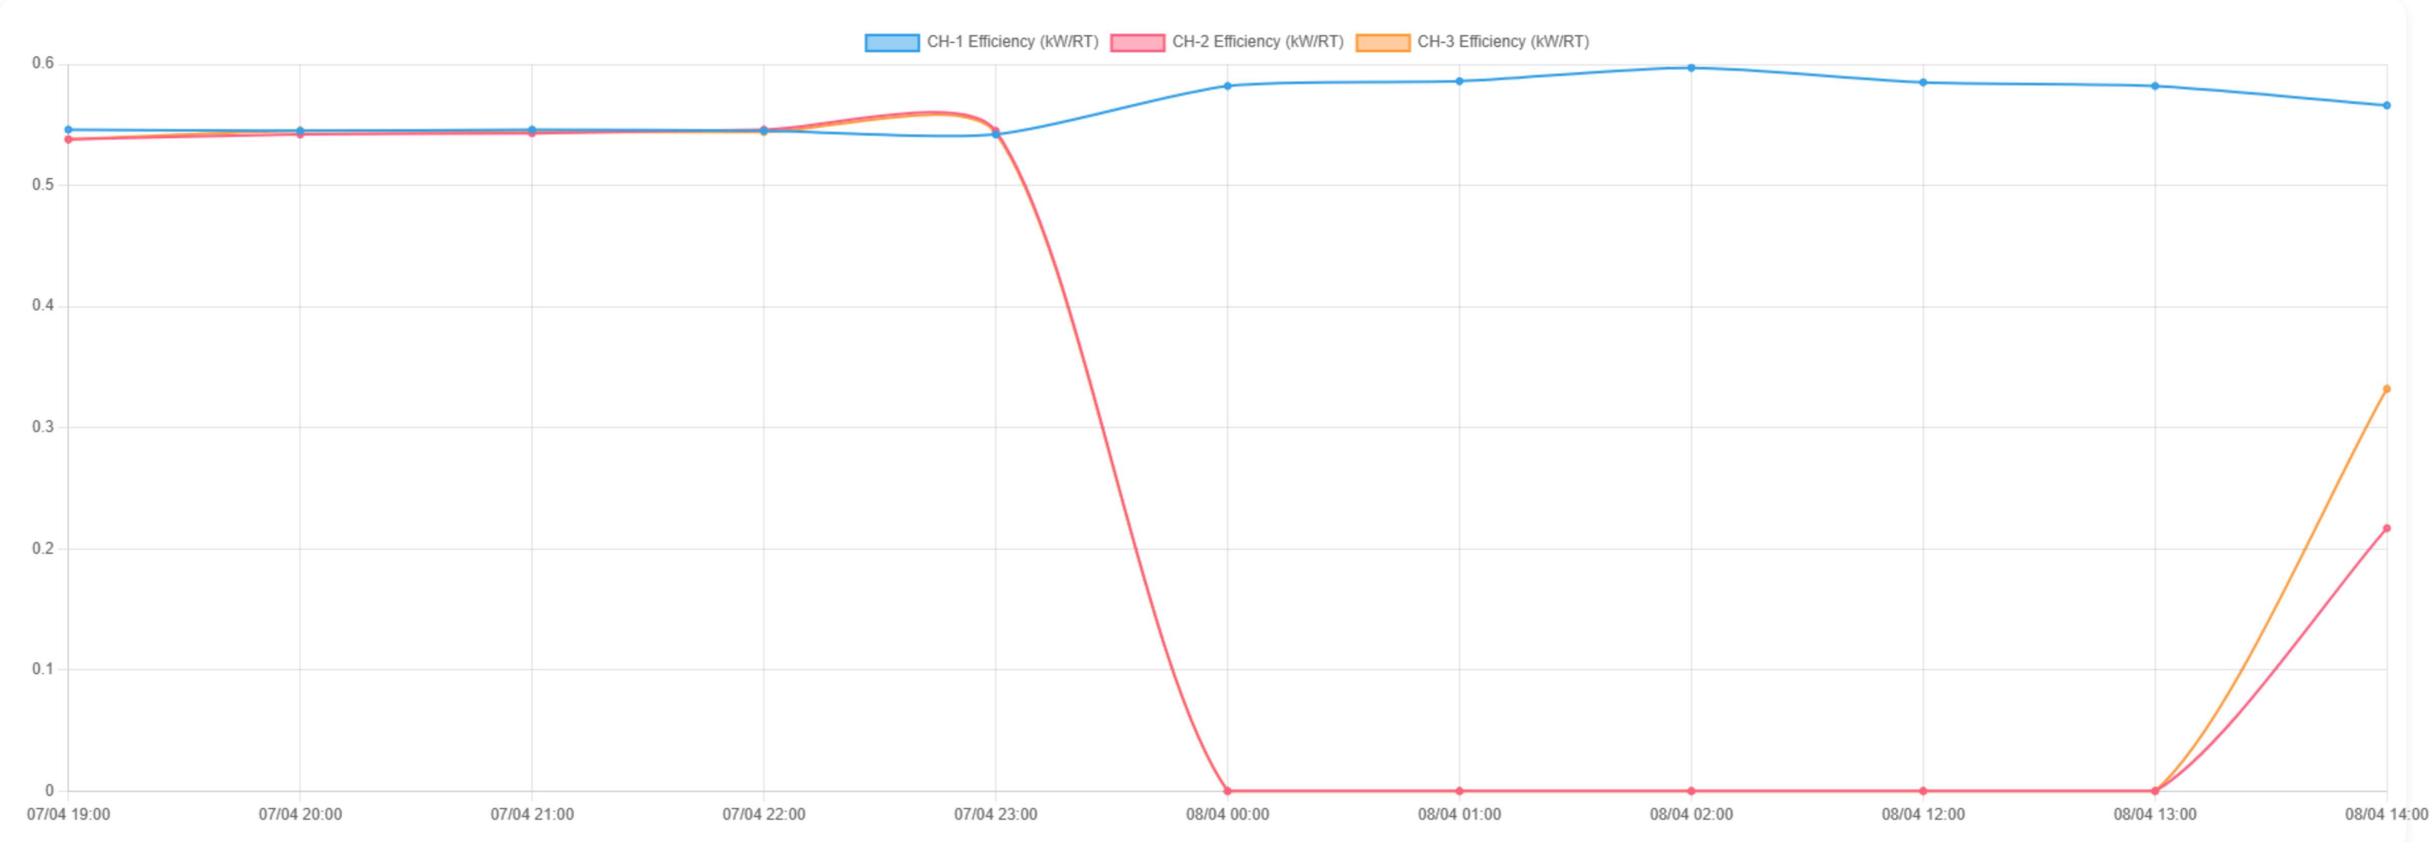
CH-1 Efficiency (kW/RT)
CH-2 Efficiency (kW/RT)
CH-3 Efficiency (kW/RT)
0.6
0.5
0.4
0.3
0.2
0.1
0
07/04 19:00
07/04 20:00
07/04 21:00
07/04 22:00
07/04 23:00
08/04 00:00
08/04 01:00
08/04 02:00
08/04 12:00
08/04 13:00
08/04 14:00