HVAC Main Dashboard

Main | Chiller | Air | Electrical

Time selector for analytics and trend

Last Day

Main Power (Current)
1160.92 kW
Last update: 08/04/2569 14:58:47

Avg Main Power
754.09 kW
Over selected time range

Peak Demand
1179.94 kW
Maximum main power in selected range

Main Energy Consumption
5600.40 kWh
Delta from main energy meter over selected range

Total Floor Energy
931.50 kWh
Sum of floor meter energy over selected range

Avg Indoor Temp
24.00 °C
Average IAQ temperature in selected range

Avg CO_2
702.00 ppm
Average IAQ CO_2 in selected range

Avg PM2.5
14.50 µg/m³
Average IAQ PM2.5 in selected range

Main Power Trend

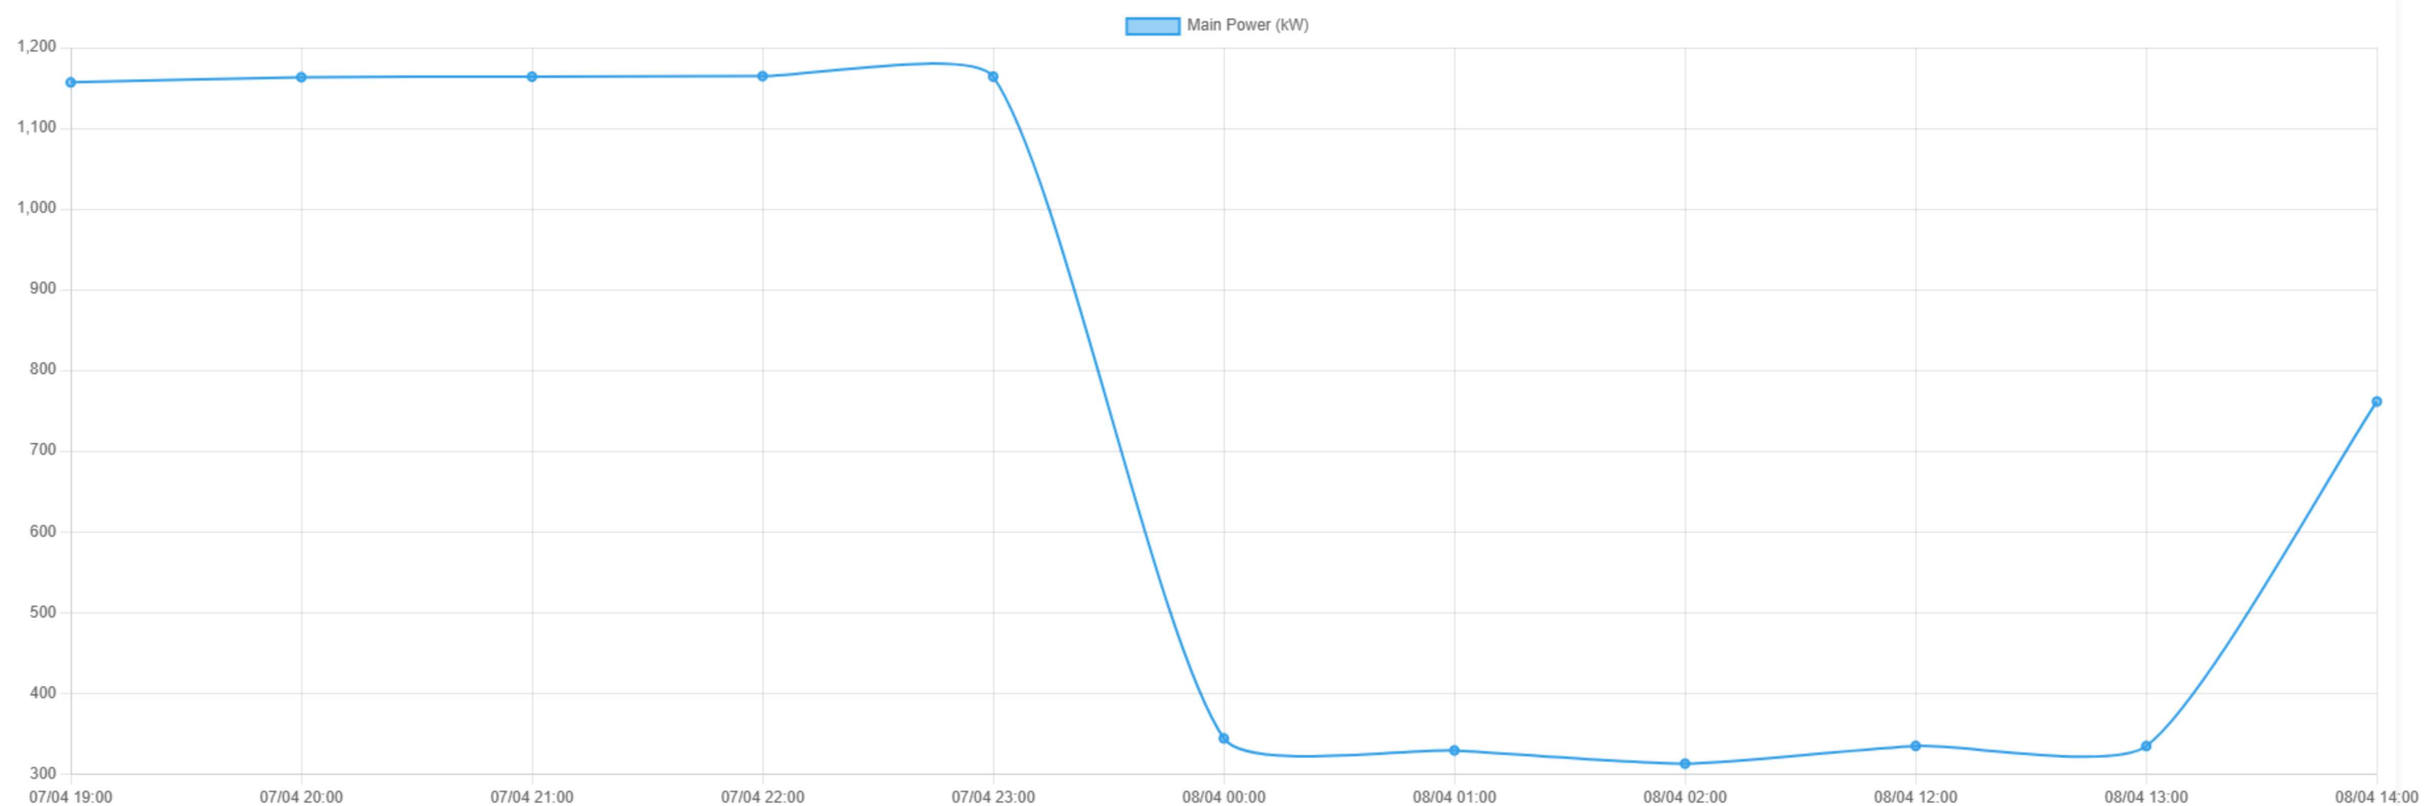

Average CO_2 Trend by Floor

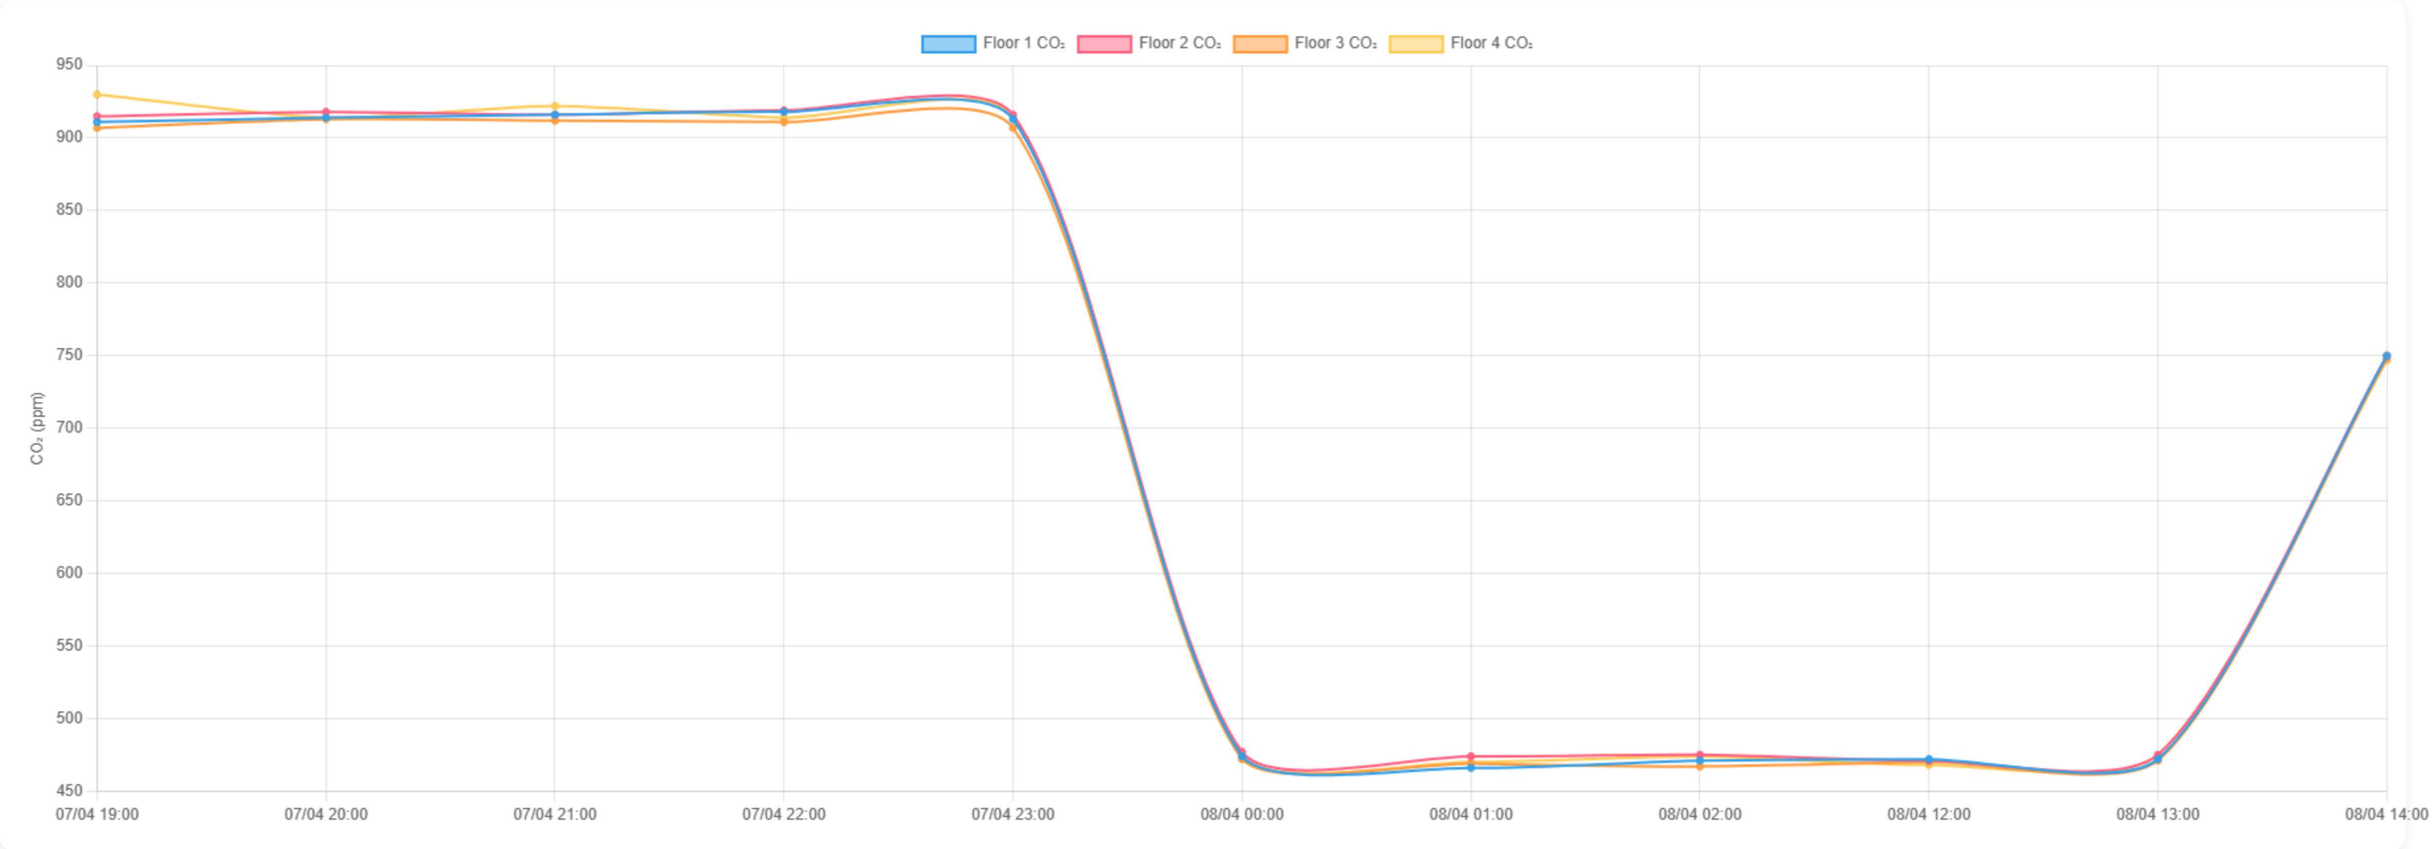

Average PM2.5 Trend by Floor

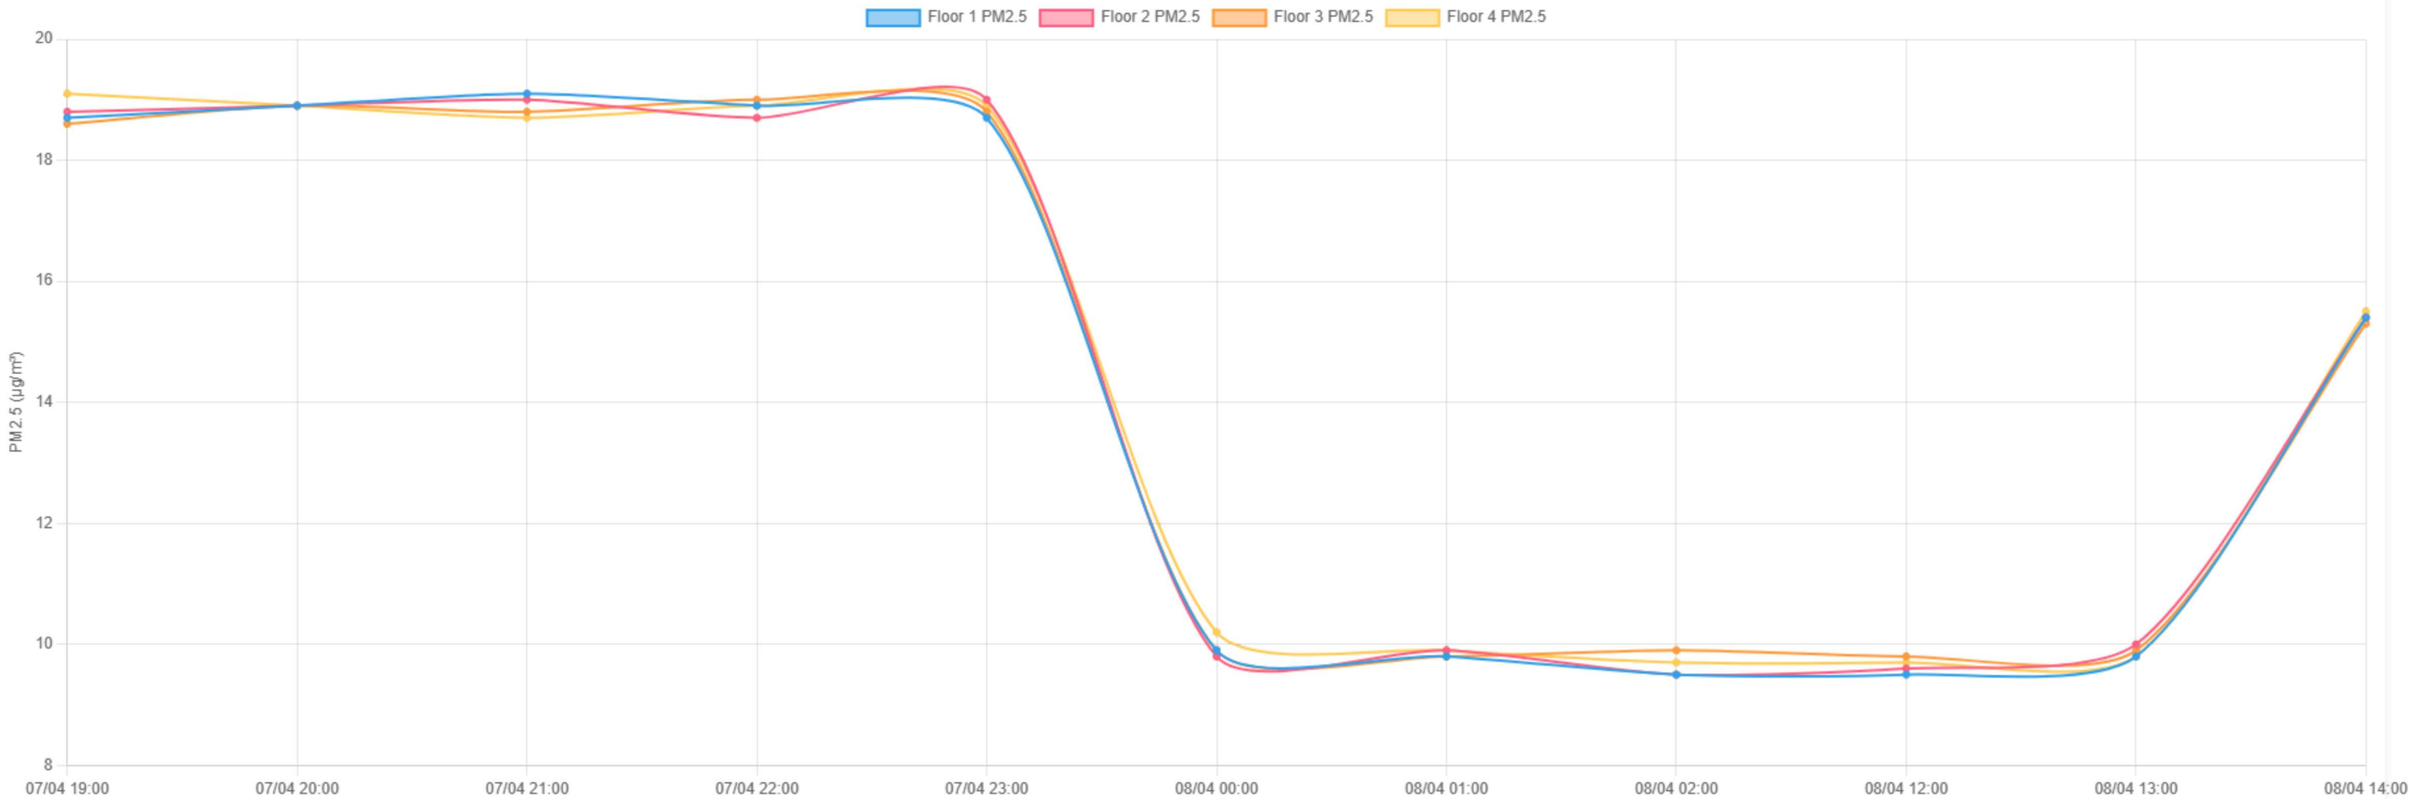

IAQ Analytics by Floor

Average / Minimum / Maximum over selected time range

Floor 1

Temperature	**24.00 °C** min 22.80 / max 26.00
Humidity	**58.20 %** min 51.10 / max 65.30
CO_2	**702.00 ppm** min 452.00 / max 974.00
PM2.5	**14.50 µg/m³** min 8.80 / max 19.90

Floor 2

Temperature	**24.00 °C** min 22.80 / max 25.90
Humidity	**58.30 %** min 51.00 / max 65.30
CO_2	**705.00 ppm** min 453.00 / max 971.00
PM2.5	**14.50 µg/m³** min 8.80 / max 19.90

Floor 3

Temperature	**24.00 °C** min 22.80 / max 25.90
Humidity	**58.10 %** min 50.90 / max 65.10

Floor 4

Temperature	**24.00 °C** min 22.80 / max 25.80
Humidity	**58.20 %** min 51.10 / max 65.30

CO_2	**700.00 ppm** min 452.00 / max 971.00
PM2.5	**14.50 µg/m³** min 8.80 / max 19.90

CO_2	**703.00 ppm** min 453.00 / max 969.00
PM2.5	**14.60 µg/m³** min 8.80 / max 19.80