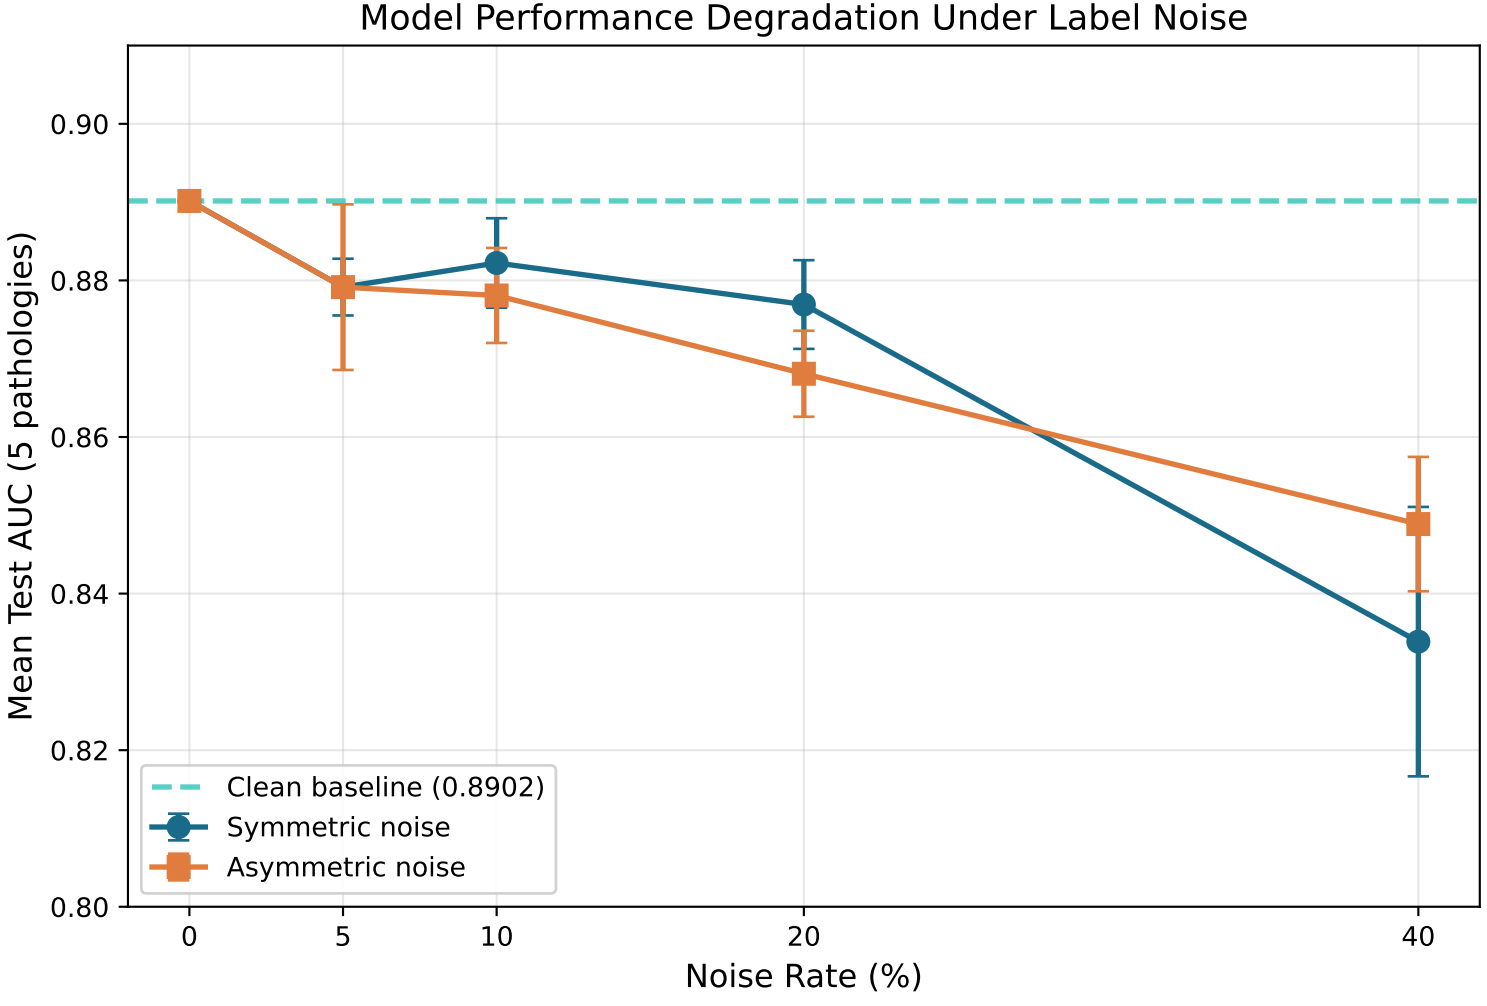
Model Performance Degradation Under Label Noise
Mean Test AUC (5 pathologies)
0.90
0.88
0.86
0.84
0.82
0.80
0
5
10
20
40
Noise Rate (%)
Clean baseline (0.8902)
Symmetric noise
Asymmetric noise