


Do not build a data center inside the approach surfaces of a Cat II/III ILS runway.

RWY 1L approach / RWY 19R departure surfaces

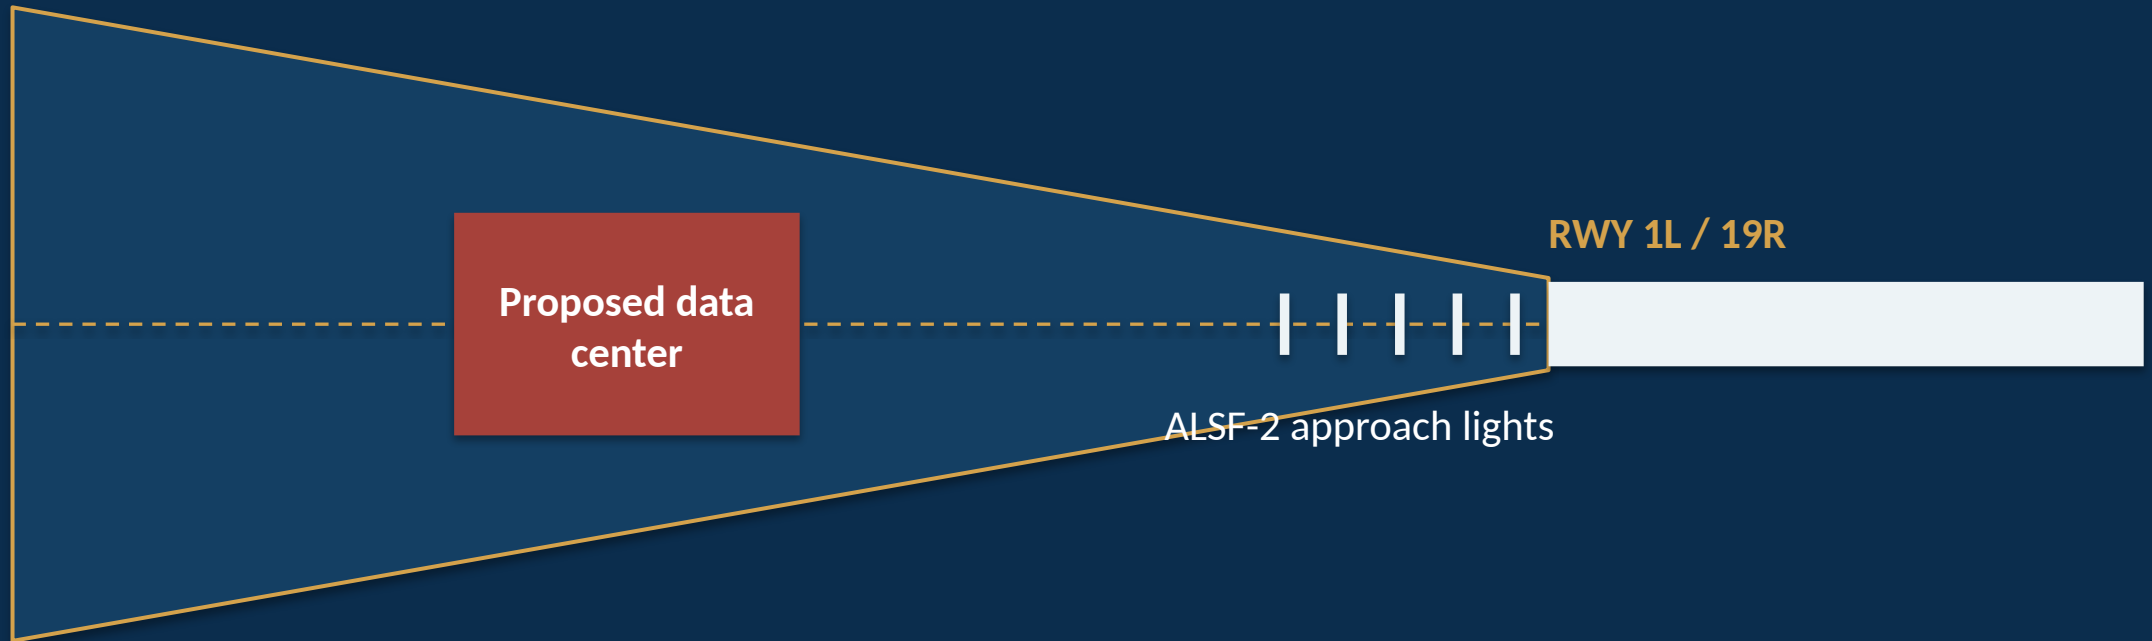


9,400-ft Cat II/III ILS runway with ALSF-2 approach lighting.

Schematic, not to scale. Source: FAA instrument approach data, KIAD RWY 01L/19R — Cat II/III ILS, ALSF-2 (FlightAware approach plate).

A data center puts three interference vectors under one glide path.

- 1 Plume turbulence to 1,000 ft above the tower (AIM § 7-6-16)
- 2 Open-water basin draws wildlife (AC 150/5200-33C)
- 3 Metallic mass and emissions degrade the ILS signal (Order 6750.16E)

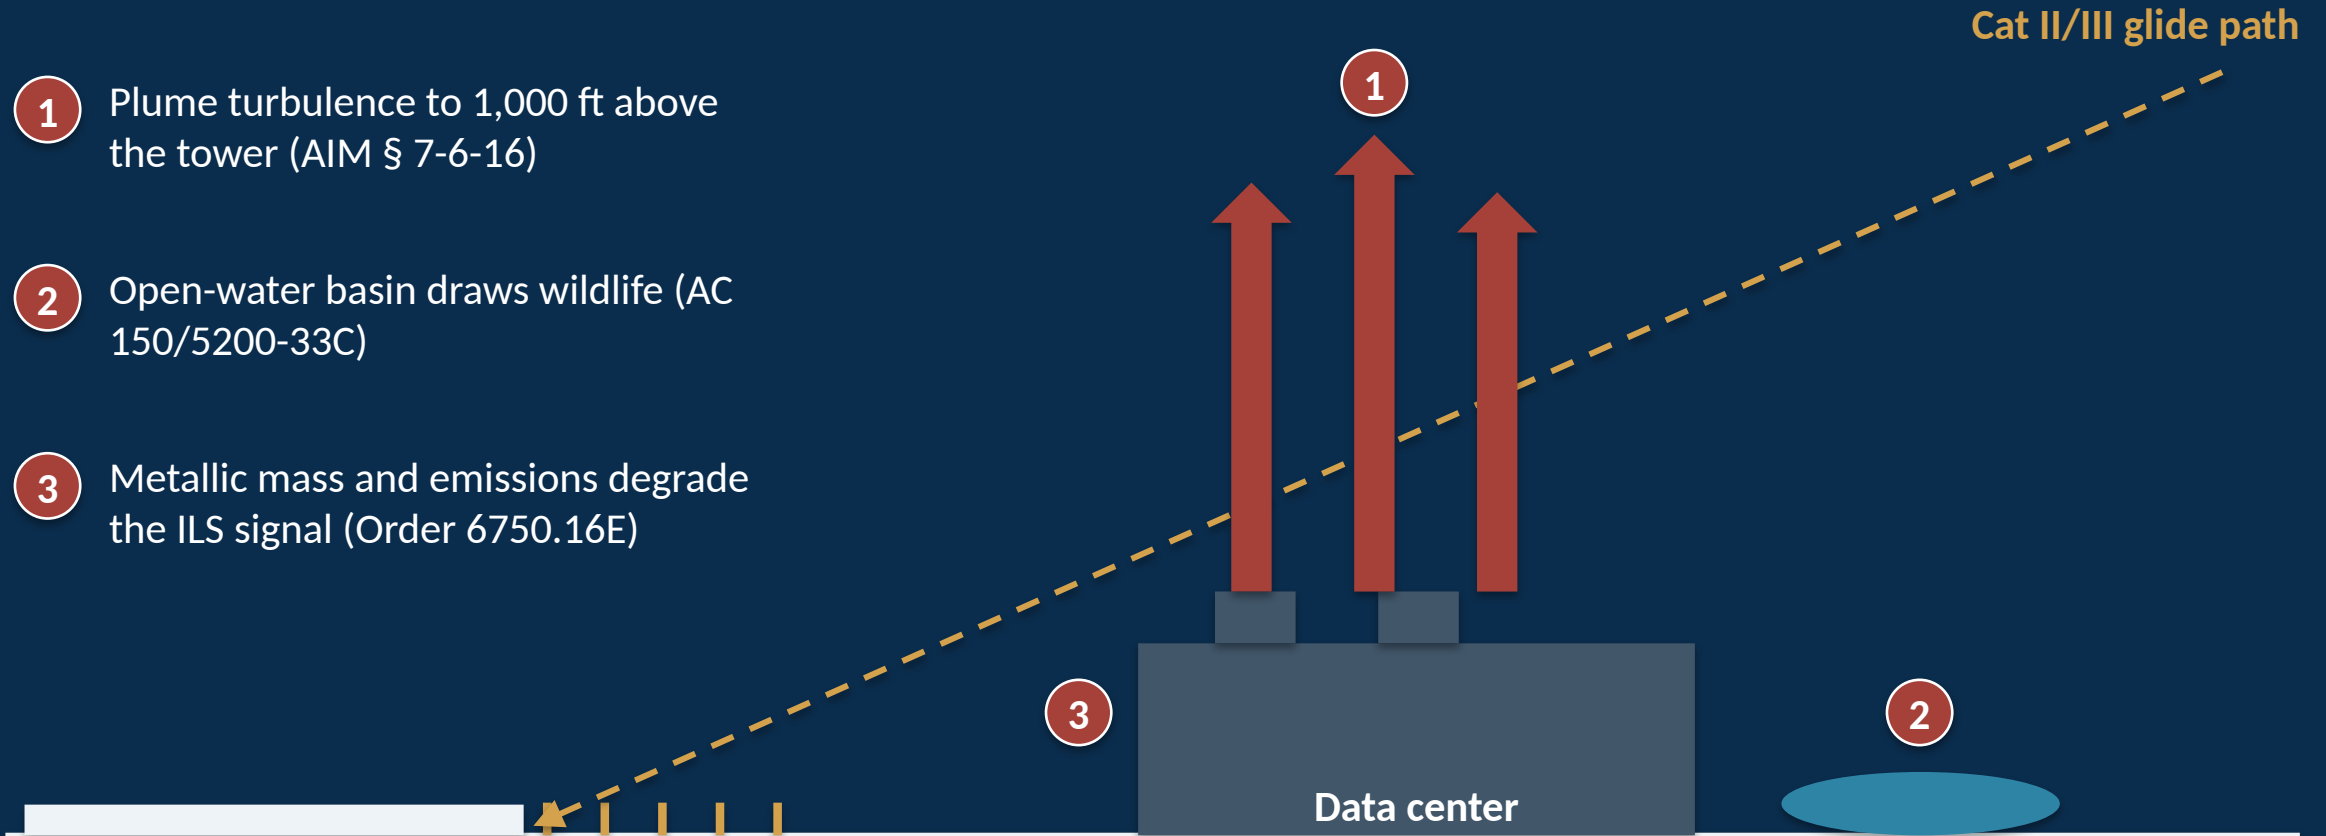

“Placing an object outside the critical area does not guarantee non-interference with the ILS signal in space.” — FAA Order 6750.16E

The FAA has already called this hazard class incompatible — and it holds the enforcement pen.

PRECEDENT

Thermal plumes “incompatible with airport operations” —
FAA guidance, 2015

Cooling-tower plumes a hazard to Long Beach departures
— Puente docket

ENFORCEMENT

Section 743 preserves FAA review: aircraft safety, ground
safety, federal investment

Grant Assurances 19, 20, 29 attach independently

14 CFR Part 16: penalties up to 3x diverted revenue

MWAA's own data-center precedent argues for a different parcel, not this one.

2018 Western Lands

424 acres to Digital Realty

ALP change subject to NEPA

Environmental Assessment in preparation

Proposed site

Inside the 1L approach and 19R departure surfaces

Aircraft-safety test is implicated

Federal-investment test is implicated

Section 743 preserves FAA review on safety and federal investment — assume review; do not lean on the 45-day window.

Halt, file the 7460-1, and move the deal — the aeronautical study governs, not the lease.

1

Halt advancement
pending FAA coordination

PLANNING

2

File Form 7460-1; require
a No Hazard
determination

PLANNING

3

Move the deal to master-
plan non-aeronautical
zones

COMMERCIAL REAL ESTATE

4

Route Grant Assurance
exposure; ALP re-enters
the master plan

GENERAL COUNSEL