

MAIN TANK ANALYSIS




Equipment Name	GT2C Bleeding	Site	SITE2
Serial No.	383204886	Power Rating	4500 kVA
Manufacture	EAKARAT	Voltage Rating	11 /6.9 kV
Fluid Type	Mineral Oil	Service Type	Auxiliary Transformer

Test Result

	Sampling Date Lab. test date	Current Sampling 07-Oct-2025	Previous Sampling 29-Oct-2024	Previous Sampling 22-Sep-2022
Dielectric Breakdown Voltage				
ASTM D1816-Gap 2 mm. (kV)		A 88.7	A 56.5	A 85
Moisture/Water Content				
ASTM D1533 (ppm.)		A 11	A 4.5	A 9

Trending Graph

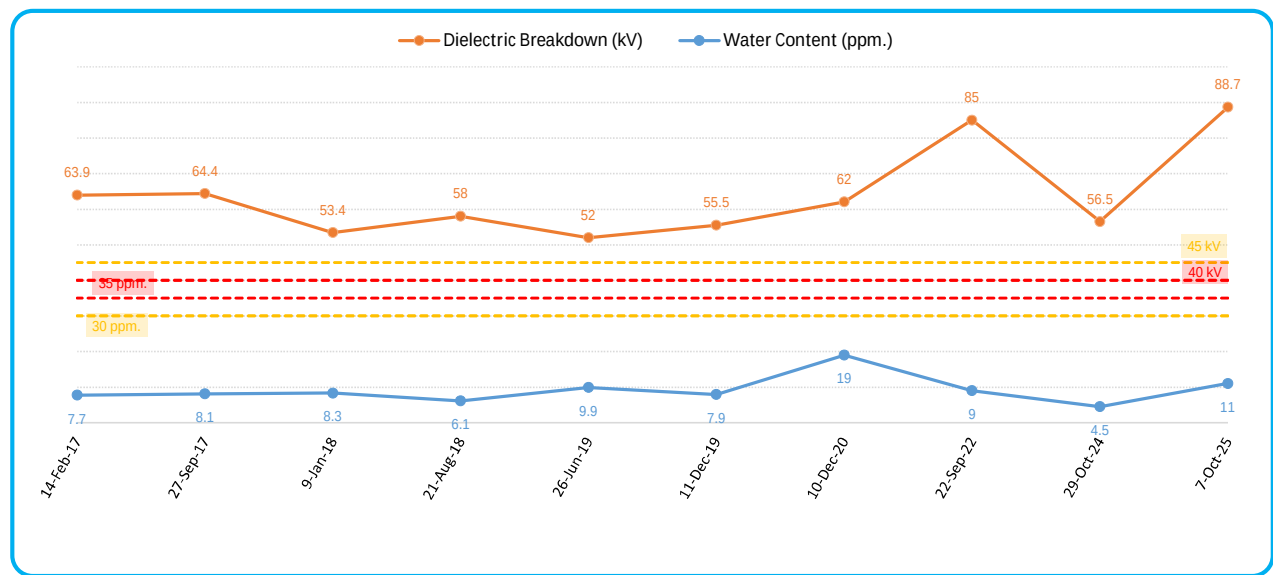

Response	Tested By	Review By	Approved By
Company	Hitachi Energy	-	
Name	Mr. Aekapong Klamchang	-	Mr.Pimchart P.
Signature			
Date	7/Oct/2025	-	7/Oct/2025

MAIN TANK ANALYSIS







Equipment Name	GT2C Bleeding	Site	SITE2
Serial No.	383204886	Power Rating	4500
Manufacture	EAKARAT	Voltage Rating	11 /6.9
Fluid Type	Mineral Oil	Service Type	Auxiliary Transformer

Test Result

	Sampling Date Lab test date	Current Sampling 07-Oct-2025	Previous Sampling 29-Oct-2024	Previous Sampling 22-Sep-2022
The Power Factor				
The Power Factor at 25 °C (%)		A 0.047	A 0.045	A 0.036
The Power Factor at 100 °C (%)		A 1.424	A 0.996	A 1.14
Interfacial Tension (IFT)				
ASTM D971 (dynes/cm)		A 36.5	A 39	A 38
Acid Number				
ASTM D974 (mgKOH/g)		A 0.01	A 0.027	A 0.006

Trending Graph

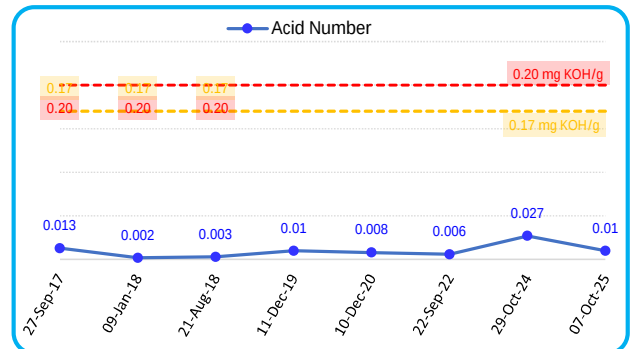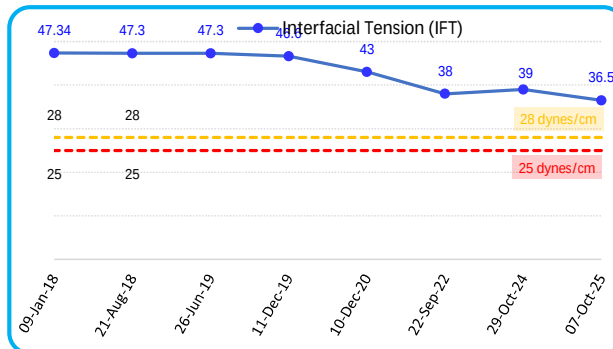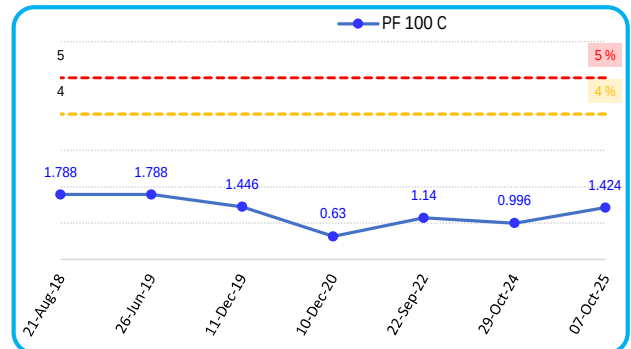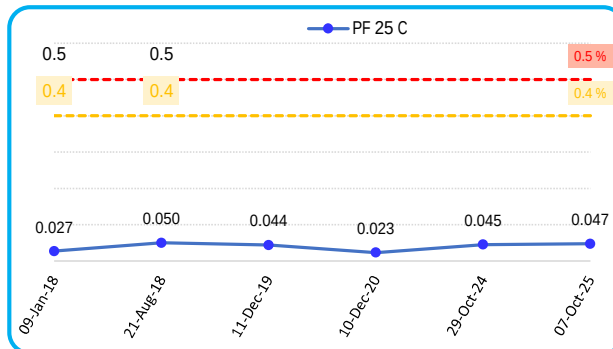

Response	Tested By	Review By	Approved By
Company	Hitachi Energy	-	0
Name	Mr. Aekapong Klamchang	-	Mr.Pimchart P.
Signature			
Date	7/Oct/2025	-	7/Oct/2025

MAIN TANK ANALYSIS







Equipment Name	GT2C Bleeding	Site	SITE2
Serial No.	383204886	Power Rating	4500 kVA
Manufacture	EAKARAT	Voltage Rating	11 /6.9 kV
Fluid Type	Mineral Oil	Service Type	Auxiliary Transformer

Test Result

	Sampling Date Lab test date	Current Sampling 07-Oct-2025	Previous Sampling 29-Oct-2024	Previous Sampling 22-Sep-2022
Oil Conductivity				
IEC 61620 (pS/m)		U 11.8	U 14.8	A 1.7
Color Number				
ASTM D1500		A 0.5	A 0.5	A 0.5
Corrosive Sulfur				
ASTM D1275		Q 3b	Q 3b	U 4A
Passivator				
IEC60666 (ppm.)		- 0	- 0	Q 5

Trending Graph

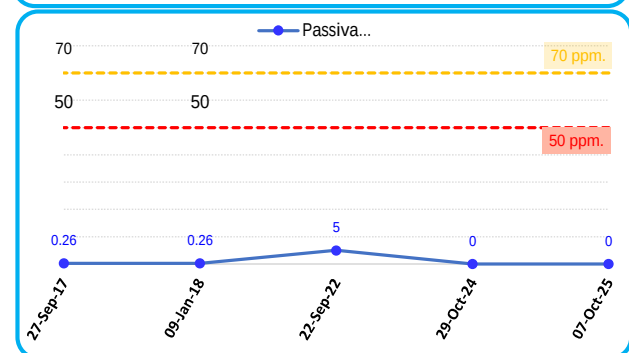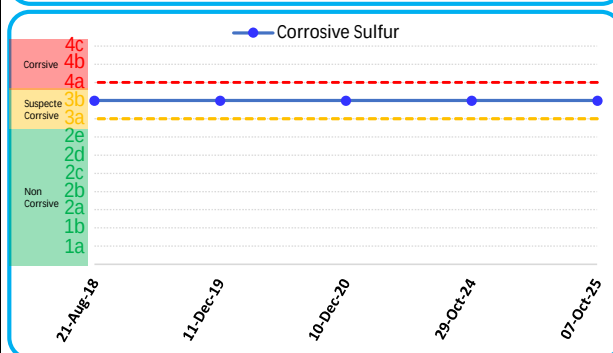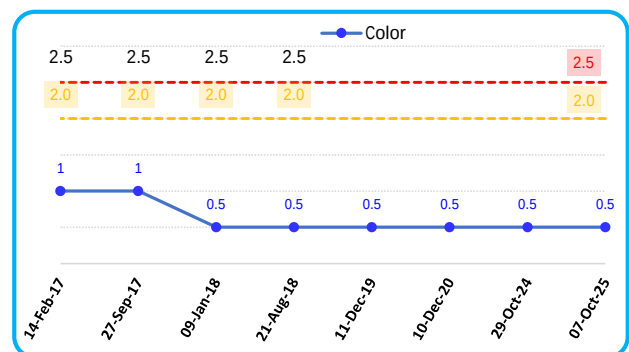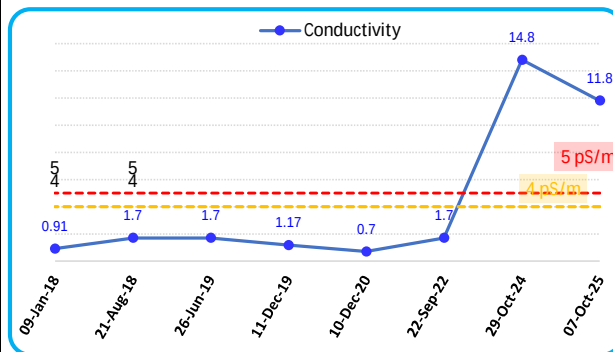

Response	Tested By	Review By	Approved By
Company	Hitachi Energy	-	0
Name	Mr. Aekapong Klamchang	-	Mr.Pimchart P.
Signature			
Date	7/Oct/2025	-	7/Oct/2025

MAIN TANK ANALYSIS







Equipment Name	GT2C Bleeding	Site	SITE2
Serial No.	383204886	Power Rating	4500 kVA
Manufacture	EAKARAT	Voltage Rating	11 /6.9 kV
Fluid Type	Mineral Oil	Service Type	Auxiliary Transformer

Test Result

	Current Sampling 07-Oct-2025	Previous Sampling 29-Oct-2024	Previous Sampling 22-Sep-2022
Sampling Date Lab test date			
Sediment and sludge			
IEC60422 (%w)	A 0.01	- 0	U 0.02
Inhibitor			
ASTM D3487 (%Minimum if in original oil)	- -	- -	- -
Furan [2-FAL]			
ASTM D5837 (ppb.)	A 4	A 0.02	A 5
Estimated DP (Chengdong Equation)			
The research by Dominelli [CIGRE323]	A 1117	A 1774	A 1089

Trending Graph

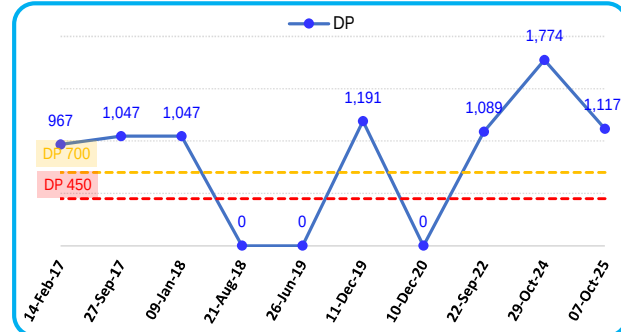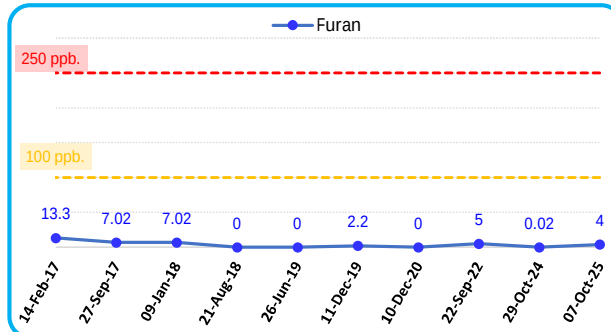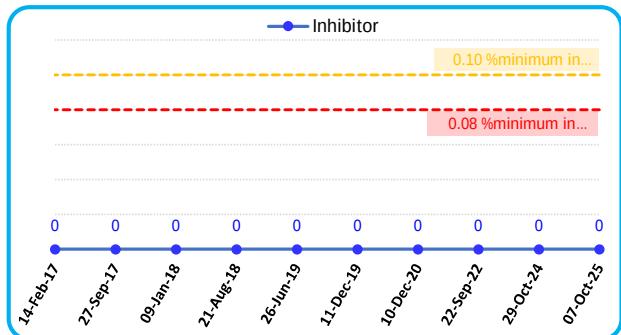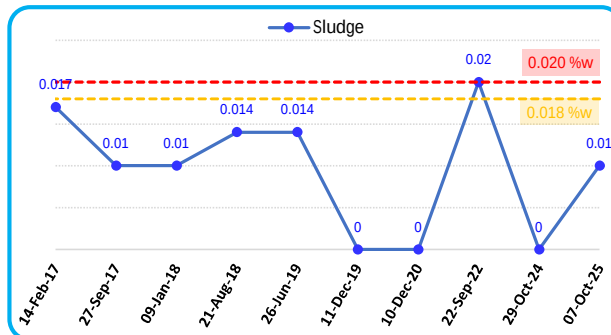

Response	Tested By	Review By	Approved By
Company	Hitachi Energy	-	0
Name	Mr. Aekapong Klamchang	-	Mr.Pimchart P.
Signature			
Date	7/Oct/2025	-	7/Oct/2025