

## PUMP TEST REPORT


|                 |            |
|-----------------|------------|
| Invoice Number: | 1          |
| Customer:       | MEZE FOODS |
| Job Number:     | 1          |

| FABRICATION        |               | HYDRAULIC TEST    |            |
|--------------------|---------------|-------------------|------------|
| Pump Model:        | P1 1.1KW      | Date of Test:     | 2025-03-24 |
| Serial Number:     | 4101 003 - 25 | Duration of Test: | 1 HOUR     |
| Impeller Diameter: | 160           | Test Medium:      | WATER      |
| Assembled By:      | tester1       | Tested By:        | tester1    |

| DETAILS          |       |                    |         |
|------------------|-------|--------------------|---------|
| Motor Size:      | 4KW   | Frequency:         | 50      |
| Motor Speed:     | 2880  | Pump Housing:      | S/S 316 |
| Motor Volts:     | 380   | Pump Connection:   | DIN     |
| Motor Enclosure: | IP 55 | Suction:           | 50      |
| Mechanical Seal: | TC/TC | Discharge:         | 40      |
|                  |       | Flush Arrangement: | No      |

### TEST RESULTS

| Test   | Flowrate (L/h) | Pressure (bar) | Amperage (A) |
|--------|----------------|----------------|--------------|
| Test 1 | 17912          | 2.85           | 6.19         |
| Test 2 | 12050          | 3.05           | 5.52         |
| Test 3 | 8078           | 3.05           | 5.2          |
| Test 4 | 4089           | 3.05           | 4.87         |
| Test 5 | 0              | 3.05           | 4.74         |

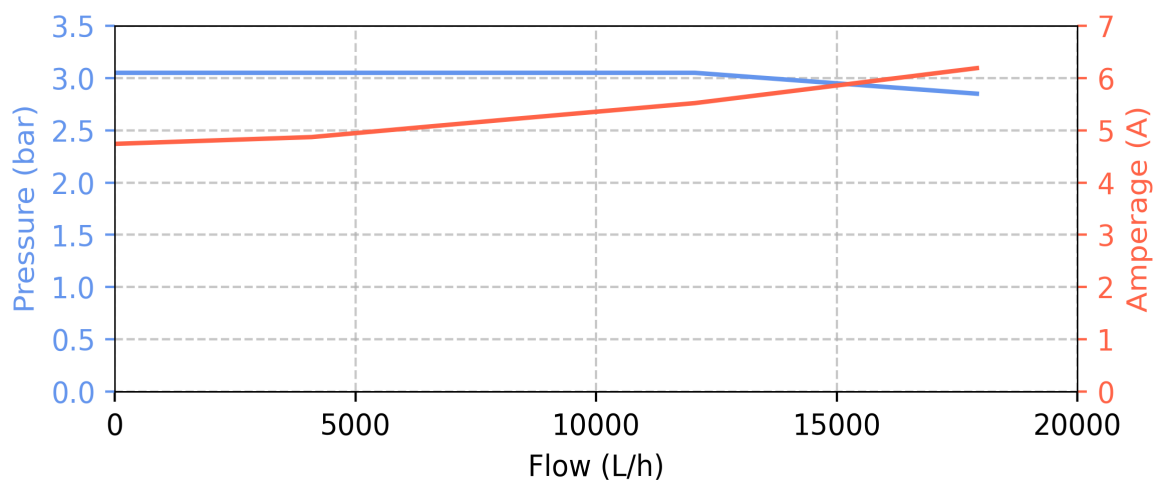

| APPROVAL     |            |  |  |
|--------------|------------|--|--|
| Approved By: | approver1  |  |  |
| Date:        | 2025-03-24 |  |  |