


STS-3 ELECTRICAL BOX ASSY. P/N 54445 REV B

NOTE: New UL requirement – 24 VAC remote wire connections are now located in the electrical box in its own enclosure. Electrician will have to run remote wires into the low voltage section through the strain relief

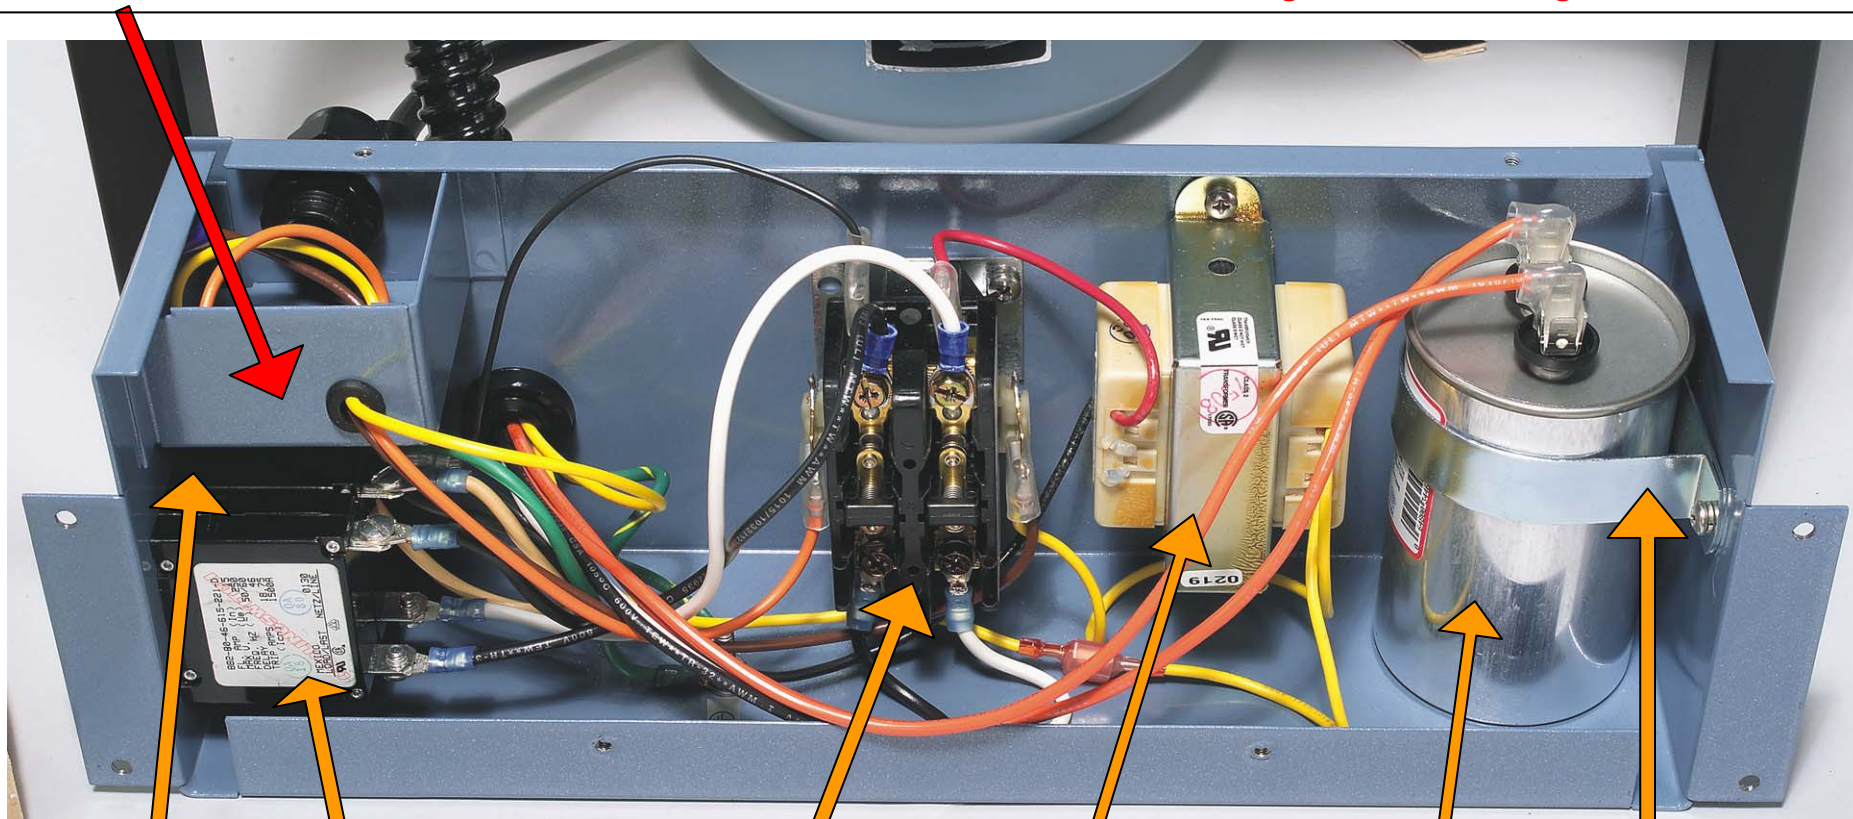

CIRCUIT
BREAKER
¼ AMP
LOW
VOLTAGE
P/N 117690

CIRCUIT
BREAKER
ON/OFF
15 AMP
P/N 54247

CONTACTOR
230 VAC
P/N 55407

TRANSFORMER
230 VAC TO 24
VAC DRY VAC
P/N 54623

CAPACITOR 50
MFD 440 VAC
2.5" DIAMETER
P/N 54323

CLAMP
CAPACITOR
P/N 80178-4P