


# STS-5 ELECTRICAL BOX ASSY. S/N 500 & ABOVE

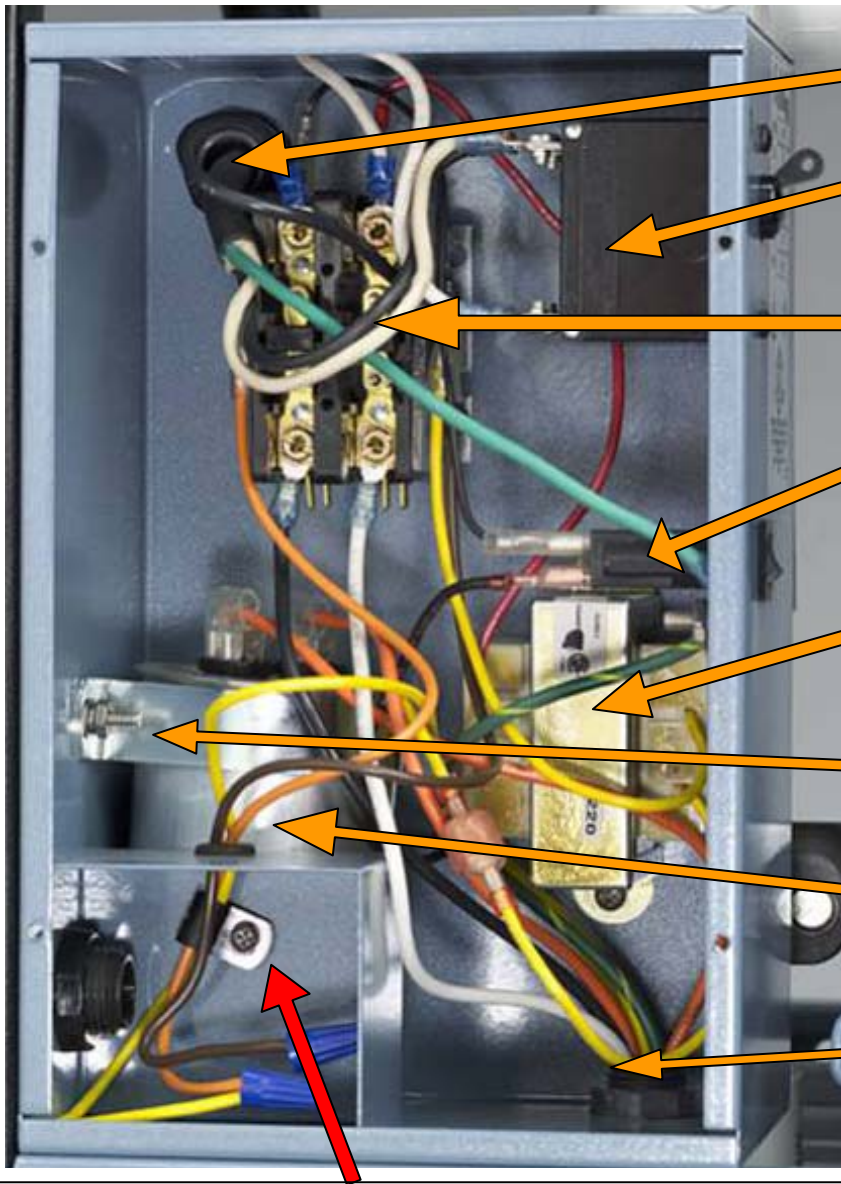

- LINE CORD ASSY. 230V P/N 54383
- CIRCUIT BREAKER ON/OFF 15 AMP P/N 54247
- CONTACTOR 230 VAC P/N 55407
- CIRCUIT BREAKER 1/4 AMP LOW VOLTAGE P/N 117690
- TRANSFORMER 230VAC TO 24VAC DRY VAC P/N 54375
- CLAMP CAPACITOR P/N 80178-4P
- CAPACITOR 50 MFD 440VAC 2.5 " DIAMETER P/N 54323
- WIRE HARNESS ASSEMBLY STS P/N 54286

**NOTE: New UL requirement** – 24 VAC remote wire connections are now located in the electrical box in its own enclosure. Electrician will have to run remote wires into the low voltage section through the strain relief