

Tech West Ultra Clean Compressor LUBRICATED


QUICK INSTALL

1. New Installations

- For new installations, mount relay control unit near compressor and near power. Mount remote control panel in a convenient to use location, and identify compressor location. Note distance and determine amount of wire and other materials necessary.

2. Connect Remote Control Panel


- Color code and attach wires from the "AIR" ("A") control on the Remote Control Panel to the top of the Relay Control Unit ("B").

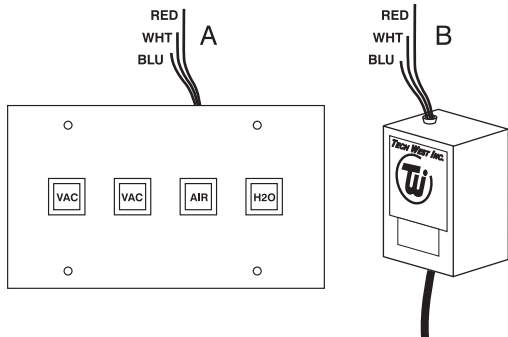

3. Connect Remote Control Panel

- Color code and attach wires from the "AIR" ("A") control on the Remote Control Panel to the top of the Relay Control Unit ("B").

4. Relay Control 24V/115-230V (wall mount control unit)

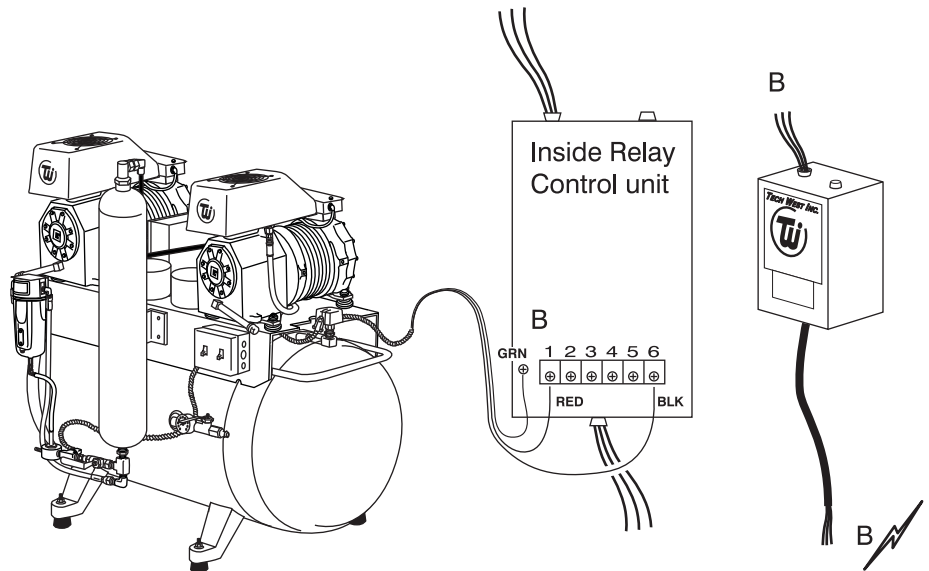

- Hard wire to a fused 230V power source.
- Attach compressor red and black wires to relay control unit. Attach Red wire to terminal "1" and black wire to terminal "6". Attach green wire to ground terminal.

