Historical contact-state diagnostic: actual successful and failed suffixes

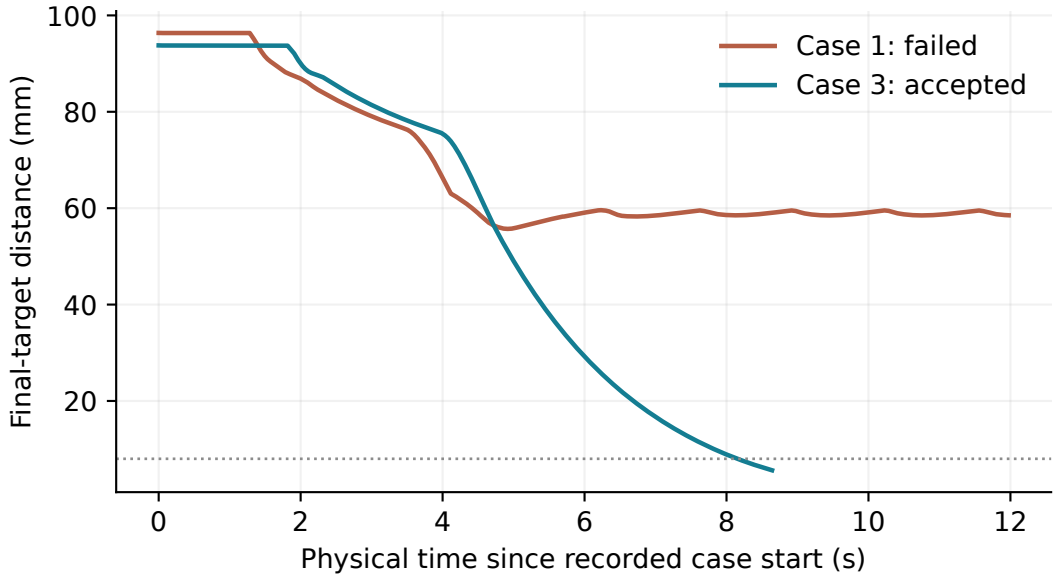

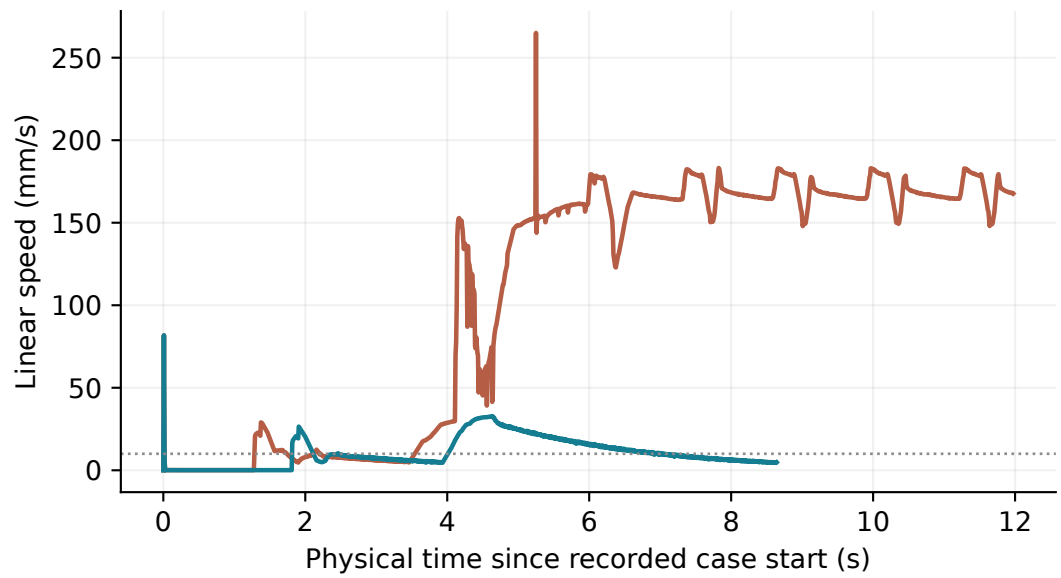

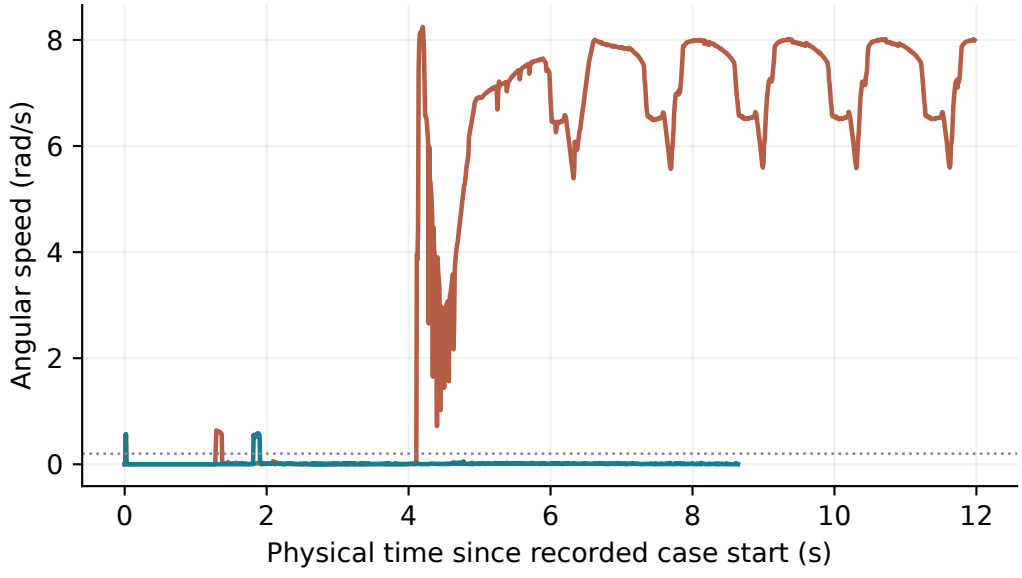

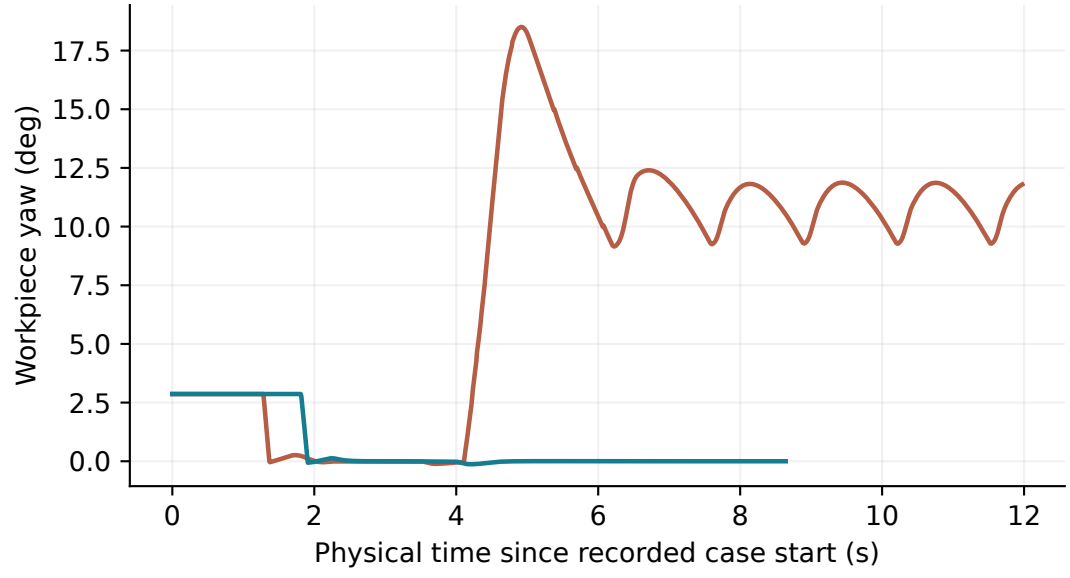

Explicit diagnostic cases 1 and 3 from residual seed31 validation. Recorded 120 Hz PhysX states; CSV decimated 4x for readability.
These are different cases, not a controlled velocity/rotation intervention; no causal or population claim.