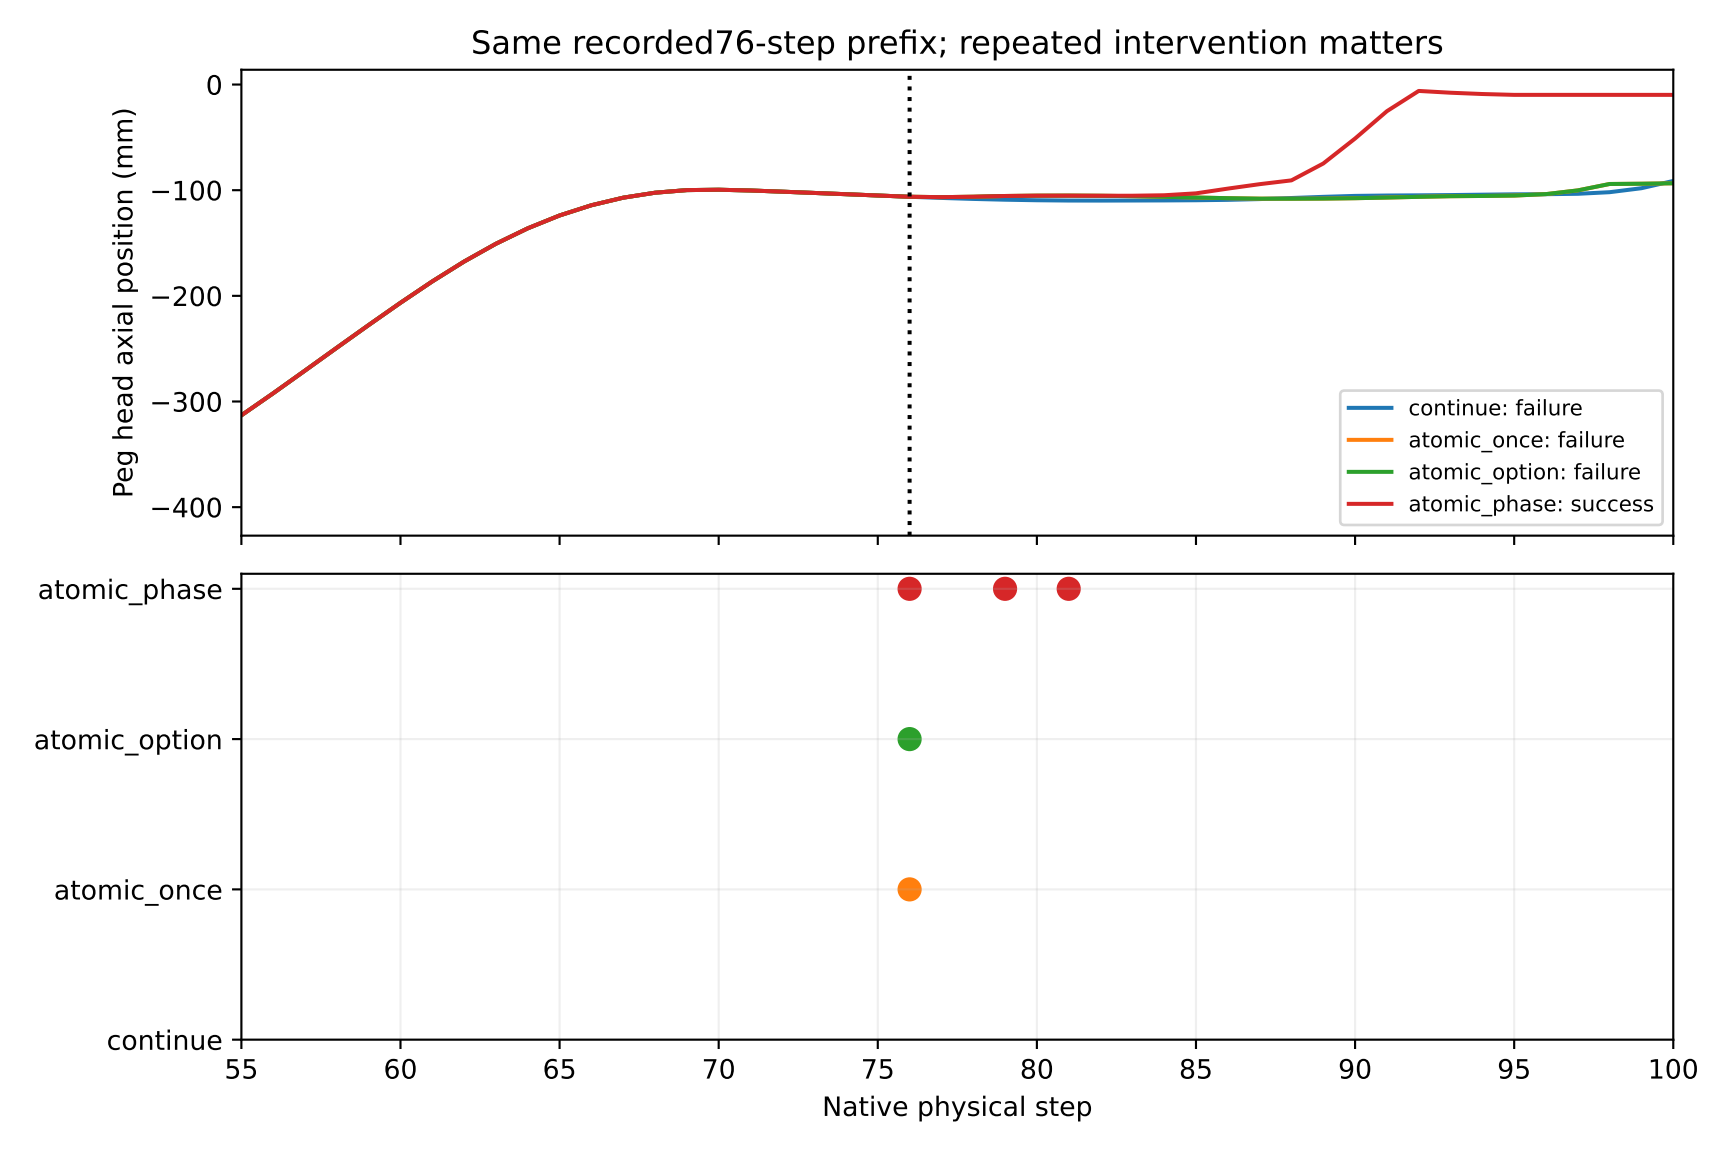
Same recorded76-step prefix; repeated intervention matters
Peg head axial position (mm)
0
−100
−200
−300
−400
continue: failure
atomic_once: failure
atomic_option: failure
atomic_phase: success
atomic_phase
atomic_option
atomic_once
continue
55
60
65
70
75
80
85
90
95
100
Native physical step