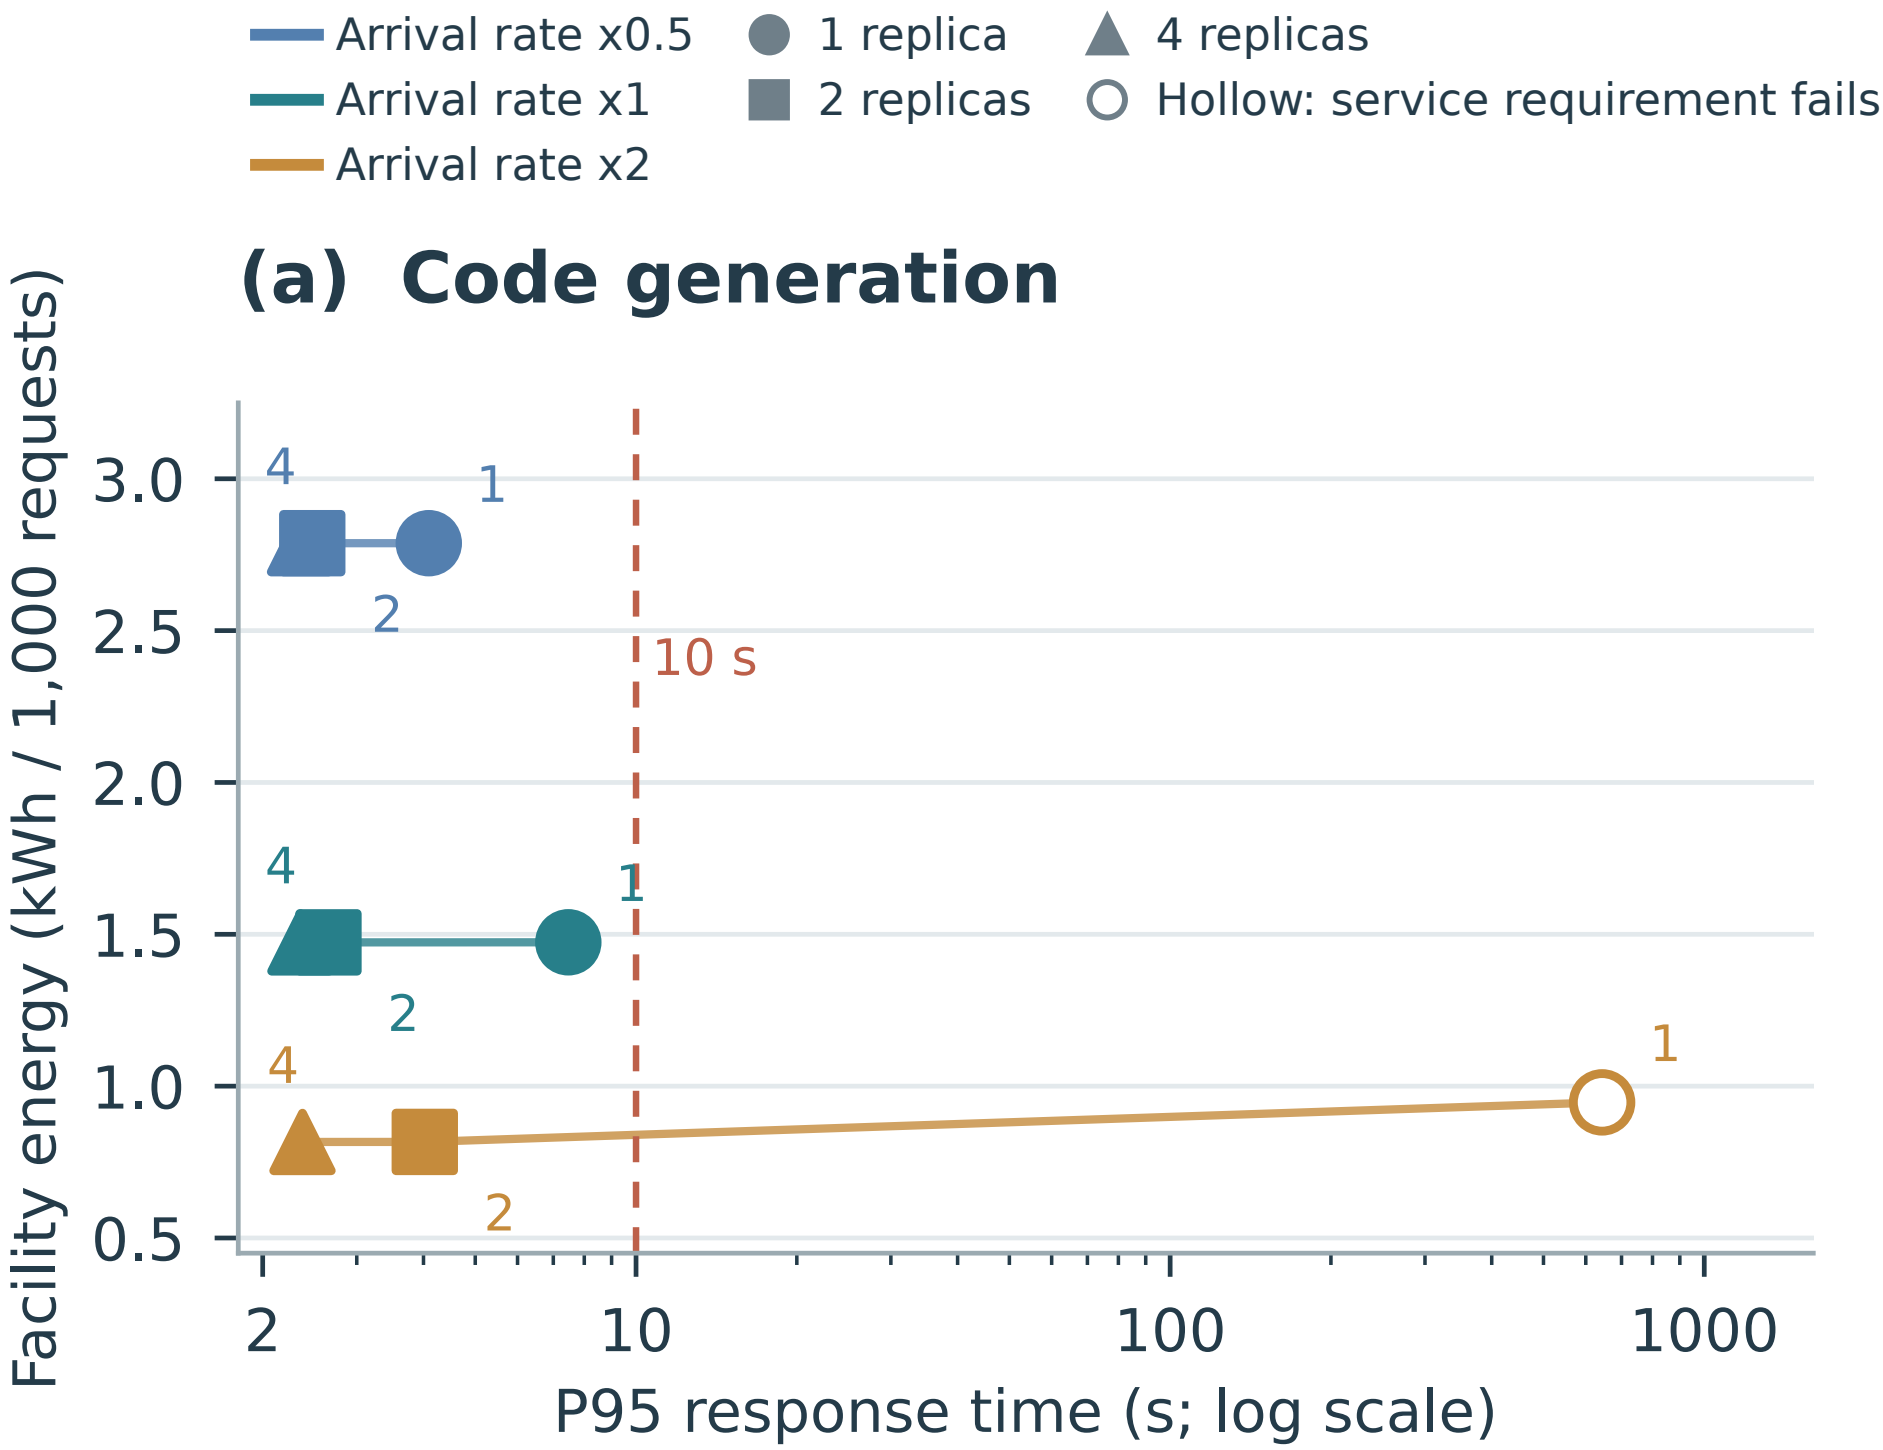
Arrival rate x0.5
Arrival rate x1
Arrival rate x2
1 replica
2 replicas
4 replicas
Hollow: service requirement fails
(a) Code generation
Facility energy (kWh / 1,000 requests)
3.0
2.5
2.0
1.5
1.0
0.5
10 s
4
1
2
4
1
2
4
1
2
2
10
100
1000
P95 response time (s; log scale)