

Johnson Lifts Private Limited

PLOT NO.R7/2 & 3, NORTH MAIN ROAD, ANNA NAGAR WESTERN EXTN. CHENNAI PIN: 600101

ROHIT BUILDERS

JOB NO L-R2970

10, RANGAN STREET, T
NAGAR, CHENNAI,
TAMILNADU, PIN:
600017,

DATE :-Tue Oct 11 2022 12:49:57 GMT+0530 (India Standard Time)

Respected sir,

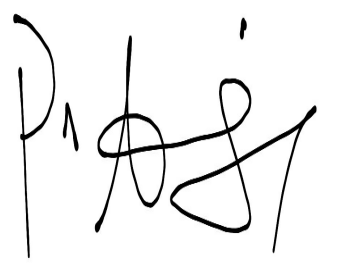
With ref to our site visit /inspection we have found the following works are pending from your side & the same has been informed to your supervisor / engineer. We request you to complete the below pending work at the earliest to prepare lift shaft for material delivery and lift installation.

S.No	TASK DESCRIPTION	STATUS
1	MACHINE ROOM LIFTING HOOK / LIFTING BEAM TO BE PROVIDED AS PER OUR GAD	No
2	SMOKE WINDOW TO BE PROVIDED FOR MRL TYPE LIFT AS PER GAD	No
3	LIFT WELL BRICK WORK AND PLASTERING, TO BE COMPLETED AS PER GAD.	No
4	LIFT WELL ENTRANCE WALL BRICK WORKS, LINTAL WORKS & PLASTERING AT ALL FLOOR LANDINGS TO BE COMPLETED ONLY FOR POD LIFTS/MS SWING DOOR LIFTS	No
5	LIFT PIT TO BE FINISHED AS PER GAD _____ MM AND WATER PROOFING TO BE DONE	No
6	SCAFFOLDING TO BE COMPLETED AS PER THE SKETCH GIVEN BY JOHNSON LIFTS.	No
7	LIFT WELL WHITE WASHING ONE COAT TO BE COMPLETED	No
8	STORE ROOM TO BE PROVIDED PREFERABLY AT GROUND FLOOR WITH LOCKABLE ARRANGEMENT NEAR THE LIFT SHAFT WITH ADEQUATE LIGHTING	No
9	TEMPORARY SINGLE PHASE POWER SUPPLY, 5 AMPS, 3 PIN PLUG WITH SWITCH TO BE PROVIDED NEAR THE LIFT SHAFT	No
10	MACHINE ROOM 3 PHASE POWER SUPPLY METAL PANNEL BOARD TO BE PROVIDED WITH SUITABLE 4 POLE MCB 1 NO. _____ AMPS AND ELCB 1NO _____AMPS .	No
11	MACHINE ROOM SINGLE PHASE POWER SUPPLY TO BE PROVIDED WITH SUITABLE 2 POLE MCB (3 NOS.) FOR SHAFT, MACHINE ROOM AND LIFT LIGHTING	No
12	TWO INDEPENDENT EARTH TERMINALS (8 GAUGE COPPER / G1 WIRE) TO BE PROVIDED TO THE MACINE ROOM.	No
13	TWO NOS. 40 W. TUBE LIGHTS TO BE FIXED IN THE MACHINE ROOM	No
14	POWER CABLE TO TAKEN OUTSIDE OF THE LIFT SHAFT (NOT APPLICABLE FOR MAHARASHTRA STATE)	No
15	PERMANENT LIFT WELL LIGHTING WITH 5 AMPS 3 PIN PLUG WITH SWITCH AS PER DRAWING	No
16	TEMPORARY LIGHTING ARRANGEMENT TO BE PROVIDED AT THE LIFT SHAFT AREA FOR LIGHTING DURING ERECTION TIME	No
17	TWO NOS. TUBE LIGHT TO BE FIXED AT THE HEAD ROOM FOR MRL TYPE LIFTS	No

Remarks :-

lift shaft 2nd floor work in progress.

Site Engineer Signature

A handwritten signature in black ink, appearing to be 'P. Singh' or similar, written in a cursive style.

Name :- Vellore gastro care Pvt limited

Designation :- owner