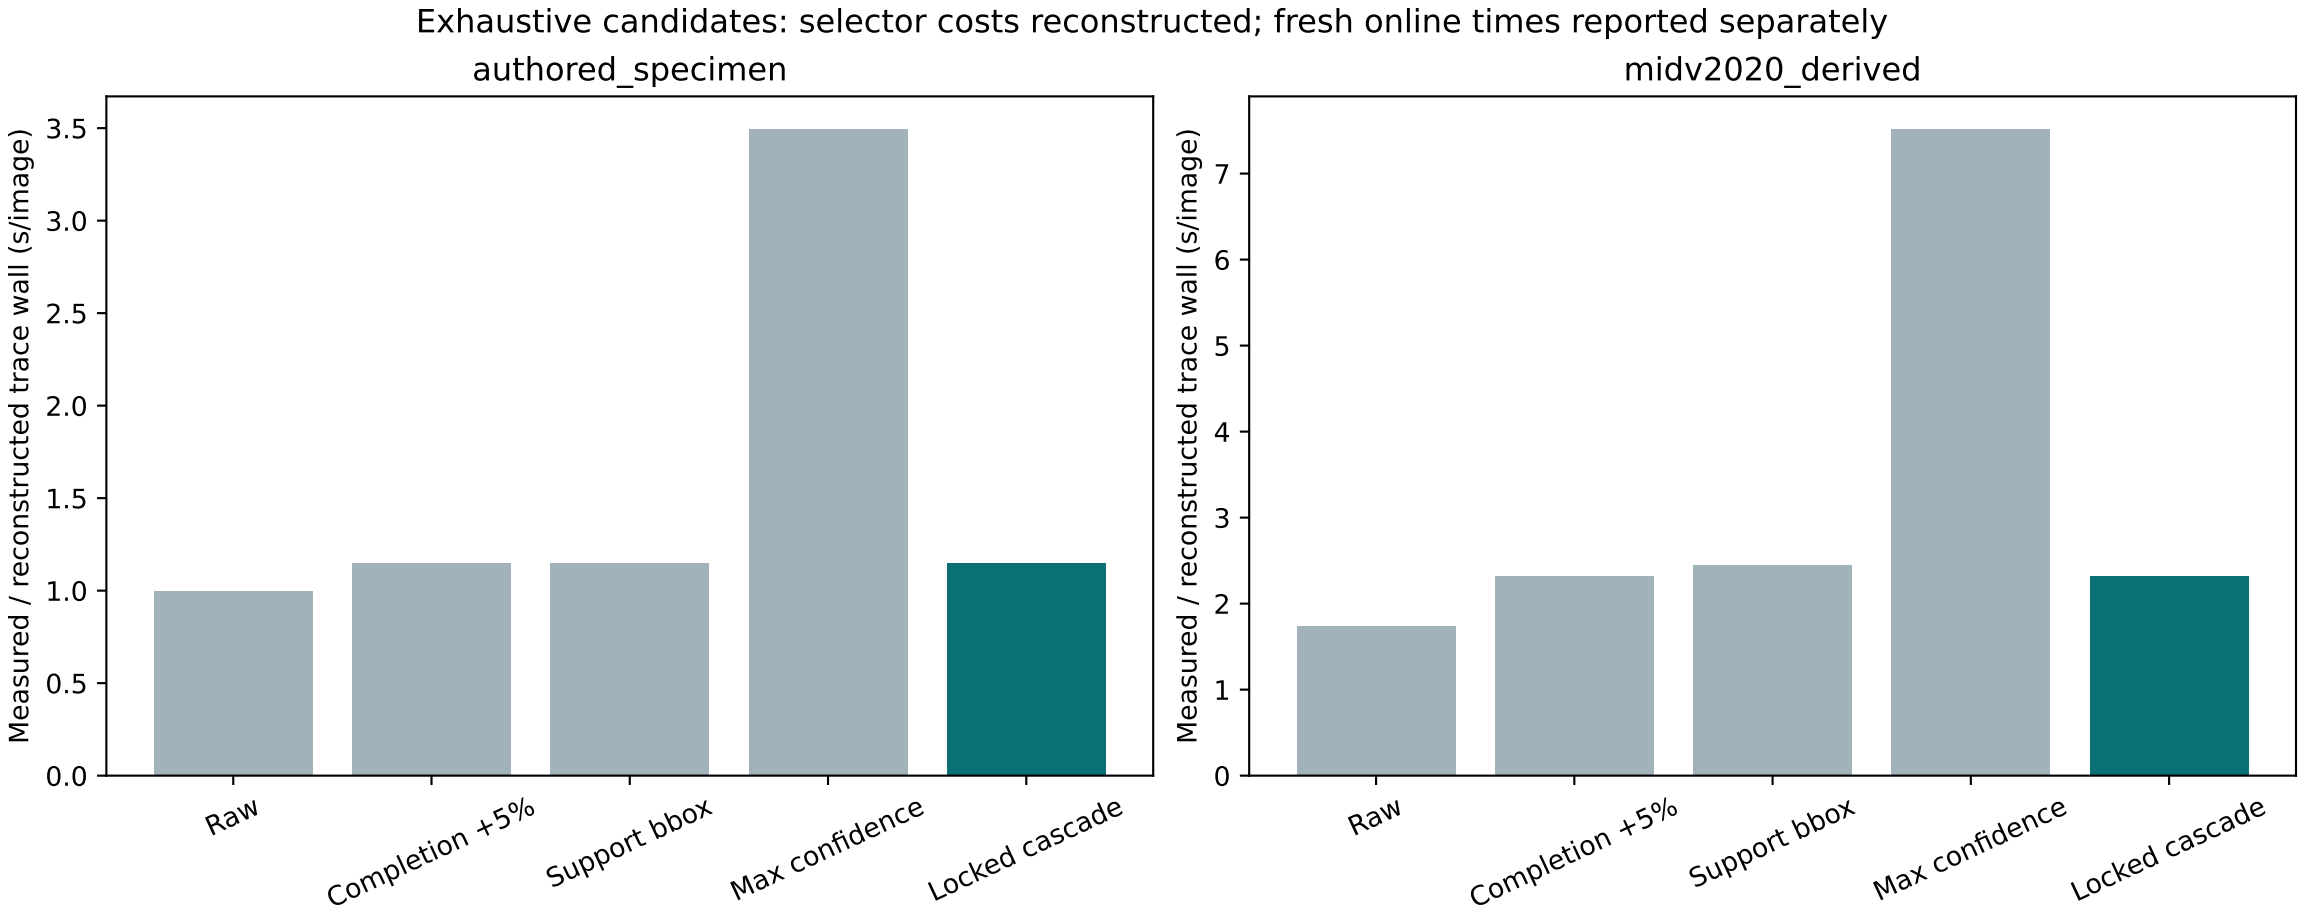
Exhaustive candidates: selector costs reconstructed; fresh online times reported separately
authored_specimen
midv2020_derived
Measured / reconstructed trace wall (s/image)
0.0
0.5
1.0
1.5
2.0
2.5
3.0
3.5
0
1
2
3
4
5
6
7
Raw
Completion +5%
Support bbox
Max confidence
Locked cascade