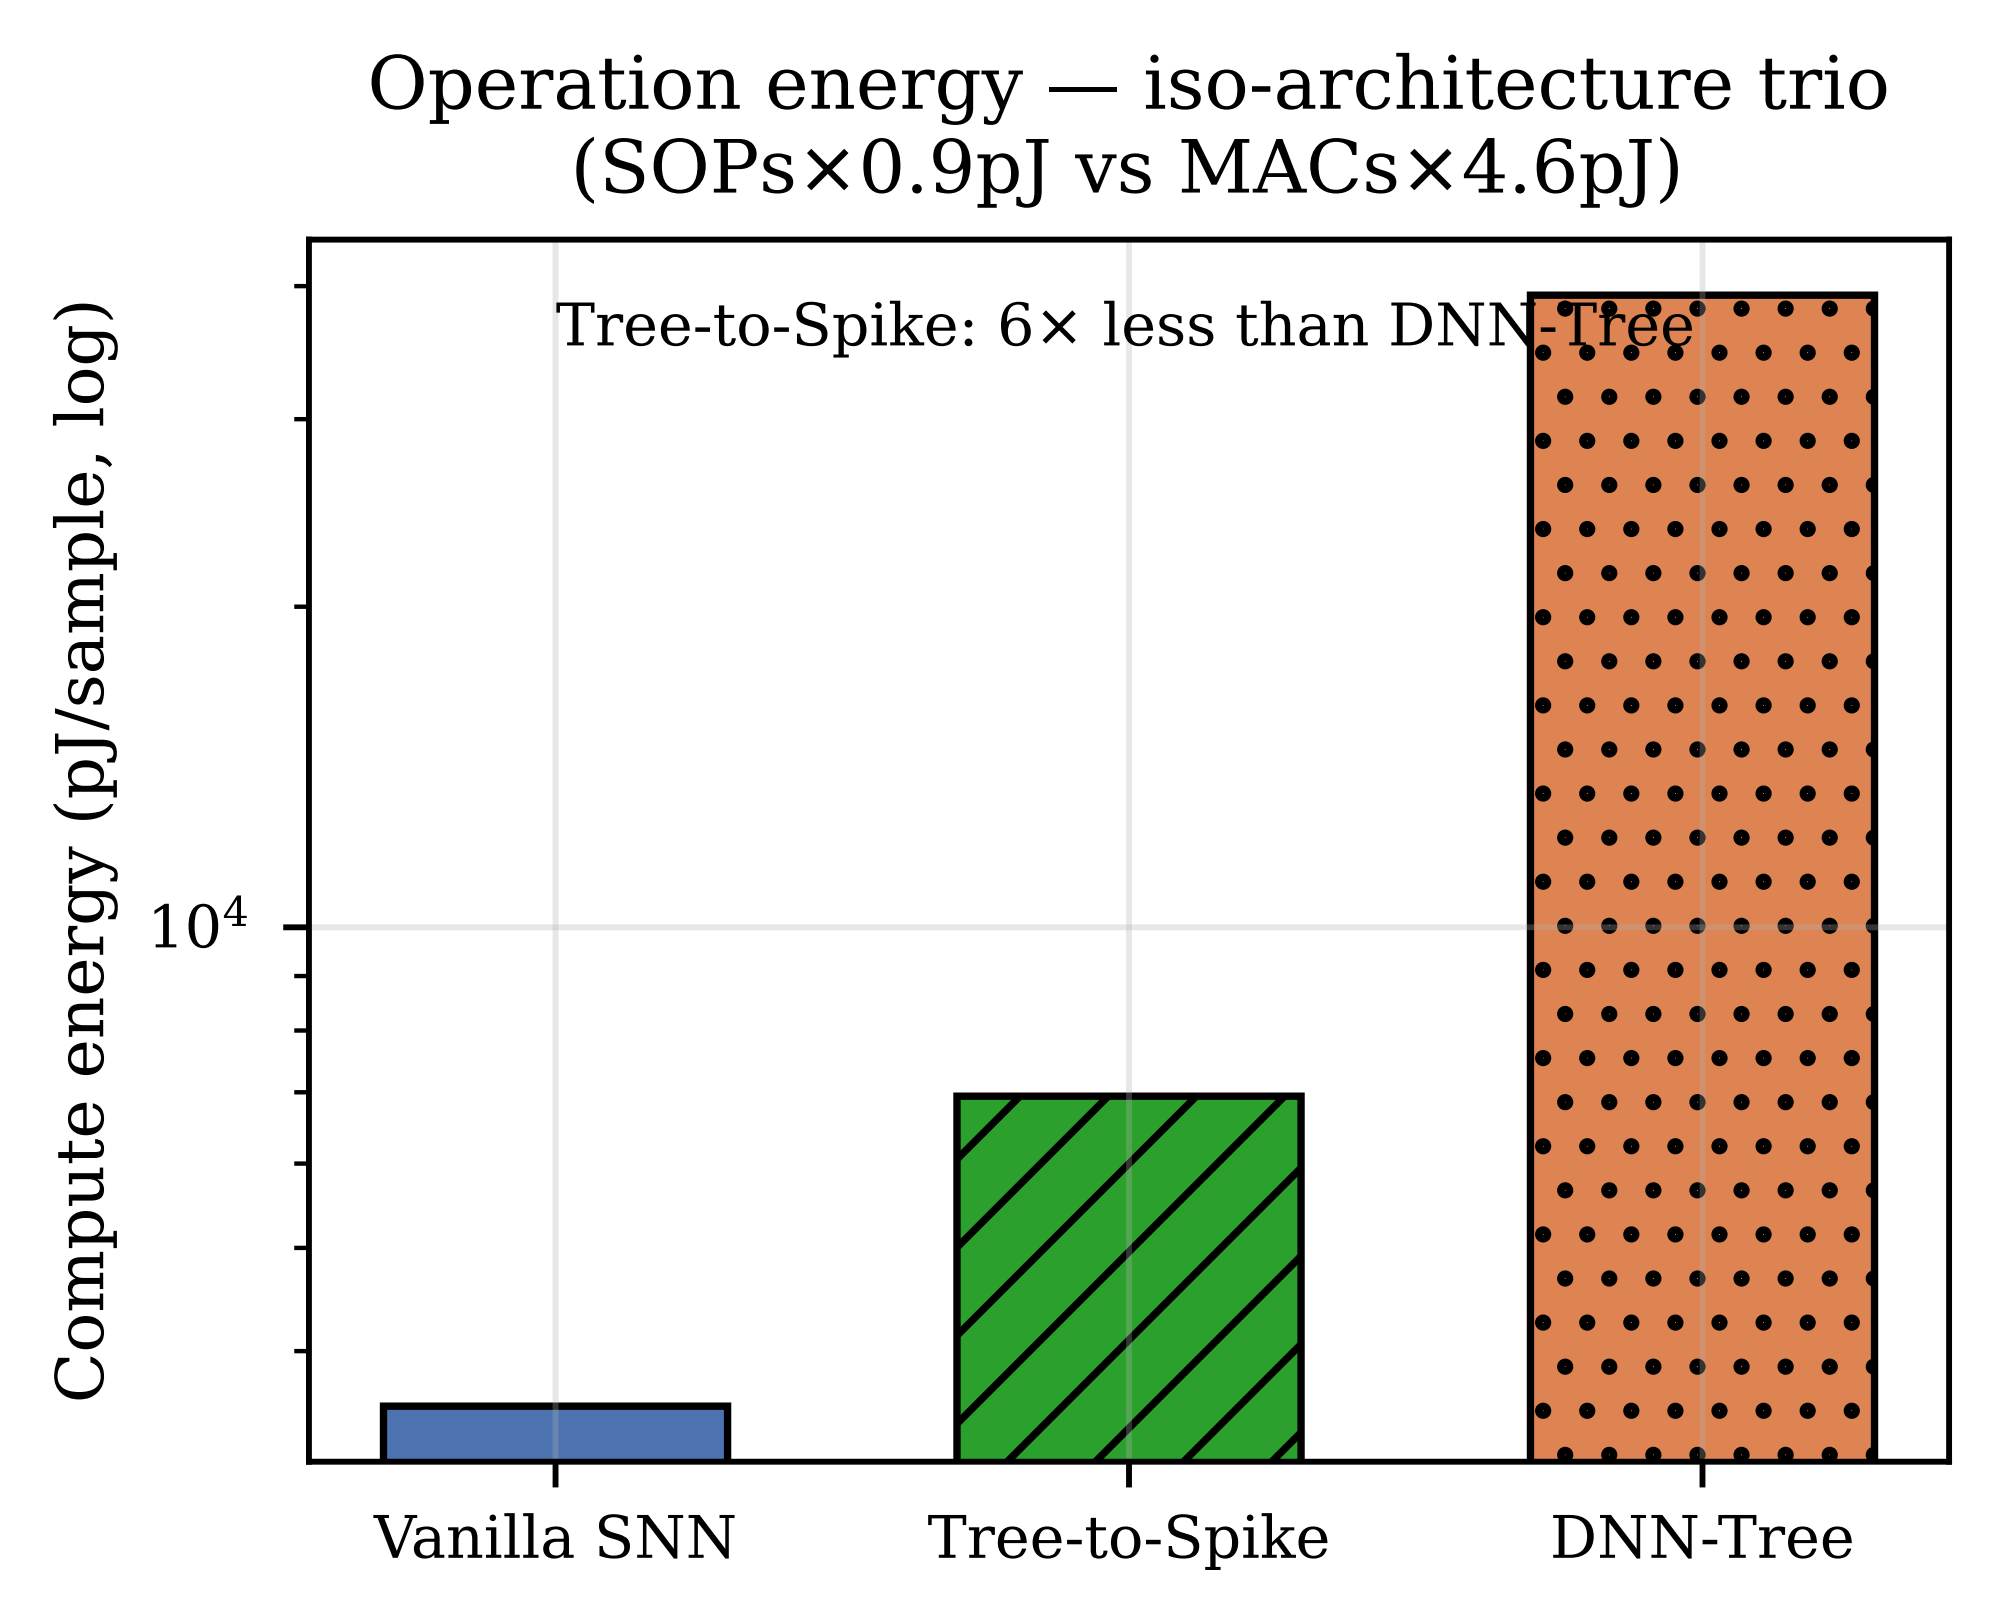
Operation energy — iso-architecture trio
(SOPs×0.9pJ vs MACs×4.6pJ)
Tree-to-Spike: 6× less than DNN-Tree
Compute energy (pJ/sample, log)
10^4
Vanilla SNN
Tree-to-Spike
DNN-Tree