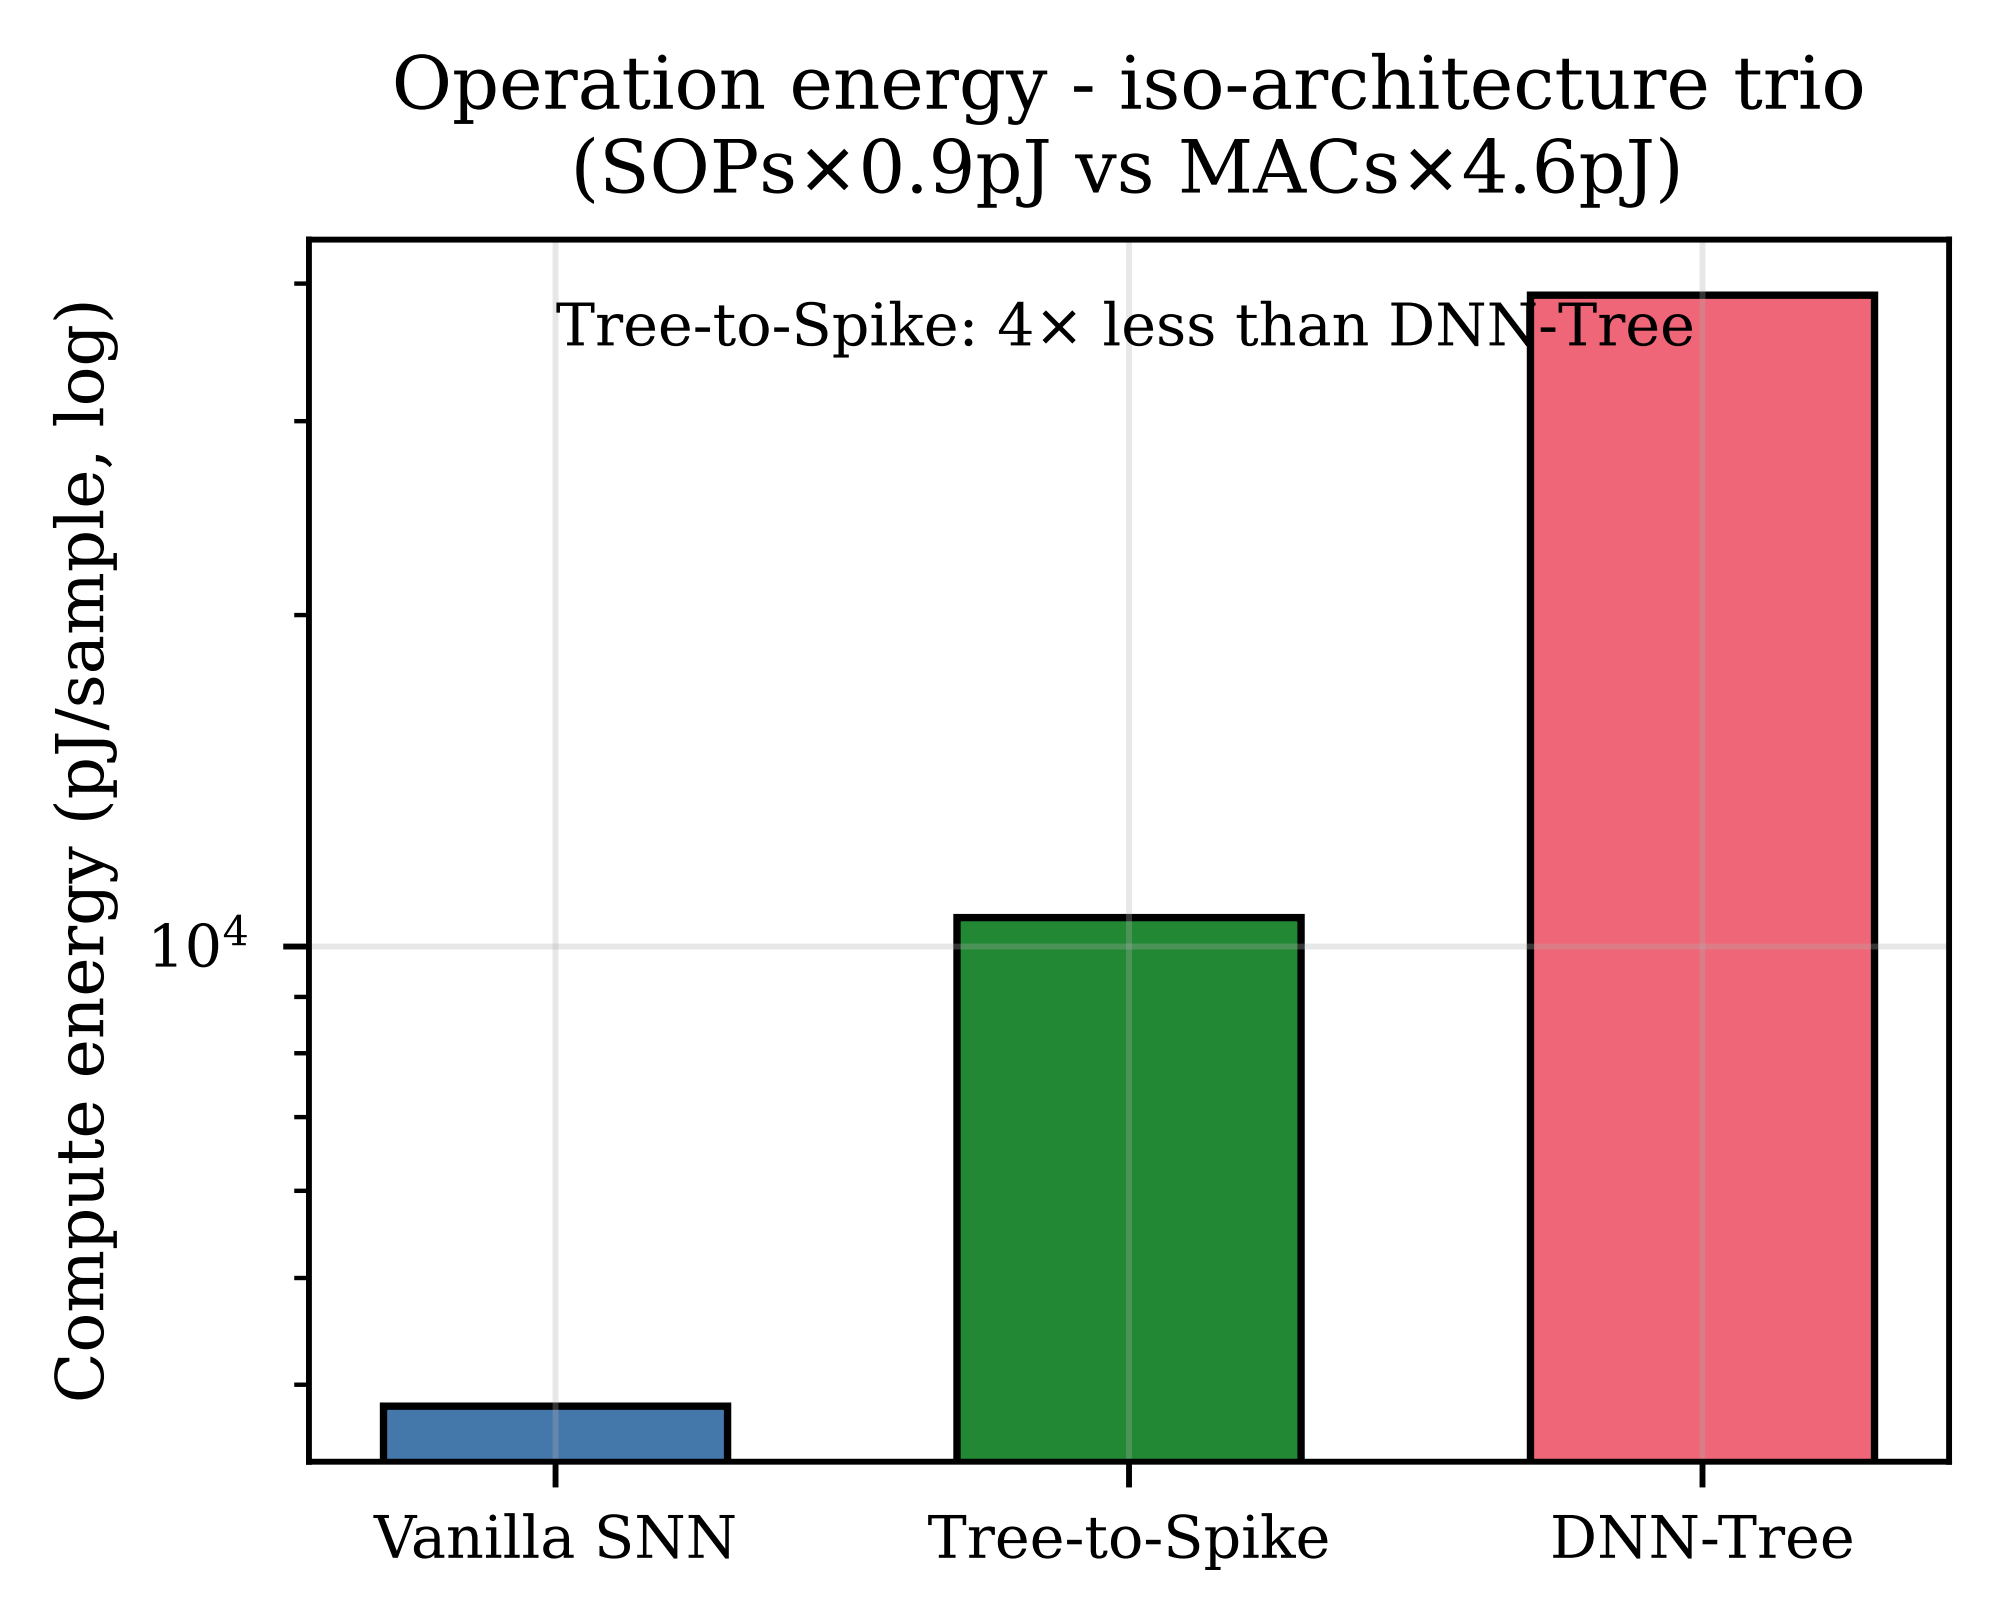
Operation energy - iso-architecture trio
(SOPs×0.9pJ vs MACs×4.6pJ)
Tree-to-Spike: 4× less than DNN-Tree
Compute energy (pJ/sample, log)
$10^4$
Vanilla SNN
Tree-to-Spike
DNN-Tree