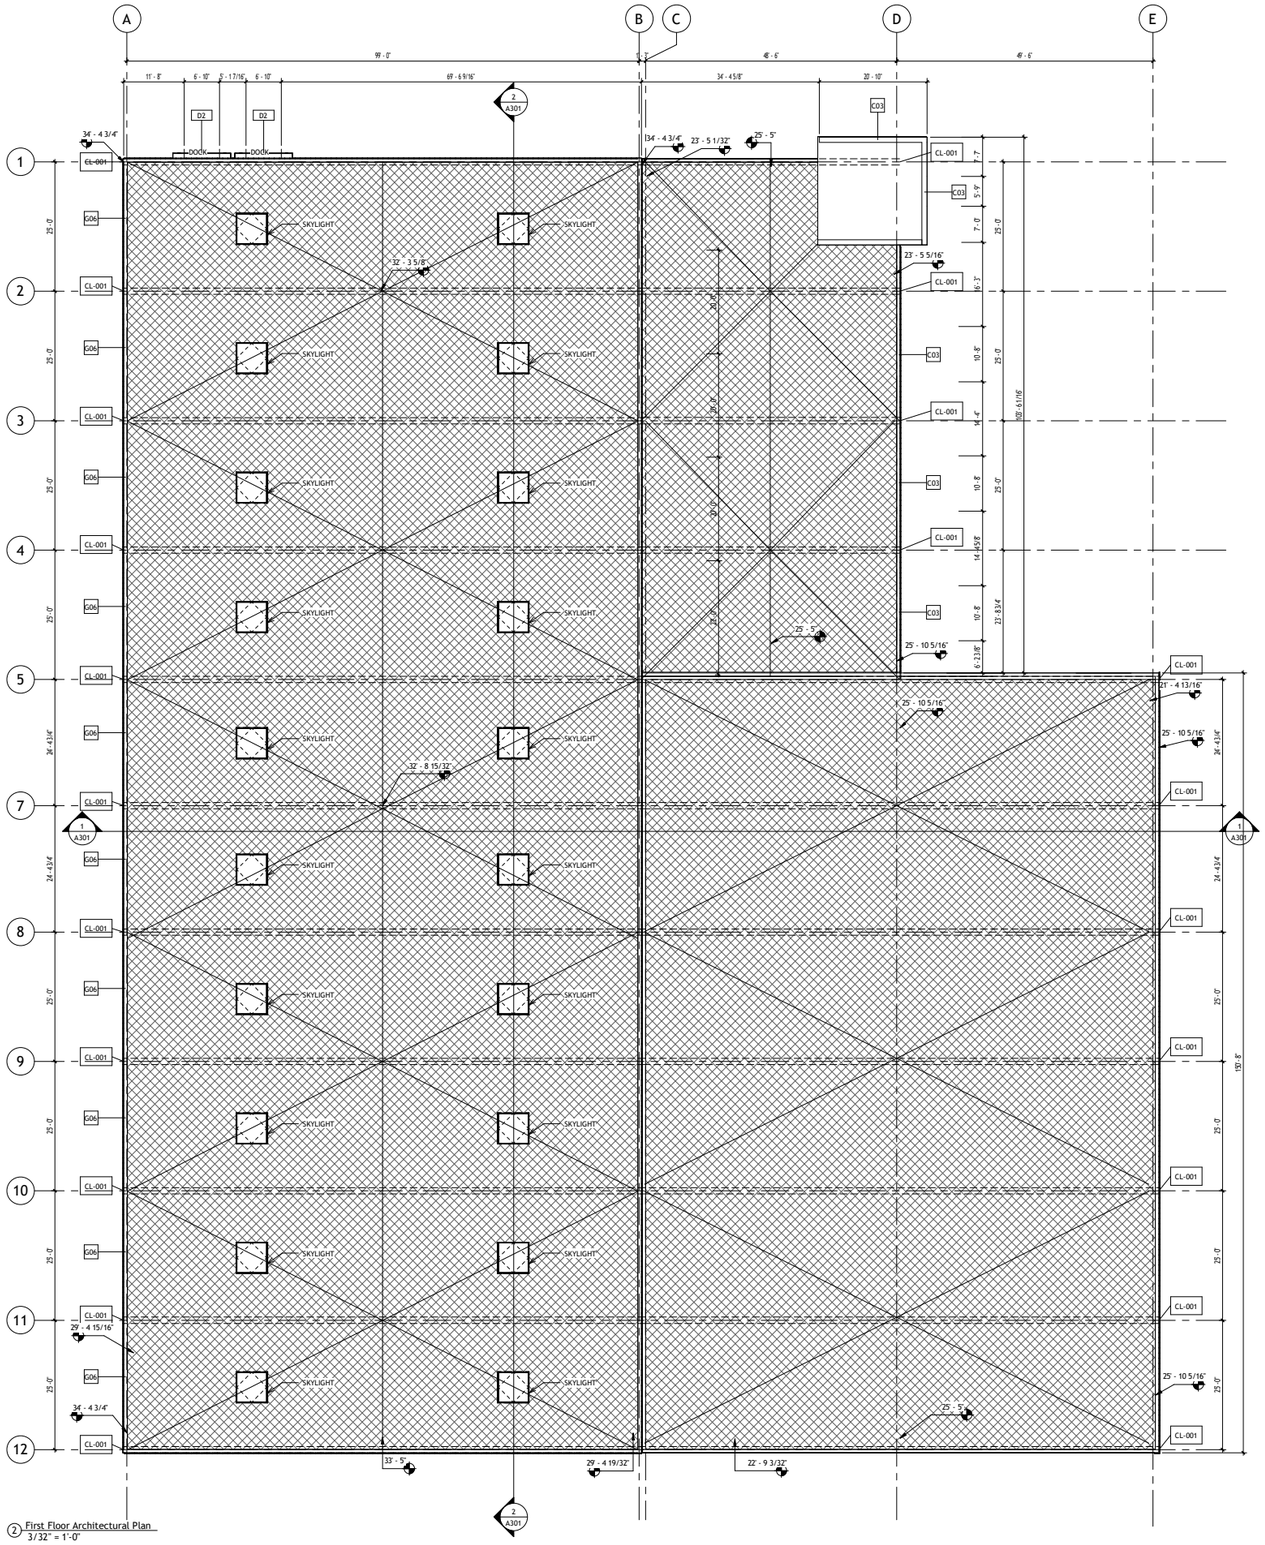

2 First Floor Architectural Plan
3/32" = 1'-0"

ROOFING NOTES (TYPICAL):

1. PROVIDE FULL MANUFACTURERS WARRANTY ON MATERIALS AND 5 YEAR WARRANTY MIN. ON LABOR. U.N.O.
2. ALL COLORS, ASSEMBLIES AND MATERIALS MUST MEET APPROVAL OF OWNER AND DESIGN PROFESSIONAL.
3. PROVIDE PRODUCT SUBMITTALS FOR PRE APPROVAL PRIOR TO ORDERING AND INSTALLATION
4. FOR TYPICAL ROOF/FLASHING DETAILS, SEE ROOFING DETAILS SHEET
5. PROVIDE STEP FLASHING COUNTER FLASHING, DRIP EDGES AS REQ'D. CAULK AND SEAL. ROOFING TO EXTEND 18" MIN. UP ADJACENT WALLS AND DISCONTINUITIES TYPICAL.
6. INSTALL ROOF PER MANUFACTURERS RECOMMENDATIONS AND SPECIFICATIONS. MANUFACTURER TO INSPECT INSTALLATION AS REQ'D FOR WARRANTEE. PROVIDE 1/4" PER FOOT MIN. SLOPE.
7. FOR ALL PLUMBING PENETRATIONS REFER TO DETAILS ON ROOFING DETAILS SHEET AND PLUMBING DRAWINGS.
8. TYPICAL MINIMUM ROOF SLOPE @ 1/4" MIN. PER FOOT ALL PLACES.
9. SEE MECHANICAL PLAN FOR ROOF MOUNTED EQUIPMENT AND CURBS, ETC.
10. CONSTRUCT ROOF FREE OF NON-DRAINING AREAS, WITH POSITIVE SLOPE TO DRAIN, UNDER ALL CONDITIONS. SUCH DEFECTS THAT CREATE AREAS NOT SUITED TO FREE DRAINAGE SHALL BE CAUSE FOR REJECTION OF THE INSTALLATION UNTIL CORRECTED.
11. PROVIDE CRICKETS WITH 1/4" PER FOOT MINIMUM SLOPE AT THE ASLOPE SIDE OF ALL EQUIPMENT CURB LOCATIONS & AT ALL PENETRATIONS GREATER THAN 30 INCHES WIDE AS MEASURED PERPENDICULAR TO THE SLOPE.
12. PROVIDE INSULATION WITH TOTAL BUILD UP THICKNESS AS REQUIRED TO ATTAIN LONG-TERM R-VALUE AS SPECIFIED IN ENERGY MODEL OR CROSSCHECK.
13. PROVIDE WALKWAY PROTECTION MAN AT ALL ROOF ACCESS AND LADDER LOCATIONS.
14. THE ROOF DECK TO SLOPE TO DRAIN LOCATION AS OUTLINED AT THE ROOF PLAN.
15. ROOFING SYSTEM TO MEET FM-1-90 RATING.
16. SEE ROOFING SPECIFICATION ON NEXT PAGE FOR ADDITIONAL INFORMATION.

Project Name

Client Name

ROOF PLAN

Project Number	
Issue Date	
Author	
Checker	

A202

As indicated