
Substation Scan

Date: 01-06-2024

Time: 11:57:14

Legend

Hotspot Temperature	PD detection
11°C < hotspot temp < 20°C	>15 dB
20°C < hotspot temp <= 40°C	
hotspot temp > 40°C	

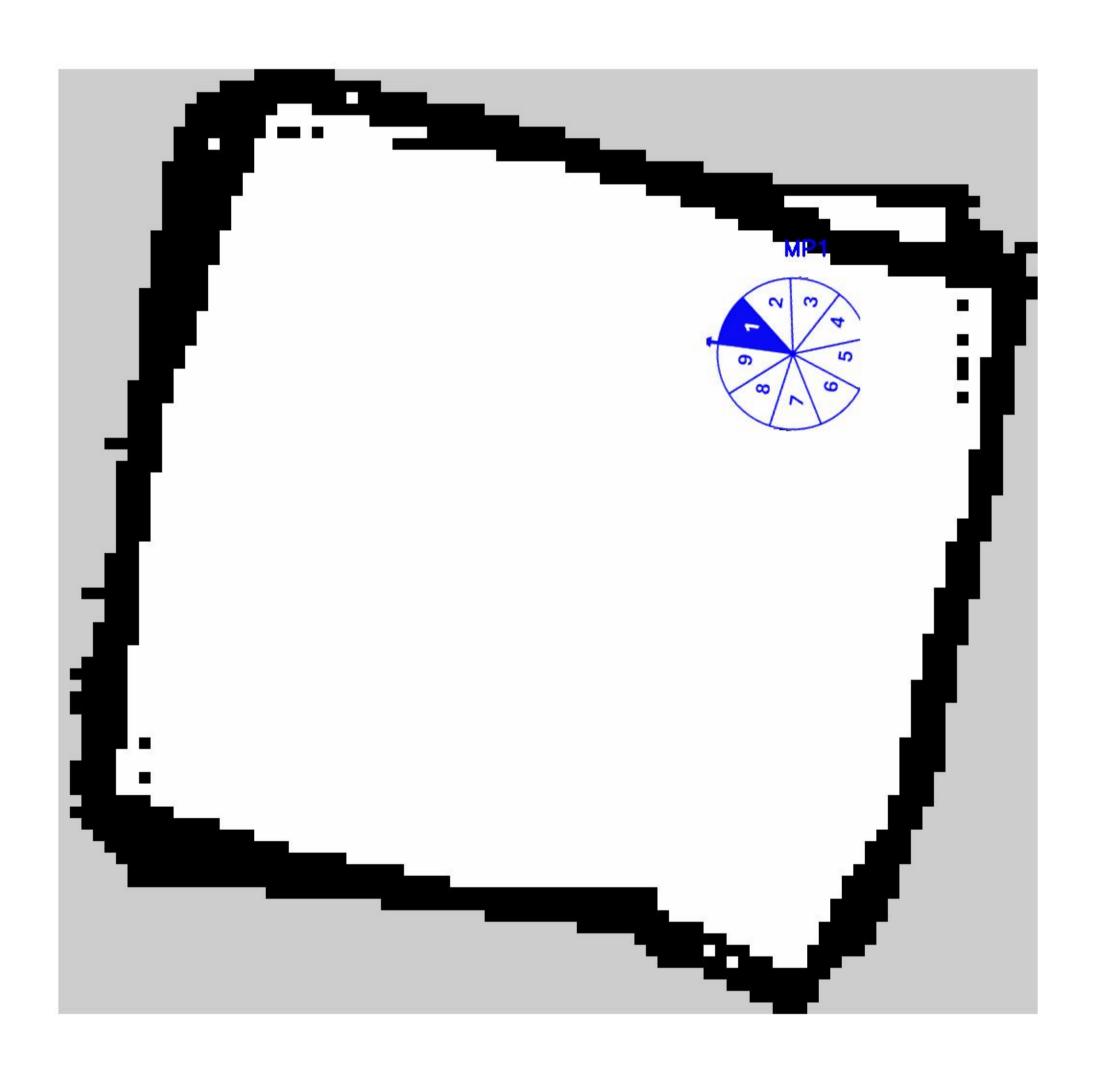

Highlights

МР	Thermal Hotspots	Partial Discharge
1	p_2_t_1	
1	p_2_t_2	
1	p_2_t_3	
1	p_3_t_3	
1	p_5_t_1	
1	p_5_t_2	
1	p_5_t_3	
1	p_5_t_4	
1	p_6_t_1	
1	p_6_t_2	
1	p_6_t_4	
1	p_7_t_1	
1	p_7_t_2	
1	p_7_t_4	
1	p_8_t_3	
1	p_8_t_4	
1	p_9_t_2	
1	p_9_t_3	
1	p_9_t_4	
1	p_10_t_2	
1	p_10_t_3	

