
## Substation Scan

Date: 31-05-2024

Time: 15:28:57


## Legend


Hotspot Temperature	PD detection
11°C < hotspot temp < 20°C	>15 dB
20°C < hotspot temp <= 40°C	
hotspot temp > 40°C	

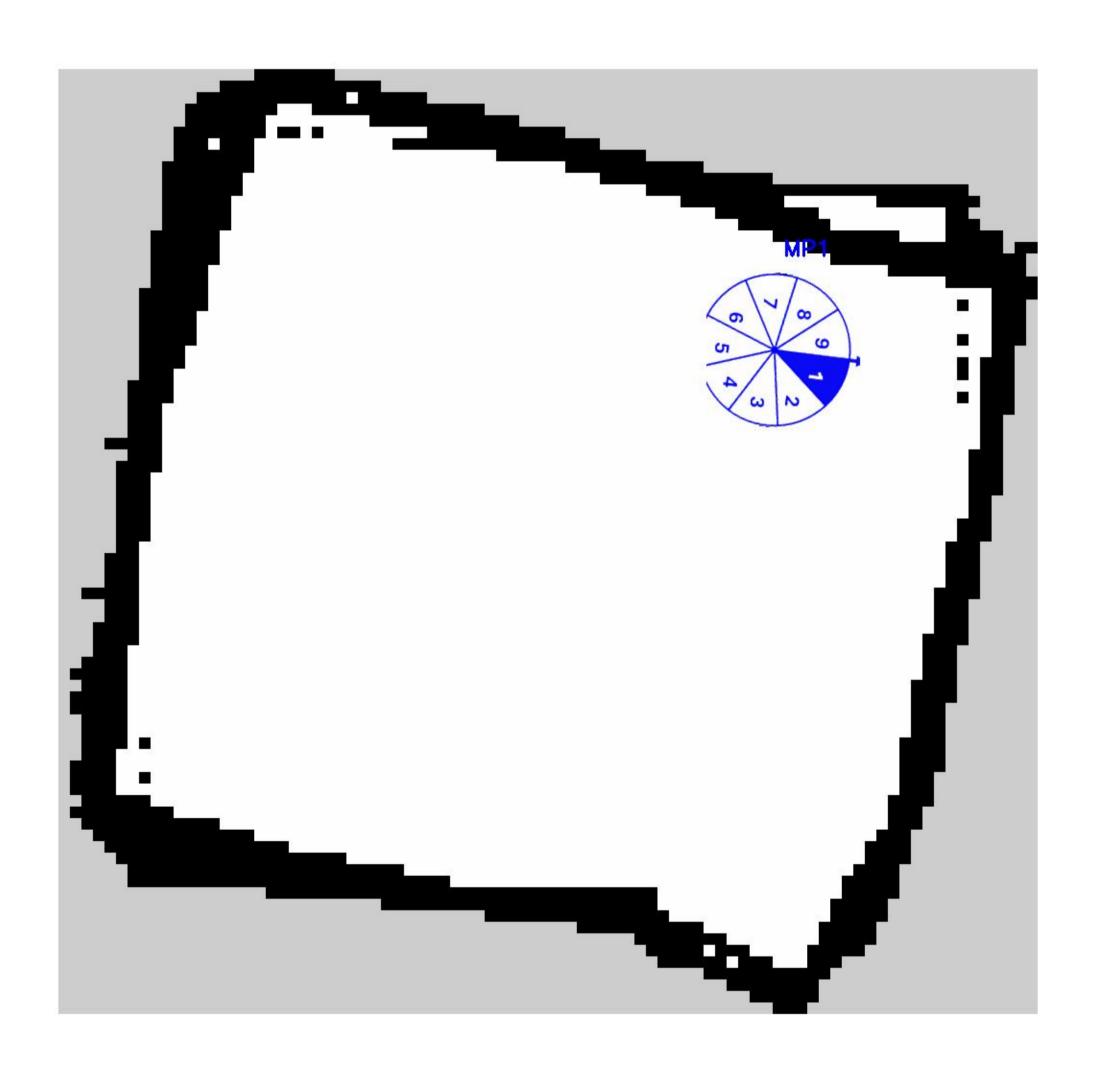

## Highlights

MP	Thermal Hotspots	Partial Discharge
1	p_6_t_4	
1	p_7_t_2	
1	p_8_t_1	
1	p_8_t_2	
1	p_8_t_4	
1	p_9_t_1	
1	p_9_t_2	
1	p_9_t_3	
1	p_9_t_4	

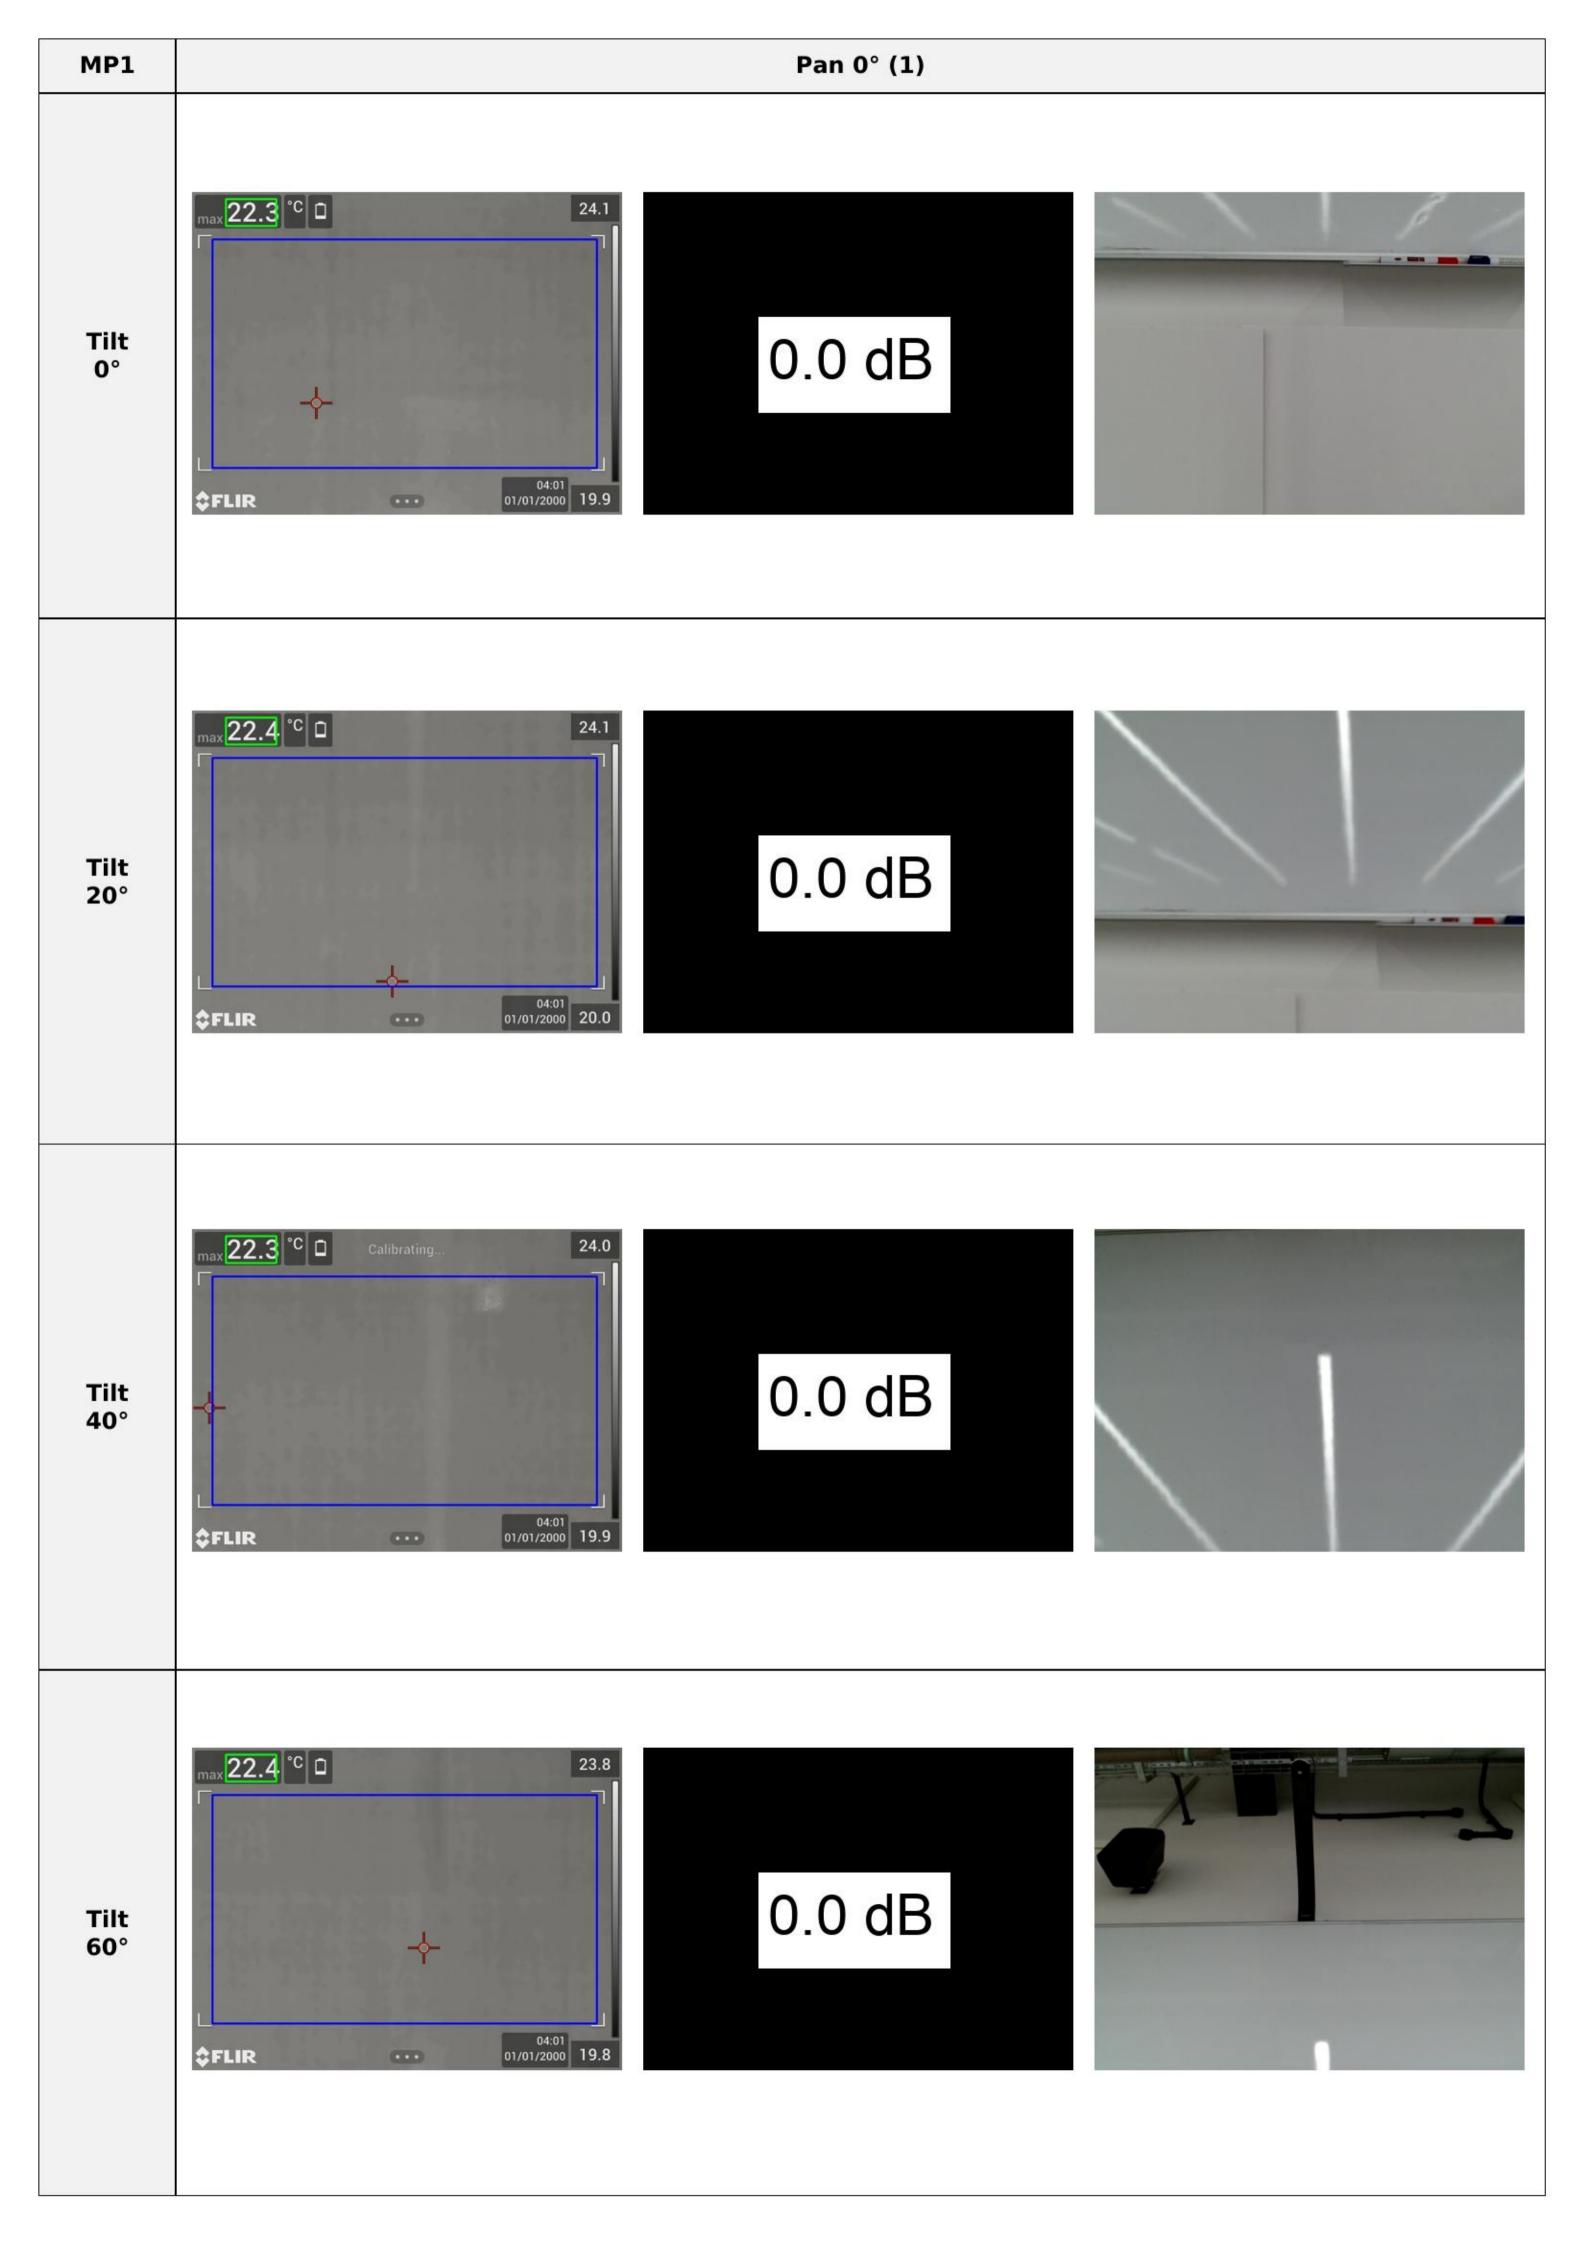

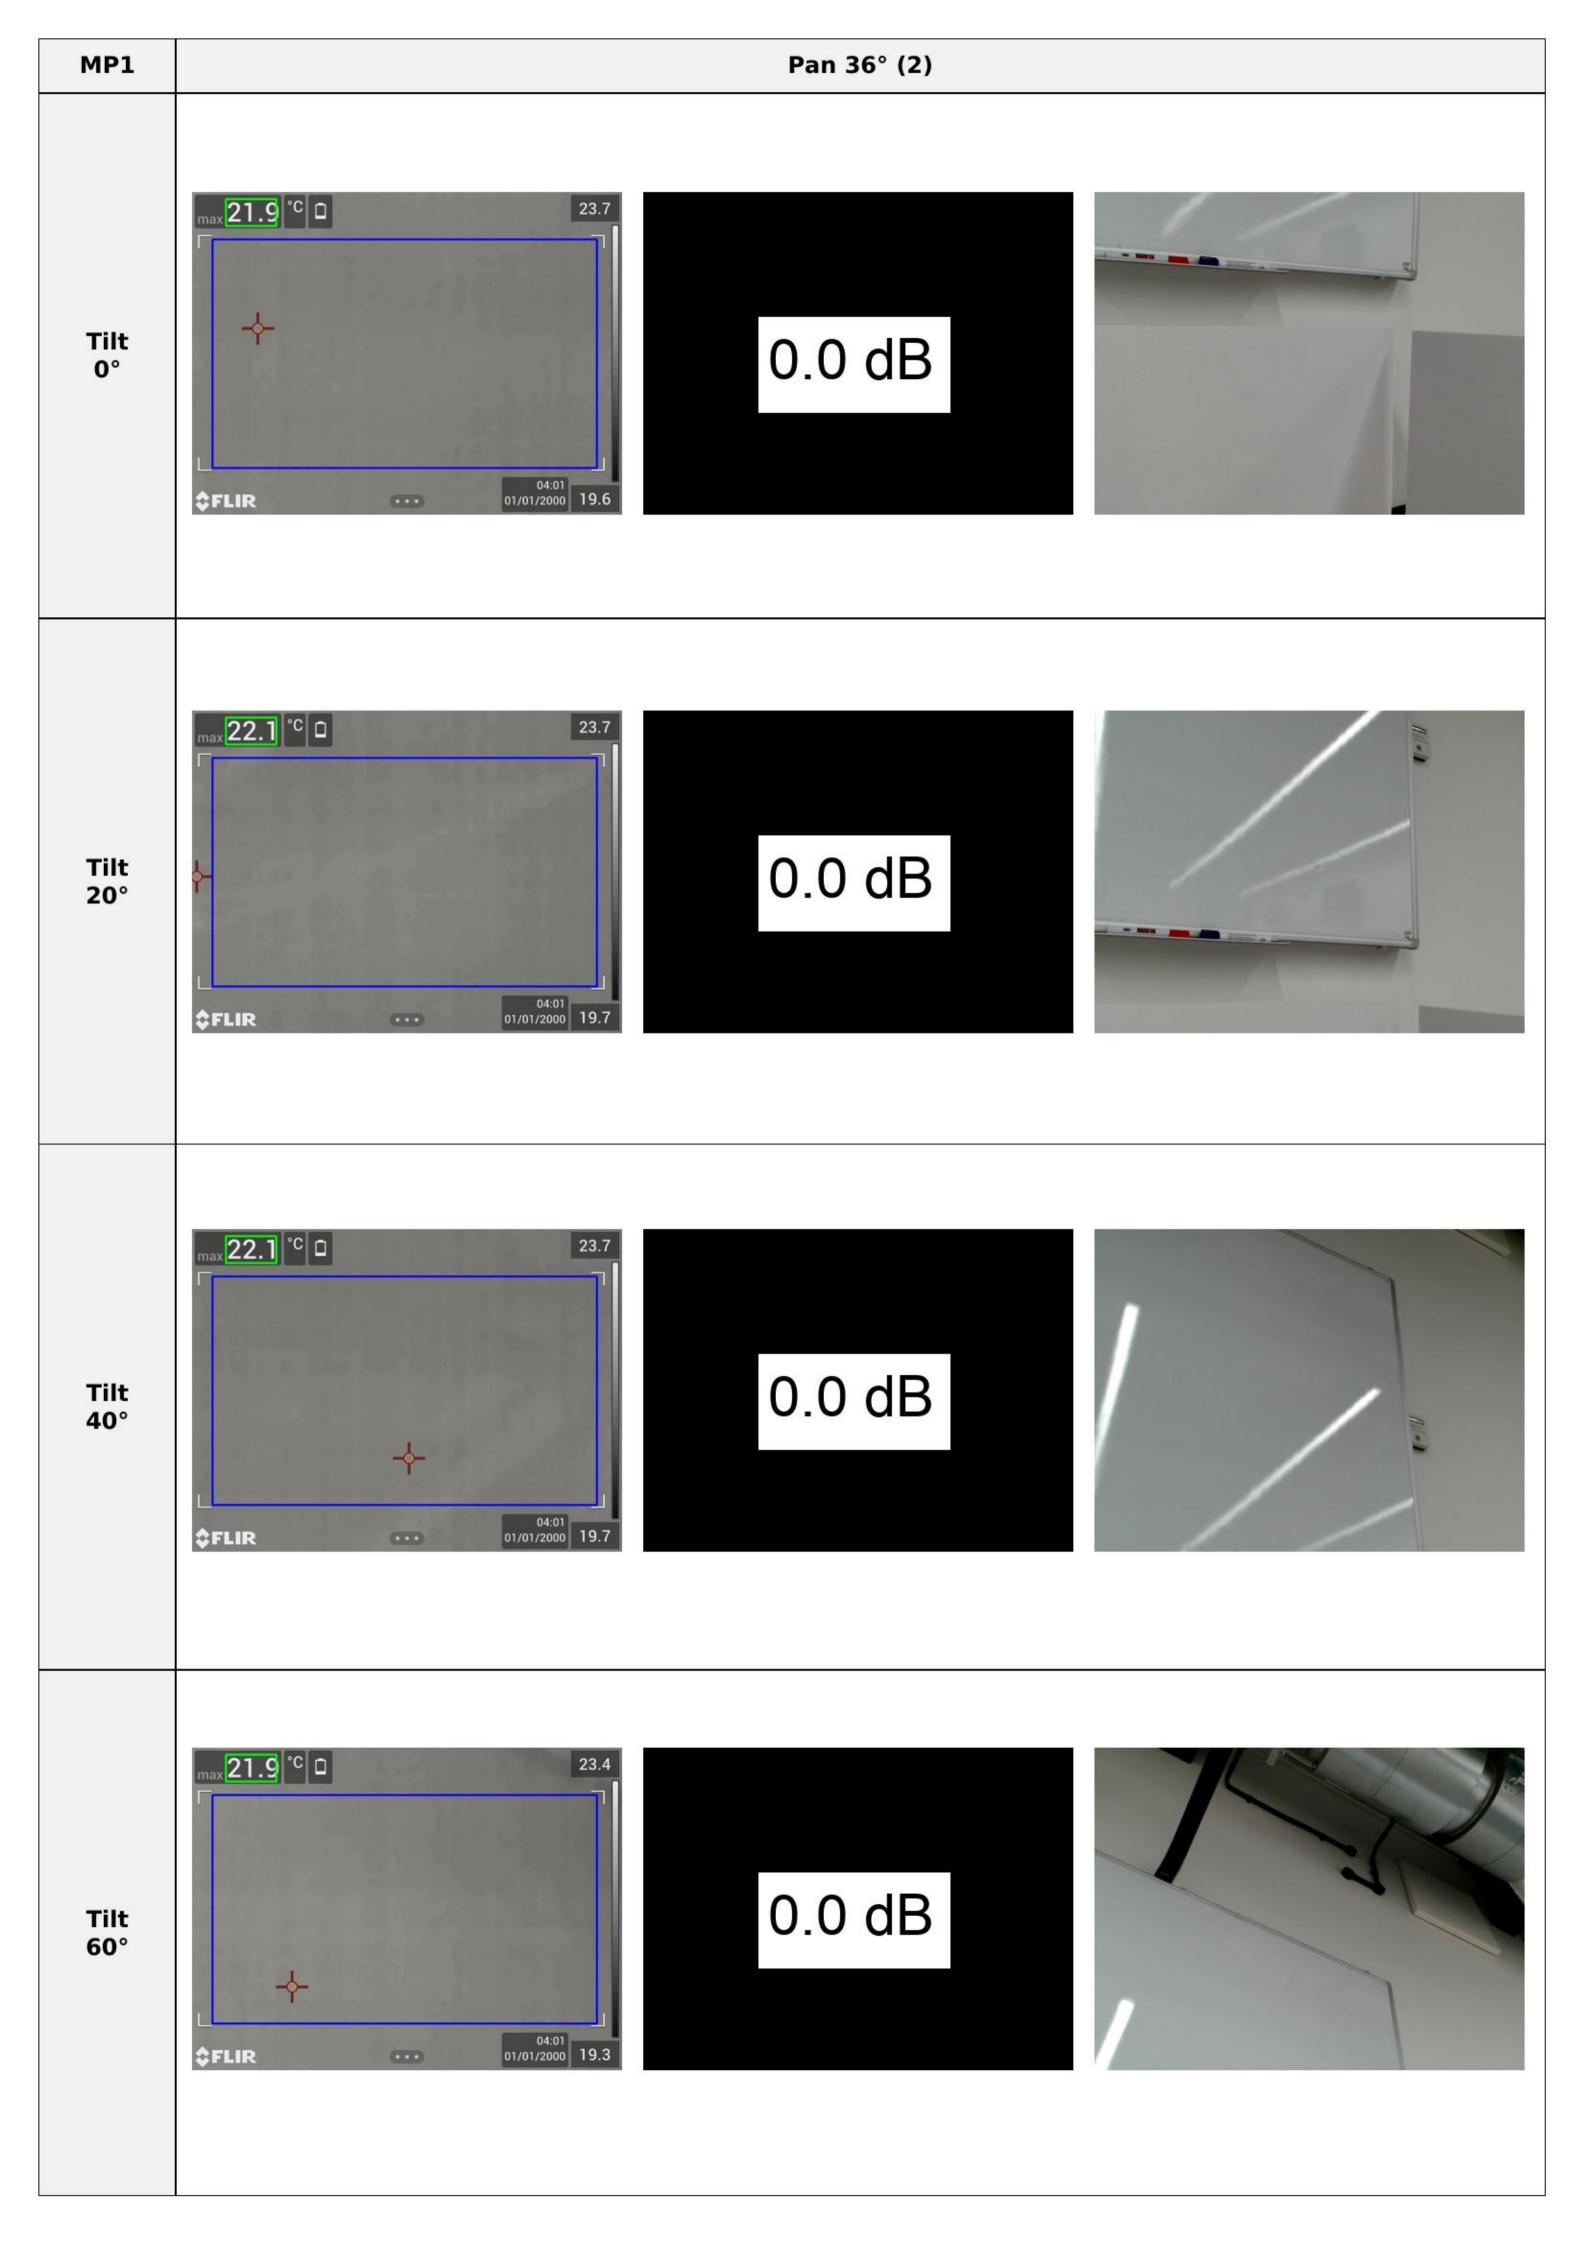

MP1	Pan 72° (3)
Tilt	0.0 dB
Tilt 20°	0.0 dB
Tilt 40°	0.0 dB
Tilt 60°	0.0 dB

MP1	Pan 108° (4)
Tilt 0°	0.0 dB
Tilt 20°	0.0 dB
Tilt 40°	0.0 dB
Tilt 60°	0.0 dB

MP1	Pan 144° (5)
Tilt	0.0 dB
Tilt 20°	0.0 dB
Tilt 40°	0.0 dB
Tilt 60°	0.0 dB

