
Substation Scan

Date: 30-05-2024

Time: 14:55:05

Legend

Hotspot Temperature	PD detection
11°C < hotspot temp < 20°C	>15 dB
20°C < hotspot temp <= 40°C	
hotspot temp > 40°C	

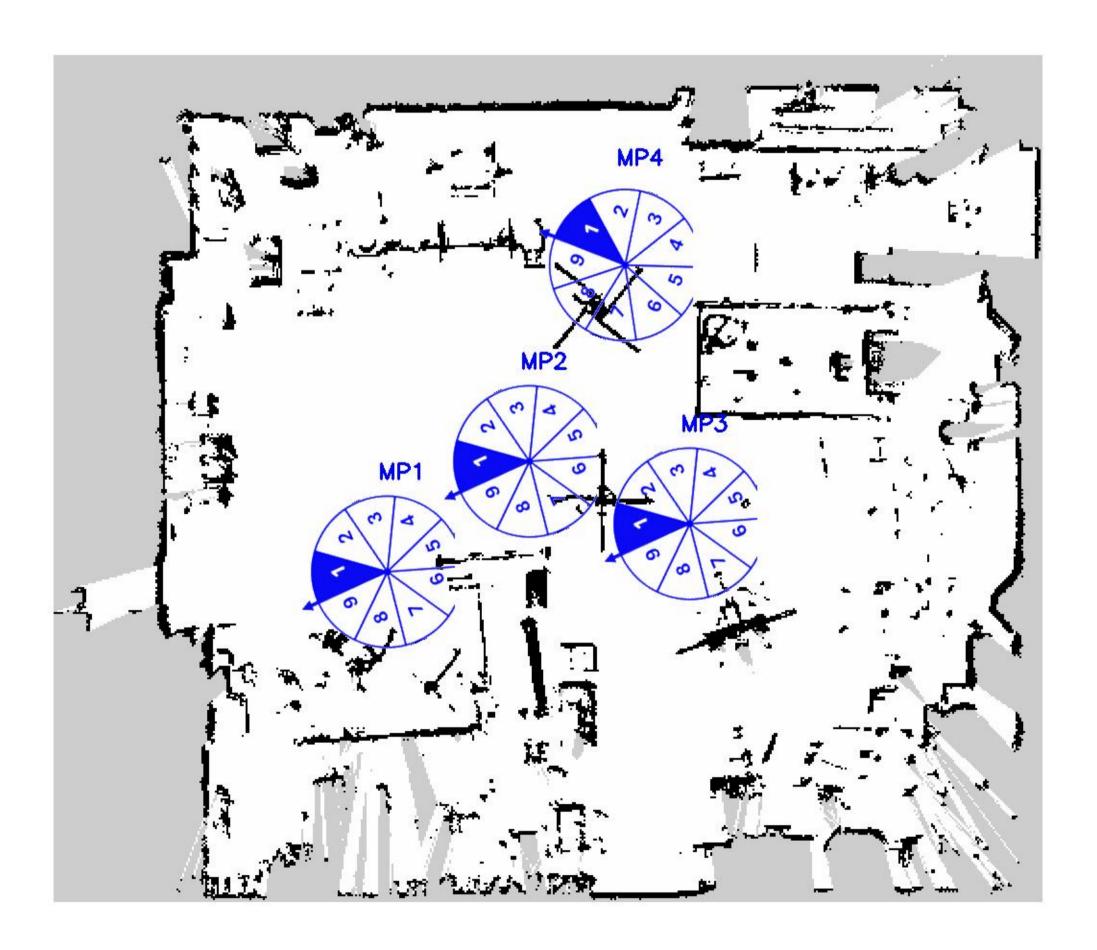

Highlights

MP	Thermal Hotspots	Partial Discharge
1	p_1_t_2	p_1_t_2
1	p_2_t_4	p_2_t_4
1	p_2_t_5	p_2_t_5
1	p_4_t_3	p_4_t_3
1		p_9_t_1
1		p_10_t_2

