
Substation Scan

Date: 31-05-2024

Time: 15:28:57


Legend


| Hotspot Temperature | PD detection |
|-----------------------------|--------------|
| 11°C < hotspot temp < 20°C | >15 dB |
| 20°C < hotspot temp <= 40°C | |
| hotspot temp > 40°C | |

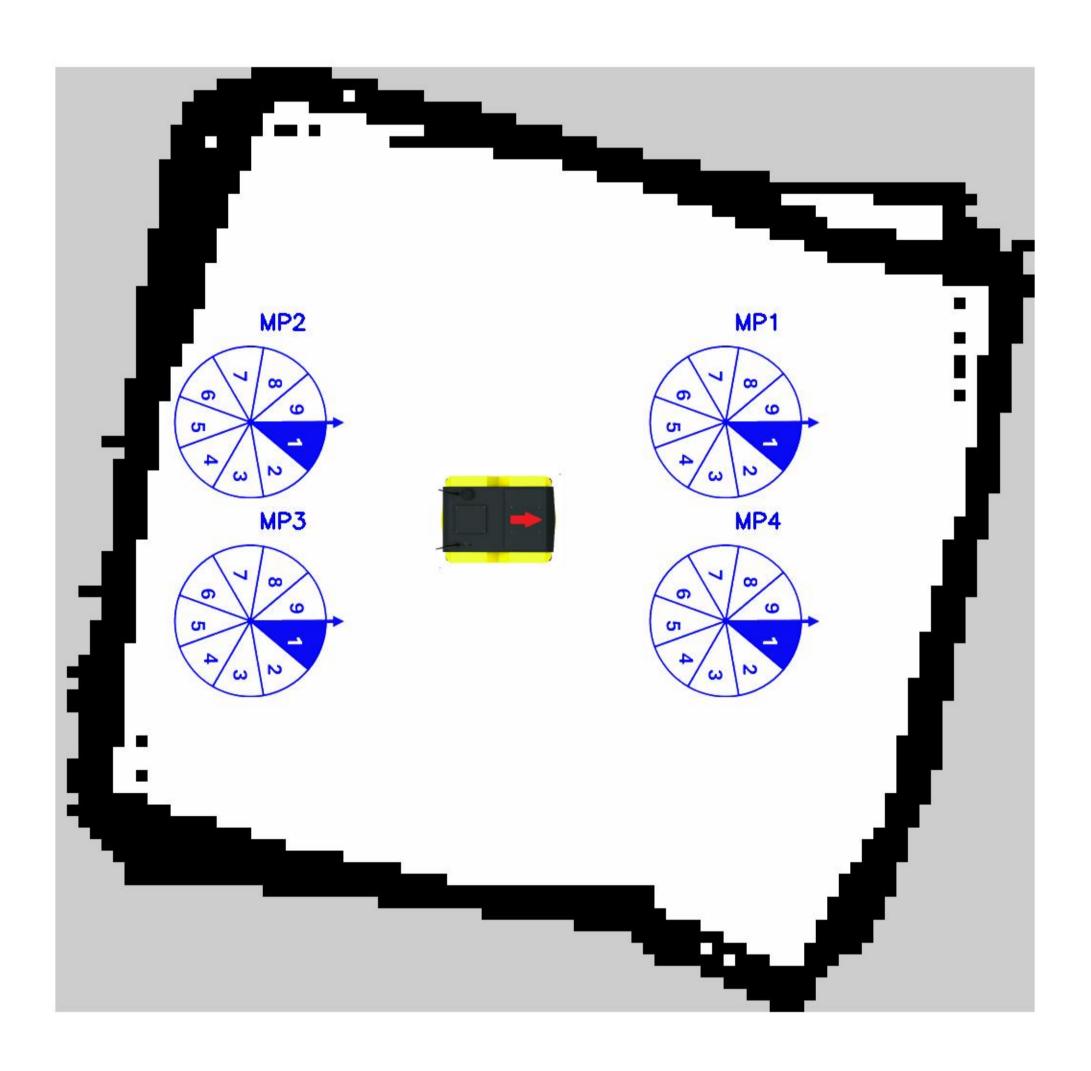

Highlights

| MP | Thermal Hotspots | Partial Discharge |
|----|------------------|-------------------|
| 1 | p_6_t_4 | |
| 1 | p_7_t_2 | |
| 1 | p_8_t_1 | |
| 1 | p_8_t_2 | |
| 1 | p_8_t_4 | |
| 1 | p_9_t_1 | |
| 1 | p_9_t_2 | |
| 1 | p_9_t_3 | |
| 1 | p_9_t_4 | |

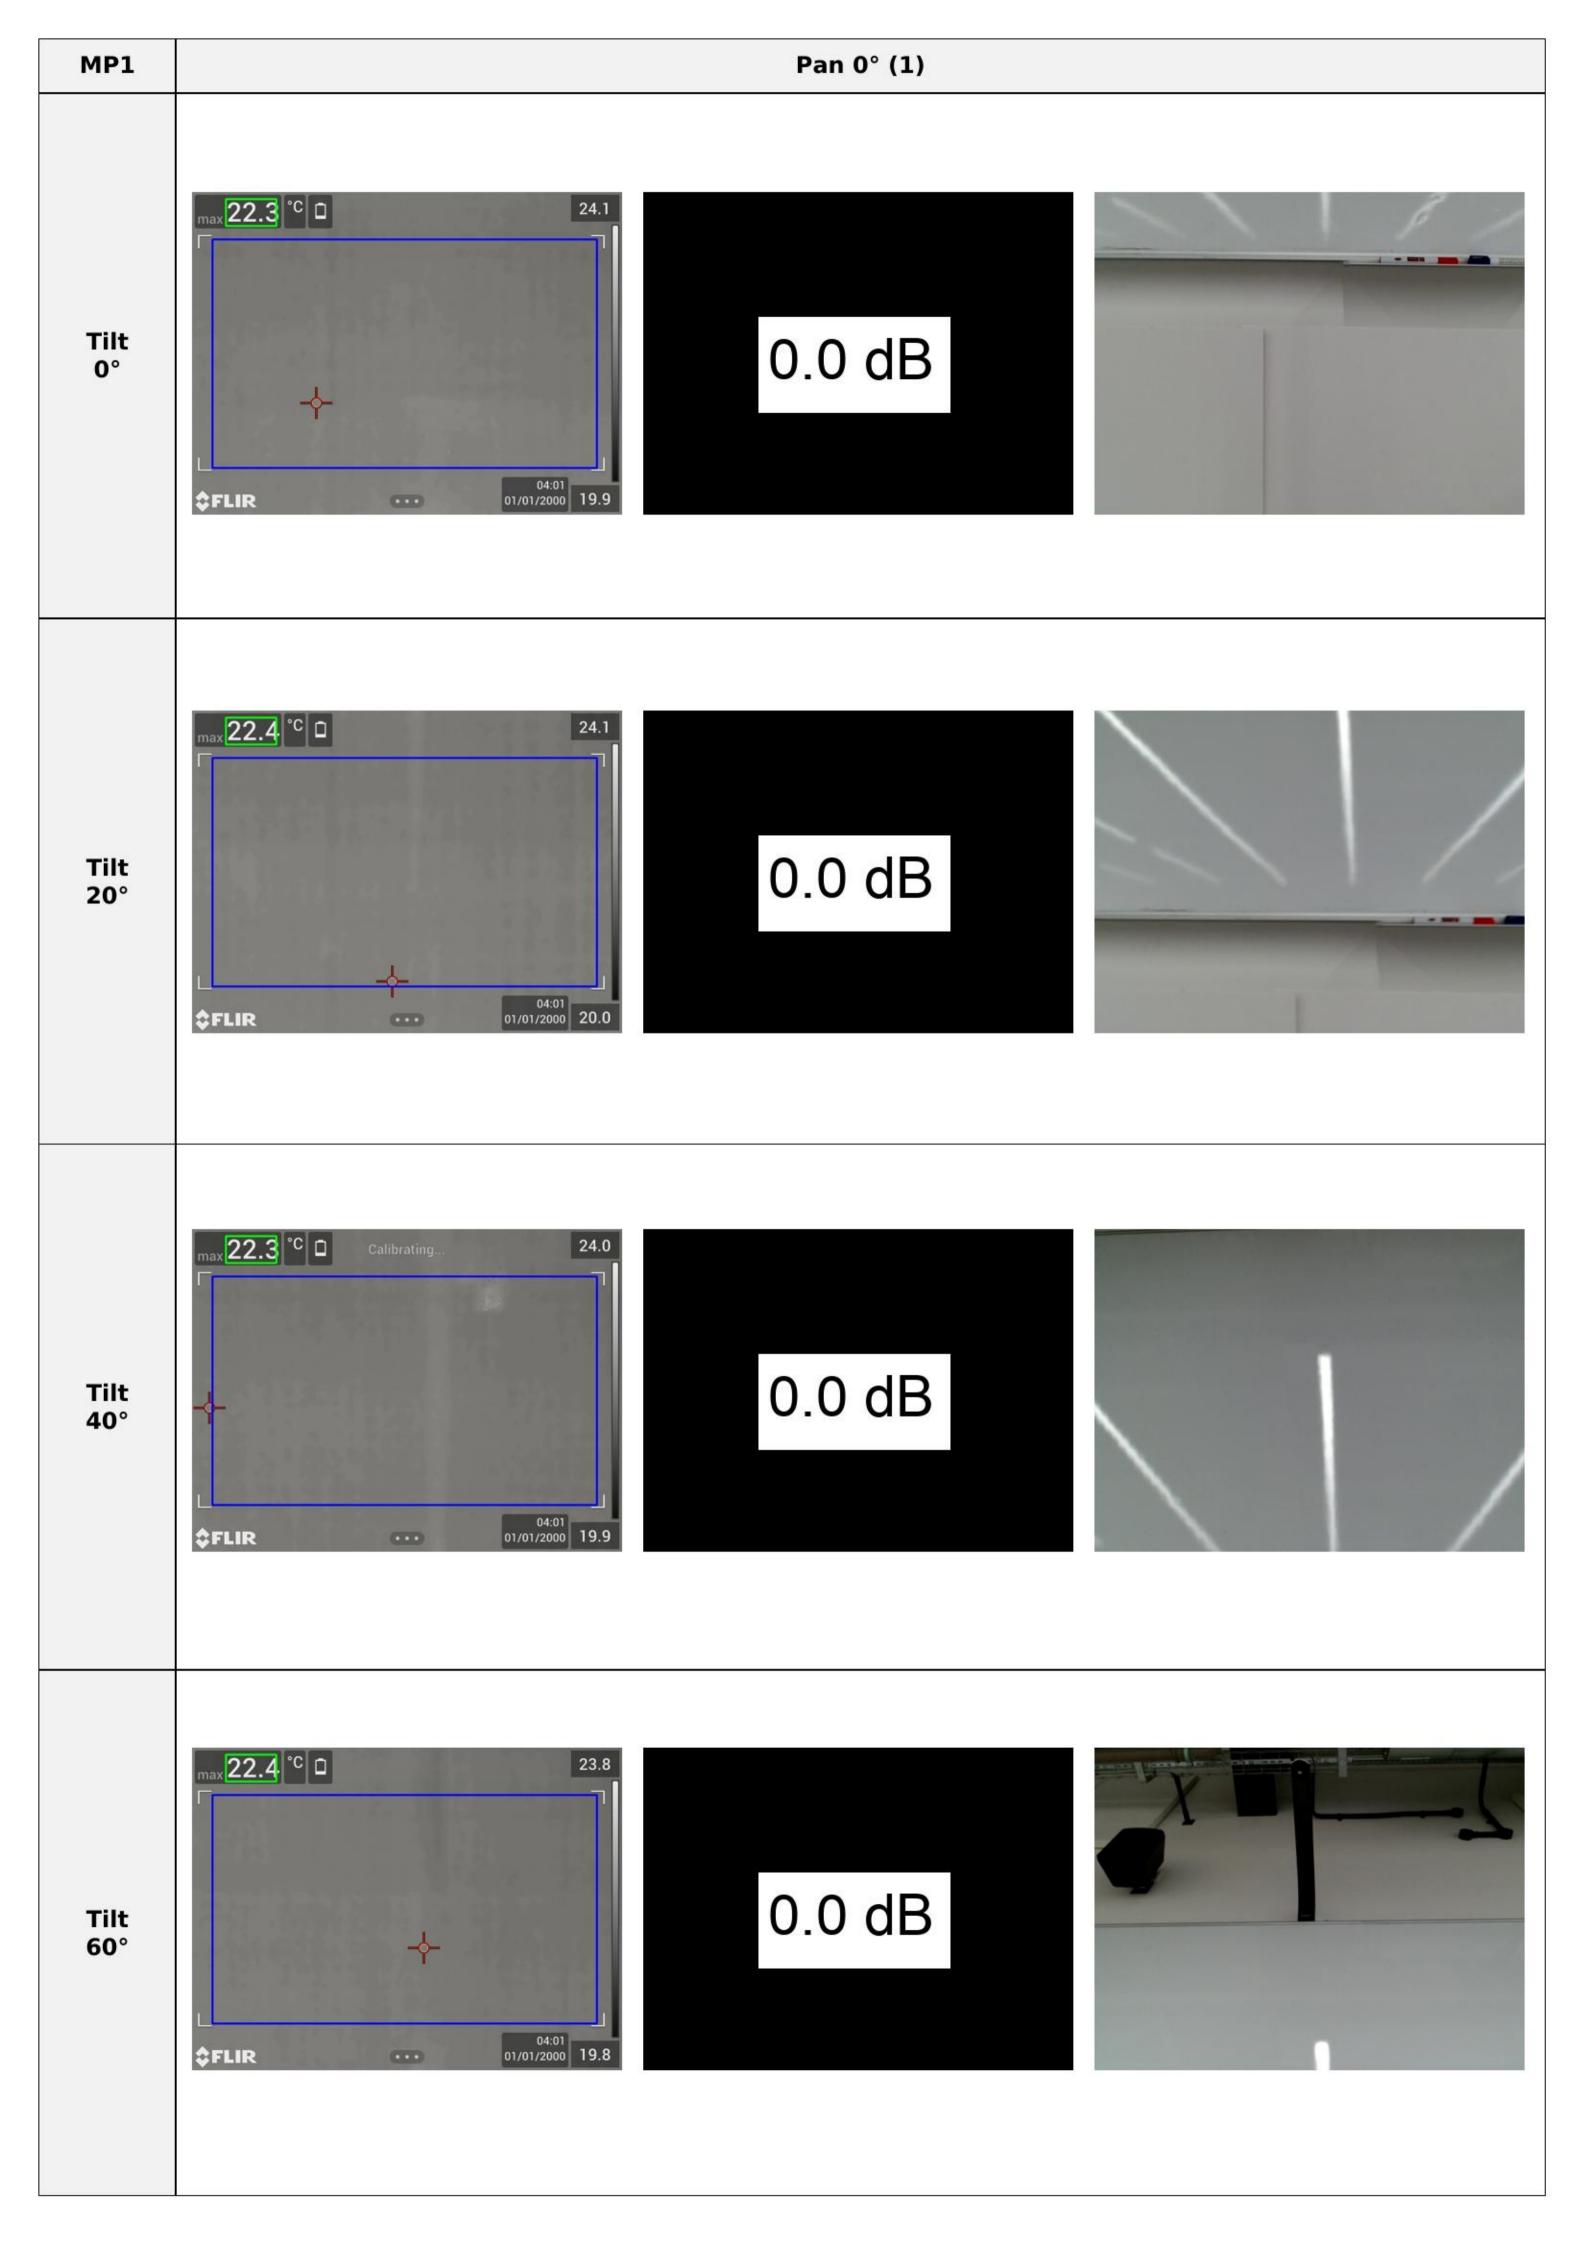

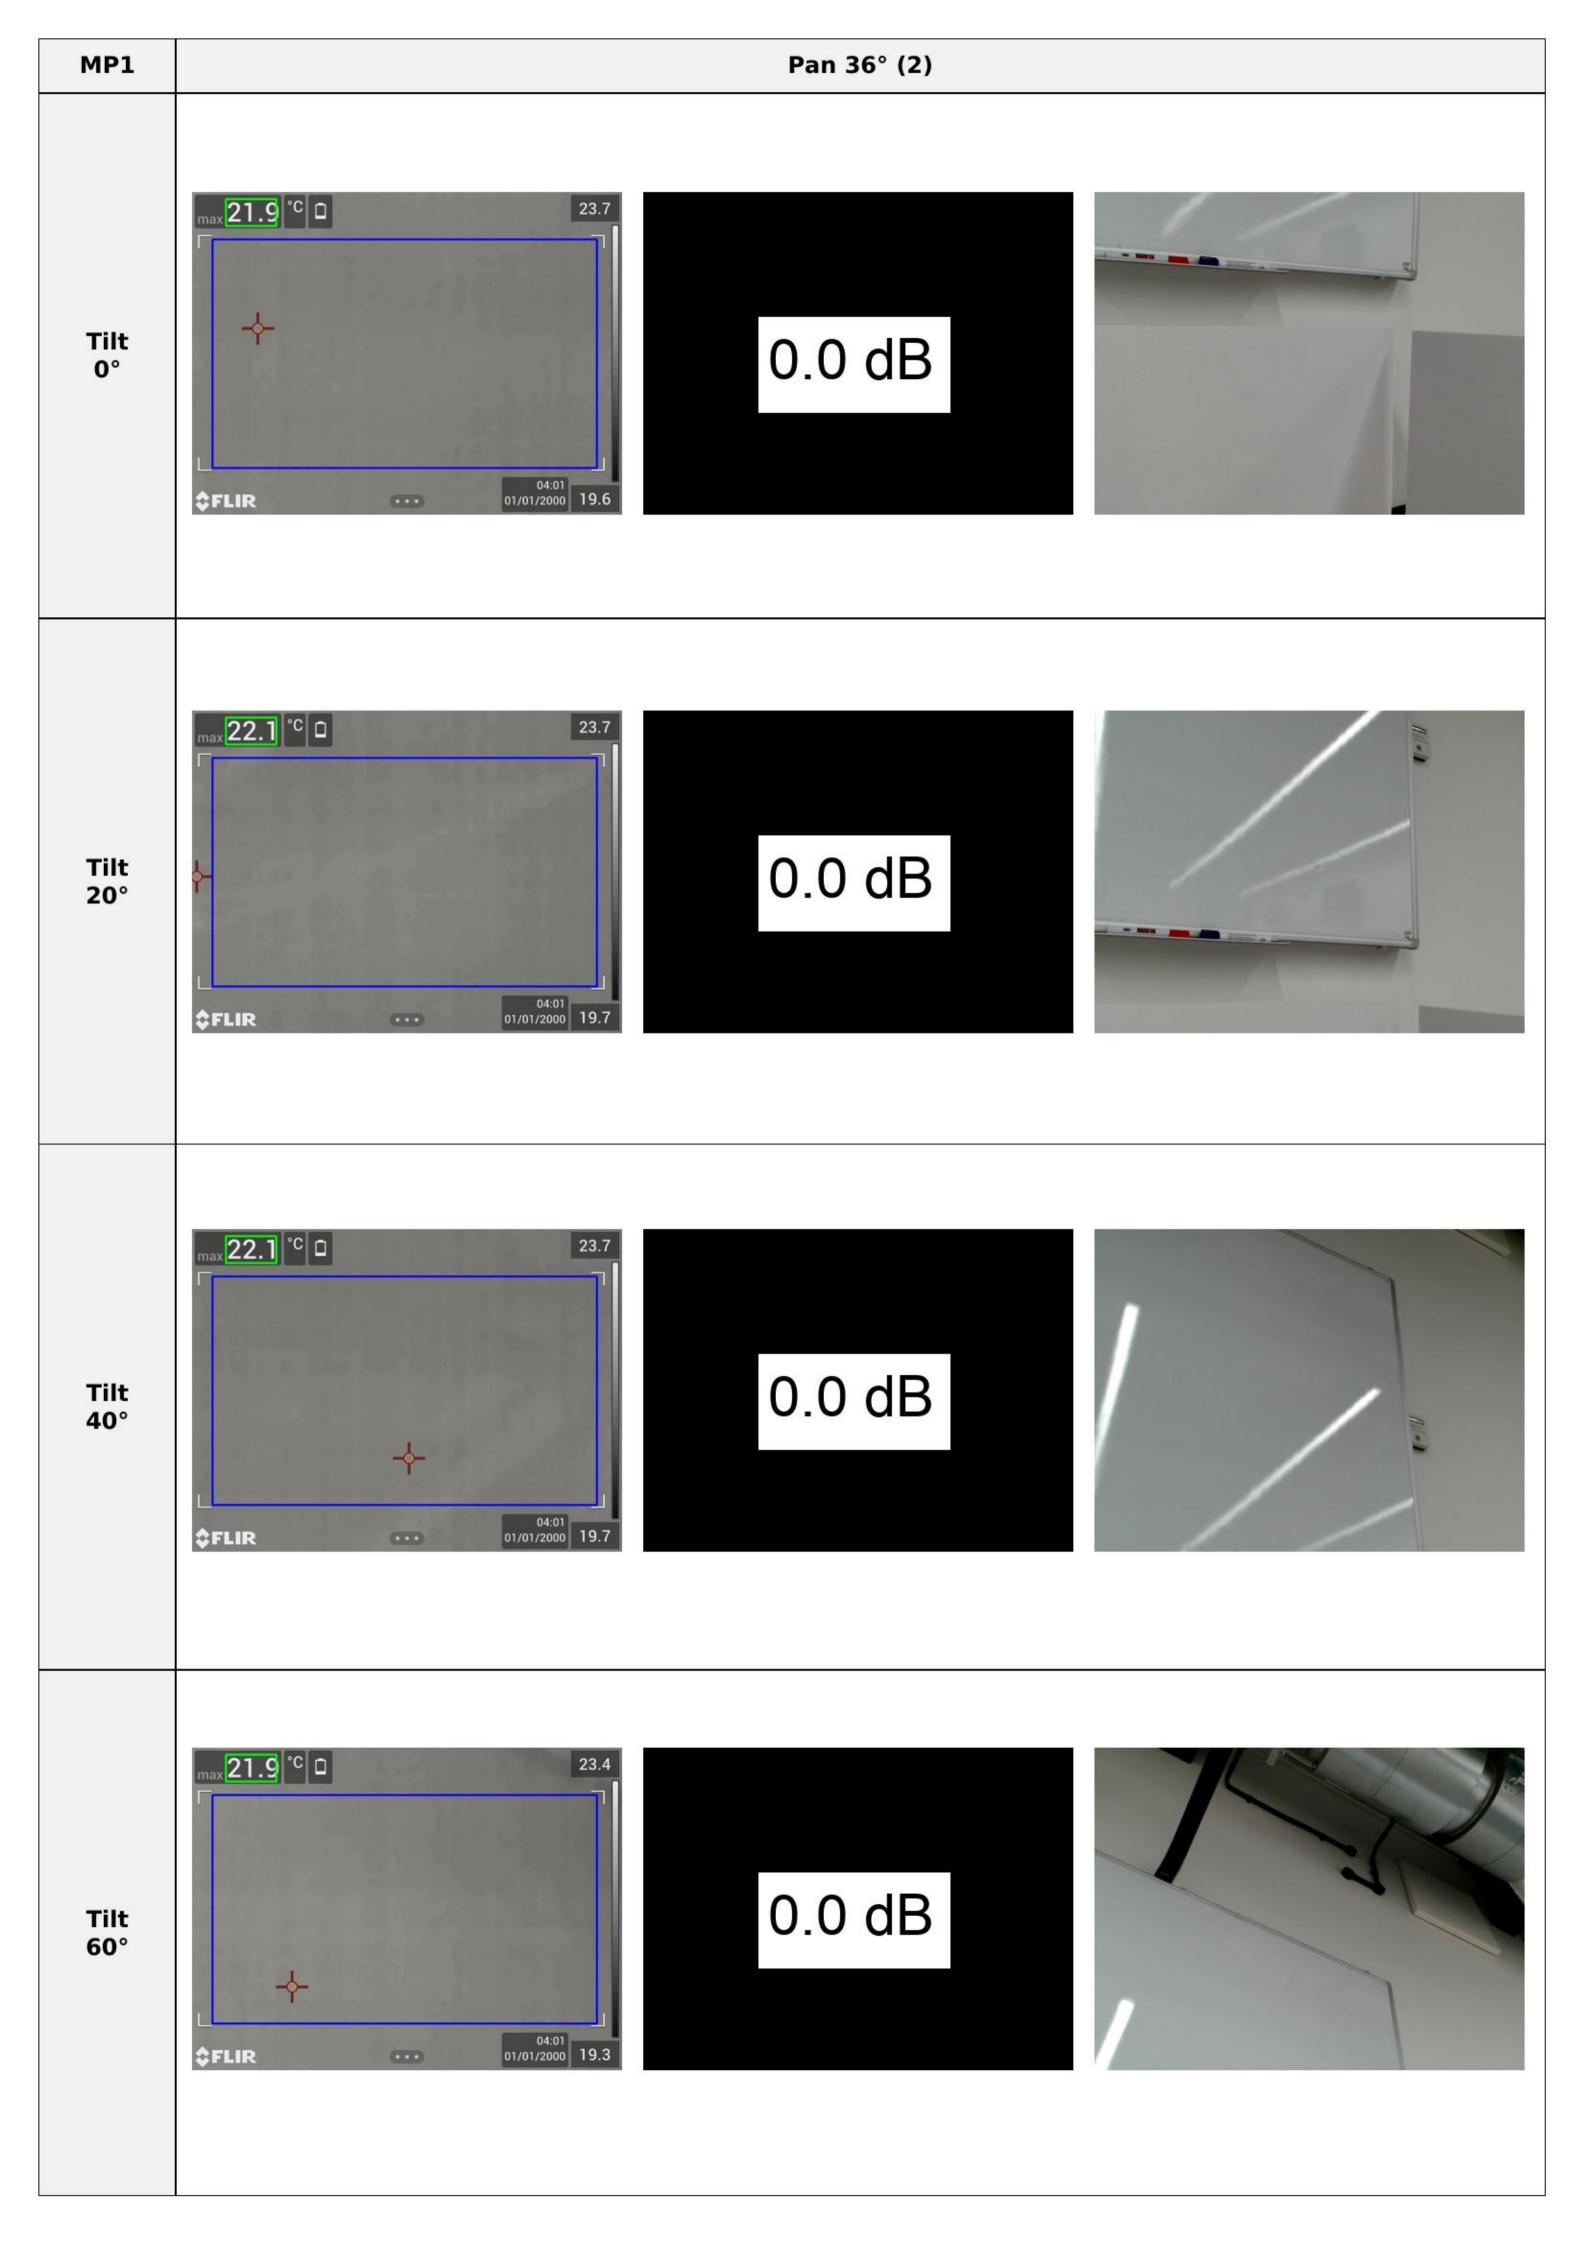

| MP1 | Pan 72° (3) |
|-------------|-------------|
| Tilt | 0.0 dB |
| Tilt 20° | 0.0 dB |
| Tilt 40° | 0.0 dB |
| Tilt 60° | 0.0 dB |

| MP1 | Pan 108° (4) |
|-------------|--------------|
| Tilt 0° | 0.0 dB |
| Tilt 20° | 0.0 dB |
| Tilt 40° | 0.0 dB |
| Tilt 60° | 0.0 dB |

| MP1 | Pan 144° (5) |
|-------------|--------------|
| Tilt | 0.0 dB |
| Tilt 20° | 0.0 dB |
| Tilt 40° | 0.0 dB |
| Tilt 60° | 0.0 dB |

