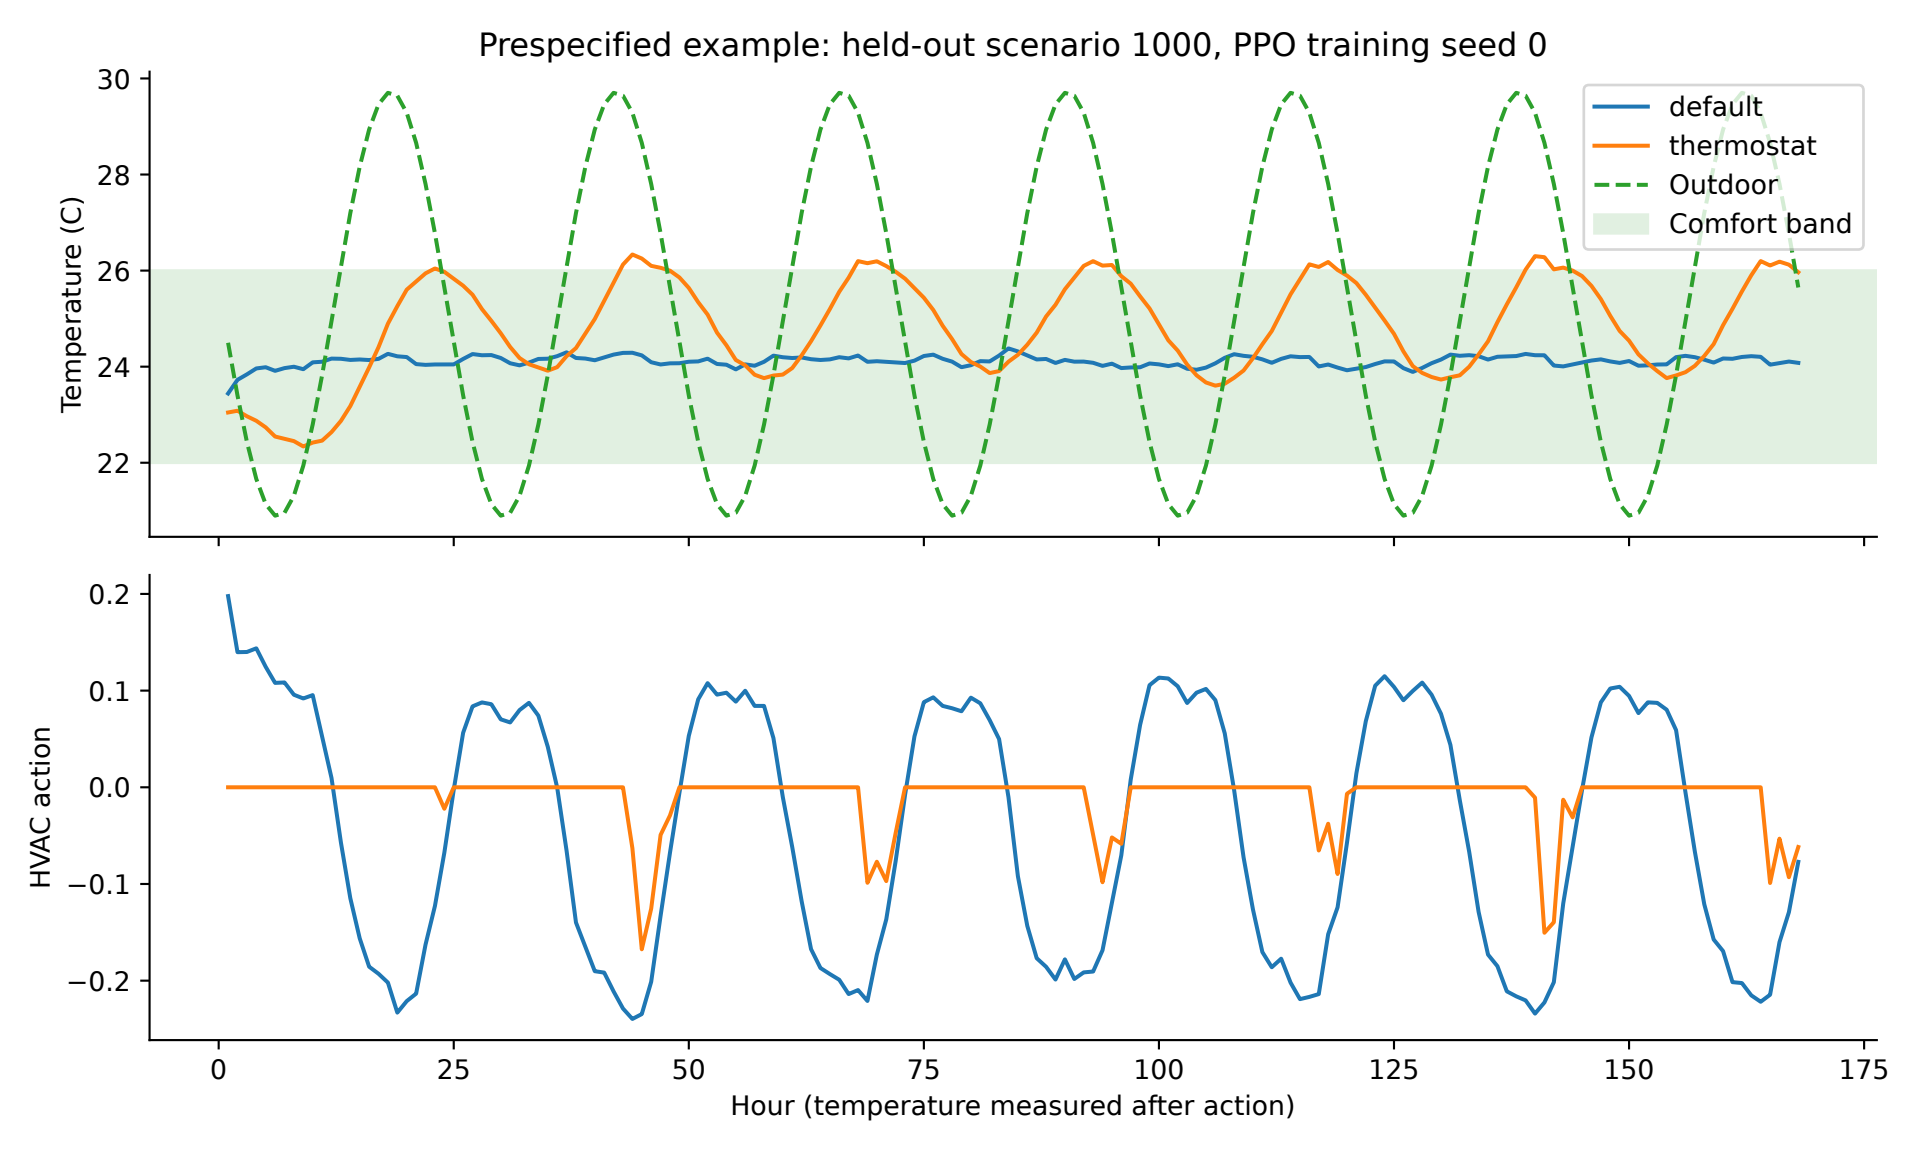
Prespecified example: held-out scenario 1000, PPO training seed 0
Temperature (C)
30
28
26
24
22
default
thermostat
Outdoor
Comfort band
HVAC action
0.2
0.1
0.0
−0.1
−0.2
0
25
50
75
100
125
150
175
Hour (temperature measured after action)