



IEEE123 bus Energy Storage Dispatch – KPI Dashboard


Energy & Cycles

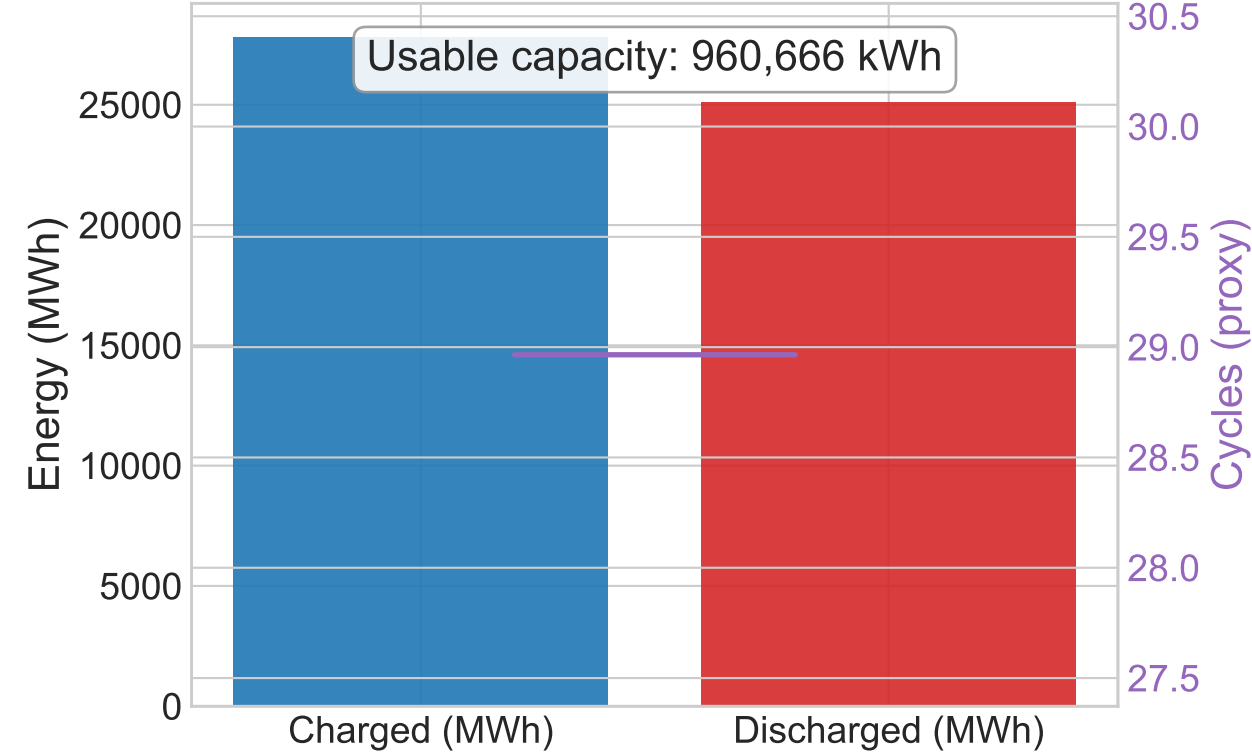


Utilization (%)

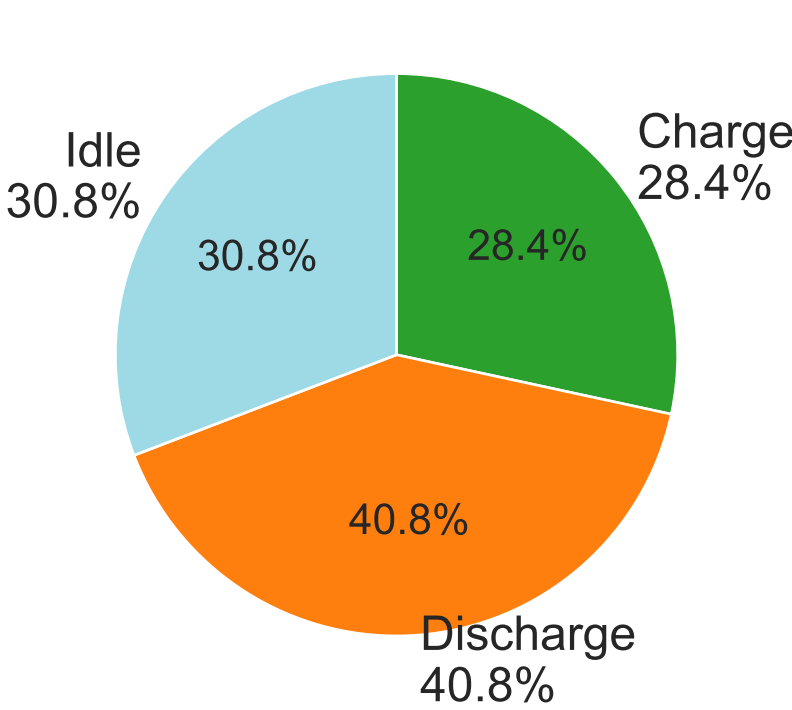


Policy Compliance (counts)

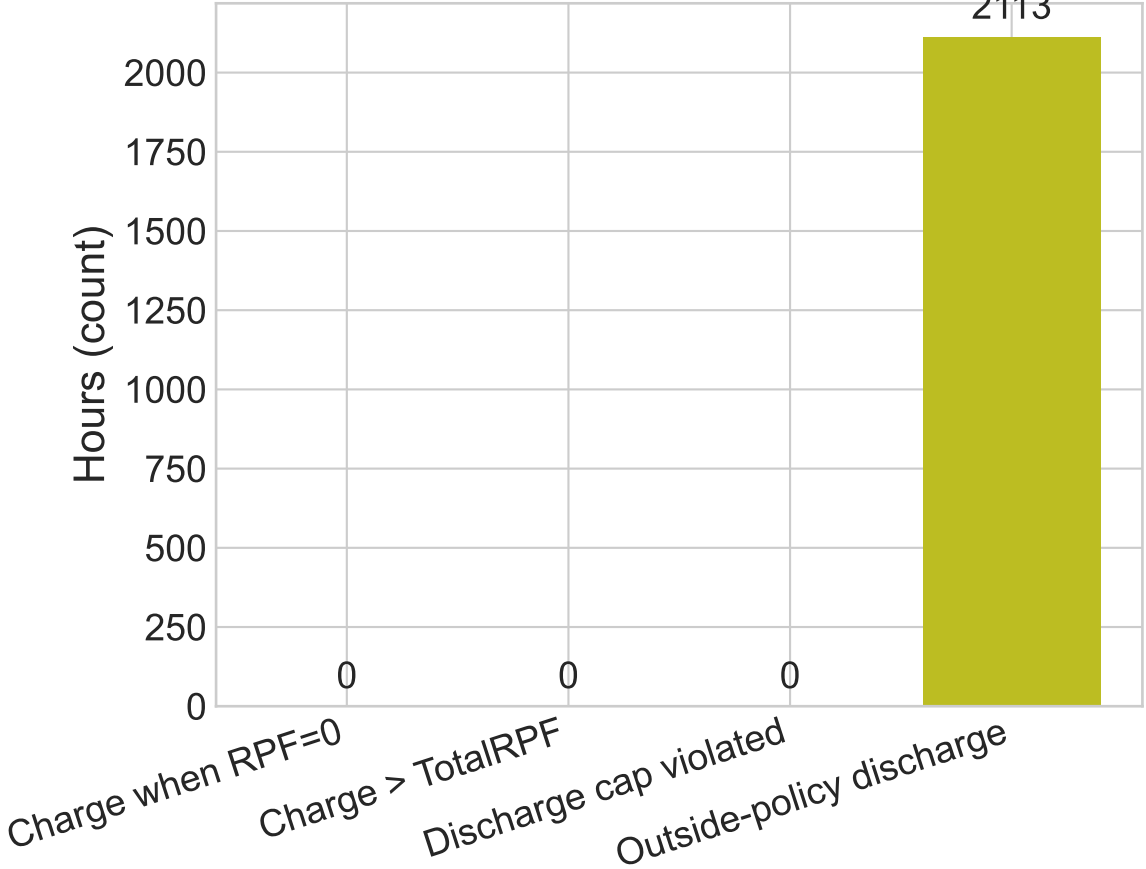


Ampacity

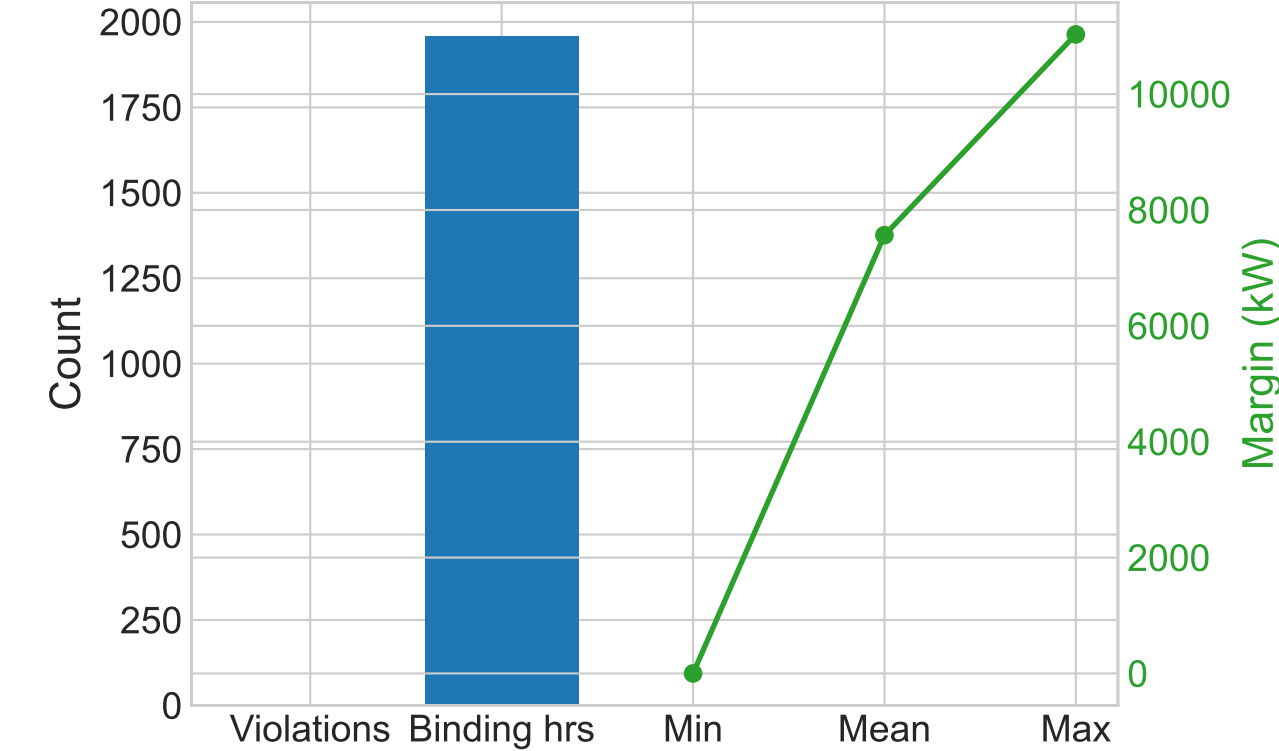

Peak Impact

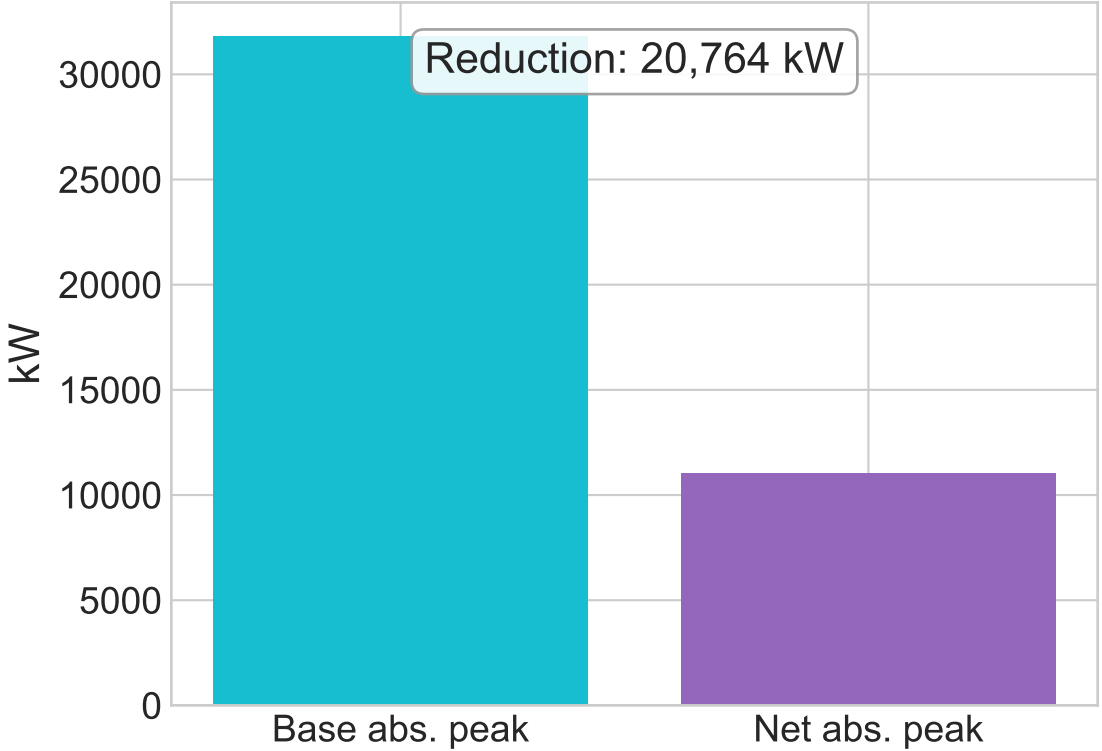

Objective Components

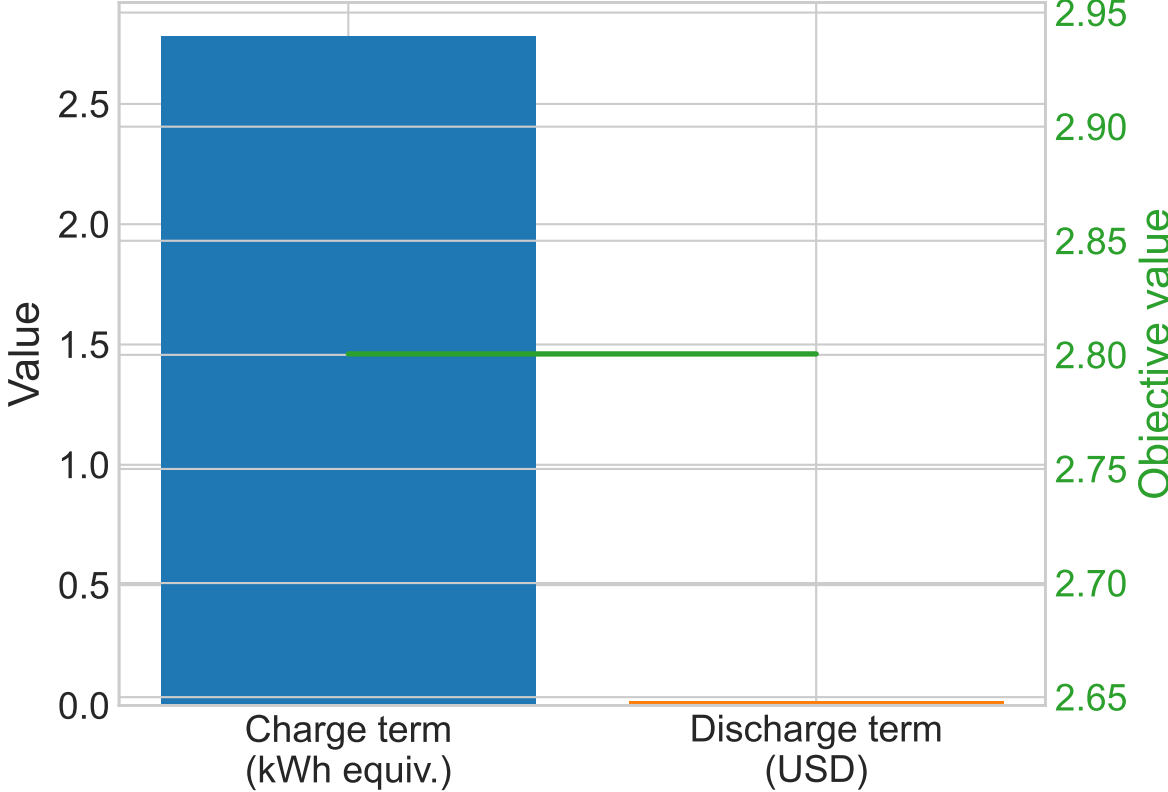

Counts — hours: 8,760 charge: 2,487 discharge: 3,573 idle: 2,700 Caps/Mutex — at P<sub>c</sub>max: 0 at P<sub>d</sub>max: 0 mutex violations: 0