




Logical Physical x 1563, y: 174

Root 05:17:30

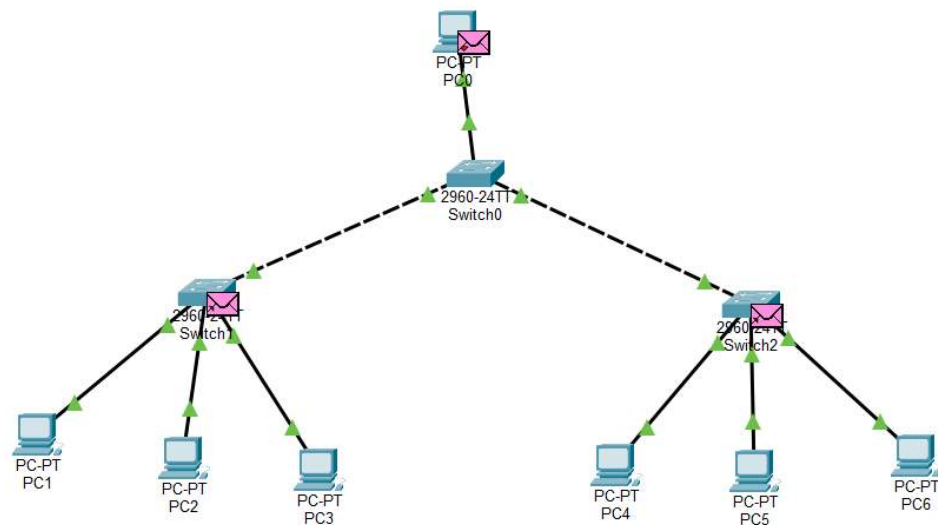

Simulation Panel

At Device	Type
Switch1	ARP
PC4	ARP
PC5	ARP
PC6	ARP
PC1	ARP
PC1	ICMP
Switch1	ICMP
PC2	ICMP
Switch1	ICMP
PC1	ICMP
Switch0	STP
PC0	STP
Switch1	STP
Switch2	STP

Reset Simulation ☒ Constant Delay Captured to 23.248 s




Event List Filters - Visible Events
 ACL Filter, ARP, BGP, Bluetooth, CAPWAP, CDP, DHCP, DHCPv6, DNS, DTP, EAPOL, EIGRP, EIGRPv6, FTP, H.323, HSRP, HSRPv6, HTTP, HTTPS, ICMP, ICMPv6, IEC, IPsec, ISAKMP, IoT, IoT TCP, LACP, LLDP, MODBUS, Meraki, NDP, NETFLOW, NTP, OSPF, OSPFv6, PAgP, POP3, PPP, PPPoE, PTP, Profinet, RADIUS, REP, RIP, RIPng, RTP, SCCP, SMTP, SNMP, SSH, STP, SYSLOG, TACACS, TCP, TFTP, Telnet, UDP, USB, VTP

Edit Filters Show All/None

Event List Realtime Simulation

Time: 00:05:21.754 PLAY CONTROLS

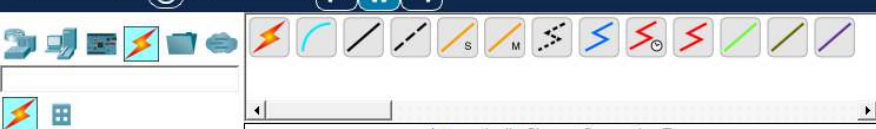

Scenario 0

New Delete

Toggle PDU List Window

Fire	Last Status	Source	Destination	Type	Color	Time(sec)	Periodic	Num	Edit	Delete
...	Successful	PC1	PC2	ICMP		21.246	N	0	(edit)	(delete)