




Logical Physical x 1328, y: 554

Root 03:26:30

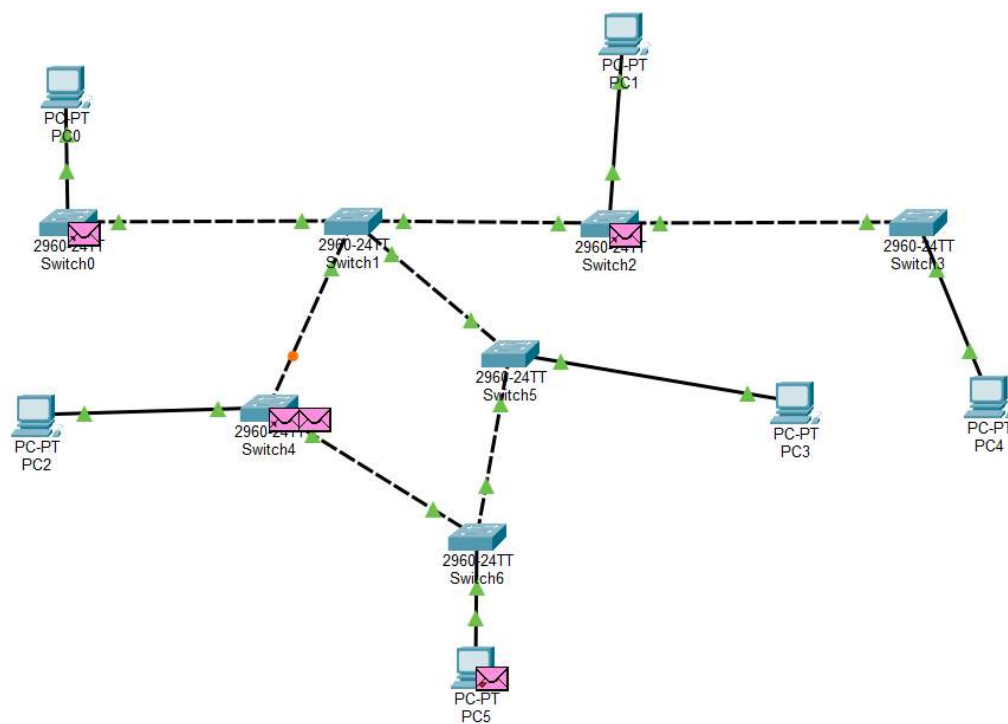

Simulation Panel

Event List

At Device	Type
Switch1	ICMP
Switch0	ICMP
PC0	ICMP
Switch2	DTP
PC1	DTP
Switch5	STP
Switch6	STP
Switch1	STP
PC3	STP
PC5	STP
Switch4	STP
Switch2	STP
Switch4	STP
Switch0	STP

Reset Simulation

☒ Constant Delay

Captured to 1.637 s

Play Controls



Event List Filters - Visible Events

ACL Filter, ARP, BGP, Bluetooth, CAPWAP, CDP, DHCP, DHCPv6, DNS, DTP, EAPOL, EIGRP, EIGRPv6, FTP, H.323, HSRP, HSRPv6, HTTP, HTTPS, ICMP, ICMPv6, IEC, IPsec, ISAKMP, IoT, IoT TCP, LACP, LLDP, MODBUS, Meraki, NDP, NETFLOW, NTP, OSPF, OSPFv6, PAgP, POP3, PPP, PPPoE, PTP, Profinet, RADIUS, REP, RIP, RIPng, RTP, SCCP, SMTP, SNMP, SSH, STP, SYSLOG, TACACS, TCP, TFTP, Telnet, UDP, USB, VTP

Edit Filters

Show All/None

Time: 00:05:39.888 PLAY CONTROLS:

Fire	Last Status	Source	Destination	Type	Color	Time(sec)	Periodic	Num	Edit	Delete
	Successful	PC0	PC1	ICMP		0.000	N	0	(edit)	(delete)

Scenario 0

New

Delete

Toggle PDU List Window