





**PILING WORK CHECKLIST (C7)**

CONTRACTOR :	RFI NO : TBSKS.RFI.
TYPE OF WORK:	DRAWING REFERENCE NO. :
ZONE :	ROW NO :

No	Description	Inspection Result			Remark																								
		Accept	N/A	Reject																									
1	No visual dent or any damage on motor piers & typical array piers																												
2	<div>Piers embedment and exposure height are according to the given tolerances.</div> <table><thead><tr><th>PIER TYPE</th><th>COLOR CODE</th><th>MIN. EMBEDMENT DEPTH (mm)</th><th>EXPOSED PIER (mm)</th></tr></thead><tbody><tr><td>HAP</td><td>White</td><td>2600</td><td>1200 ± 15</td></tr><tr><td>HMP</td><td>Black</td><td>2600</td><td>1160 ± 15</td></tr><tr><td>SAP</td><td>-</td><td>1680</td><td>1200 ± 15</td></tr><tr><td>SAPE</td><td>Blue</td><td>2140</td><td>1200 ± 15</td></tr><tr><td>SMP</td><td>Yellow</td><td>1680</td><td>1200 ± 15</td></tr></tbody></table>	PIER TYPE	COLOR CODE	MIN. EMBEDMENT DEPTH (mm)	EXPOSED PIER (mm)	HAP	White	2600	1200 ± 15	HMP	Black	2600	1160 ± 15	SAP	-	1680	1200 ± 15	SAPE	Blue	2140	1200 ± 15	SMP	Yellow	1680	1200 ± 15				
PIER TYPE	COLOR CODE	MIN. EMBEDMENT DEPTH (mm)	EXPOSED PIER (mm)																										
HAP	White	2600	1200 ± 15																										
HMP	Black	2600	1160 ± 15																										
SAP	-	1680	1200 ± 15																										
SAPE	Blue	2140	1200 ± 15																										
SMP	Yellow	1680	1200 ± 15																										
3	<div>Location of pier from E-W must be within ±15mm</div> 																												
4	<div>Location of pier from N-S must be within ±22mm</div> 																												
5	Top of piers E-W and N-S position within tolerance 90 ± 0.5°																												
6	<div>Orientation of the piers must be facing N-S</div> 																												

**PILING WORK CHECKLIST (C7)**

CONTRACTOR :	RFI NO : TBSKS.RFI.
TYPE OF WORK:	DRAWING REFERENCE NO. :
ZONE :	ROW NO :

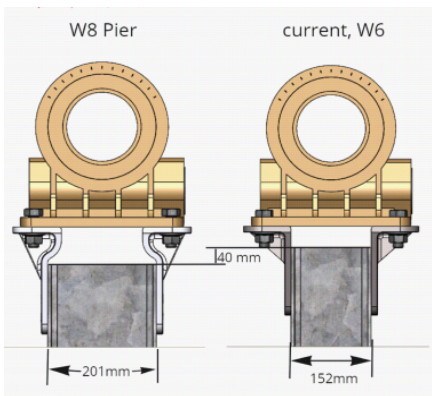No	Description	Inspection Result			Remark
		Accept	N/A	Reject	
7	HMP (W8) was installed at $1160 \pm 15\text{mm}$ 				
8	Location of pier as per designated point according to drawing for each zone				
9	Top of pile head reading on each row	<b>Piers point</b>	<b>1</b>	<b>2</b>	<b>3</b>
		<b>Top pile (mm)</b>			

Remarks:

Inspection Result : ☐ Accept ☐ Conditionally Accept ☐ Reject

Prepared by	Verified by	Witnessed by	Approved by
          (Project Engineer)	          (QA/QC Engineer)	          (Owner's Engineer)	          (Owner's Representative)
Name : Designation : Date :	Name : Designation : Date :	Name : Designation : Date :	Name : Designation : Date :