Case summary

Birth Date:

Incident ID: 23-08182

Patient ID: 2023032216213000-LP1547543206

Patient Name: Doe

Patient ID: <u>2023032216213000-</u>

LP1547543206

Incident ID: <u>23-08182</u> Device ID: <u>DCMH 4</u>

Age at Incident: 30 Years Case Start Date: 3/22/2023

Sex: Male Case Start Time: 4:21:30 PM

Race: <u>Unspecified</u> Time Adjustment: <u>System Adjusted Time</u>

Notes:

Finished Demos

Updated at 4/8/2023 9:52:46 PM by zphillips (Zach Phillips). Updated at 5/19/2023 11:39:58 PM by zphillips (Zach Phillips).

Comments:

# **Table of Contents**

CPR reports (by CPR period)	3
CPR report (by CPR period)	3



Device Type: LIFEPAK® 15 Power On: 3/22/2023 4:21:30 PM

CPR Annotations Edited: Yes


Device Configuration: 2L355RO40200OR


\*Non-paddles lead intervals are included in the reported CPR Ratio

\*Times have been adjusted by the system.


Duration: 00:44:33 Incident ID: 23-08182

Statistical Parameters: 1000-0300-3000-05





Compression rate





Ventilations/minute

17:14 / 18:44 = 92 %

127/minute

12/minute

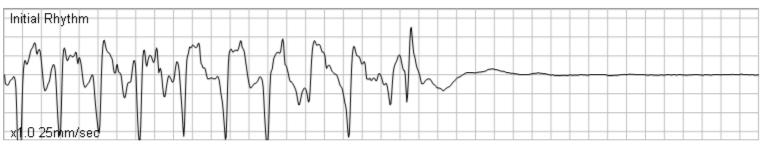

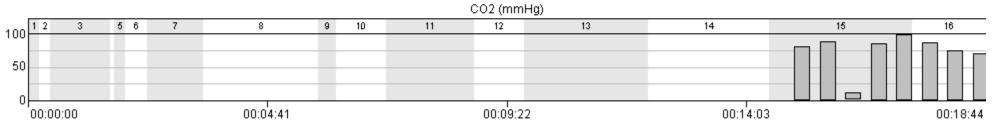



Device Type: LIFEPAK® 15
Power On: 3/22/2023 4:21:30 PM

CPR Annotations Edited: Yes

Device Configuration: 2L355RO40200OR

\*Non-paddles lead intervals are included in the reported CPR Ratio

\*Times have been adjusted by the system.

Duration: 00:44:33 Incident ID: 23-08182

Statistical Parameters: 1000-0300-3000-05

## Summary

CPR not done = 1:41 Compression count = 2138

Longest compression pause = 0:16 Pauses over 10 sec = 2

Comment Onl

Only two cycles were 2 minutes in duration.

#### Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:00	00:00:04	00:00:04	00:00:08	Pulse/rhythm check	Initial check	42	136	
2		00:00:12	00:00:20	00:00:08	00:00:06	Unknown		65	139	
3		00:00:26	00:01:34	00:01:08	00:00:02	Pulse/rhythm check		100	136	
4		00:01:36	00:01:39	00:00:03	00:00:02	Unknown		100	134	
5		00:01:40	00:01:46	00:00:06	00:00:07	Unknown		48	142	
6		00:01:53	00:02:15	00:00:22	00:00:04	Pulse/rhythm check		88	137	
7		00:02:19	00:03:22	00:01:03	00:00:03	Pulse/rhythm check		96	122	
8		00:03:25	00:05:32	00:02:07	00:00:08	Pulse/rhythm check		95	116	
9		00:05:40	00:05:53	00:00:13	00:00:08	Unknown		65	111	
10		00:06:01	00:06:52	00:00:51	00:00:08	Unknown		87	99	
11		00:07:00	00:08:36	00:01:36	00:00:07	Pulse/rhythm check		94	123	
12		00:08:43	00:09:39	00:00:55	00:00:03	Unknown		96	129	
13		00:09:42	00:12:03	00:02:22	00:00:04	Pulse/rhythm check		98	139	
14		00:12:08	00:14:15	00:02:07	00:00:14	Pulse/rhythm check		90	129	
15		00:14:29	00:17:02	00:02:32	00:00:16	Pulse/rhythm check		90	112	
16		00:17:18	00:18:43	00:01:26	00:00:01	Termination/Transfer of Care		99	146	8



Device Type: LIFEPAK® 15
Power On: 3/22/2023 4:21:30 PM

CPR Annotations Edited: Yes


Device Configuration: 2L355RO40200OR


\*Non-paddles lead intervals are included in the reported CPR Ratio

\*Times have been adjusted by the system.

Duration: 00:44:33 Incident ID: 23-08182

Statistical Parameters: 1000-0300-3000-05



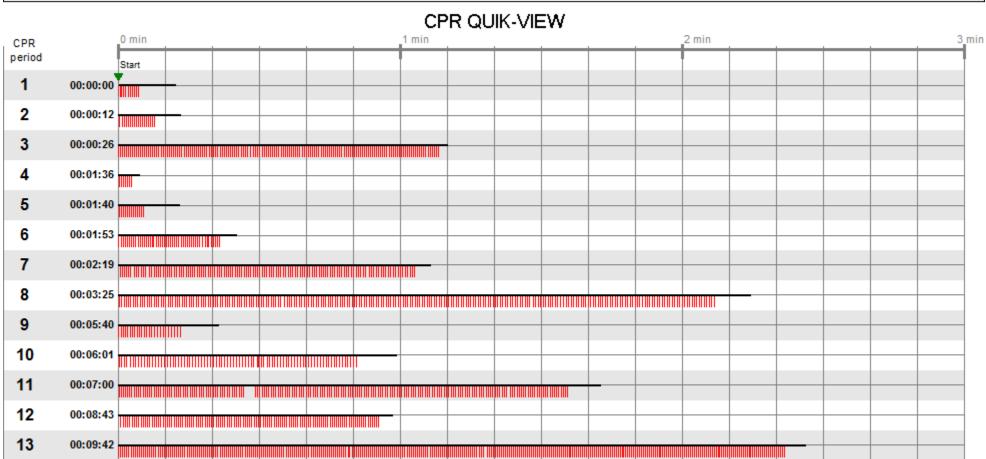



Device Type: LIFEPAK® 15 Power On: 3/22/2023 4:21:30 PM

Power On: 3/22/2023 4:21:30 P CPR Annotations Edited: Yes

Device Configuration: 2L355RO40200OR

\*Non-paddles lead intervals are included in the reported CPR Ratio

\*Times have been adjusted by the system.

Duration: 00:44:33 Incident ID: 23-08182

Statistical Parameters: 1000-0300-3000-05

