

Case summary

Incident ID: 23-08939
Patient ID: 2023033019482600-LP1547542988
Patient Name: Ellis

Patient ID:	<u>2023033019482600-LP1547542988</u>	Birth Date:	
Incident ID:	<u>23-08939</u>	Device ID:	<u>CROZER EMS</u>
Age at Incident:	<u>57 Years</u>	Case Start Date:	<u>3/30/2023</u>
Sex:	<u>Male</u>	Case Start Time:	<u>7:48:26 PM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

Case Summary:

Total Analyses: 0
Total Shocks: 0
Total 12-Leads: 3
Total Time Paced: 00:04:51

Notes:

STEMI, Pacing, CPR
Updated at 4/8/2023 10:19:05 PM by zphillips (Zach Phillips).
Updated at 5/20/2023 2:08:20 AM by zphillips (Zach Phillips).
Updated at 5/20/2023 9:42:36 PM by zphillips (Zach Phillips).

Comments:

Table of Contents

- 12-Lead reports3
 - 12-Lead 13
 - 12-Lead 24
 - 12-Lead 35
- CPR reports (by CPR period)6
 - CPR report (by CPR period)6


*Times have been adjusted by the system.

12-Lead 1

Incident ID: 23-08939
Patient ID: 2023033019482600-LP1547542988
Patient Name: Ellis
Power On: 3/30/2023 7:48:26 PM
Speed/Size: 25mm/sec/ x1.0

Device Type: LIFEPAK® 15
Device ID: CROZER EMS
Serial Number: LP1547542988
Device Configuration: 2LB55RO40200UR
Software Version: 3313494-010

Name: 12-Lead 1 HR 51bpm Abnormal ECG **Unconfirmed**
ID: 033023194826 3/30/2023 7:51:40 PM *** MEETS ST ELEVATION MI CRITERIA ***
Patient ID: PR 0.192s QRS 0.164s Sinus rhythm
Incident ID: QT/QTc: 0.418s/0.403s Severe right axis deviation
Age: 57 Sex: M P-QRS-T Axes: 56°-146°52° Right bundle branch block
Lateral ST elevation, CONSIDER ACUTE INFARCT

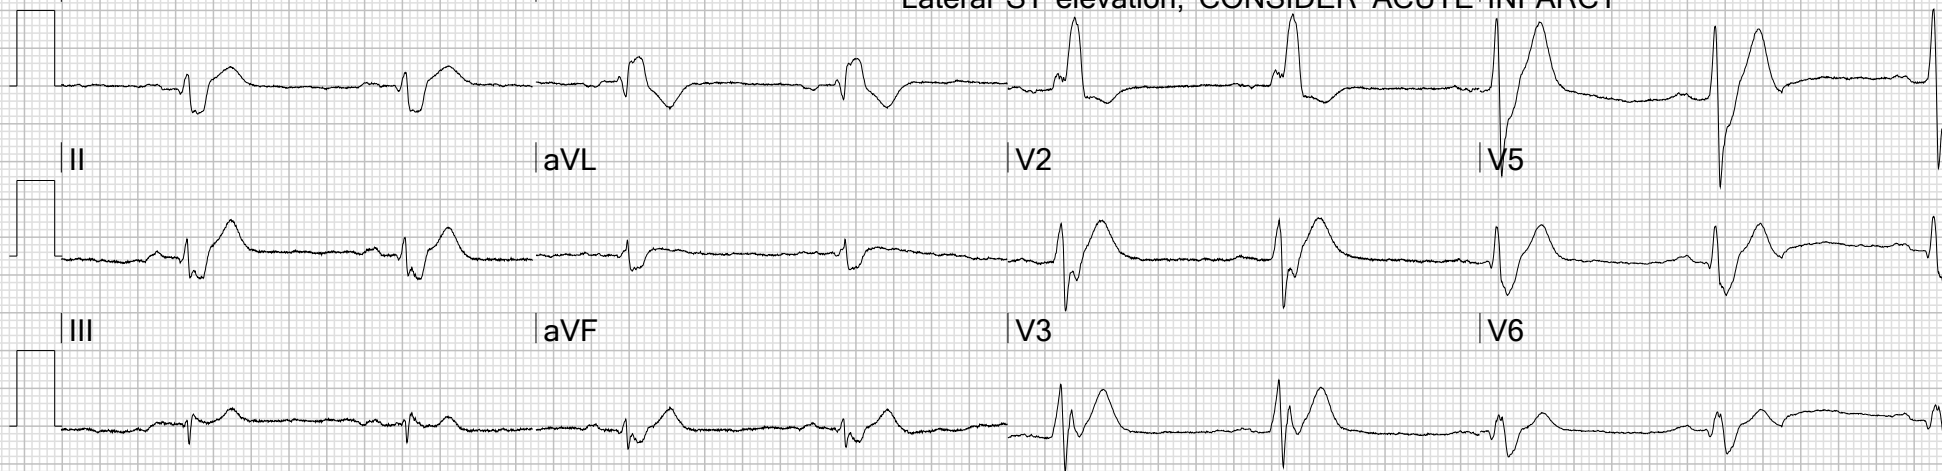

x1.0 .05-150Hz 25mm/sec

Physio-Control, Inc. Comments:

CROZER EMS MEDIC 100-D 3313494-010 LP1547542988

*Times have been adjusted by the system.

12-Lead 2

Incident ID: 23-08939
Patient ID: 2023033019482600-LP1547542988
Patient Name: Ellis
Power On: 3/30/2023 7:48:26 PM
Speed/Size: 25mm/sec/ x1.0

Device Type: LIFEPAK® 15
Device ID: CROZER EMS
Serial Number: LP1547542988
Device Configuration: 2LB55RO40200UR
Software Version: 3313494-010


Name: 12-Lead 2 HR 80bpm Pacer On, Interpretation suppressed

ID: 033023194826 3/30/2023 7:58:08 PM

Patient ID: PR 0.202s QRS 0.156s

Incident ID: QT/QTc: 0.334s/0.369s

Age: 57 Sex: M P-QRS-T Axes: 155°-99°162°

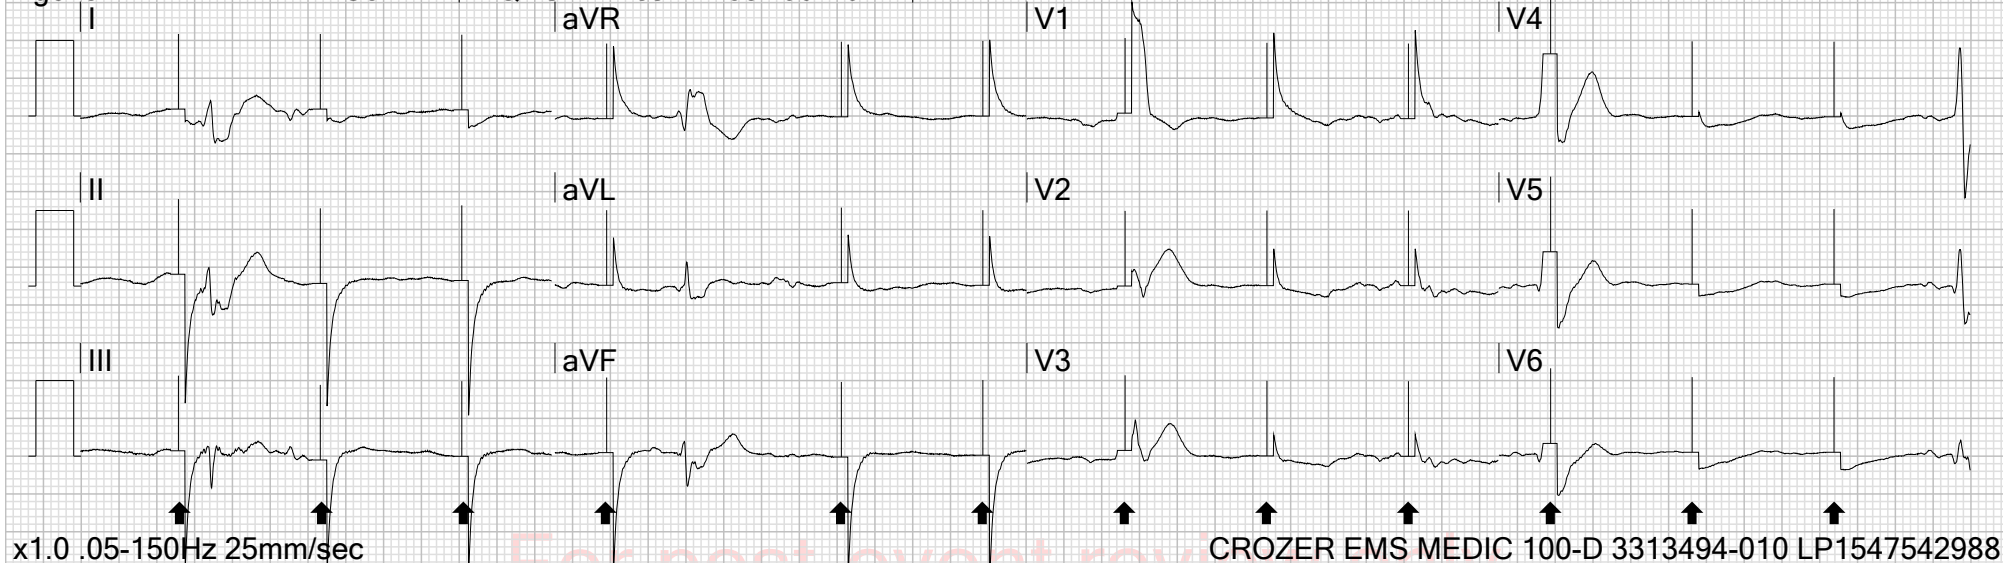

Physio-Control, Inc. Comments:

*Times have been adjusted by the system.

12-Lead 3

Incident ID: 23-08939
Patient ID: 2023033019482600-LP1547542988
Patient Name: Ellis
Power On: 3/30/2023 7:48:26 PM
Speed/Size: 25mm/sec/ x1.0

Device Type: LIFEPAK® 15
Device ID: CROZER EMS
Serial Number: LP1547542988
Device Configuration: 2LB55RO40200UR
Software Version: 3313494-010


Name: 12-Lead 3 HR 79bpm Pacer On, Interpretation suppressed

ID: 033023194826 3/30/2023 8:00:38 PM

Patient ID: PR 0.238s QRS 0.116s

Incident ID: QT/QTc: 0.316s/0.349s

Age: 57 Sex: M P-QRS-T Axes: 120°-102°113°

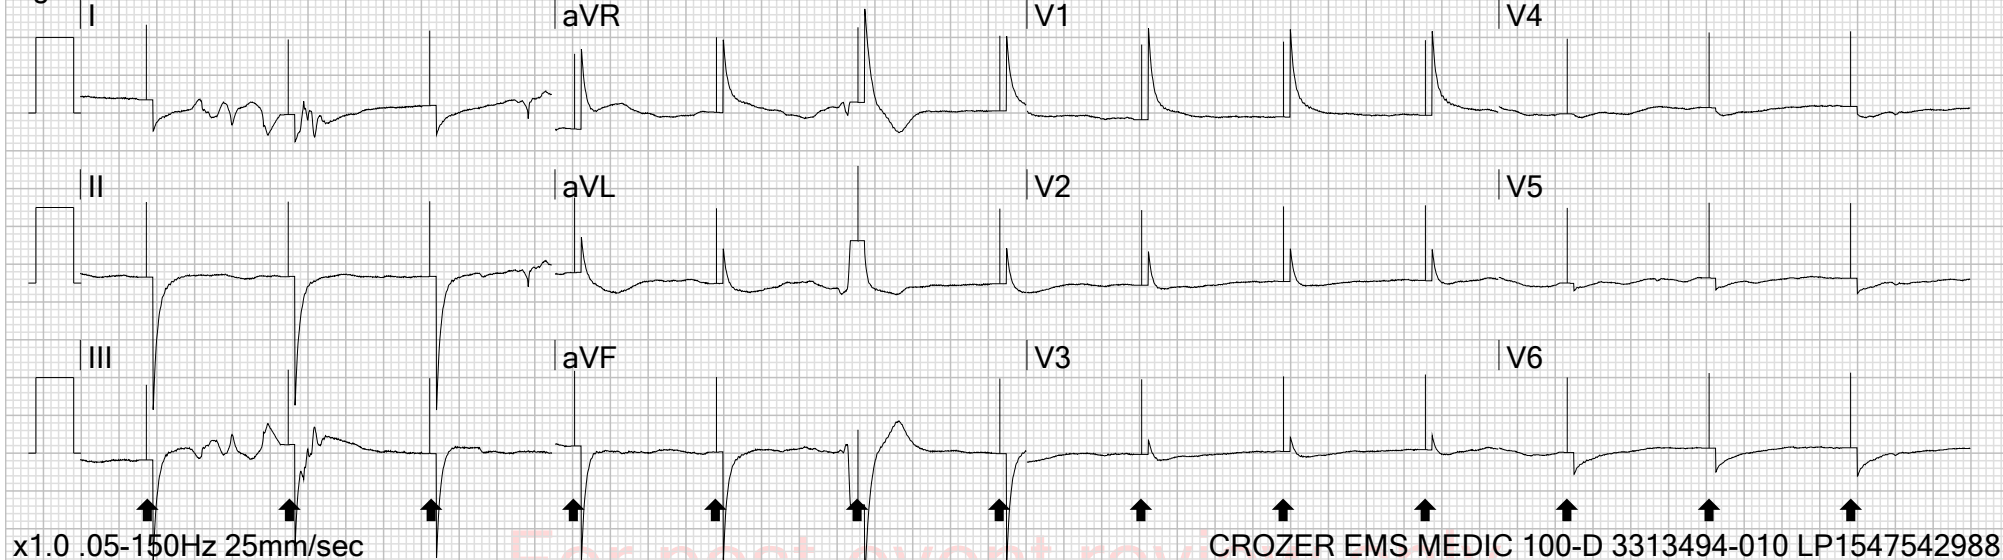

Physio-Control, Inc. Comments:

CPR report




Device Type: LIFEPAK® 15
Power On: 3/30/2023 7:48:26 PM
CPR Annotations Edited: Yes
Device Configuration: 2LB55RO40200UR

Duration: 00:39:04
Incident ID: 23-08939
Statistical Parameters: 1000-0300-3000-05


*Times have been adjusted by the system.

Compression ratio
(/total time)




16:52 / 18:40 = 90 %

Compression rate




113/minute

Ventilations/minute




2/minute

Initial Rhythm

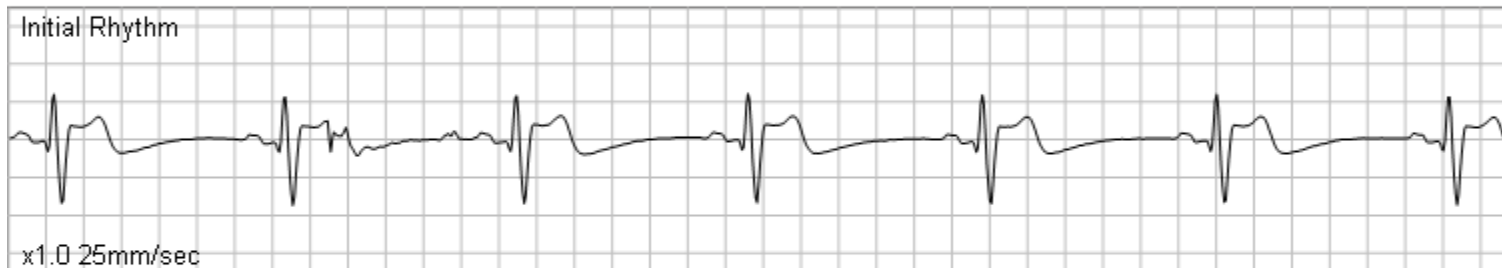

CO2 (mmHg)

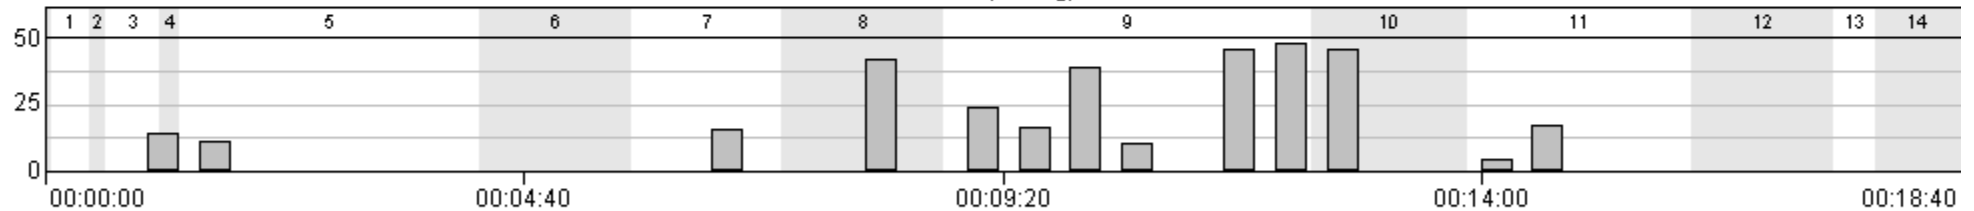

CPR report



Device Type: LIFEPAK® 15
 Power On: 3/30/2023 7:48:26 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2LB55RO40200UR

Duration: 00:39:04
 Incident ID: 23-08939
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

Summary

CPR needed	= 18:40	CPR done	= 16:51
CPR not done	= 1:49	Compression count	= 1840
Longest compression pause	= 0:21	Pauses over 10 sec	= 3
Comment	2 minute cycles		

Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:00	00:00:19	00:00:19	00:00:06	Pulse/rhythm check		77	130	--
2		00:00:25	00:00:30	00:00:04	00:00:05	Unknown		58	129	--
3		00:00:34	00:00:45	00:00:11	00:00:21	Unknown		35	131	2
4		00:01:07	00:01:15	00:00:08	00:00:03	Unknown		80	102	--
5		00:01:18	00:04:07	00:02:49	00:00:07	Pulse/rhythm check		96	97	--
6		00:04:14	00:05:37	00:01:23	00:00:05	Pulse/rhythm check		95	107	--
7		00:05:42	00:07:04	00:01:22	00:00:06	Pulse/rhythm check		94	109	1
8		00:07:10	00:08:38	00:01:27	00:00:07	Pulse/rhythm check		93	112	1
9		00:08:45	00:12:09	00:03:25	00:00:10	Pulse/rhythm check		95	111	3
10		00:12:19	00:13:45	00:01:26	00:00:06	Pulse/rhythm check		94	120	1
11		00:13:51	00:15:53	00:02:02	00:00:09	Pulse/rhythm check		93	114	--
12		00:16:03	00:17:17	00:01:14	00:00:08	Pulse/rhythm check		86	122	--
13		00:17:25	00:17:35	00:00:11	00:00:14	Unknown		43	130	--
14		00:17:49	00:18:39	00:00:50	00:00:01	Termination/Transfer of Care		99	122	--

CPR report




Device Type: LIFEPAK® 15
 Power On: 3/30/2023 7:48:26 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2LB55RO40200UR

Duration: 00:39:04
 Incident ID: 23-08939
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.


- Ventilation
- AED-prompted CPR period
- Shock
- Chest compression
- AED Analysis
- ROSC (user annotated)

CPR QUIK-VIEW

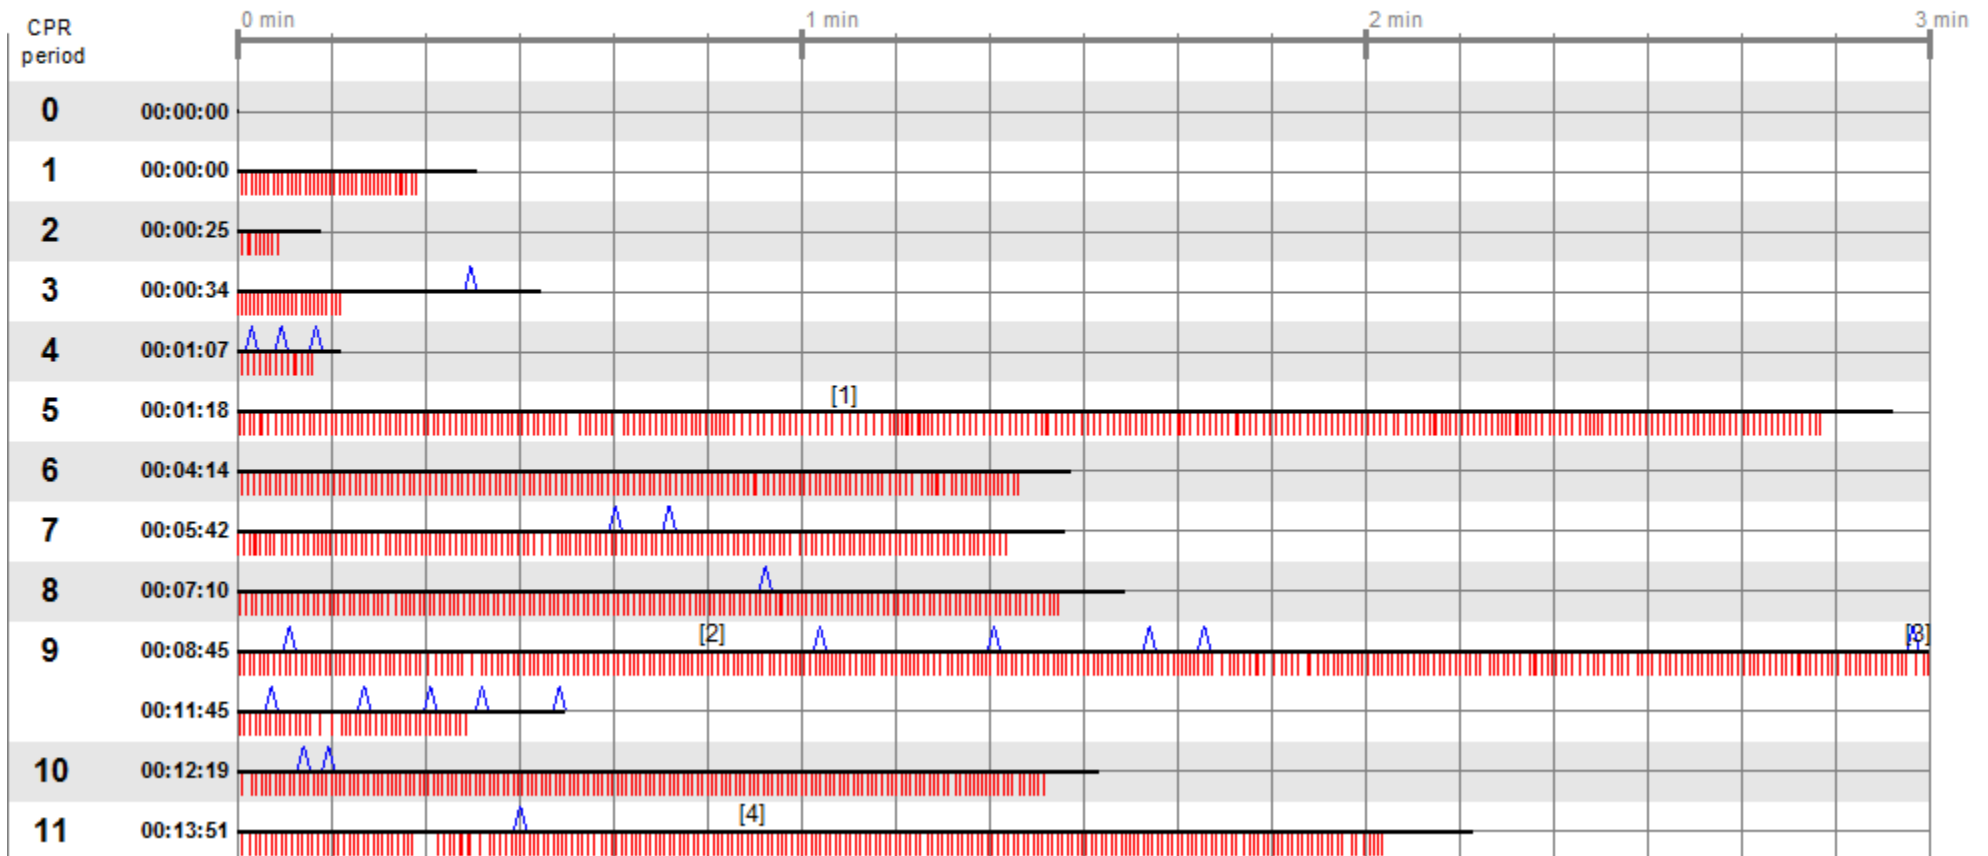

CPR report

	Device Type:	LIFEPAK® 15	Duration:	00:39:04
	Power On:	3/30/2023 7:48:26 PM	Incident ID:	23-08939
	CPR Annotations Edited:	Yes	Statistical Parameters:	1000-0300-3000-05
	Device Configuration:	2LB55RO40200UR		
	*Times have been adjusted by the system.			

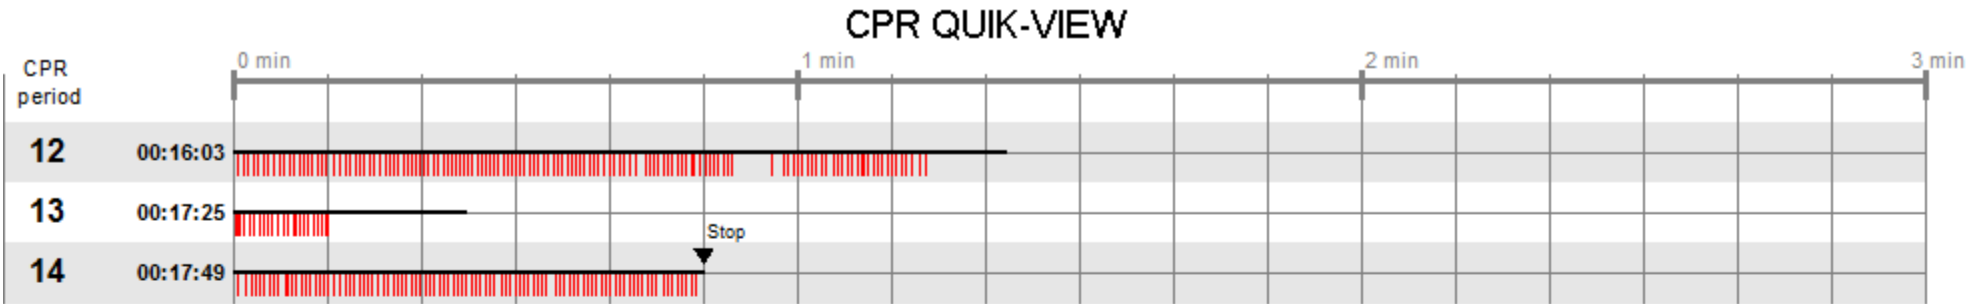

[1] Epinephrine, [2] Epinephrine, [3] Epinephrine, [4] Epinephrine