

Case summary

Incident ID: 23-05005
Patient ID: 2023021817201500-LP1547545197
Patient Name: Duddy

Patient ID:	<u>2023021817201500-LP1547545197</u>	Birth Date:	
Incident ID:	<u>23-05005</u>	Device ID:	<u>MICU 66</u>
Age at Incident:	<u>86 Years</u>	Case Start Date:	<u>2/18/2023</u>
Sex:	<u>Female</u>	Case Start Time:	<u>5:20:16 PM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

Case Summary:

Total Analyses: 0
Total Shocks: 1
Total 12-Leads: 0
Total Time Paced: 00:00:00

Notes:

Probable VF under pacemaker.
Demo only
Updated at 3/13/2023 1:29:10 AM by zphillips (Zach Phillips).
Updated at 3/26/2023 9:24:59 PM by zphillips (Zach Phillips).

Comments:

Table of Contents

CPR reports (by CPR period)3

 CPR report (by CPR period)3

CPR report




Device Type: LIFEPAK® 15
Power On: 2/18/2023 5:20:16 PM
CPR Annotations Edited: Yes
Device Configuration: 2L355R040200UR

Duration: 01:07:30
Incident ID: 23-05005
Statistical Parameters: 1000-0300-3000-05


*Times have been adjusted by the system.

Compression ratio
(/total time)




40:36 / 47:14 = 86 %

Compression rate





139/minute

Ventilations/minute



7/minute

Initial Rhythm

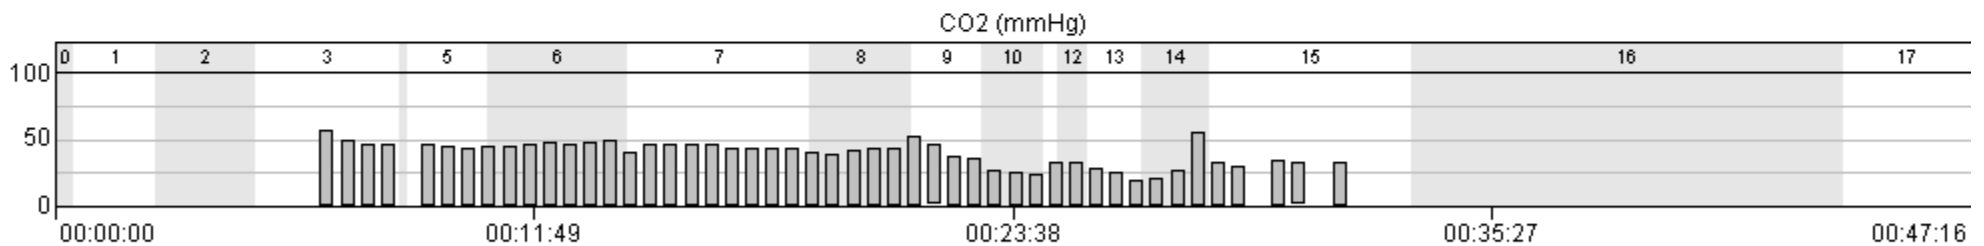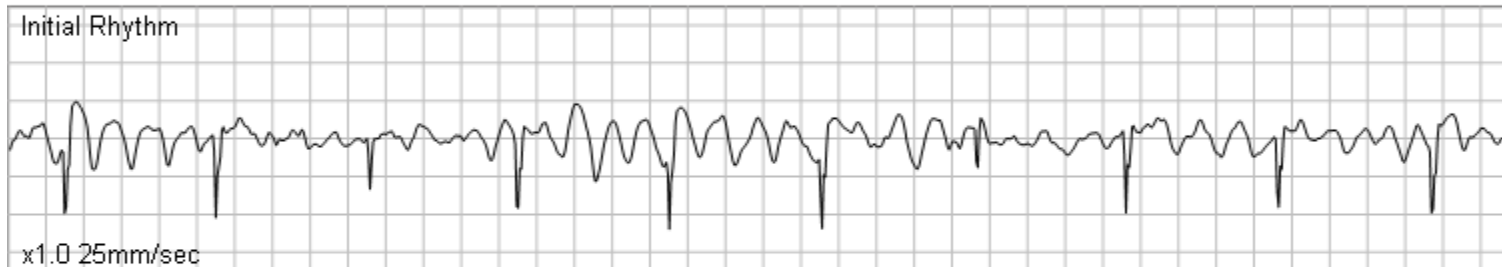

CPR report



Device Type: LIFEPAK® 15
 Power On: 2/18/2023 5:20:16 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355RO40200UR

Duration: 01:07:30
 Incident ID: 23-05005
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

Summary

CPR needed	= 47:14	CPR done	= 40:36
CPR not done	= 6:38	Compression count	= 5484
Longest compression pause	= 1:32	Pauses over 10 sec	= 11

Comment: Patient appeared to have pacemaker, making the initial underlying rhythm VF.

Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:25	00:02:16	00:01:51	00:00:12	Pulse/rhythm check	Initial pause before compressions for pulse check. Probable VF under pacemaker.	90	118	--
2		00:02:28	00:04:43	00:02:15	00:00:12	Pulse/rhythm check	Probable VF	90	117	--
3		00:04:55	00:07:54	00:02:59	00:00:32	Pulse/rhythm check	Probable VF	85	118	5
4		00:08:27	00:08:35	00:00:09	00:00:06	Defibrillation	VF, good pre/post pause duration	79	129	--
5		00:08:41	00:10:26	00:01:45	00:00:13	Pulse/rhythm check		89	128	7
6		00:10:39	00:13:07	00:02:28	00:00:58	Pulse/rhythm check	Long pause	72	129	6
7		00:14:05	00:17:05	00:03:00	00:01:32	Pulse/rhythm check	Very long pause	66	141	7
8		00:18:37	00:20:57	00:02:20	00:00:09	Pulse/rhythm check		94	144	8
9		00:21:06	00:22:36	00:01:30	00:00:14	Pulse/rhythm check		86	137	12
10		00:22:50	00:24:13	00:01:22	00:00:09	Pulse/rhythm check		88	142	12
11		00:24:22	00:24:36	00:00:14	00:00:09	Pulse/rhythm check		65	132	--
12		00:24:45	00:24:51	00:00:06	00:00:37	Transfer		14	121	12
13		00:25:28	00:26:01	00:00:33	00:00:47	Transfer		41	145	13
14		00:26:48	00:28:16	00:01:29	00:00:13	Pulse/rhythm check		88	142	8
15		00:28:29	00:33:20	00:04:51	00:00:09	Transfer		97	143	3
16		00:33:29	00:44:06	00:10:37	00:00:03	Transfer	Long time with no pulse check.	100	147	--

CPR report



Device Type: LIFEPAK® 15
 Power On: 2/18/2023 5:20:16 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355R040200UR

Duration: 01:07:30
 Incident ID: 23-05005
 Statistical Parameters: 1000-0300-3000-05


*Times have been adjusted by the system.

Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
17		00:44:09	00:47:16	00:03:07	00:00:00	Termination/Transfer of Care		100	152	--

Ventilation
 Chest compression
 AED Analysis
 AED-prompted CPR period
 Shock
 ROSC (user annotated)

CPR QUIK-VIEW

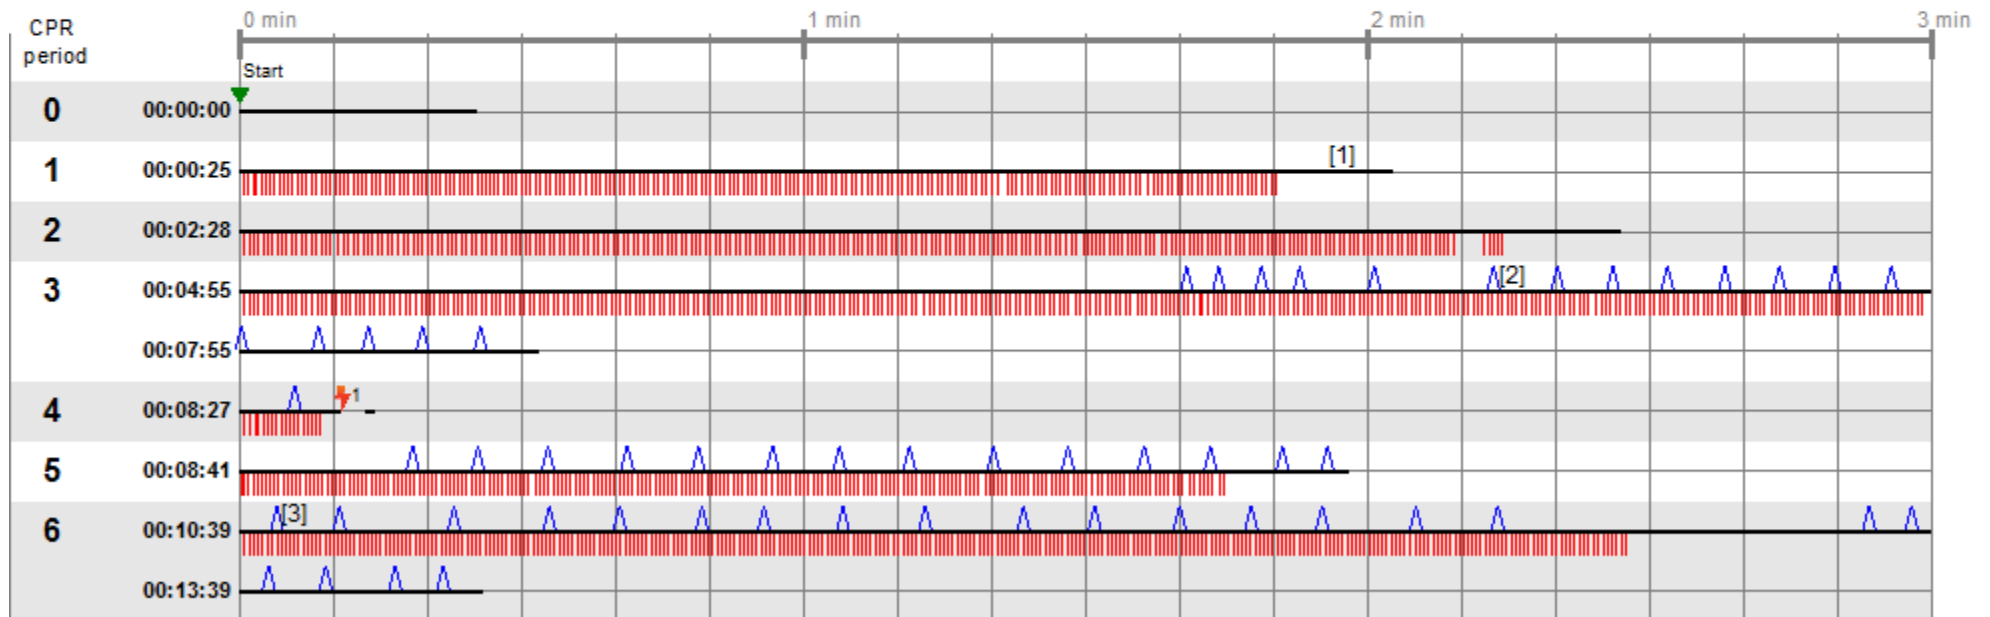

CPR report




Device Type: LIFEPAK® 15
 Power On: 2/18/2023 5:20:16 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355RO40200UR

Duration: 01:07:30
 Incident ID: 23-05005
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

CPR QUIK-VIEW

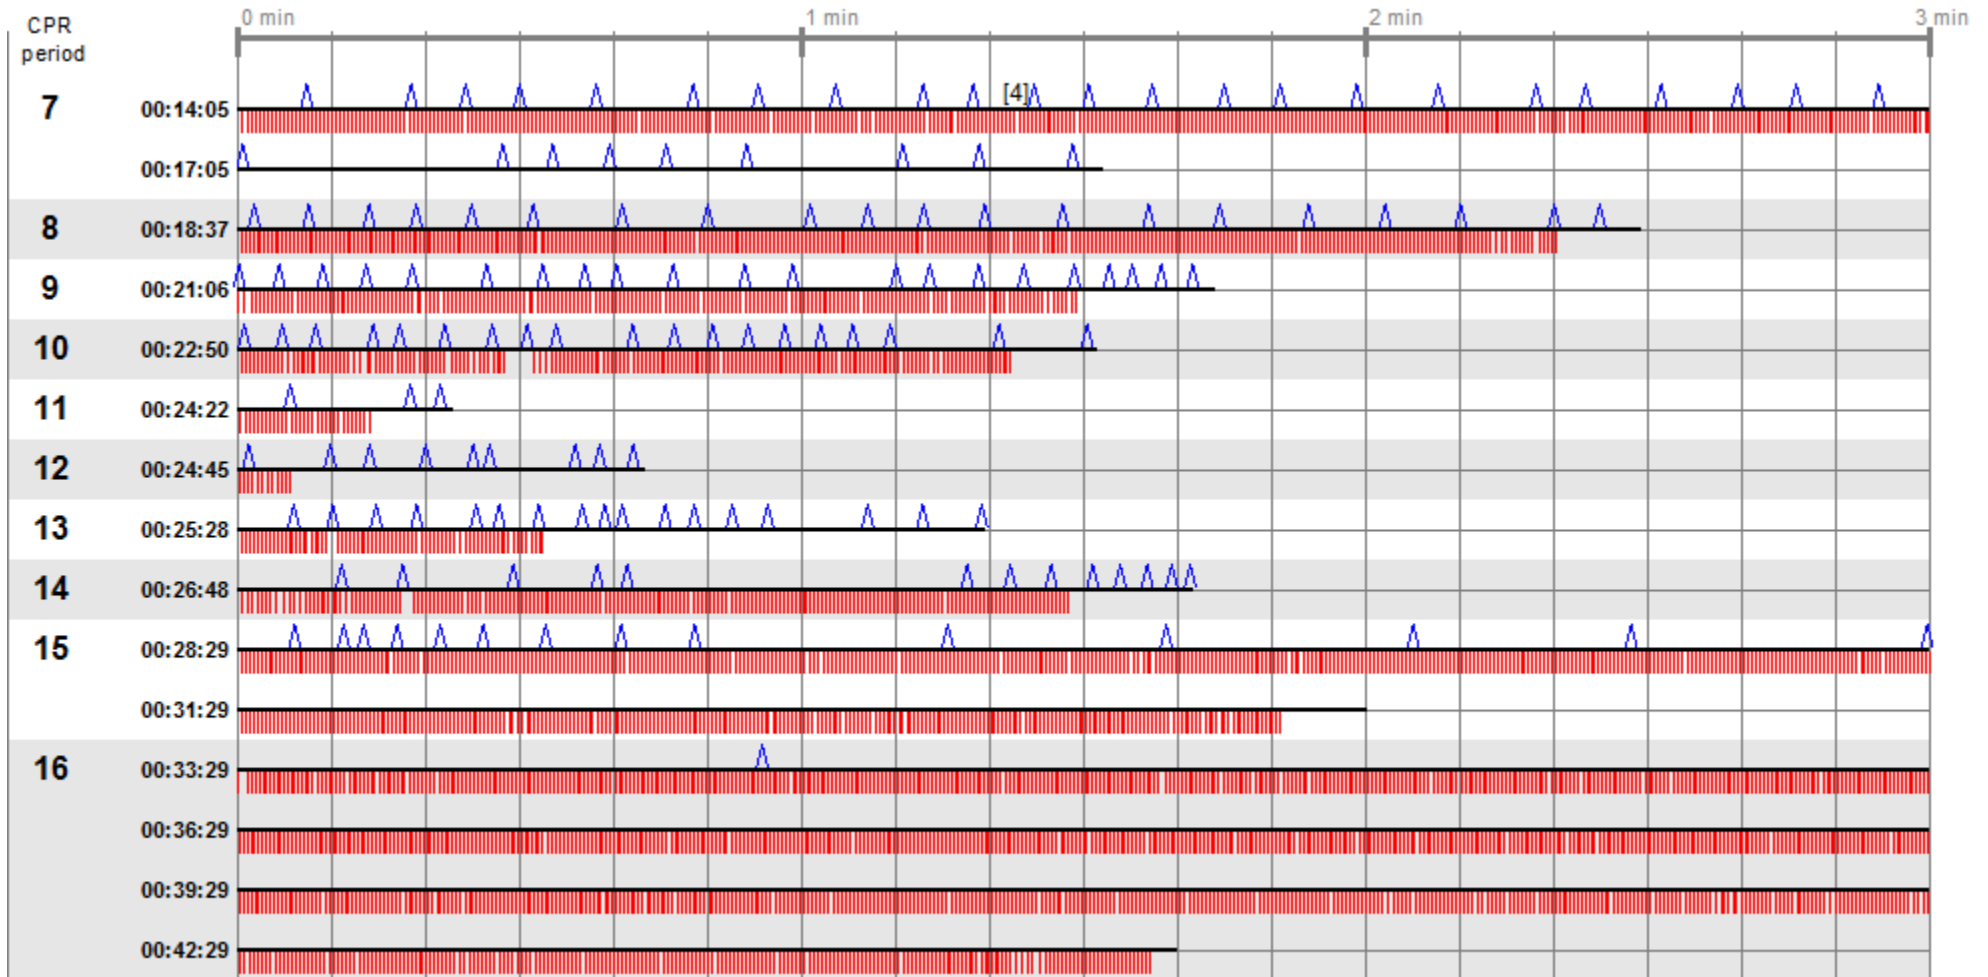

CPR report




Device Type: LIFEPAK® 15
 Power On: 2/18/2023 5:20:16 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355R040200UR

Duration: 01:07:30
 Incident ID: 23-05005
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

CPR QUIK-VIEW

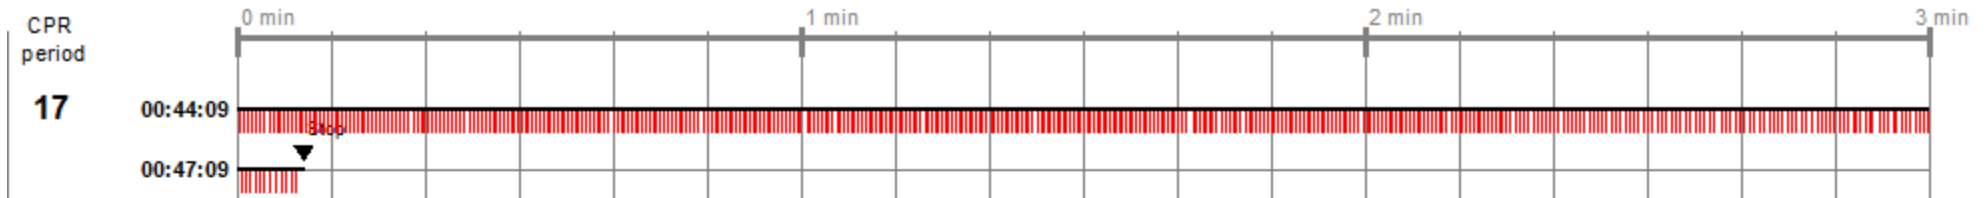

[1] EPINEPHRINE 10, [2] EPINEPHRINE 10, [3] EPINEPHRINE 10, [4] EPINEPHRINE 10

Shock	Time	Energy	Pre-shock CPR pause	Post-shock CPR pause
⚡ 1	8:38	360 J	0:02	0:03