

Case summary

Incident ID: 23-05439
Patient ID: 2023022313122300-LP1547545108
Patient Name: Douglass

Patient ID:	<u>2023022313122300-LP1547545108</u>	Birth Date:	
Incident ID:	<u>23-05439</u>	Device ID:	<u>MICU 103A</u>
Age at Incident:	<u>43 Years</u>	Case Start Date:	<u>2/23/2023</u>
Sex:	<u>Male</u>	Case Start Time:	<u>1:12:23 PM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

Notes:

Rate < 140
Summary complete.
Demos only
Updated at 3/13/2023 1:44:53 AM by zphillips (Zach Phillips).
Updated at 3/29/2023 4:34:16 PM by zphillips (Zach Phillips).

Comments:

Table of Contents

CPR reports (by CPR period)3

 CPR report (by CPR period)3

CPR report




Device Type: LIFEPAK® 15
 Power On: 2/23/2023 1:12:23 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355R0402000R

Duration: 00:32:55
 Incident ID: 23-05439
 Statistical Parameters: 1000-0300-3000-05


*Times have been adjusted by the system.

Compression ratio
 (/total time)




28:04 / 31:05 = 90 %

Compression rate




137/minute

Ventilations/minute




2/minute

Initial Rhythm

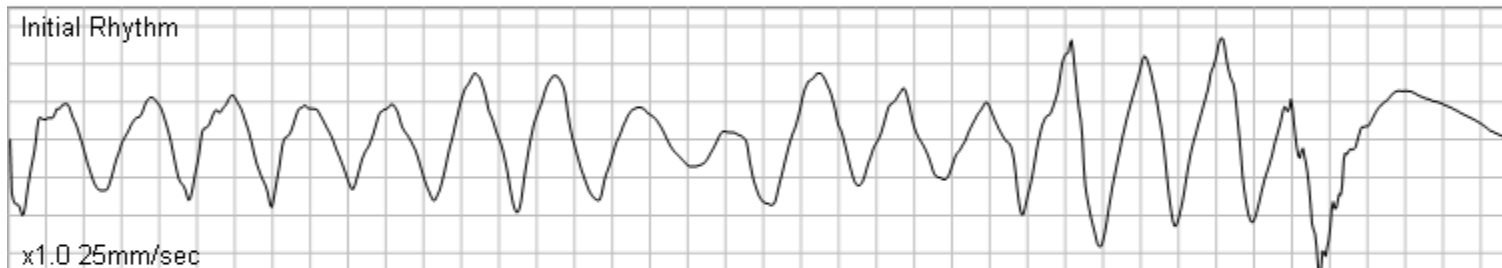

x1.0 25mm/sec

CO2 (mmHg)

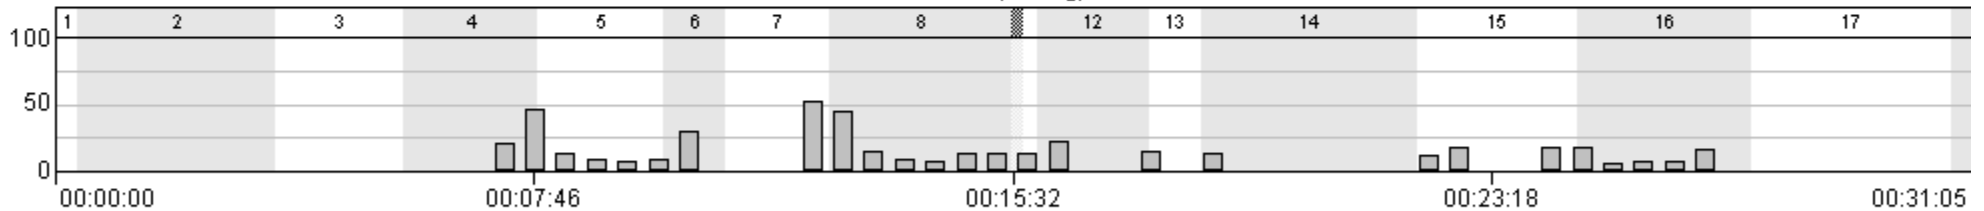

CPR report



Device Type: LIFEPAK® 15
Power On: 2/23/2023 1:12:23 PM
CPR Annotations Edited: Yes
Device Configuration: 2L355R0402000R

Duration: 00:32:55
Incident ID: 23-05439
Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

Summary

CPR needed	= 31:05	CPR done	= 28:16
CPR not done	= 2:49	Compression count	= 3680
Longest compression pause	= 0:28	Pauses over 10 sec	= 8

Comment	Compression rate consistently over 130. HR < 139 alarm going off most of the time.
---------	--

CPR report



Device Type: LIFEPAK® 15
 Power On: 2/23/2023 1:12:23 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355RO402000R

Duration: 00:32:55
 Incident ID: 23-05439
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:00	00:00:07	00:00:07	00:00:14	Pulse/rhythm check	Initial pulse check. Long pause.	35	135	--
2		00:00:21	00:03:20	00:03:00	00:00:13	Pulse/rhythm check	Long pause	93	142	--
3		00:03:33	00:05:27	00:01:54	00:00:10	Pulse/rhythm check	Good 2 mins	92	142	--
4		00:05:37	00:07:21	00:01:44	00:00:27	Pulse/rhythm check	Rhythm change. Long pause	76	139	2
5		00:07:48	00:09:39	00:01:51	00:00:12	Pulse/rhythm check	Rhythm change back to asystole	90	141	3
6		00:09:51	00:10:47	00:00:55	00:00:04	Pulse/rhythm check		94	136	1
7		00:10:51	00:12:29	00:01:38	00:00:05	Compressor switch?		96	136	1
8		00:12:34	00:15:29	00:02:55	00:00:02	Pulse/rhythm check	Long duration	100	148	4
9		00:15:31	00:15:33	00:00:02	00:00:03	Unknown		54	131	--
10		00:15:36	00:15:40	00:00:04	00:00:03	Unknown		68	139	--
11		00:15:43	00:15:48	00:00:05	00:00:08	Unknown		40	150	--
12		00:15:56	00:17:36	00:01:41	00:00:08	Pulse/rhythm check		93	135	1
13		00:17:45	00:18:26	00:00:41	00:00:10	Pulse/rhythm check	Short duration	80	139	1
14		00:18:36	00:21:39	00:03:03	00:00:28	Pulse/rhythm check	Long duration	85	129	1
15		00:22:07	00:24:35	00:02:29	00:00:06	Pulse/rhythm check	Long duration	97	140	2
16		00:24:41	00:27:21	00:02:40	00:00:11	Pulse/rhythm check	Long duration	94	125	1
17		00:27:32	00:30:42	00:03:10	00:00:04	Pulse/rhythm check	Long duration	92	124	--
18		00:30:46	00:31:04	00:00:18	00:00:01	Termination/Transfer of Care		97	139	--

Ventilation

Chest compression

AED-prompted CPR period

AED Analysis

Shock

ROSC (user annotated)

CPR report




Device Type: LIFEPAK® 15
 Power On: 2/23/2023 1:12:23 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355R0402000R

Duration: 00:32:55
 Incident ID: 23-05439
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

CPR QUIK-VIEW

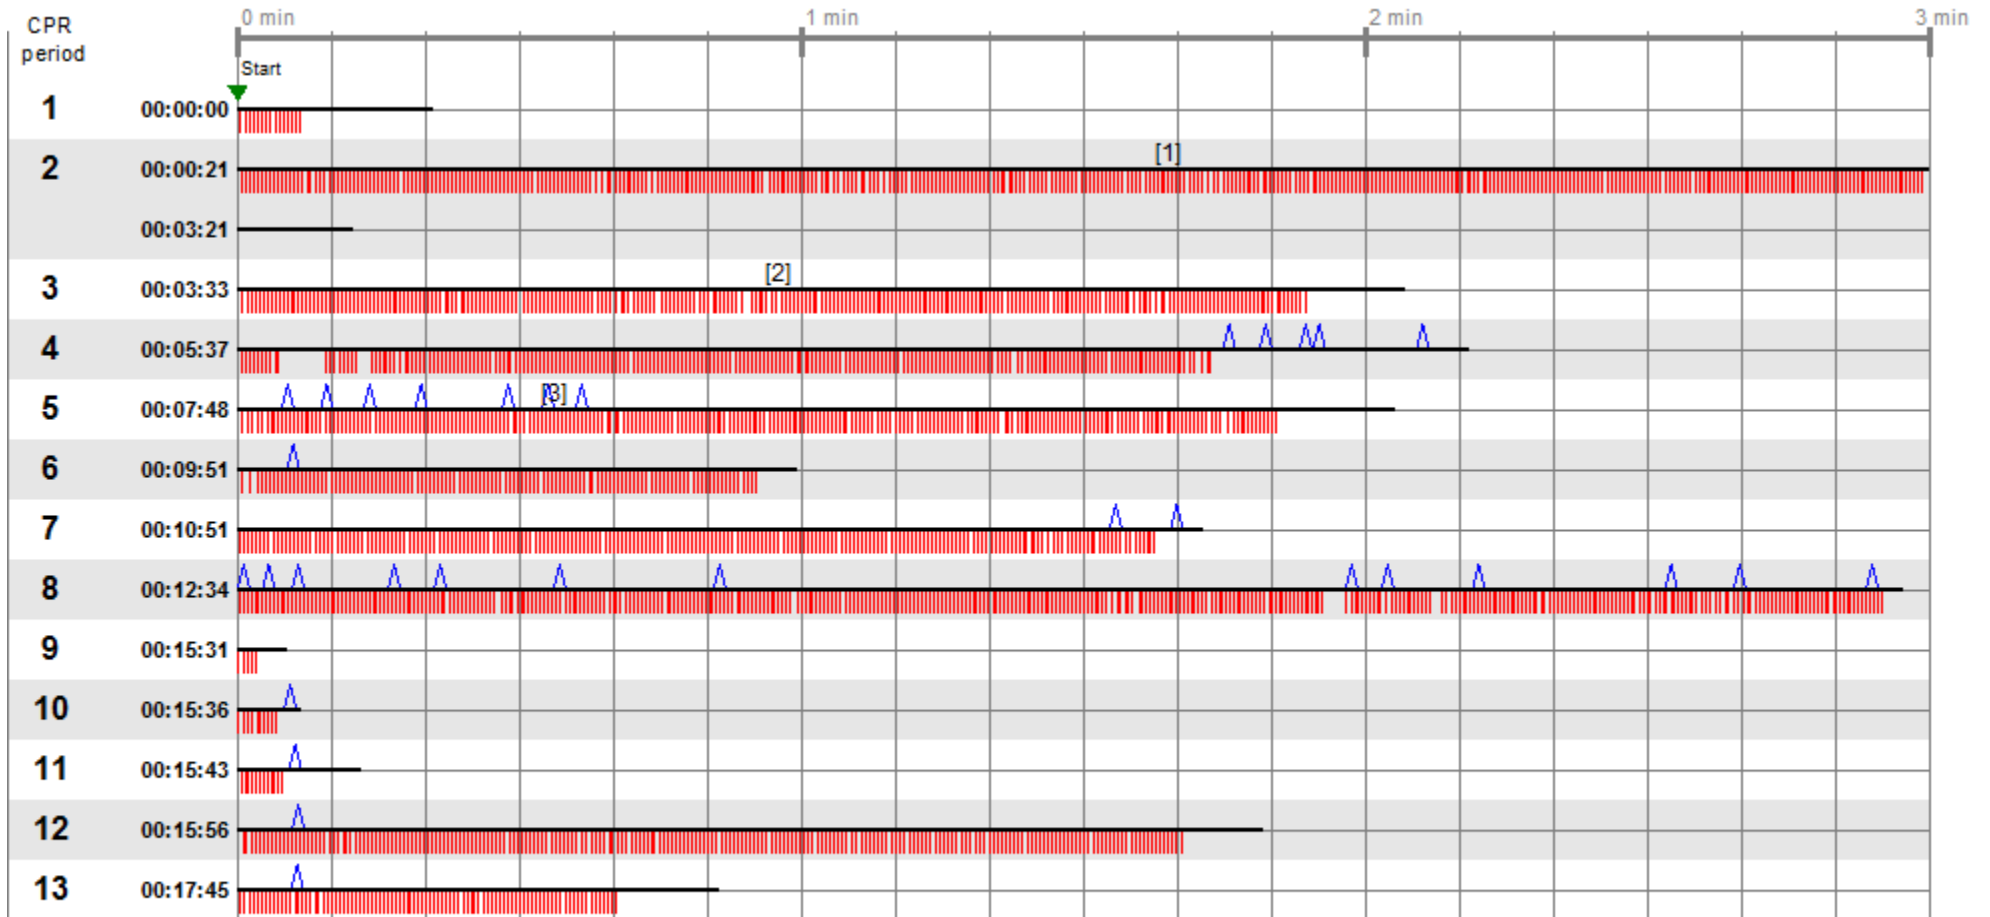

CPR report




Device Type: LIFEPAK® 15
Power On: 2/23/2023 1:12:23 PM
CPR Annotations Edited: Yes
Device Configuration: 2L355R0402000R

Duration: 00:32:55
Incident ID: 23-05439
Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

CPR QUIK-VIEW

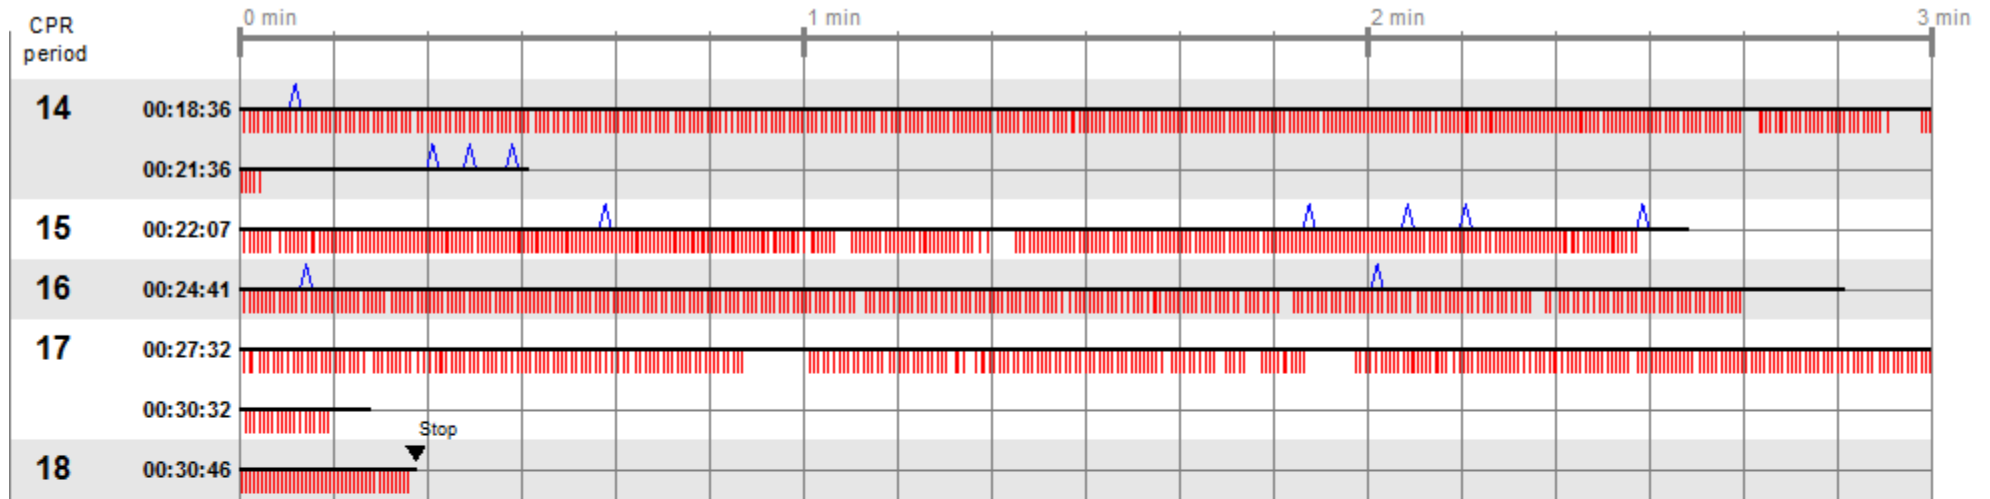

[1] Generic, [2] Generic, [3] Generic