Case summary

Incident ID:	23-05047
Patient ID:	2023021904101100-LP1547542357
Patient Name:	Schmincke

Patient ID:	2023021904101100-LP1547542357	Birth Date:	
Incident ID:	23-05047	Device ID:	LP152357
Age at Incident:	Unknown	Case Start Date:	2/19/2023
Sex:	Unknown	Case Start Time:	4:10:10 AM
Race:	Unspecified	Time Adjustment:	System Adjusted Time

Notes:

Summary complete

Cases have been merged at 2/19/2023 4:45:16 AM by importer (Importer System).

Demos only
Updated at 3/13/2023 1:30:08 AM by zphillips (Zach Phillips).
Updated at 3/29/2023 11:41:24 PM by zphillips (Zach Phillips).

Comments:

CaseReports Version 21.0.0.4

Table of Contents

CPR report

|			
Device Type:	LIFEPAK® 15	Duration:	00:32:16
Power On:	2/19/2023 4:10:10 AM	Incident ID:	23-05047
CPR Annotations Edited:	Yes	Statistical Parameters:	1000-0300-3000-05
Device Configuration:	2L355RRB0200UR		

*Times have been adjusted by the system.

Compression ratio (/total time)

20:43 / 22:38 = 92 %

Compression rate

131/minute

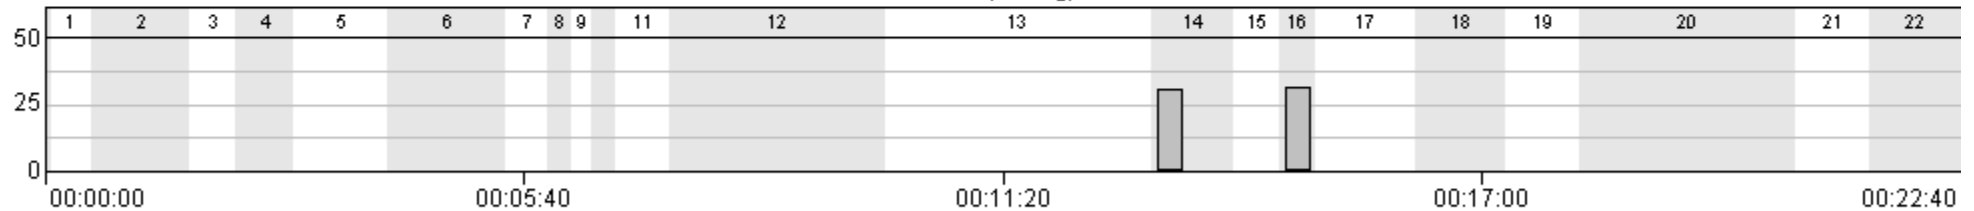## Ventilations/minute

6/minute

Initial Rhythm
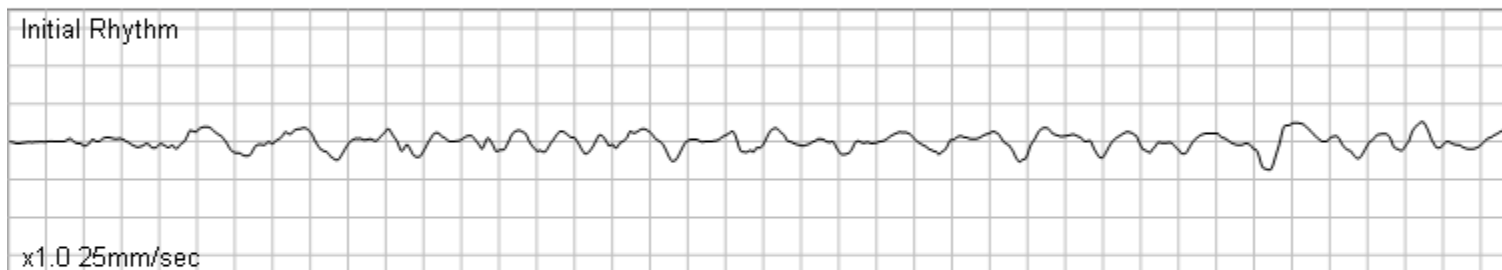
x1.0 25mm/sec

CO2 (mmHg)

| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 |

50

25

0

00:00:00   00:05:40   00:11:20   00:17:00   00:22:40

CPR report

Device Type:	LIFEPAK® 15		Duration:	00:32:16
Power On:	2/19/2023 4:10:10 AM		Incident ID:	23-05047
CPR Annotations Edited:	Yes		Statistical Parameters:	1000-0300-3000-05
Device Configuration:	2L355RRB0200UR			

*Times have been adjusted by the system.

Summary

CPR needed	= 22:38	CPR done	= 20:30
CPR not done	= 2:07	Compression count	= 2602
Longest compression pause	= 0:17	Pauses over 10 sec	= 3

Comment   Possible fine VF throughout.

Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:00	00:00:26	00:00:26	00:00:05	Pulse/rhythm check	Initial rhythm check	86	136	--
2		00:00:32	00:01:38	00:01:07	00:00:03	Pulse/rhythm check	Aim for 2 minutes between pulse checks	96	130	--
3		00:01:42	00:02:07	00:00:25	00:00:07	Pulse/rhythm check	Try to minimize interruptions to compressions	80	134	--
4		00:02:14	00:02:46	00:00:33	00:00:09	Pulse/rhythm check	Try to minimize interruptions to compressions	81	136	--
5		00:02:55	00:03:50	00:00:55	00:00:11	Pulse/rhythm check		81	124	--
6		00:04:02	00:05:21	00:01:19	00:00:05	Pulse/rhythm check	Aim for 2 minutes between pulse checks. Possible shockable rhythm.	95	133	--
7		00:05:26	00:05:52	00:00:26	00:00:04	Unknown	Try to minimize interruptions to compressions	87	139	--
8		00:05:56	00:06:10	00:00:13	00:00:03	Unknown	Try to minimize interruptions to compressions	84	144	--
9		00:06:13	00:06:25	00:00:12	00:00:02	Unknown	Try to minimize interruptions to compressions	100	151	--
10		00:06:27	00:06:42	00:00:15	00:00:03	Unknown	Try to minimize interruptions to compressions.	86	138	--
11		00:06:45	00:07:20	00:00:35	00:00:03	Pulse/rhythm check	Possible VF	93	137	--
12		00:07:23	00:09:39	00:02:16	00:00:17	Pulse/rhythm check	Possible VF	89	105	--
13		00:09:56	00:12:51	00:02:55	00:00:13	Pulse/rhythm check	Aim for 2 minutes between pulse checks	93	131	--
14		00:13:04	00:14:00	00:00:56	00:00:03	Pulse/rhythm check	Aim for 2 minutes between pulse checks.	96	141	4
15		00:14:03	00:14:32	00:00:30	00:00:04	Unknown		89	144	--
16		00:14:36	00:14:54	00:00:17	00:00:08	Unknown		70	135	--

PDFExporter 21.0.0.1

CPR report

Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
17		00:15:02	00:16:06	00:01:04	00:00:06	Pulse/rhythm check	Aim for 2 minutes between pulse checks	91	126	2
18		00:16:12	00:17:13	00:01:01	00:00:04	Pulse/rhythm check	Aim for 2 minutes between pulse checks.	95	134	--
19		00:17:16	00:17:59	00:00:43	00:00:10	Pulse/rhythm check	Aim for 2 minutes between pulse checks	83	139	--
20		00:18:09	00:20:39	00:02:30	00:00:03	Pulse/rhythm check	Aim for 2 minutes between pulse checks	98	115	--
21		00:20:43	00:21:32	00:00:49	00:00:03	Pulse/rhythm check	Aim for 2 minutes between pulse checks.	100	132	--
22		00:21:35	00:22:39	00:01:04	00:00:00	Termination/Transfer of Care		99	138	--

- Ventilation
- Chest compression
- AED-prompted CPR period
- AED Analysis
- Shock
- ROSC (user annotated)

CPR QUIK-VIEW

CPR report

CPR QUIK-VIEW

CPR period		0 min	1 min	2 min	3 min
6	00:04:02				
7	00:05:26				
8	00:05:56				
9	00:06:13				
10	00:06:27				
11	00:06:45				
12	00:07:23				
13	00:09:56				
	00:12:56				
14	00:13:04				
15	00:14:03				
16	00:14:36				
17	00:15:02				
18	00:16:12				
19	00:17:16				

PDFExporter 21.0.0.1
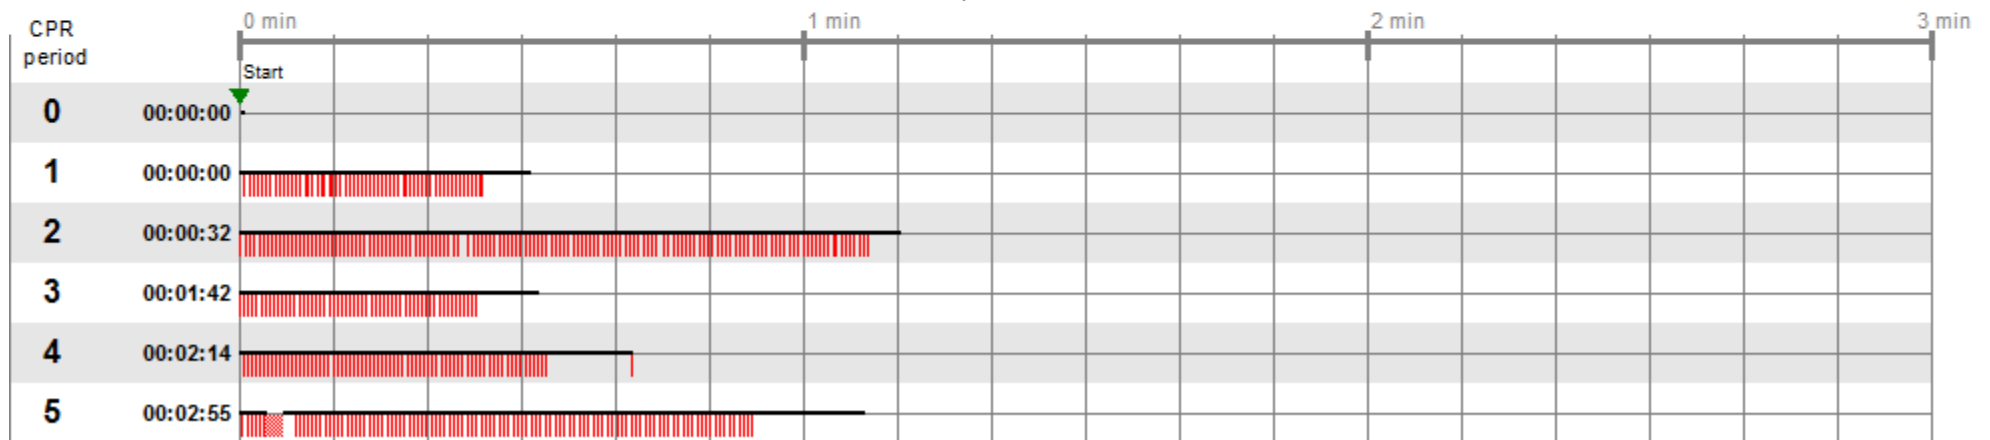
CPR report
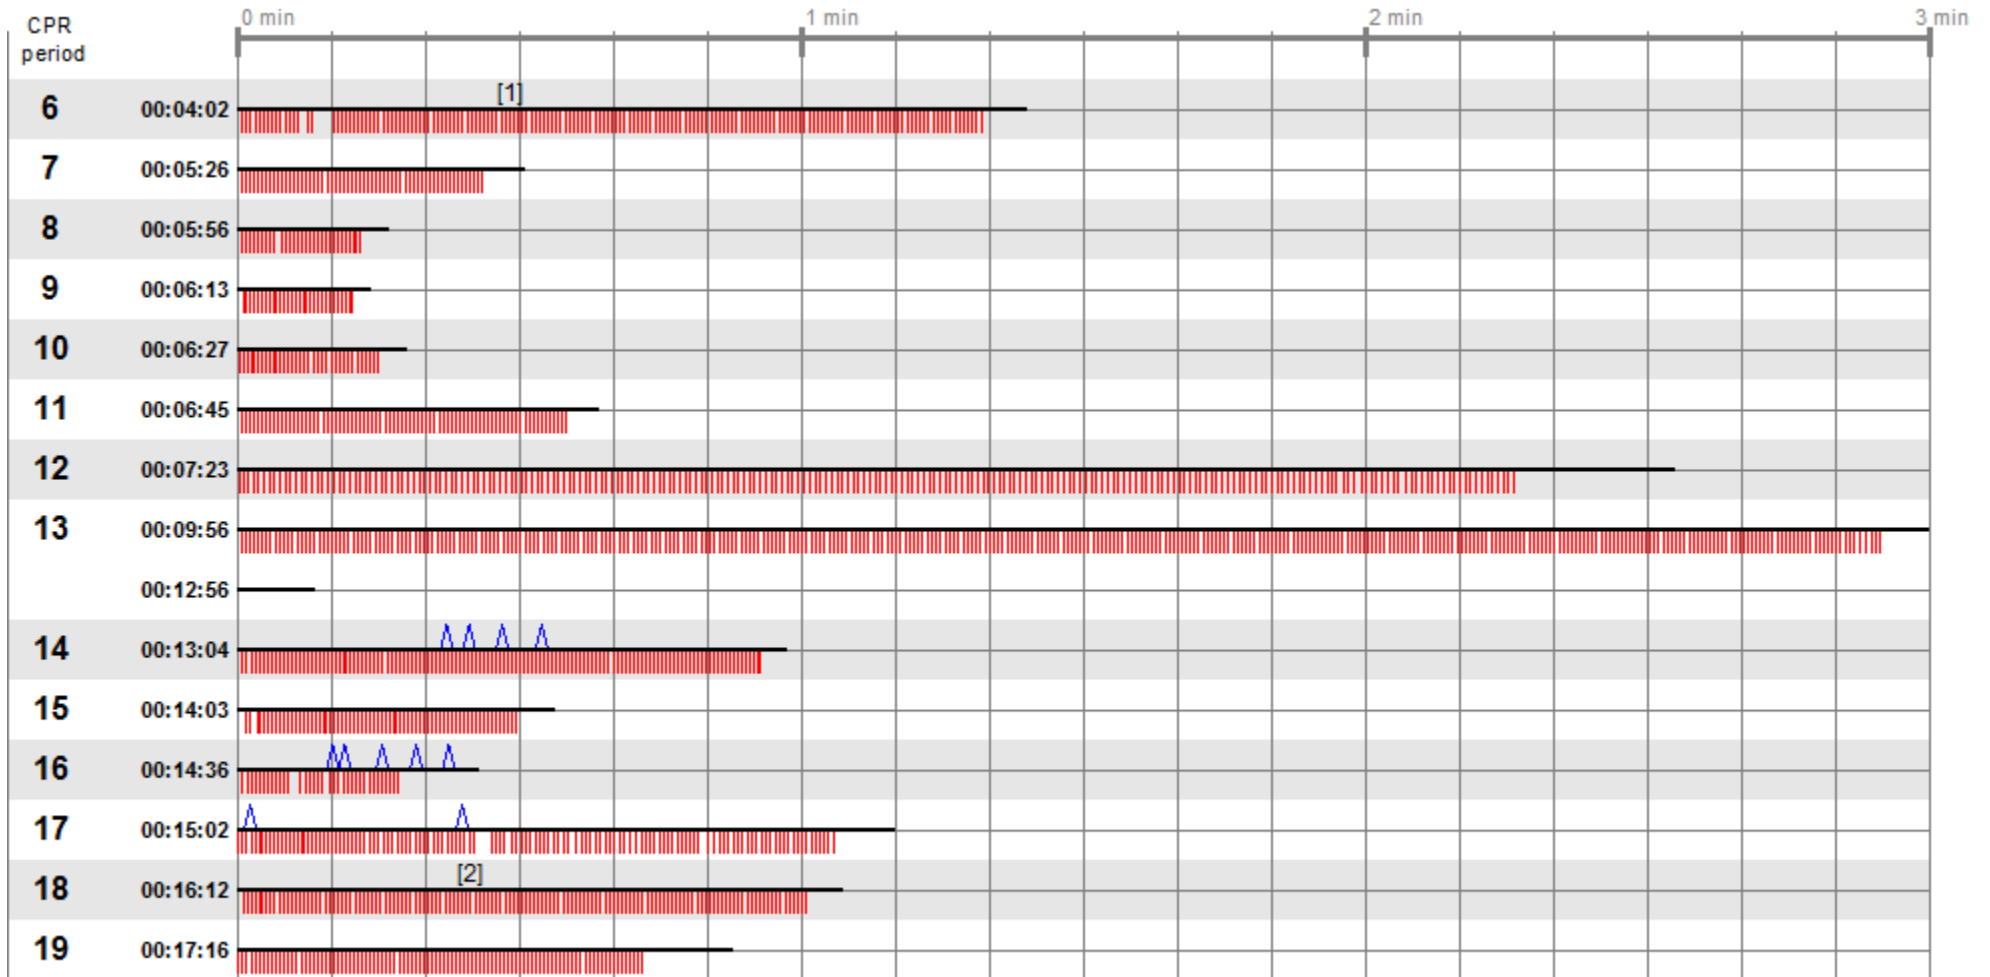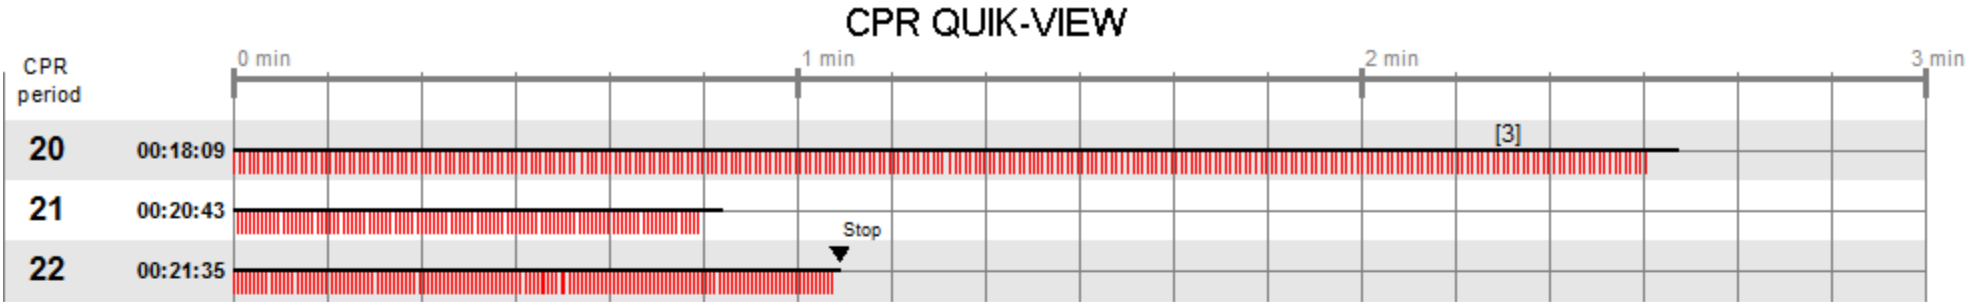
Device Type: LIFEPAK® 15
Power On: 2/19/2023 4:10:10 AM
CPR Annotations Edited: Yes
Device Configuration: 2L355RRB0200UR

*Times have been adjusted by the system.

Duration: 00:32:16
Incident ID: 23-05047
Statistical Parameters: 1000-0300-3000-05

CPR QUIK-VIEW

CPR period		0 min	1 min	2 min	3 min
20	00:18:09			[3]	
21	00:20:43		Stop		
22	00:21:35				

[1] Epinephrine, [2] Generic, [3] Epinephrine

Crozer Health EMS