

## Case summary

Incident ID: 23-03797  
Patient ID: 2023020710235900-LP1547546690  
Patient Name: Faulkner

Patient ID:	<u>2023020710235900-LP1547546690</u>	Birth Date:	
Incident ID:	<u>23-03797</u>	Device ID:	<u>SPARE 1</u>
Age at Incident:	<u>74 Years</u>	Case Start Date:	<u>2/7/2023</u>
Sex:	<u>Female</u>	Case Start Time:	<u>10:24:00 AM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

### Case Summary:

Total Analyses: 0  
Total Shocks: 1  
Total 12-Leads: 0  
Total Time Paced: 00:00:00

### Notes:

Rate too fast  
Time pulse checks better

Updated at 3/12/2023 7:59:31 PM by zphillips (Zach Phillips).

### Comments:

# Table of Contents

CPR reports (by CPR period) .....3

    CPR report (by CPR period) .....3

## CPR report




Device Type: LIFEPAK® 15  
Power On: 2/7/2023 10:24:00 AM  
CPR Annotations Edited: Yes  
Device Configuration: 2DB55RO40200UR

Duration: 00:42:54  
Incident ID: 23-03797  
Statistical Parameters: 1000-0300-3000-05


\*Times have been adjusted by the system.

Compression ratio  
(/total time)




16:37 / 18:16 = 91 %

Compression rate




133/minute

Ventilations/minute




--

Initial Rhythm

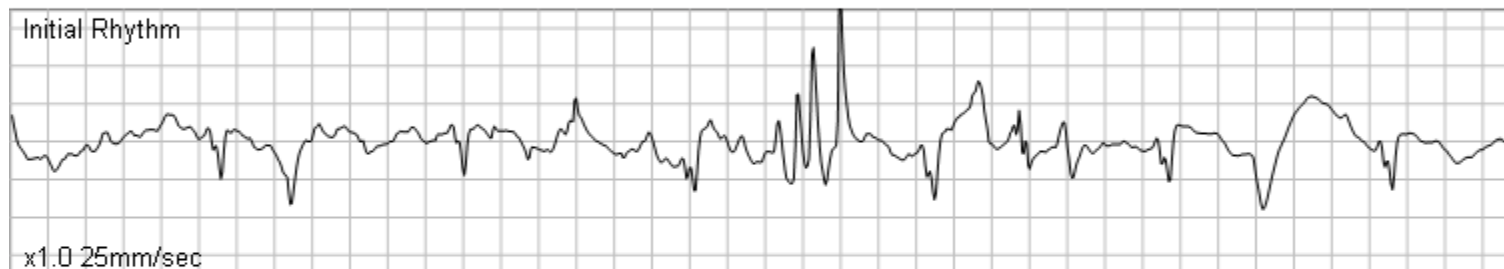

CO2 (mmHg)

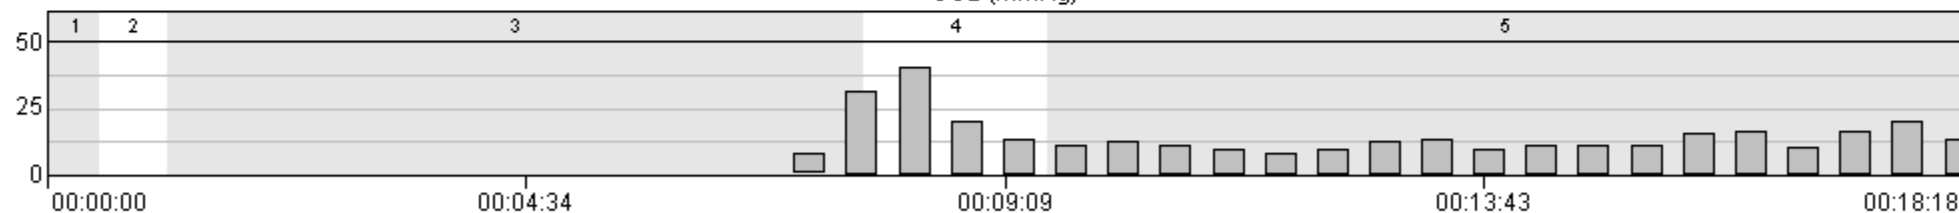

## CPR report



Device Type: LIFEPAK® 15  
 Power On: 2/7/2023 10:24:00 AM  
 CPR Annotations Edited: Yes  
 Device Configuration: 2DB55RO40200UR

Duration: 00:42:54  
 Incident ID: 23-03797  
 Statistical Parameters: 1000-0300-3000-05

\*Times have been adjusted by the system.

## Summary

CPR needed	= 18:16	CPR done	= 17:15
CPR not done	= 1:00	Compression count	= 2157
Longest compression pause	= 0:20	Pauses over 10 sec	= 4

Comment


## Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:00	00:00:16	00:00:16	00:00:14			52	138	--
2		00:00:30	00:00:49	00:00:19	00:00:20			49	136	--
3		00:01:08	00:07:32	00:06:24	00:00:16			94	135	--
4		00:07:48	00:09:23	00:01:35	00:00:10			85	139	--
5		00:09:33	00:18:17	00:08:45	00:00:00			95	127	--

Ventilation
 AED-prompted CPR period
 Shock

Chest compression
 AED Analysis
 ROSC (user annotated)

## CPR QUIK-VIEW

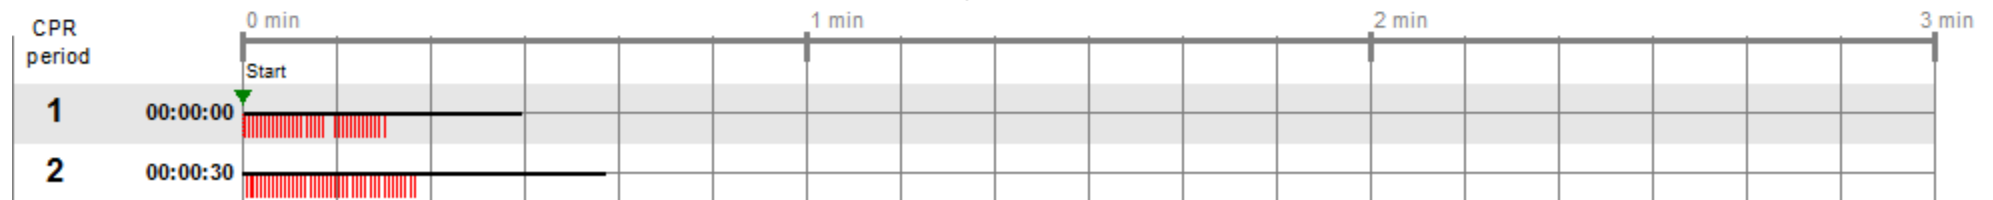

## CPR report




Device Type: LIFEPAK® 15  
 Power On: 2/7/2023 10:24:00 AM  
 CPR Annotations Edited: Yes  
 Device Configuration: 2DB55RO40200UR

Duration: 00:42:54  
 Incident ID: 23-03797  
 Statistical Parameters: 1000-0300-3000-05

\*Times have been adjusted by the system.

### CPR QUIK-VIEW

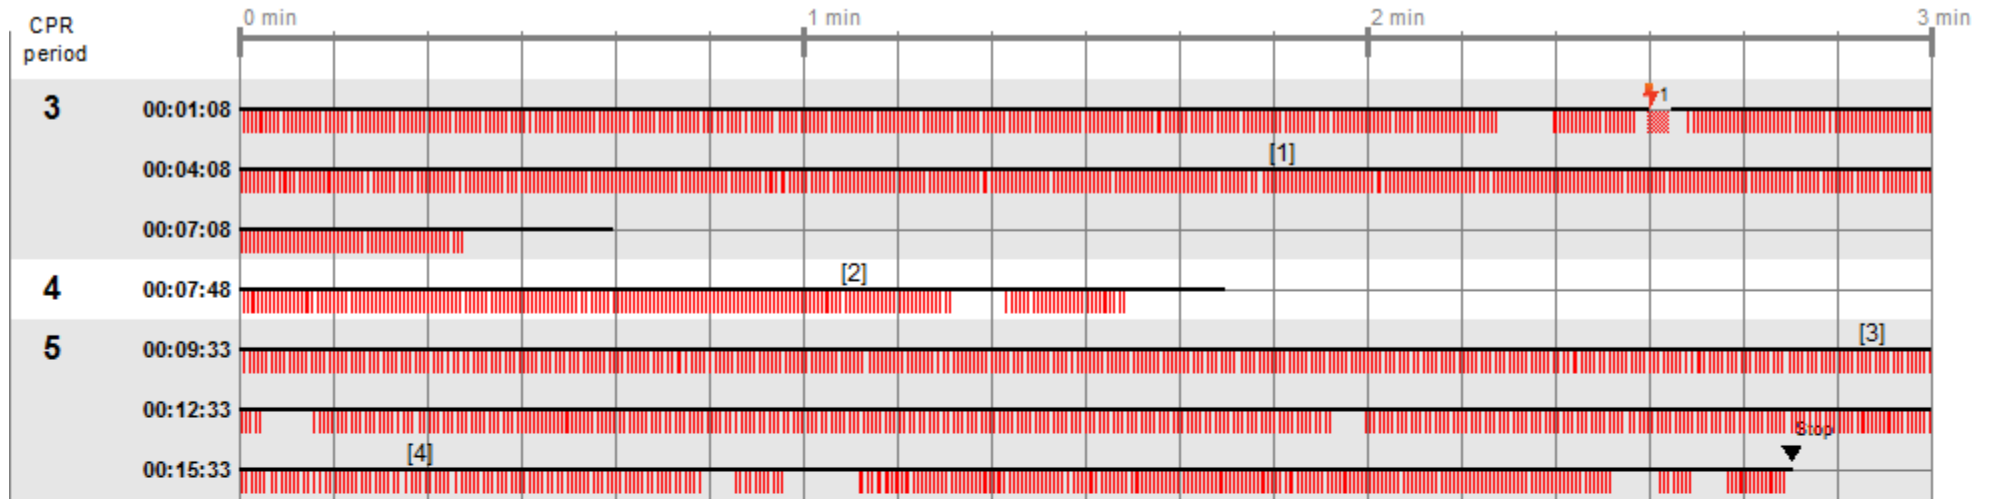

[1] Epinephrine, [2] Epinephrine, [3] Epinephrine, [4] Epinephrine

Shock	Time	Energy	Pre-shock CPR pause	Post-shock CPR pause
⚡ 1	3:38	360 J	0:00	0:00