

## Case summary

Incident ID: 23-04140  
Patient ID: 2023021102032400-LP1547542988  
Patient Name: Colbert

Patient ID:	<u>2023021102032400-LP1547542988</u>	Birth Date:	
Incident ID:	<u>23-04140</u>	Device ID:	<u>CROZER EMS</u>
Age at Incident:	<u>82 Years</u>	Case Start Date:	<u>2/11/2023</u>
Sex:	<u>Female</u>	Case Start Time:	<u>2:03:24 AM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

### Case Summary:

Total Analyses: 0  
Total Shocks: 2  
Total 12-Leads: 0  
Total Time Paced: 00:00:00

### Notes:

###  
Ideal  
Some questionable VF

Updated at 3/12/2023 11:36:44 PM by zphillips (Zach Phillips).

### Comments:

# Table of Contents

CPR reports (by CPR period) .....3

    CPR report (by CPR period) .....3

# CPR report




Device Type: LIFEPAK® 15  
Power On: 2/11/2023 2:03:24 AM  
CPR Annotations Edited: Yes  
Device Configuration: 2LB55RO40200UR

Duration: 00:56:39  
Incident ID: 23-04140  
Statistical Parameters: 1000-0300-3000-05


\*Times have been adjusted by the system.

Compression ratio  
(/total time)




38:55 / 40:55 = 95 %

Compression rate




103/minute

Ventilations/minute




8/minute

Initial Rhythm

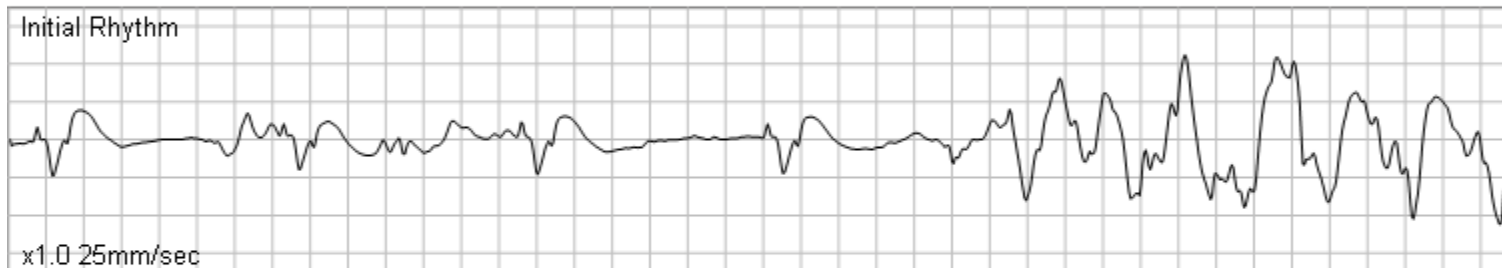

x1.0 25mm/sec

CO2 (mmHg)

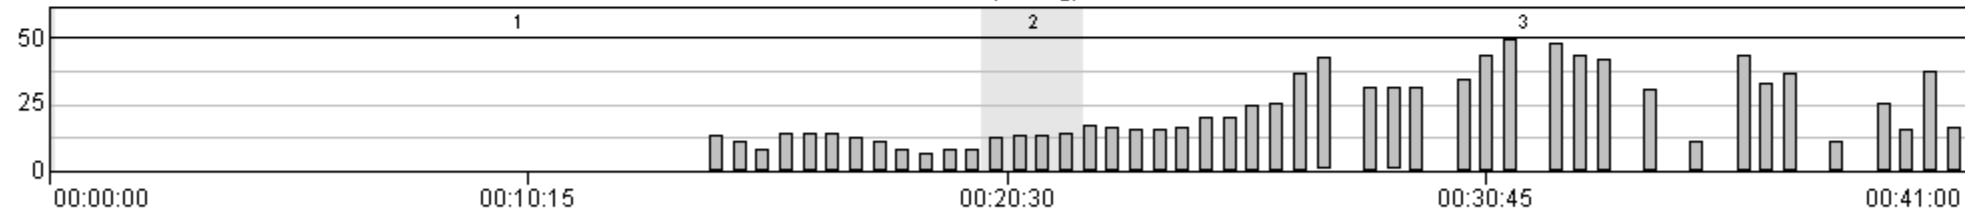

## CPR report



Device Type: LIFEPAK® 15  
Power On: 2/11/2023 2:03:24 AM  
CPR Annotations Edited: Yes  
Device Configuration: 2LB55RO40200UR

Duration: 00:56:39  
Incident ID: 23-04140  
Statistical Parameters: 1000-0300-3000-05

\*Times have been adjusted by the system.

## Summary

CPR needed	= 40:55	CPR done	= 40:24
CPR not done	= 0:31	Compression count	= 4013
Longest compression pause	= 0:16	Pauses over 10 sec	= 1

Comment


## Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:05	00:19:46	00:19:41	00:00:09			95	103	3
2		00:19:56	00:21:51	00:01:55	00:00:16			88	107	13
3		00:22:06	00:40:59	00:18:53	00:00:00			96	102	8

Ventilation
 AED-prompted CPR period
 Shock

Chest compression
 AED Analysis
 ROSC (user annotated)

## CPR QUIK-VIEW

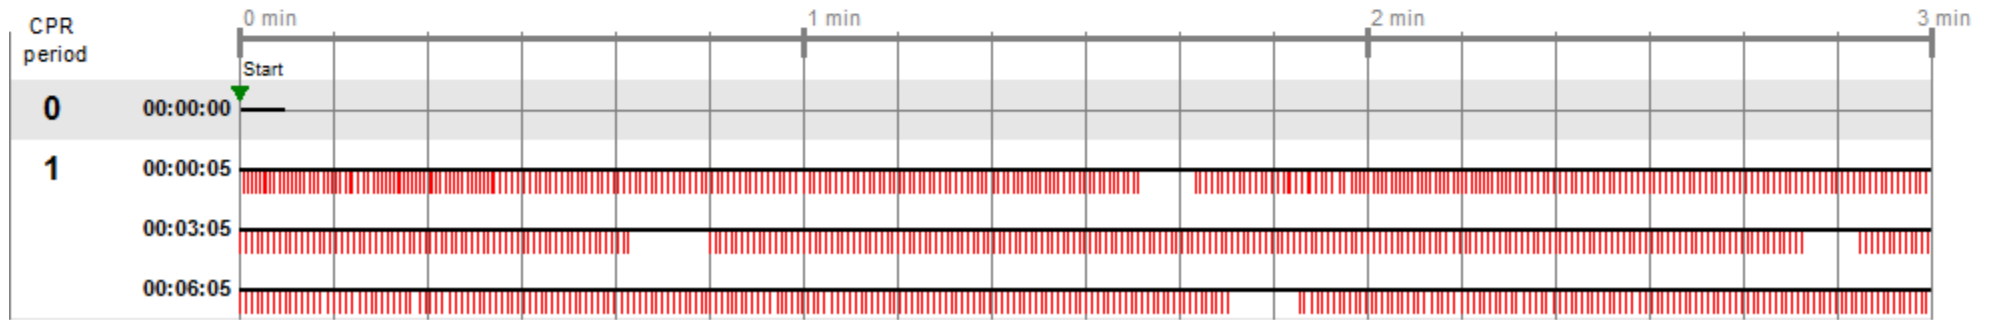

# CPR report




Device Type: LIFEPAK® 15  
 Power On: 2/11/2023 2:03:24 AM  
 CPR Annotations Edited: Yes  
 Device Configuration: 2LB55RO40200UR

Duration: 00:56:39  
 Incident ID: 23-04140  
 Statistical Parameters: 1000-0300-3000-05

\*Times have been adjusted by the system.

## CPR QUIK-VIEW

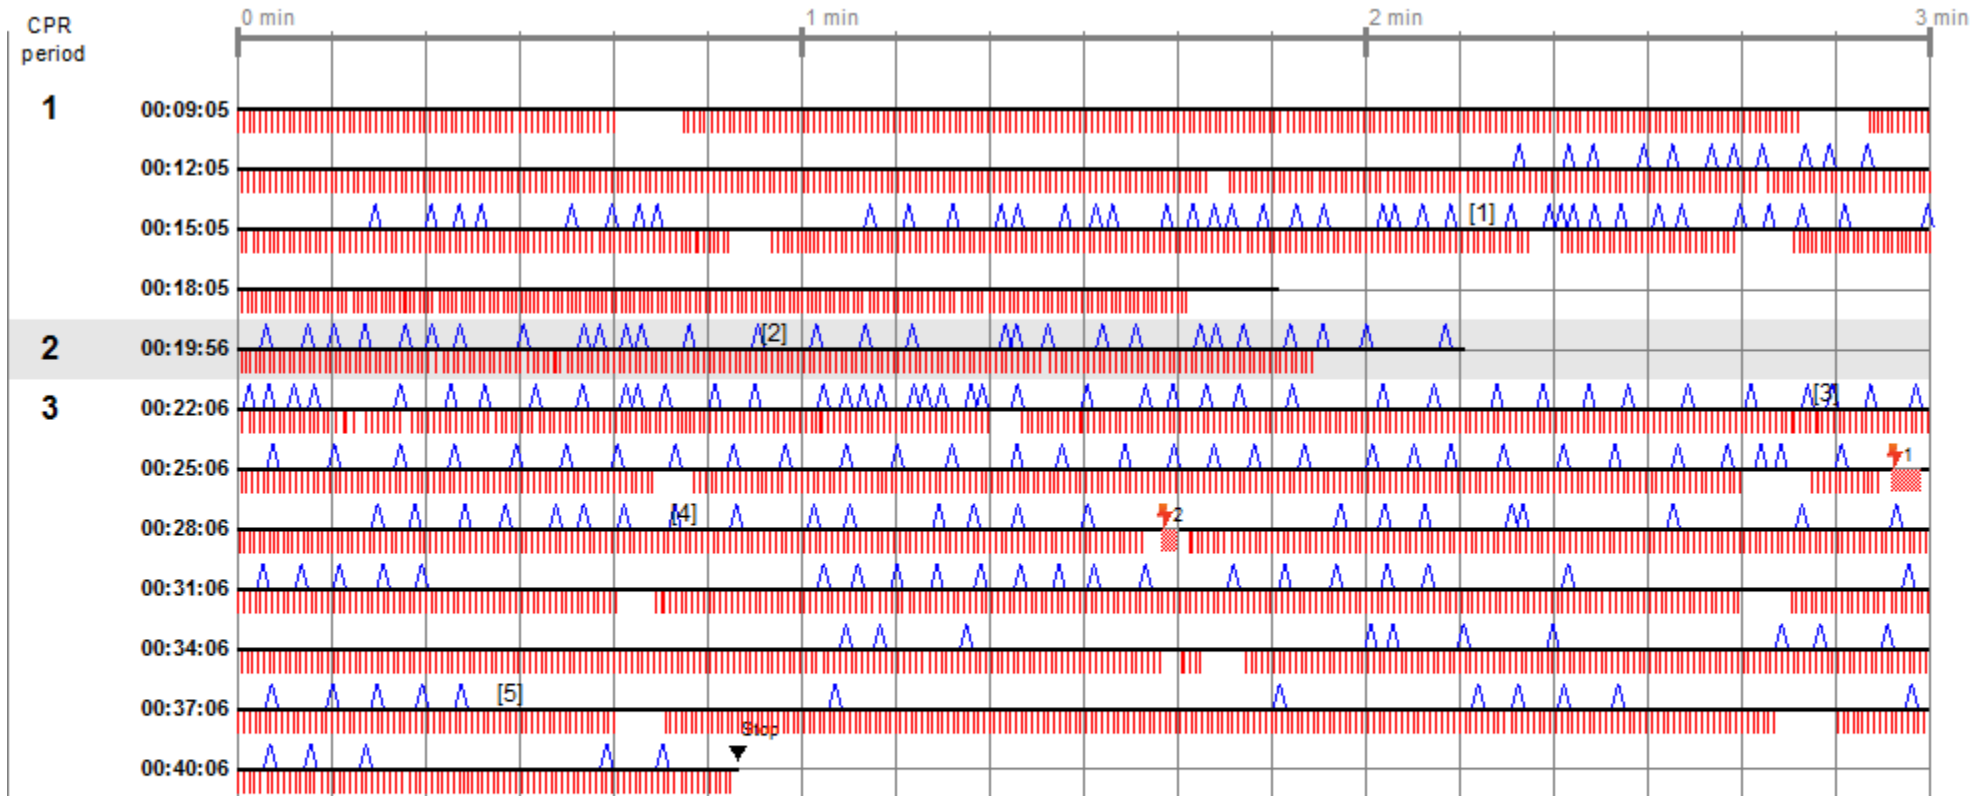

[1] Epinephrine, [2] Epinephrine, [3] Epinephrine, [4] Epinephrine, [5] Generic

Shock	Time	Energy	Pre-shock CPR pause	Post-shock CPR pause
⚡1	28:02	360 J	0:00	0:00
⚡2	29:45	360 J	0:00	0:00