

Case summary

Incident ID: 23-07852
Patient ID: 2023031822361200-LP1547546923
Patient Name: Caron

Patient ID:	<u>2023031822361200-LP1547546923</u>	Birth Date:	
Incident ID:	<u>23-07852</u>	Device ID:	<u>CROZER EMS</u>
Age at Incident:	<u>85 Years</u>	Case Start Date:	<u>3/18/2023</u>
Sex:	<u>Female</u>	Case Start Time:	<u>10:36:12 PM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

Notes:

Summary complete.
added compressions and CPR start/stop (Rdarden)
Updated at 3/22/2023 12:54:33 AM by rdarden (Rick Darden).
Updated at 3/29/2023 7:53:08 PM by zphillips (Zach Phillips).

Comments:

Table of Contents

CPR reports (by CPR period)	3
CPR report (by CPR period)	3

CPR report




Device Type: LIFEPAK® 15
Power On: 3/18/2023 10:36:12 PM
CPR Annotations Edited: Yes
Device Configuration: 2D355RO402000R

Duration: 00:27:28
Incident ID: 23-07852
Statistical Parameters: 1000-0300-3000-05


*Times have been adjusted by the system.

Compression ratio
(/total time)




23:56 / 25:13 = 95 %

Compression rate




124/minute

Ventilations/minute




--

Initial Rhythm

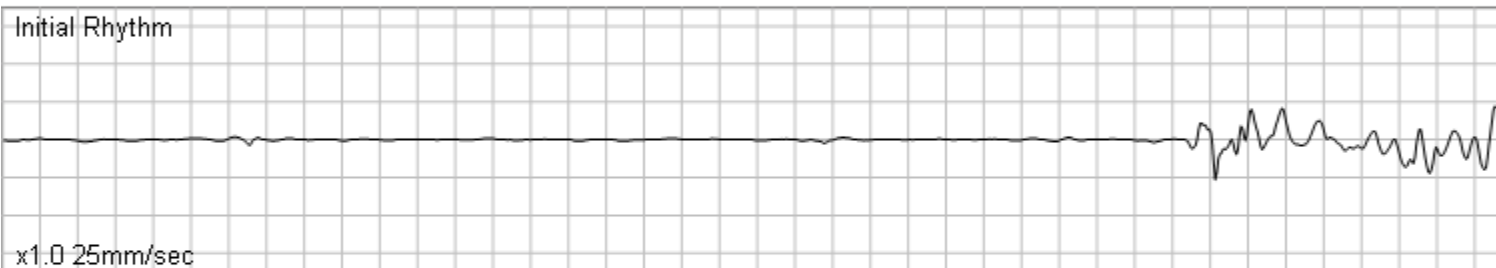

x1.0 25mm/sec

CO2 (mmHg)

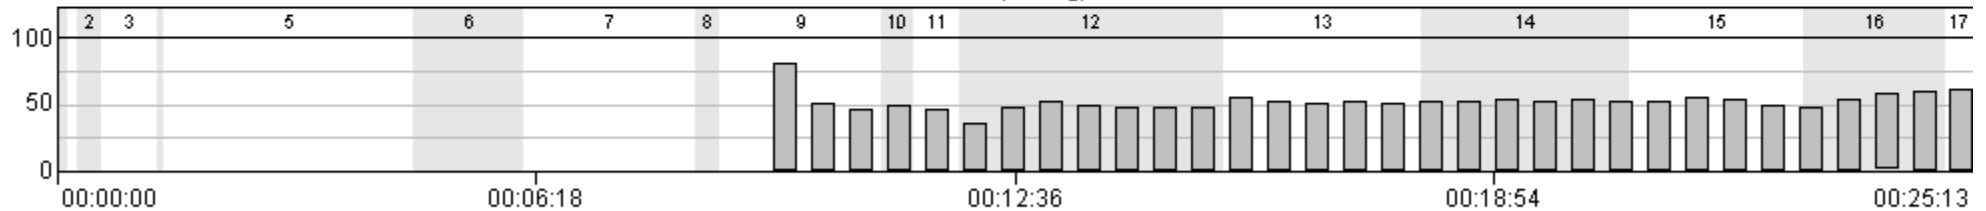

CPR report



Device Type: LIFEPAK® 15
Power On: 3/18/2023 10:36:12 PM
CPR Annotations Edited: Yes
Device Configuration: 2D355RO402000R

Duration: 00:27:28
Incident ID: 23-07852
Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

Summary

CPR needed	= 25:13	CPR done	= 23:49
CPR not done	= 1:24	Compression count	= 2927
Longest compression pause	= 0:15	Pauses over 10 sec	= 1

Comment: Try using a timer to keep 2 minute rounds.

CPR report



Device Type: LIFEPAK® 15
 Power On: 3/18/2023 10:36:12 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2D355RO40200OR

Duration: 00:27:28
 Incident ID: 23-07852
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:07	00:00:11	00:00:04	00:00:04	Pulse/rhythm check	Initial rhythm	55	149	--
2		00:00:14	00:00:33	00:00:18	00:00:01	Pulse/rhythm check	Aim for 2 minutes between pulse checks	100	143	--
3		00:00:33	00:01:16	00:00:43	00:00:02	Unknown		100	129	--
4		00:01:19	00:01:22	00:00:03	00:00:01	Unknown		100	136	--
5		00:01:23	00:04:39	00:03:16	00:00:02	Pulse/rhythm check	Aim for 2 minutes between pulse checks	100	130	--
6		00:04:41	00:06:00	00:01:19	00:00:07	Pulse/rhythm check	Aim for 2 minutes between pulse checks	92	114	--
7		00:06:07	00:08:22	00:02:15	00:00:02	Pre Pulse/rhythm check?		100	120	--
8		00:08:24	00:08:27	00:00:03	00:00:15	Pulse/rhythm check	Long pause	18	108	--
9		00:08:42	00:10:44	00:02:01	00:00:07	Pulse/rhythm check		95	123	--
10		00:10:51	00:11:13	00:00:22	00:00:03	Unknown		87	122	--
11		00:11:16	00:11:45	00:00:29	00:00:07	Unknown		80	121	--
12		00:11:52	00:15:11	00:03:19	00:00:10	Pulse/rhythm check	Aim for 2 minutes between pulse checks	95	121	--
13		00:15:21	00:17:55	00:02:34	00:00:02	Pulse/rhythm check	Aim for 2 minutes between pulse checks	99	123	--
14		00:17:58	00:20:34	00:02:36	00:00:08	Pulse/rhythm check	Aim for 2 minutes between pulse checks	95	127	--
15		00:20:42	00:22:57	00:02:15	00:00:02	Pulse/rhythm check		98	124	--
16		00:22:59	00:24:48	00:01:49	00:00:03	Pulse/rhythm check		98	130	--
17		00:24:51	00:25:12	00:00:21	00:00:01	Termination/Transfer of Care		97	131	--

Ventilation

Chest compression

AED-prompted CPR period

AED Analysis

Shock

ROSC (user annotated)

CPR report




Device Type: LIFEPAK® 15
 Power On: 3/18/2023 10:36:12 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2D355R0402000R

Duration: 00:27:28
 Incident ID: 23-07852
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

CPR QUIK-VIEW

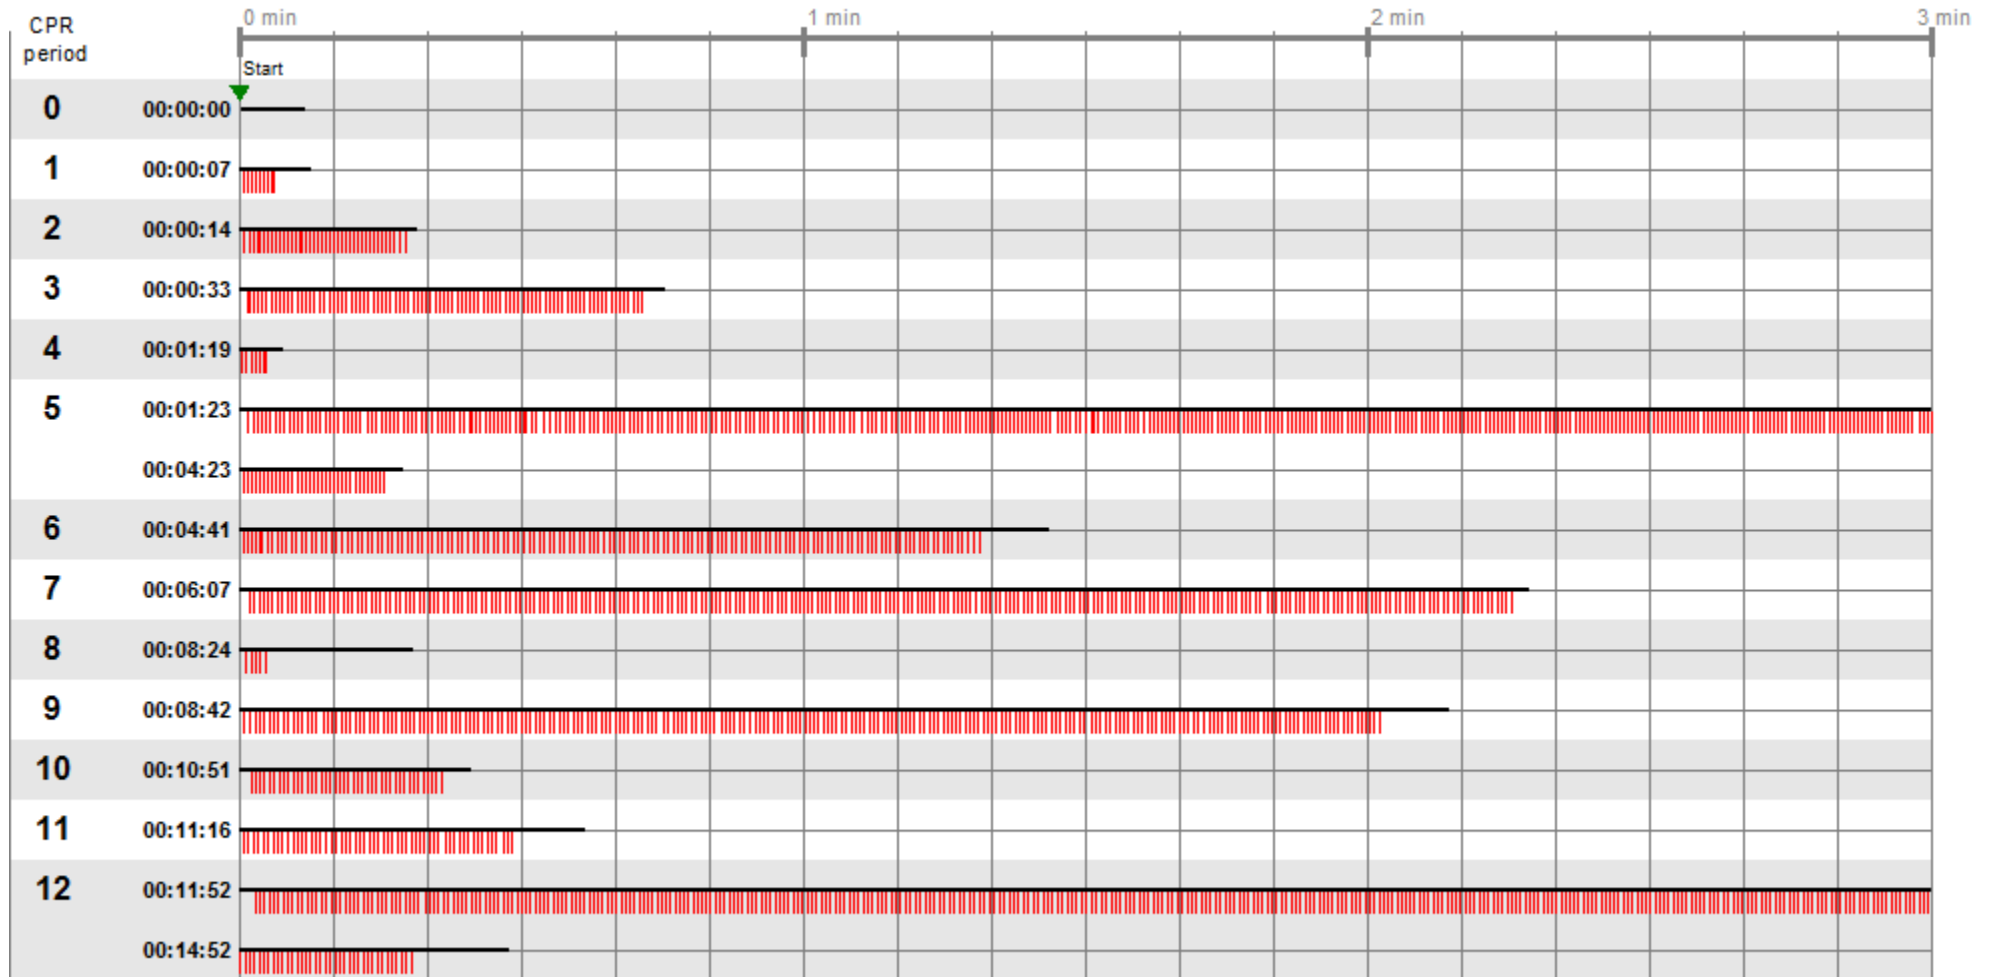

CPR report



Device Type: LIFEPAK® 15
Power On: 3/18/2023 10:36:12 PM
CPR Annotations Edited: Yes
Device Configuration: 2D355R0402000R

Duration: 00:27:28
Incident ID: 23-07852
Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

CPR QUIK-VIEW

