

Case summary

Incident ID: 23-05639
Patient ID: 2023022516491300-LP1547545197
Patient Name: Joseph

Patient ID:	<u>2023022516491300-LP1547545197</u>	Birth Date:	
Incident ID:	<u>23-05639</u>	Device ID:	<u>MICU 66</u>
Age at Incident:	<u>83 Years</u>	Case Start Date:	<u>2/25/2023</u>
Sex:	<u>Male</u>	Case Start Time:	<u>4:49:13 PM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

Case Summary:

Total Analyses: 0
Total Shocks: 1
Total 12-Leads: 0
Total Time Paced: 00:00:00

Notes:

Summary finished.
Demos only
Updated at 3/13/2023 1:59:57 AM by zphillips (Zach Phillips).
Updated at 3/27/2023 1:45:33 AM by zphillips (Zach Phillips).

Comments:

Table of Contents

CPR reports (by CPR period)3

 CPR report (by CPR period)3

CPR report




Device Type: LIFEPAK® 15
 Power On: 2/25/2023 4:49:13 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355R040200UR

Duration: 00:28:44
 Incident ID: 23-05639
 Statistical Parameters: 1000-0300-3000-05


*Times have been adjusted by the system.

Compression ratio
 (/total time)




19:28 / 23:08 = 84 %

Compression rate




145/minute

Ventilations/minute




3/minute

Initial Rhythm

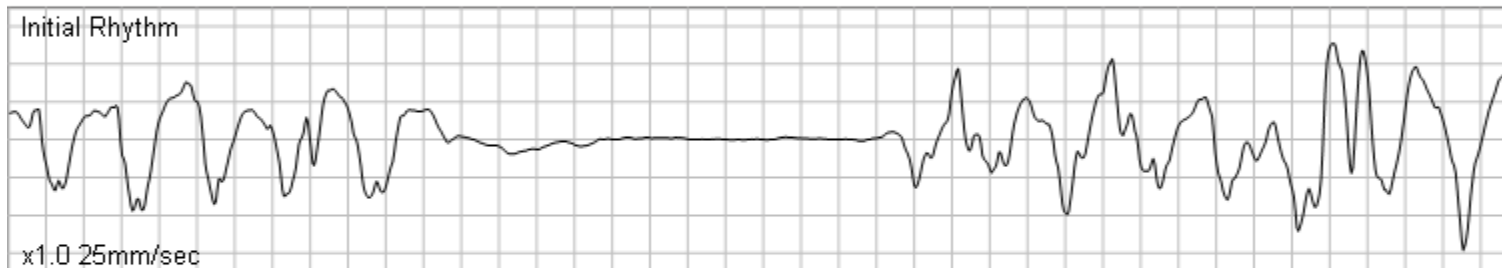

CO2 (mmHg)

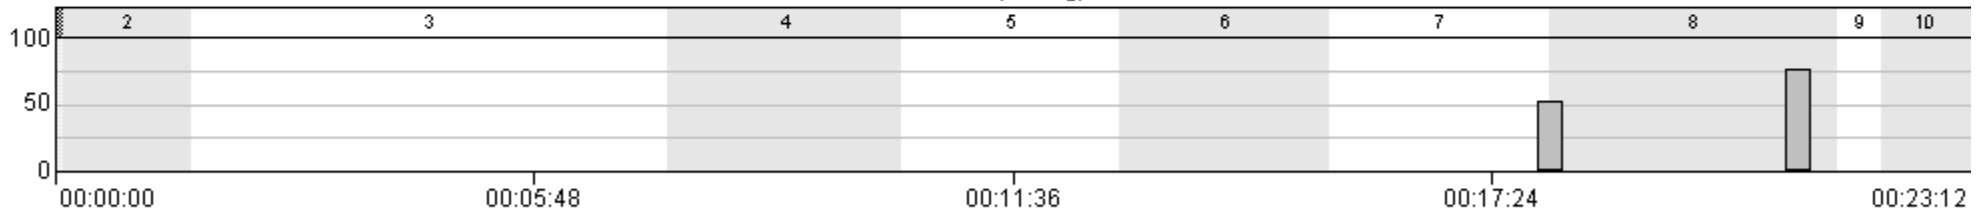

CPR report



Device Type: LIFEPAK® 15
 Power On: 2/25/2023 4:49:13 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355RO40200UR

Duration: 00:28:44
 Incident ID: 23-05639
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

Summary

CPR needed	= 23:08	CPR done	= 19:25
CPR not done	= 3:43	Compression count	= 2739
Longest compression pause	= 0:44	Pauses over 10 sec	= 7

Comment: Need to slow compression rates. One very long time between pulse checks. Shorten pulse check pauses.

Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:00	00:00:02	00:00:02	00:00:03	Pulse/rhythm check		100	58	--
2		00:00:05	00:01:28	00:01:23	00:00:10	Pulse/rhythm check		89	141	--
3		00:01:38	00:06:49	00:05:12	00:00:35	Pulse/rhythm check	5:12 between pulse checks	90	147	--
4		00:07:25	00:09:30	00:02:05	00:00:44	Pulse/rhythm check	Long pause	74	141	--
5		00:10:14	00:12:19	00:02:05	00:00:34	Pulse/rhythm check	Long pause	79	140	--
6		00:12:53	00:15:12	00:02:19	00:00:13	Pulse/rhythm check		91	146	--
7		00:15:25	00:17:49	00:02:24	00:00:17	Pulse/rhythm check	Long pause	89	147	1
8		00:18:06	00:20:53	00:02:47	00:00:42	Pulse/rhythm check	Long pause. Aim for 2 minutes between pulse checks.	80	144	2
9		00:21:35	00:21:39	00:00:05	00:00:28	Pulse/rhythm check	Long pause	16	152	--
10		00:22:08	00:23:11	00:01:04	00:00:00	Pulse/rhythm check		99	153	--

Ventilation

Chest compression

AED-prompted CPR period

AED Analysis

Shock

ROSC (user annotated)

CPR report




Device Type: LIFEPAK® 15
 Power On: 2/25/2023 4:49:13 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355R040200UR

Duration: 00:28:44
 Incident ID: 23-05639
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

CPR QUIK-VIEW

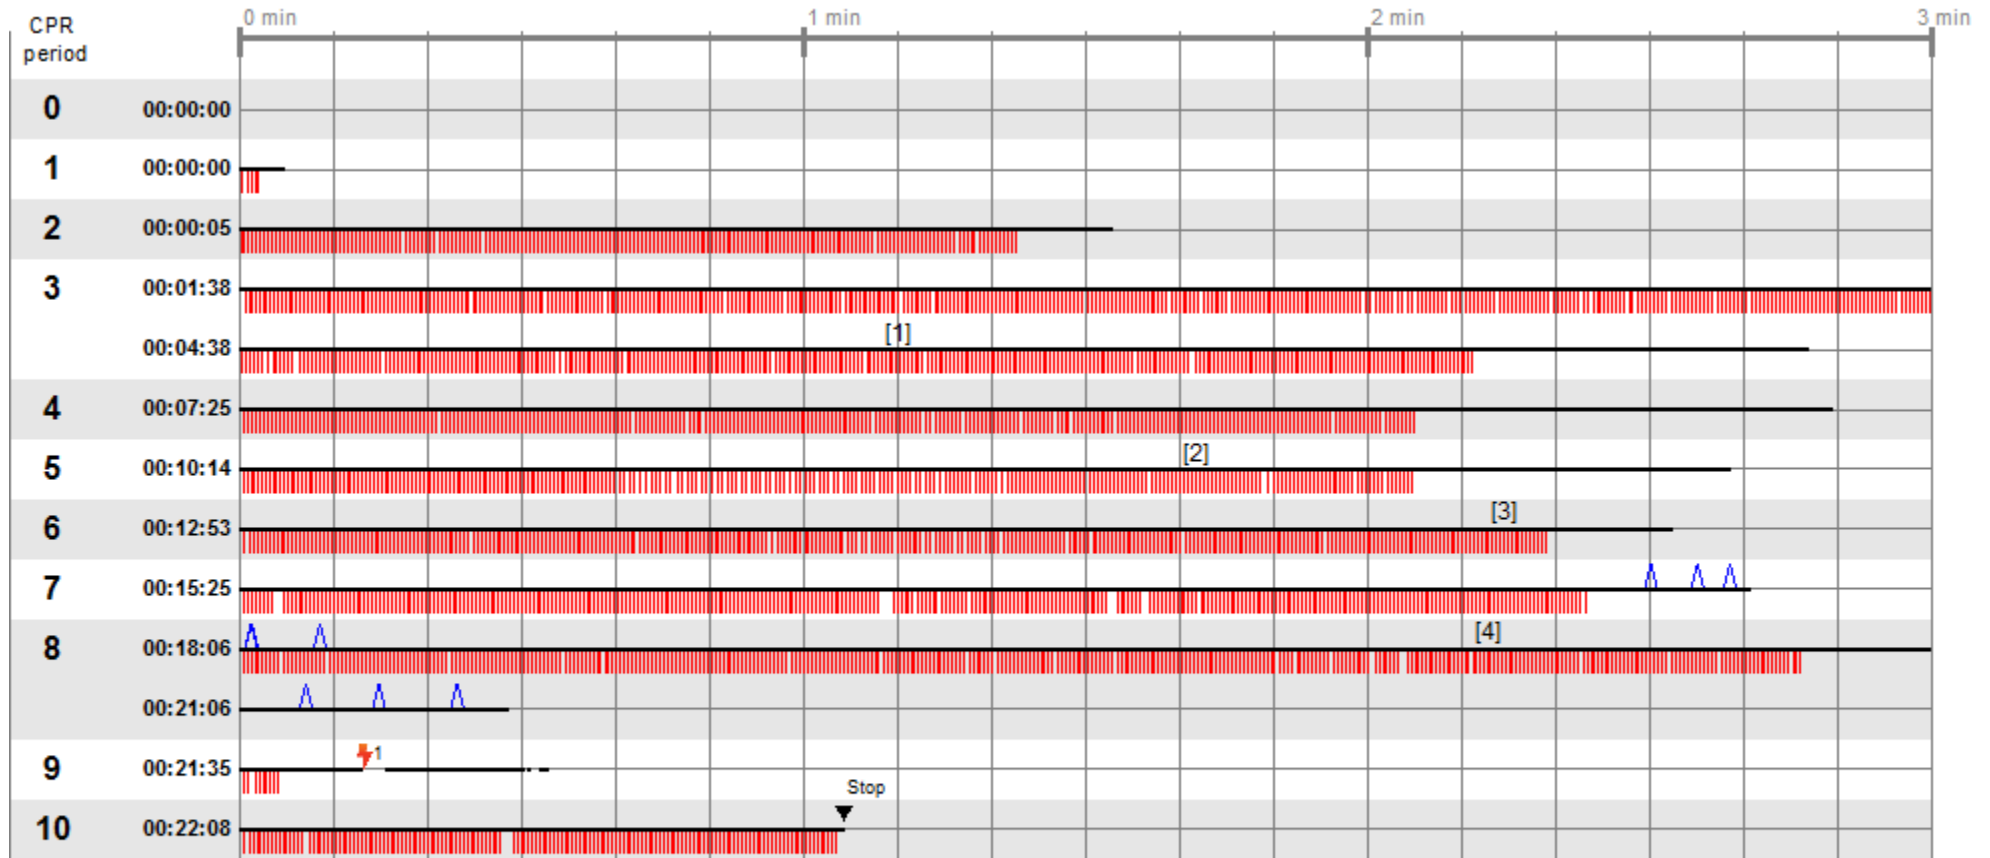

[1] Generic, [2] EPINEPHRINE 10, [3] EPINEPHRINE 10, [4] EPINEPHRINE 10

Shock	Time	Energy	Pre-shock CPR pause	Post-shock CPR pause
⚡1	21:48	360 J	0:09	0:20