

Case summary

Incident ID: 23-05105
Patient ID: 2023021912450800-LP1547545108
Patient Name: Bridgins

Patient ID:	<u>2023021912450800-LP1547545108</u>	Birth Date:	
Incident ID:	<u>23-05105</u>	Device ID:	<u>MICU 103A</u>
Age at Incident:	<u>76 Years</u>	Case Start Date:	<u>2/19/2023</u>
Sex:	<u>Male</u>	Case Start Time:	<u>12:45:09 PM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

Notes:

Finished summary.

Demos and ROSC only

Updated at 3/13/2023 1:33:43 AM by zphillips (Zach Phillips).

Updated at 3/27/2023 12:45:51 AM by zphillips (Zach Phillips).

Comments:

Table of Contents

CPR reports (by CPR period)3

 CPR report (by CPR period)3

CPR report




Device Type: LIFEPAK® 15
Power On: 2/19/2023 12:45:09 PM
CPR Annotations Edited: Yes
Device Configuration: 2L355R0402000R

Duration: 00:41:20
Incident ID: 23-05105
Statistical Parameters: 1000-0300-3000-05


*Times have been adjusted by the system.

Compression ratio
(/total time)




30:33 / 35:03 = 87 %

Compression rate




144/minute

Ventilations/minute




9/minute

Initial Rhythm

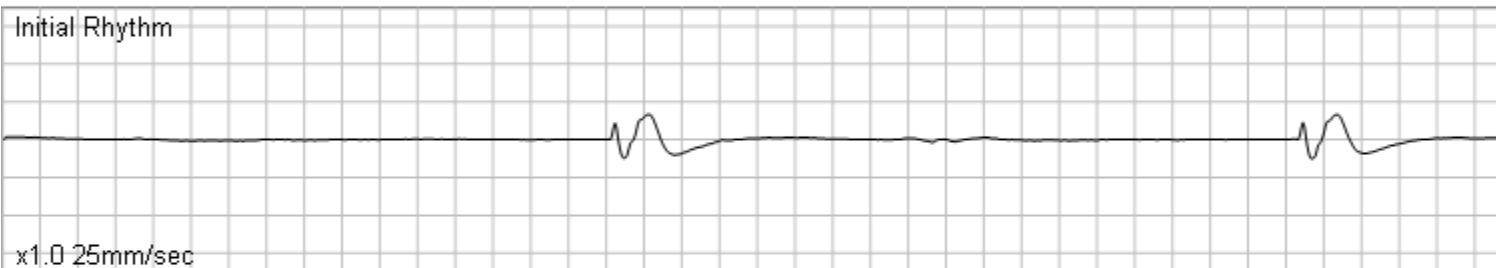

x1.0 25mm/sec

CO2 (mmHg)

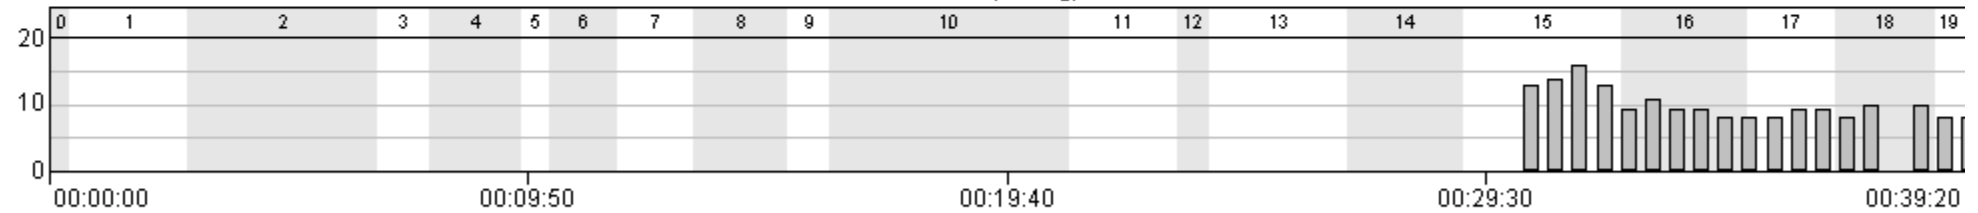

CPR report



Device Type: LIFEPAK® 15
Power On: 2/19/2023 12:45:09 PM
CPR Annotations Edited: Yes
Device Configuration: 2L355R0402000R

Duration: 00:41:20
Incident ID: 23-05105
Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

Summary

CPR needed	= 35:03	CPR done	= 30:29
CPR not done	= 4:34	Compression count	= 4317
Longest compression pause	= 0:30	Pauses over 10 sec	= 10

Comment	At no point were compression rate within 100-120 range.
---------	---

CPR report



Device Type: LIFEPAK® 15
 Power On: 2/19/2023 12:45:09 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355RO402000R

Duration: 00:41:20
 Incident ID: 23-05105
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:23	00:02:45	00:02:21	00:00:05	Pulse/rhythm check		97	136	--
2		00:02:50	00:06:28	00:03:39	00:00:15	Pulse/rhythm check	Long time between pulse checks.	93	136	--
3		00:06:44	00:07:43	00:00:59	00:00:06	Pulse/rhythm check	Only one minute between pulse checks.	92	140	--
4		00:07:48	00:09:25	00:01:36	00:00:17	Pulse/rhythm check	Long pause.	85	148	--
5		00:09:41	00:10:07	00:00:26	00:00:09	Pulse/rhythm check	Try to minimize interruptions.	75	144	--
6		00:10:16	00:11:34	00:01:18	00:00:06	Pulse/rhythm check	Allow 2 minutes between pulse checks.	93	151	--
7		00:11:39	00:12:54	00:01:14	00:00:18	Pulse/rhythm check	Might have had a weak pulse. Long pause.	80	148	--
8		00:13:12	00:15:00	00:01:48	00:00:09	Pulse/rhythm check	Might have had a weak pulse.	93	150	--
9		00:15:09	00:15:30	00:00:21	00:00:30	Pulse/rhythm check	Allow 2 minutes between pulse checks.	41	144	--
10		00:16:00	00:16:29	00:00:29	00:04:27	Pulse/rhythm check	ROSC	75	146	--
11		00:20:56	00:23:01	00:02:05	00:00:07	Pulse/rhythm check		95	143	--
12		00:23:09	00:23:36	00:00:28	00:00:12	Pulse/rhythm check	Allow 2 minutes between pulse checks.	70	144	--
13		00:23:48	00:26:14	00:02:25	00:00:26	Pulse/rhythm check	Long pause	85	146	--
14		00:26:40	00:28:53	00:02:12	00:00:09	Pulse/rhythm check		94	145	--
15		00:29:02	00:31:58	00:02:57	00:00:18	Pulse/rhythm check	3 minutes between pulse check	91	144	5
16		00:32:17	00:34:40	00:02:23	00:00:14	Pulse/rhythm check	Long pause	91	149	8
17		00:34:54	00:36:33	00:01:40	00:00:09	Pulse/rhythm check		92	138	9
18		00:36:42	00:38:15	00:01:33	00:00:29	Pulse/rhythm check		76	148	10
19		00:38:44	00:39:20	00:00:35	00:00:01	Termination/Transfer of Care		99	145	2

Ventilation

Chest compression

AED-prompted CPR period

AED Analysis

Shock

ROSC (user annotated)

CPR report




Device Type: LIFEPAK® 15
 Power On: 2/19/2023 12:45:09 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355R0402000R

Duration: 00:41:20
 Incident ID: 23-05105
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

CPR QUIK-VIEW

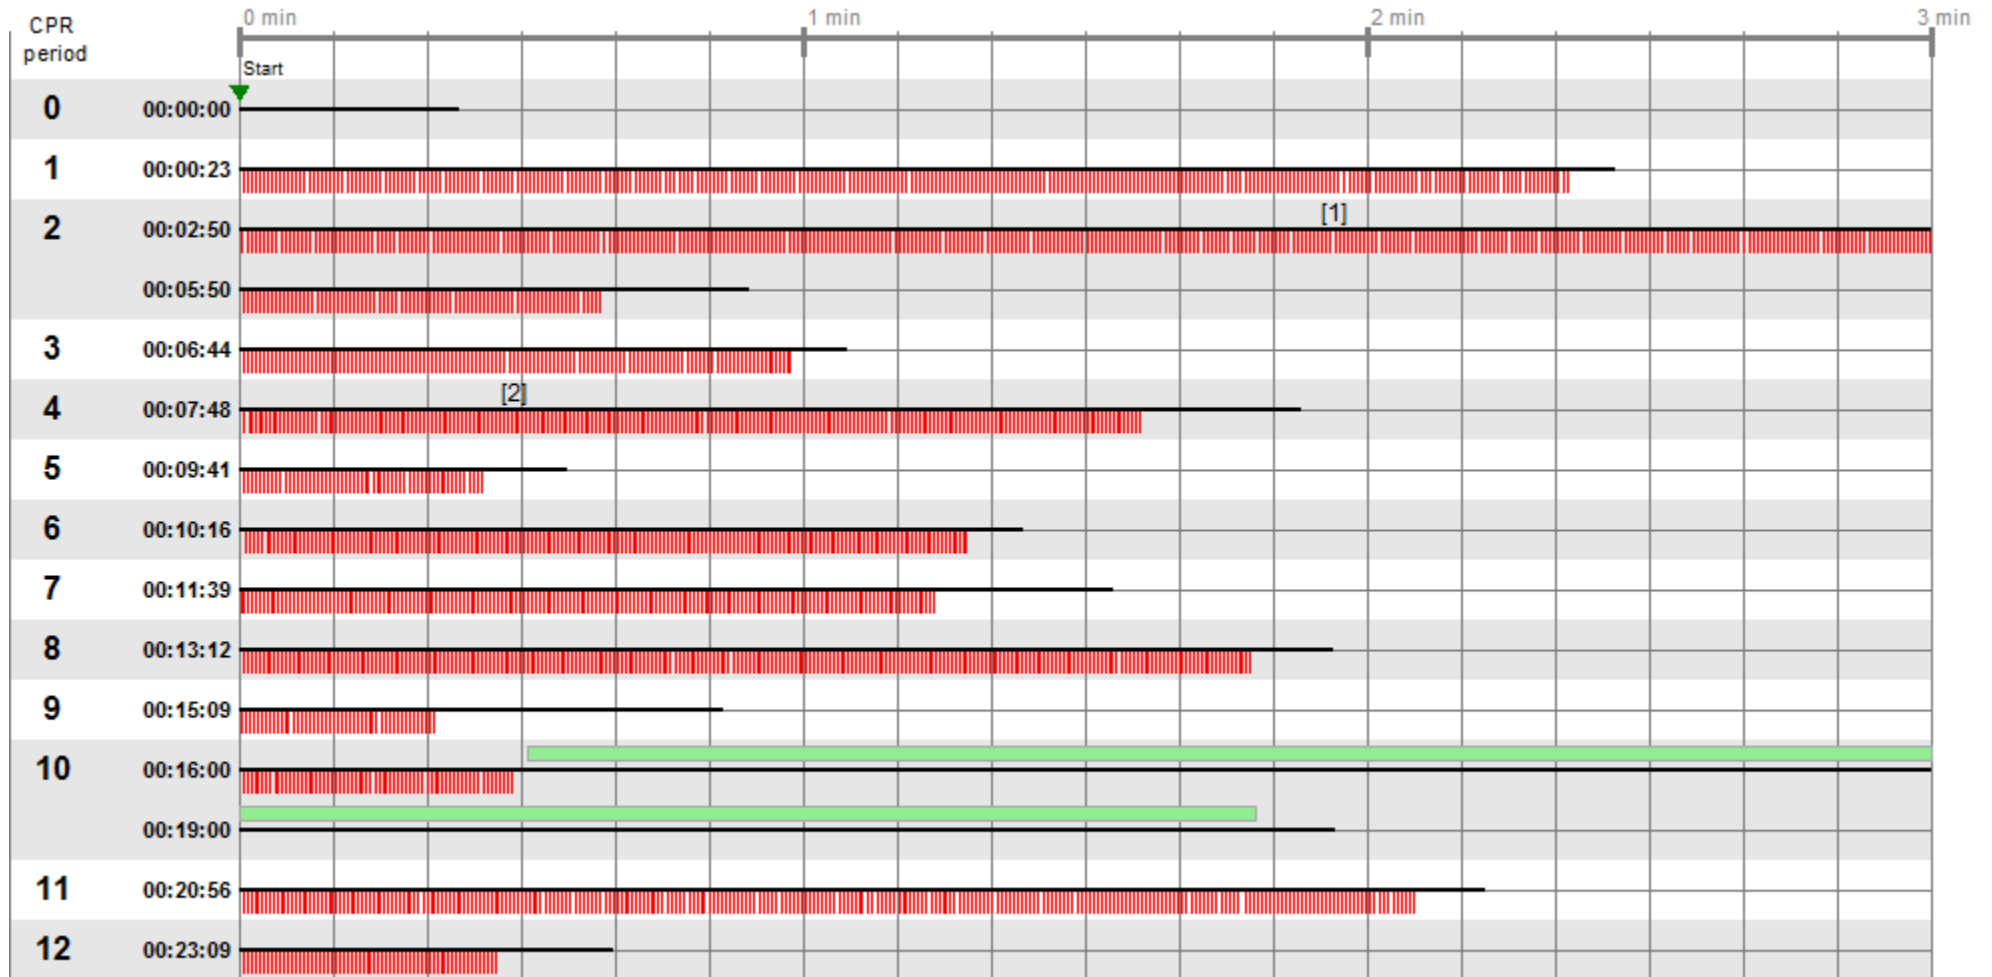

CPR report




Device Type: LIFEPAK® 15
 Power On: 2/19/2023 12:45:09 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2L355R0402000R

Duration: 00:41:20
 Incident ID: 23-05105
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

CPR QUIK-VIEW

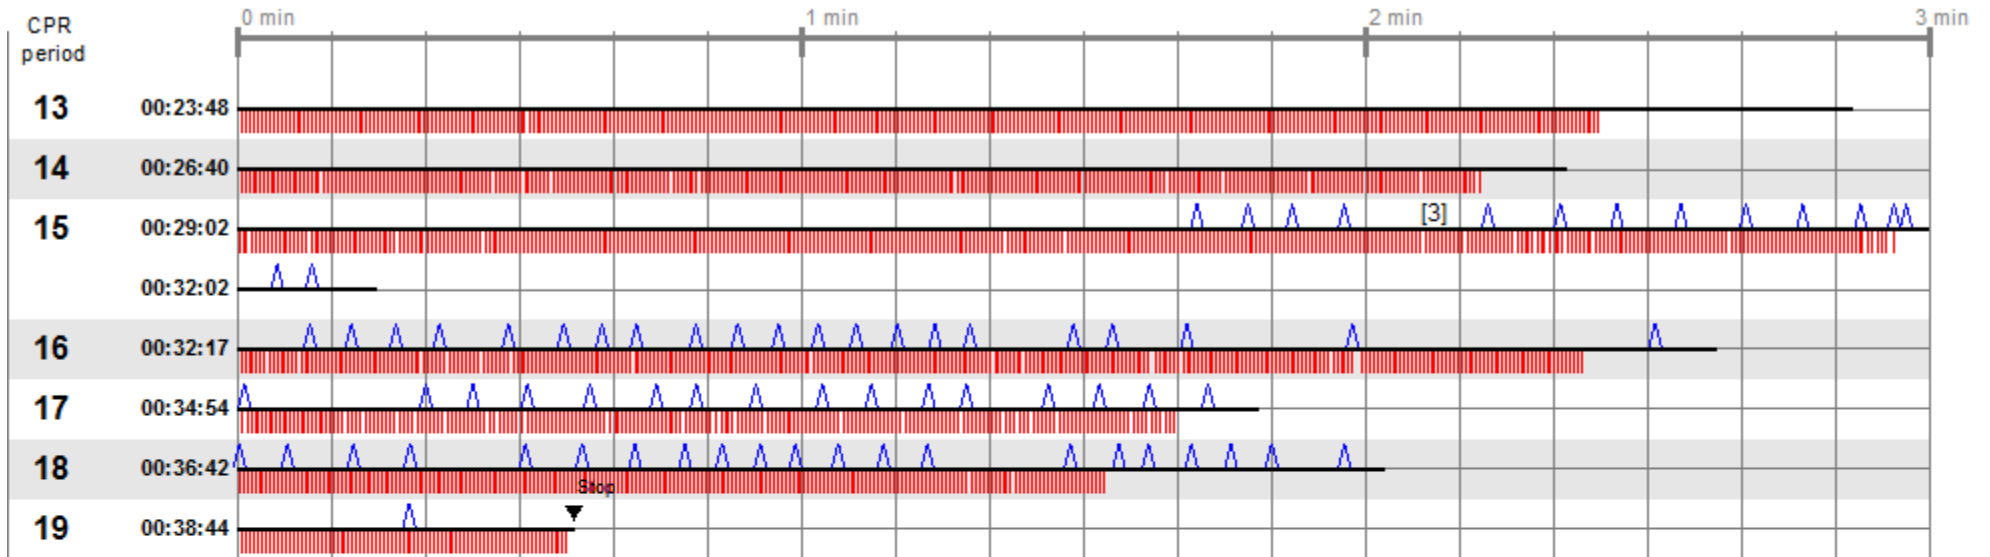

[1] Generic, [2] Generic, [3] Epinephrine