

Case summary

Incident ID: 23-07211
Patient ID: 2023031214432100-LP1547546923
Patient Name: Patterson

Patient ID:	<u>2023031214432100-LP1547546923</u>	Birth Date:	
Incident ID:	<u>23-07211</u>	Device ID:	<u>CROZER EMS</u>
Age at Incident:	<u>35 Years</u>	Case Start Date:	<u>3/12/2023</u>
Sex:	<u>Female</u>	Case Start Time:	<u>2:43:21 PM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

Notes:

Lucas?
Missed VF defib
PEA documented as asystole
5 mins between some pulse checks.
Updated at 4/8/2023 9:25:06 PM by zphillips (Zach Phillips).
Updated at 5/20/2023 12:19:17 AM by zphillips (Zach Phillips).

Comments:

Table of Contents

CPR reports (by CPR period)3

 CPR report (by CPR period)3

CPR report




Device Type: LIFEPAK® 15
 Power On: 3/12/2023 2:43:21 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2D355RO40200OR

Duration: 00:45:33
 Incident ID: 23-07211
 Statistical Parameters: 1000-0300-3000-05


*Times have been adjusted by the system.

Compression ratio
 (/total time)




37:54 / 41:35 = 91 %

Compression rate





102/minute

Ventilations/minute



--

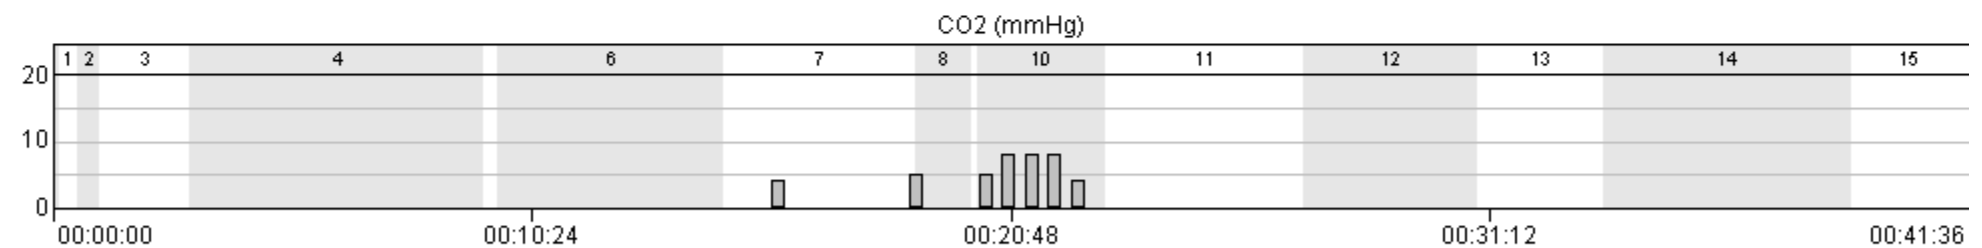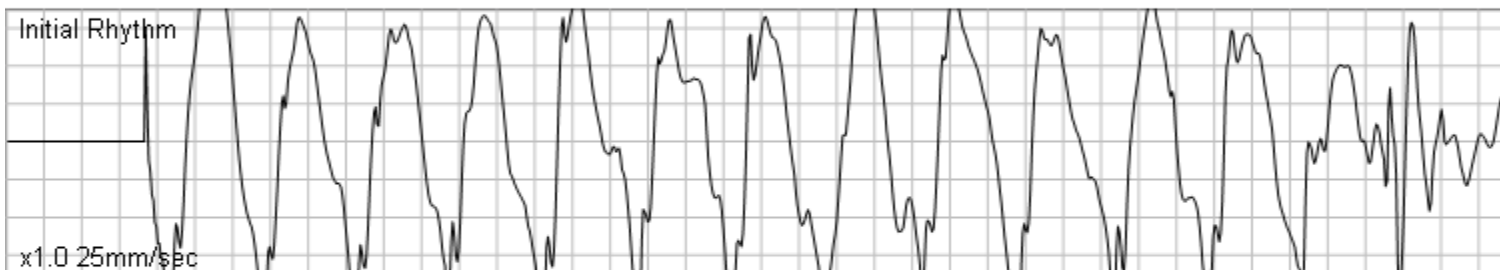

CPR report



Device Type: LIFEPAK® 15
 Power On: 3/12/2023 2:43:21 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2D355RO40200OR

Duration: 00:45:33
 Incident ID: 23-07211
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

Summary

CPR needed	= 41:35	CPR done	= 37:54
CPR not done	= 3:41	Compression count	= 3847
Longest compression pause	= 0:33	Pauses over 10 sec	= 9

Comment: LUCAS. LUCAS on, pulse checks forgotten. Missed a shockable rhythm

Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:00	00:00:07	00:00:06	00:00:23	Pulse/rhythm check		22	127	--
2		00:00:29	00:00:42	00:00:13	00:00:16	Unknown		45	123	--
3		00:00:58	00:02:22	00:01:24	00:00:33	Pulse/rhythm check	Applied LUCAS, 33 secs to put on.	72	102	--
4		00:02:56	00:09:08	00:06:12	00:00:12	Pulse/rhythm check	6:12 between pulse checks	97	102	--
5		00:09:20	00:09:28	00:00:08	00:00:10	Unknown		45	102	--
6		00:09:38	00:14:22	00:04:44	00:00:09	Pulse/rhythm check	4:44 between pulse checks	96	102	--
7		00:14:31	00:18:24	00:03:53	00:00:18	Pulse/rhythm check	3:53 between pulse checks	93	102	--
8		00:18:42	00:19:49	00:01:07	00:00:05	Pulse/rhythm check	1 min between pulse checks	94	102	--
9		00:19:54	00:19:59	00:00:04	00:00:05	Unknown		54	103	--
10		00:20:04	00:22:45	00:02:41	00:00:06	Pulse/rhythm check		96	102	--
11		00:22:51	00:26:34	00:03:43	00:00:33	Pulse/rhythm check		87	102	--
12		00:27:07	00:30:43	00:03:36	00:00:13	Pulse/rhythm check		95	102	--
13		00:30:55	00:33:18	00:02:22	00:00:23	Pulse/rhythm check		86	102	--
14		00:33:40	00:38:48	00:05:08	00:00:15	Pulse/rhythm check	5:08 between pulse checks	95	102	--
15		00:39:04	00:41:35	00:02:31	00:00:01	Termination/Transfer of Care		100	102	--


CPR report




Device Type: LIFEPAK® 15
 Power On: 3/12/2023 2:43:21 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2D355RO40200OR

Duration: 00:45:33
 Incident ID: 23-07211
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.



CPR QUIK-VIEW

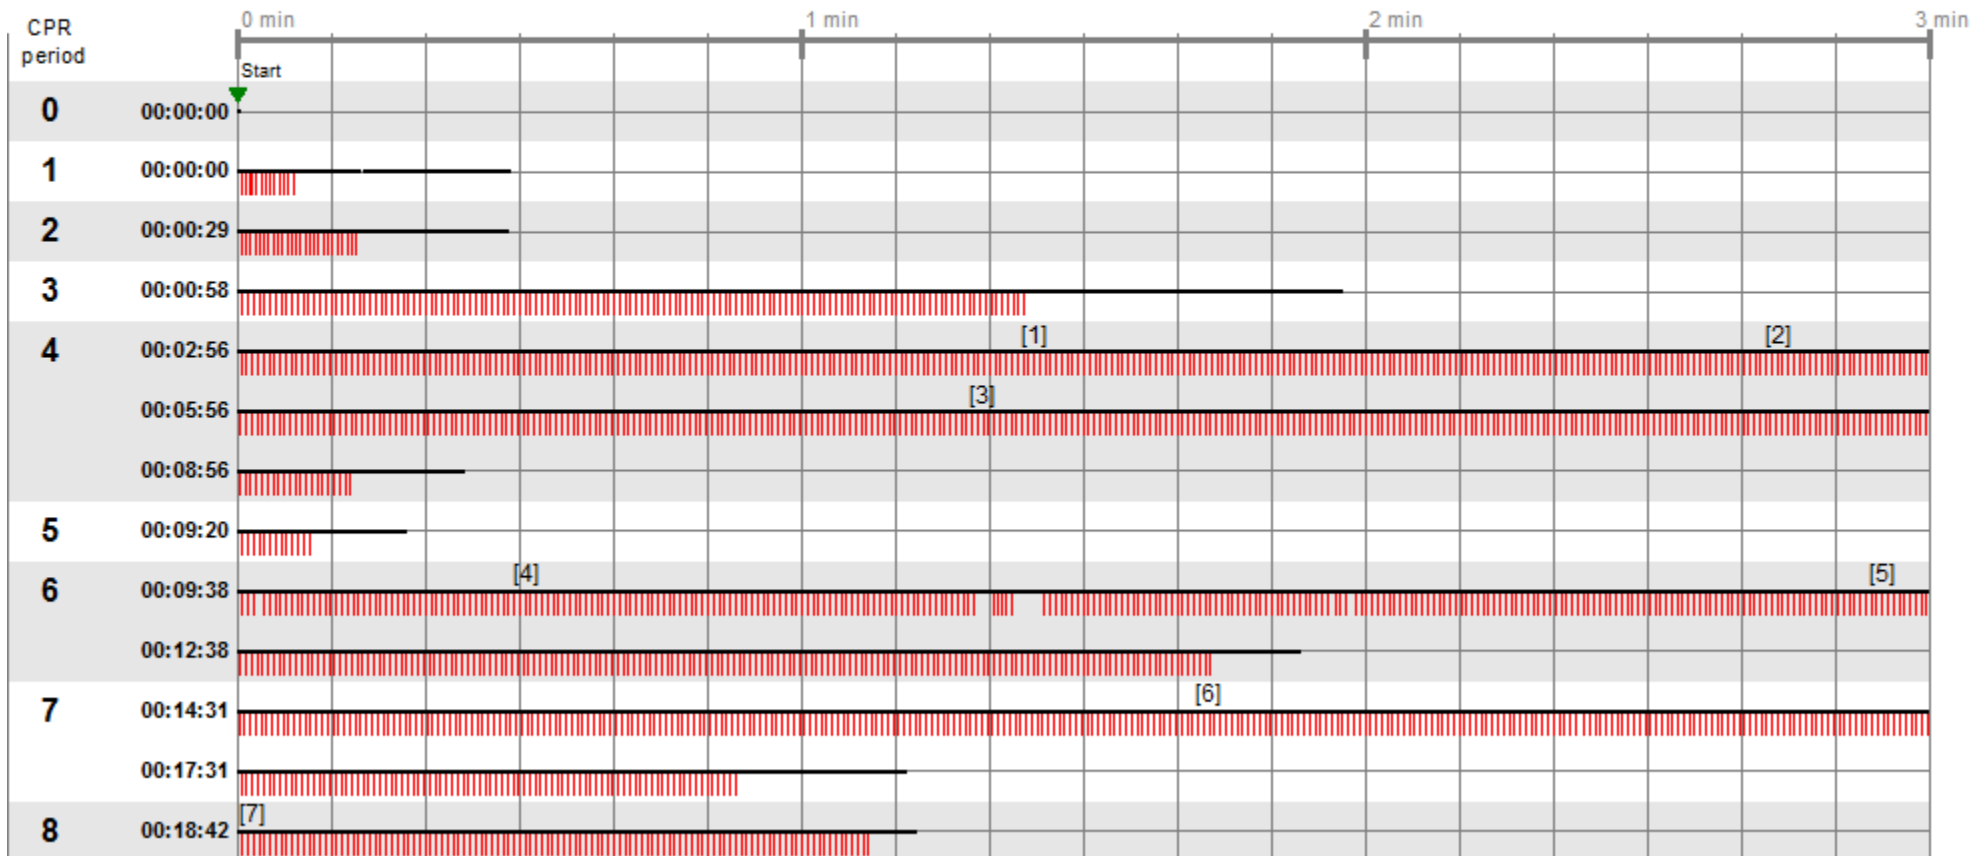

CPR report




Device Type: LIFEPAK® 15
 Power On: 3/12/2023 2:43:21 PM
 CPR Annotations Edited: Yes
 Device Configuration: 2D355R0402000R

Duration: 00:45:33
 Incident ID: 23-07211
 Statistical Parameters: 1000-0300-3000-05

*Times have been adjusted by the system.

CPR QUIK-VIEW

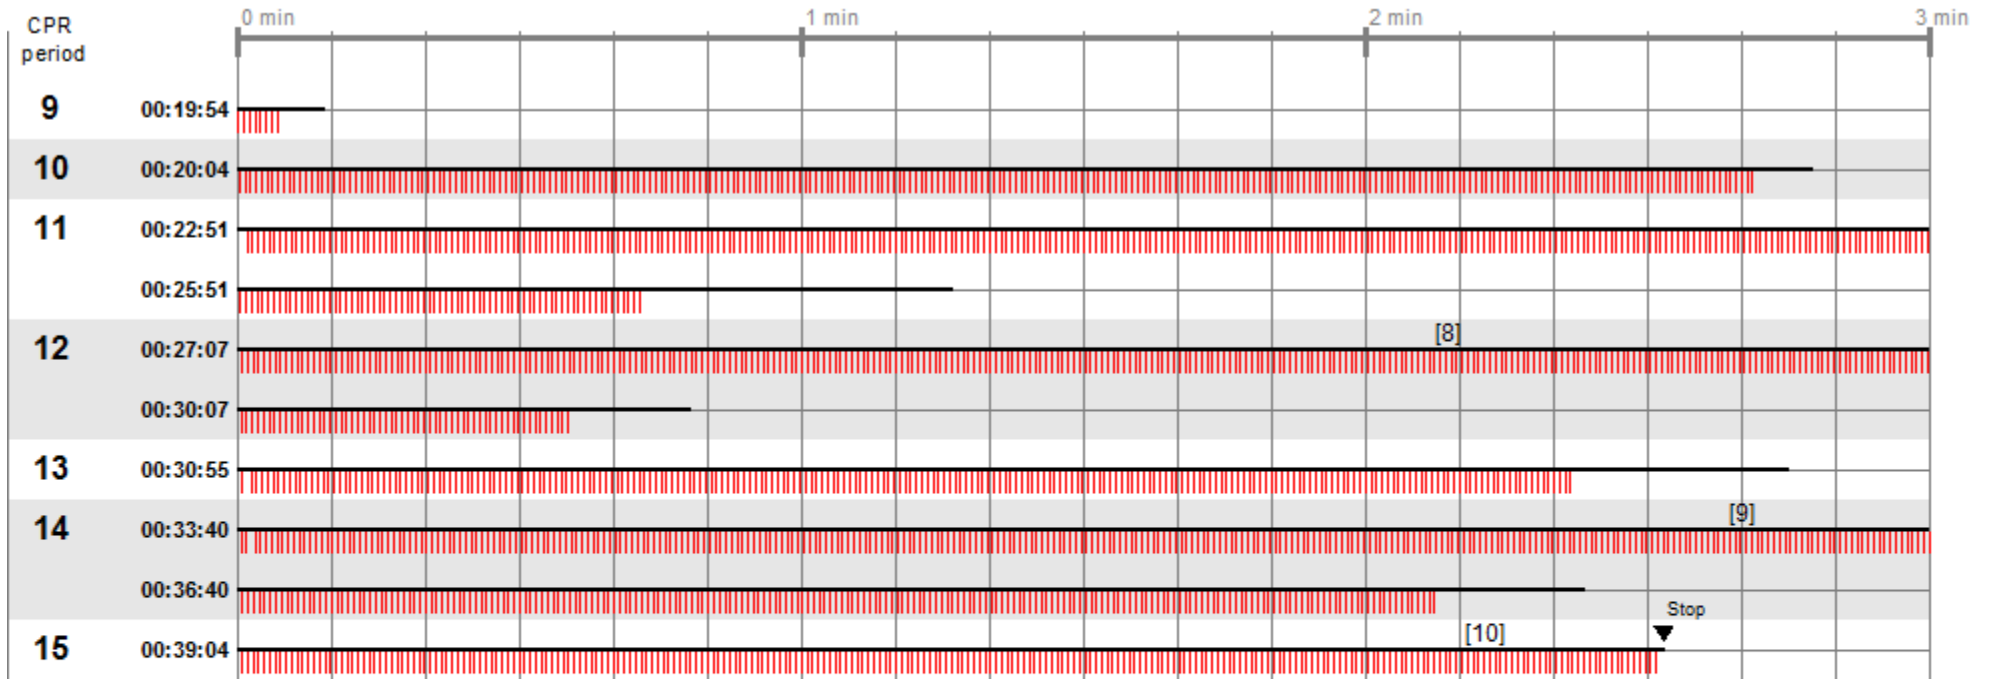

[1] Generic, [2] Generic, [3] Generic, [4] Generic, [5] Generic, [6] Generic, [7] Generic, [8] Generic, [9] Generic, [10] Generic