

## Case summary

Incident ID: 23-01720  
Patient ID: 2023011808274600-LP1547546923  
Patient Name: Florio

Patient ID:	<u>2023011808274600-LP1547546923</u>	Birth Date:	
Incident ID:	<u>23-01720</u>	Device ID:	<u>DCMH 7</u>
Age at Incident:	<u>87 Years</u>	Case Start Date:	<u>1/18/2023</u>
Sex:	<u>Male</u>	Case Start Time:	<u>8:27:46 AM</u>
Race:	<u>Unspecified</u>	Time Adjustment:	<u>System Adjusted Time</u>

### Case Summary:

Total Analyses: 0  
Total Shocks: 3  
Total 12-Leads: 2  
Total Time Paced: 00:00:00

### Notes:

\*\*\*09:11:40 - 90 seconds of probable PEA prior to compressions starting again.  
09:21:52 - VF on monitor, shocked at 09:22:59, but looks like Asystole  
09:25:18 - Looks like ST with a pulse based on impedance and rhythm  
09:26:23 - Shocked ST  
09:28:03 - Shocked ST  
Updated at 1/25/2023 3:03:46 AM by zphillips (Zach Phillips).  
Updated at 1/29/2023 9:04:36 PM by zphillips (Zach Phillips).

### Comments:

# Table of Contents

- 12-Lead reports .....3
  - 12-Lead 1 .....3
  - 12-Lead 2 .....4
- CPR reports (by CPR period) .....5
  - CPR report (by CPR period) .....5


\*Times have been adjusted by the system.

## 12-Lead 1

Incident ID: 23-01720  
Patient ID: 2023011808274600-LP1547546923  
Patient Name: Florio  
Power On: 1/18/2023 8:27:46 AM  
Speed/Size: 25mm/sec/ x1.0

Device Type: LIFEPAK® 15  
Device ID: DCMH 7  
Serial Number: LP1547546923  
Device Configuration: 2D355RO40200OR  
Software Version: 3313494-010

Name: 12-Lead 1 HR 117bpm Abnormal ECG \*\*Unconfirmed\*\*  
ID: 011823082746 1/18/2023 8:57:18 AM Atrial fibrillation with rapid ventricular response  
Patient ID: PR 0.204s QRS 0.132s RBBB with left anterior fascicular block  
Incident ID: QT/QTc: 0.300s/0.399s Left ventricular hypertrophy  
Age: 87 Sex: M P-QRS-T Axes: 23°-56°150° Inferior/lateral ST-T abnormality may be due to hypertrophy and/or ischemia  
I aVR V1 V4

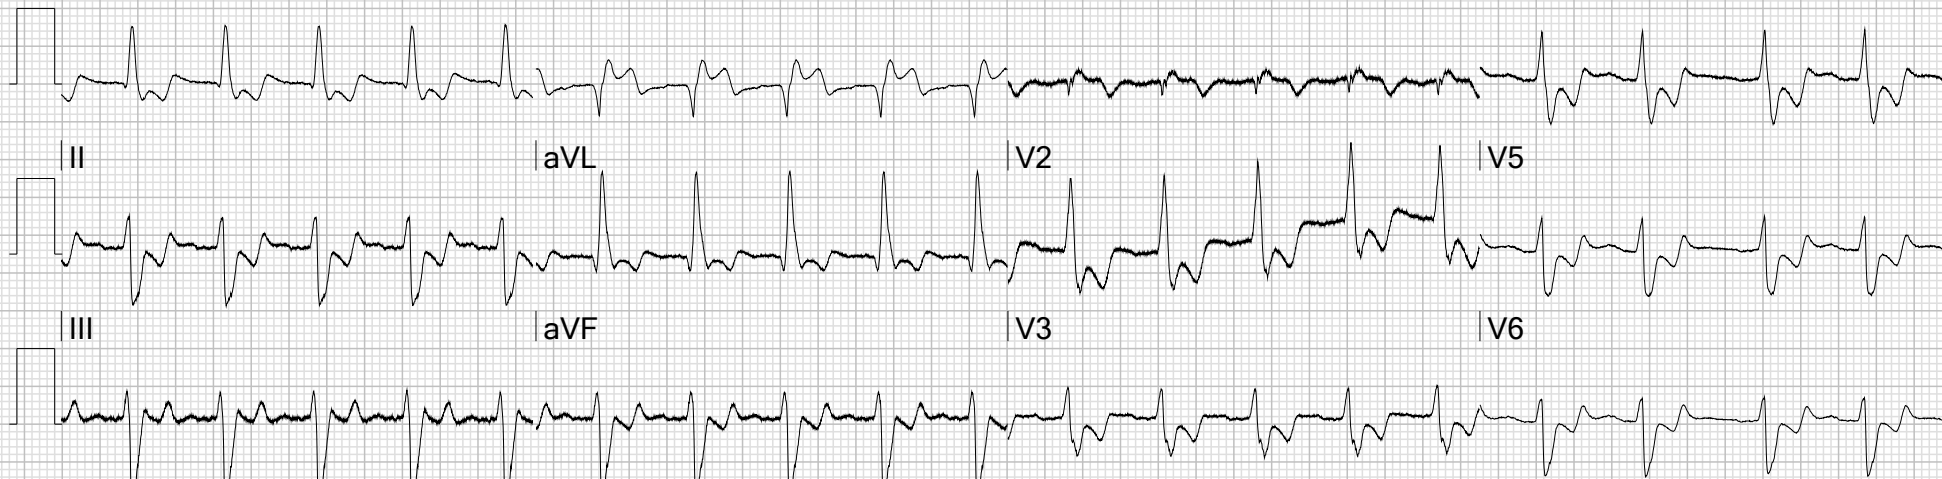

x1.0 .05-150Hz 25mm/sec

Physio-Control, Inc. Comments:


DCMH 7 DCMH MEDICS 3313494-010 LP1547546923

## 12-Lead 2

Incident ID: 23-01720  
 Patient ID: 2023011808274600-LP1547546923  
 Patient Name: Florio  
 Power On: 1/18/2023 8:27:46 AM  
 Speed/Size: 25mm/sec/ x1.0

Device Type: LIFEPAK® 15  
 Device ID: DCMH 7  
 Serial Number: LP1547546923  
 Device Configuration: 2D355RO40200OR  
 Software Version: 3313494-010

Name: 12-Lead 2 HR 67bpm Abnormal ECG \*\*Unconfirmed\*\*  
 ID: 011823082746 1/18/2023 9:09:28 AM Atrial fibrillation  
 Patient ID: PR 0.238s QRS 0.172s RBBB with left anterior fascicular block  
 Incident ID: QT/QTc: 0.370s/0.382s QRS changes V3/V4 may be due to LVH but cannot rule out anterior infarct  
 Age: 87 Sex: M P-QRS-T Axes: 81°-58°-142° Left ventricular hypertrophy  
 Inferior/lateral ST-T abnormality may be due to hypertrophy and/or ischemia

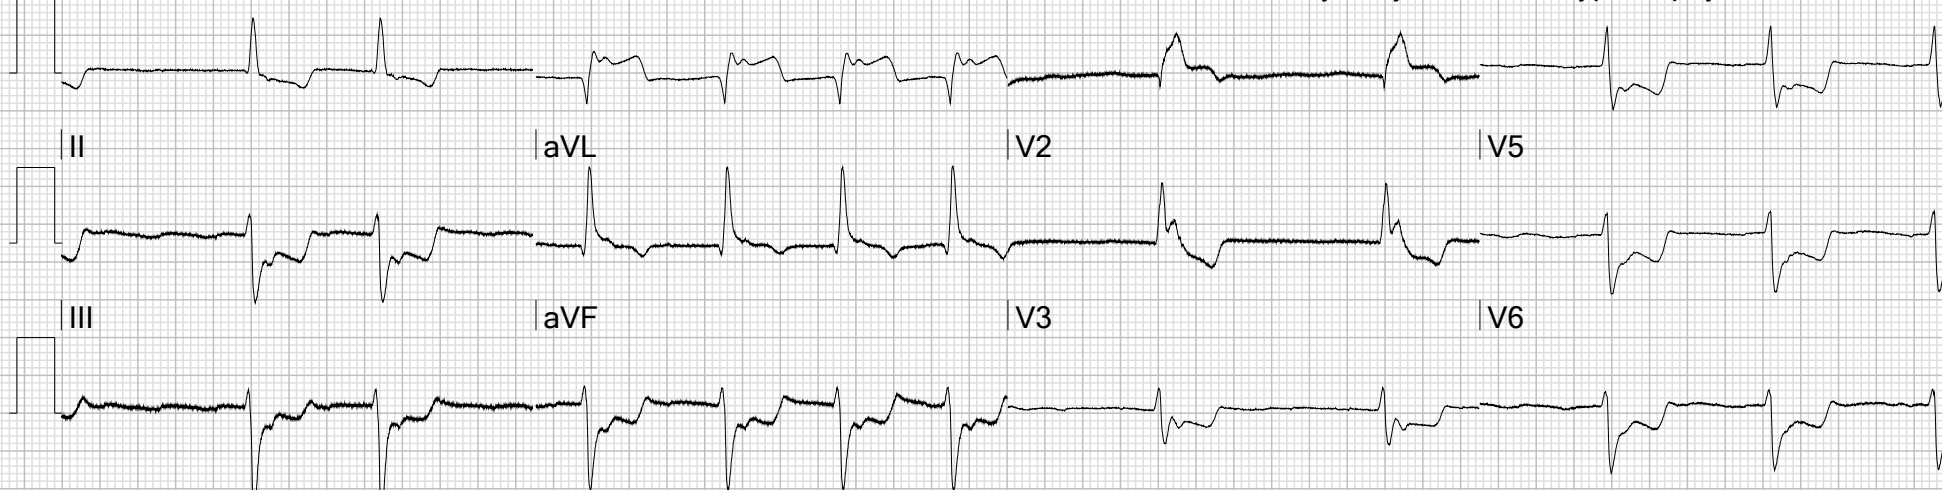

x1.0 .05-150Hz 25mm/sec

Physio-Control, Inc. Comments:

DCMH 7 DCMH MEDICS 3313494-010 LP1547546923

# CPR report




Device Type: LIFEPAK® 15  
 Power On: 1/18/2023 8:27:46 AM  
 CPR Annotations Edited: Yes  
 Device Configuration: 2D355RO402000R

Duration: 01:21:12  
 Incident ID: 23-01720  
 Statistical Parameters: 1000-0300-3000-05


\*Times have been adjusted by the system.

Compression ratio  
 (/total time)




33:28 / 44:00 = 76 %

Compression rate





124/minute

Ventilations/minute



--

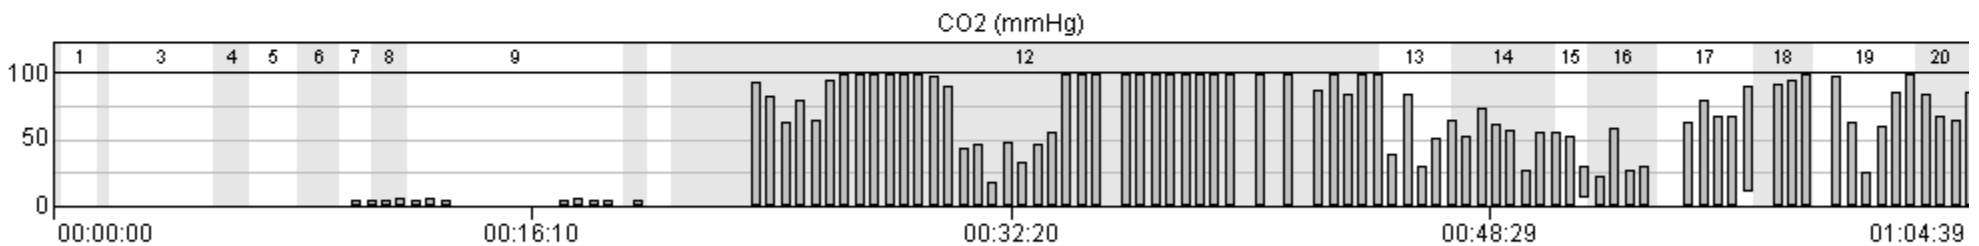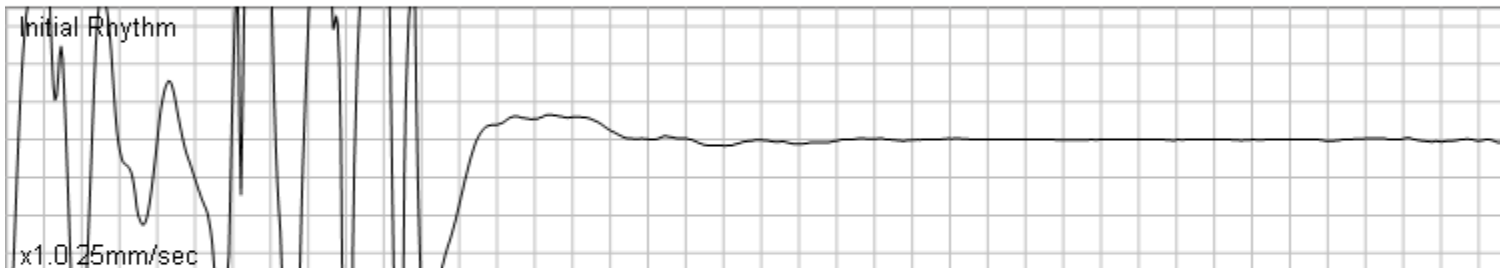

## CPR report



Device Type: LIFEPAK® 15  
Power On: 1/18/2023 8:27:46 AM  
CPR Annotations Edited: Yes  
Device Configuration: 2D355RO402000R

Duration: 01:21:12  
Incident ID: 23-01720  
Statistical Parameters: 1000-0300-3000-05

\*Times have been adjusted by the system.

## Summary

CPR needed	= 44:00	CPR done	= 34:31
CPR not done	= 9:29	Compression count	= 4042
Longest compression pause	= 1:33	Pauses over 10 sec	= 20

Comment

# CPR report



Device Type: LIFEPAK® 15  
 Power On: 1/18/2023 8:27:46 AM  
 CPR Annotations Edited: Yes  
 Device Configuration: 2D355RO40200OR

Duration: 01:21:12  
 Incident ID: 23-01720  
 Statistical Parameters: 1000-0300-3000-05

\*Times have been adjusted by the system.

## Interval Statistics

CPR period	Responsible for CPR	CPR started	CPR stopped	CPR duration	Pause duration	Reason CPR stopped	Comments	Compr. ratio, %	Compr. rate	Vent. /min
1		00:00:12	00:00:46	00:00:34	00:00:40			46	155	--
2		00:01:26	00:01:32	00:00:06	00:00:20			23	111	--
3		00:01:51	00:05:04	00:03:12	00:00:19			89	132	--
4		00:05:23	00:06:10	00:00:47	00:00:24			66	126	--
5		00:06:34	00:07:58	00:01:24	00:00:13			74	117	--
6		00:08:11	00:09:20	00:01:08	00:00:20			78	126	--
7		00:09:39	00:10:07	00:00:28	00:00:35			45	116	--
8		00:10:42	00:11:22	00:00:41	00:00:34			54	111	--
9		00:11:56	00:18:33	00:06:37	00:00:41			88	121	--
10		00:19:14	00:19:48	00:00:34	00:00:12			73	114	--
11		00:20:01	00:20:40	00:00:40	00:00:11			78	108	--
12		00:20:52	00:22:42	00:01:51	00:22:05			54	106	--
13		00:44:47	00:46:52	00:02:05	00:00:18			85	118	--
14		00:47:09	00:50:16	00:03:07	00:00:26			88	124	--
15		00:50:42	00:51:20	00:00:38	00:00:26			59	128	--
16		00:51:46	00:53:24	00:01:37	00:00:46			64	118	--
17		00:54:10	00:56:51	00:02:41	00:00:34			79	129	--
18		00:57:25	00:58:54	00:01:29	00:00:32			69	131	--
19		00:59:27	01:02:41	00:03:14	00:00:11			88	129	--
20		01:02:52	01:04:39	00:01:47	00:00:00			97	131	--

Ventilation

Chest compression

AED-prompted CPR period

AED Analysis

Shock

ROSC (user annotated)

# CPR report




Device Type: LIFEPAK® 15  
 Power On: 1/18/2023 8:27:46 AM  
 CPR Annotations Edited: Yes  
 Device Configuration: 2D355RO40200OR

Duration: 01:21:12  
 Incident ID: 23-01720  
 Statistical Parameters: 1000-0300-3000-05

\*Times have been adjusted by the system.

## CPR QUIK-VIEW

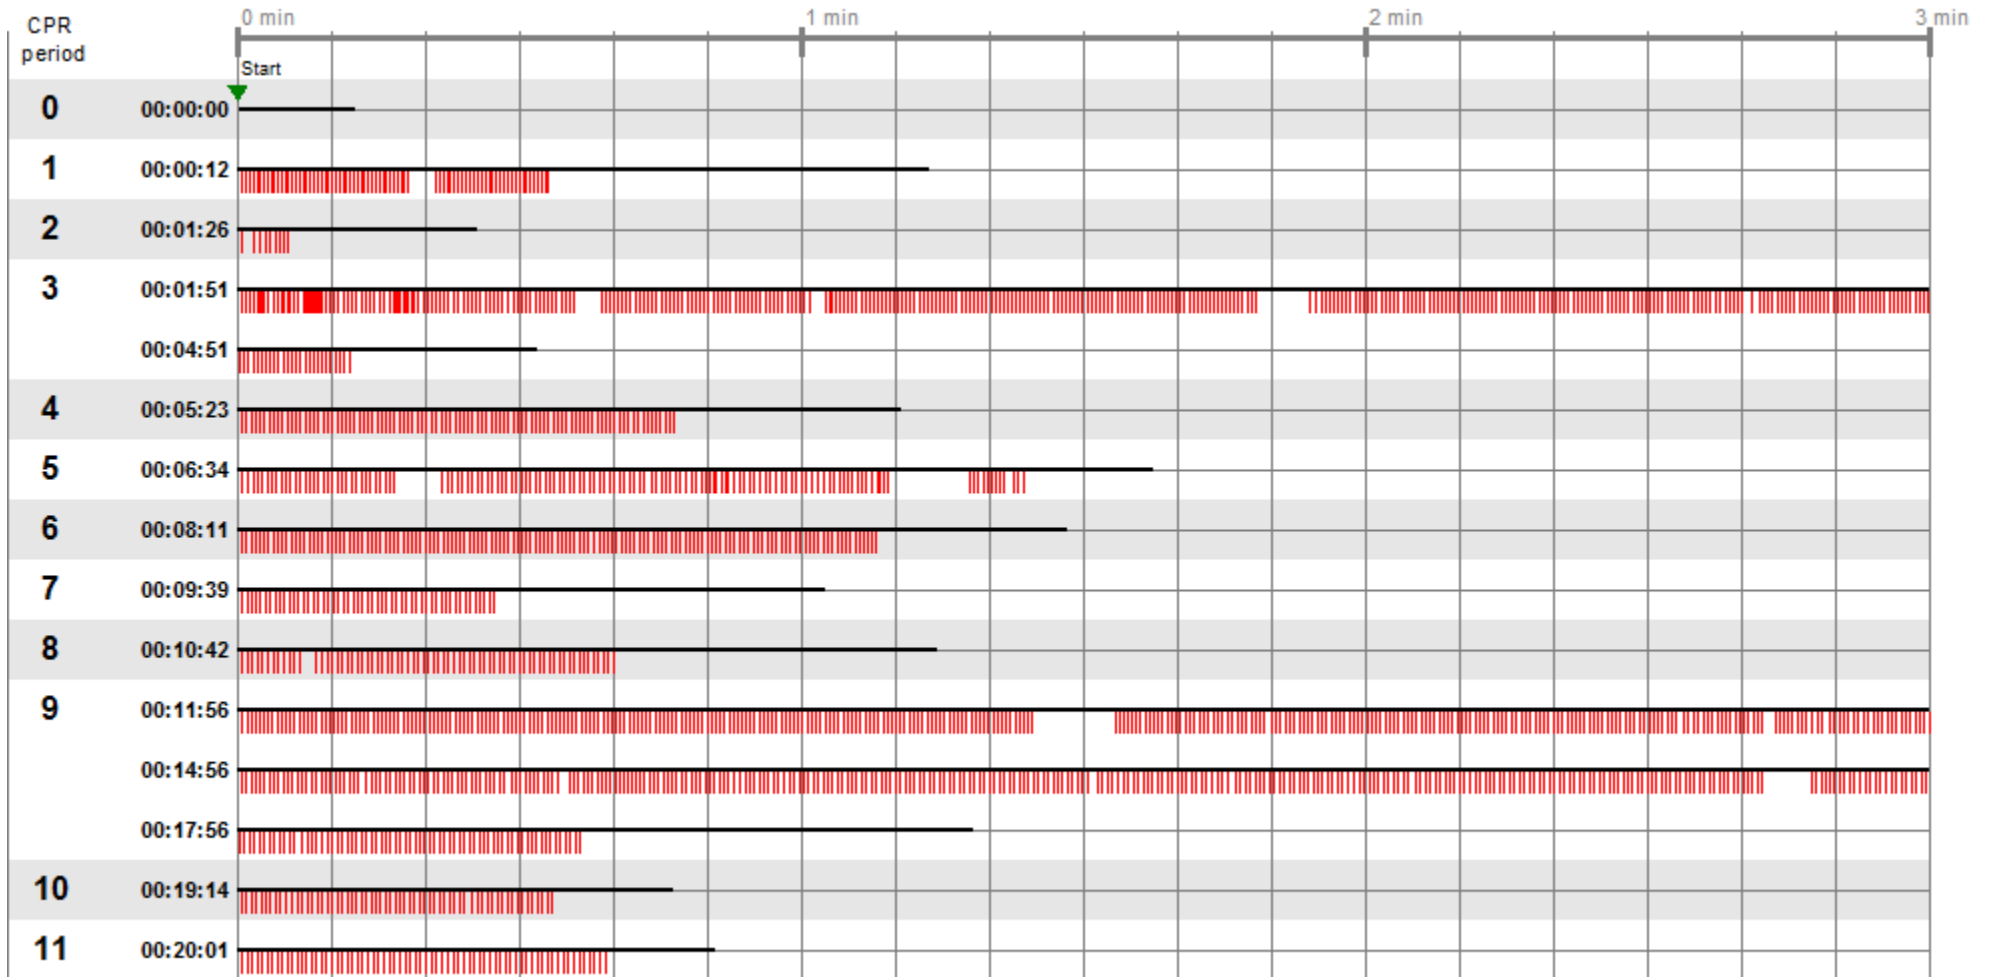



# CPR report




Device Type: LIFEPAK® 15  
 Power On: 1/18/2023 8:27:46 AM  
 CPR Annotations Edited: Yes  
 Device Configuration: 2D355R0402000R

Duration: 01:21:12  
 Incident ID: 23-01720  
 Statistical Parameters: 1000-0300-3000-05

\*Times have been adjusted by the system.

## CPR QUIK-VIEW

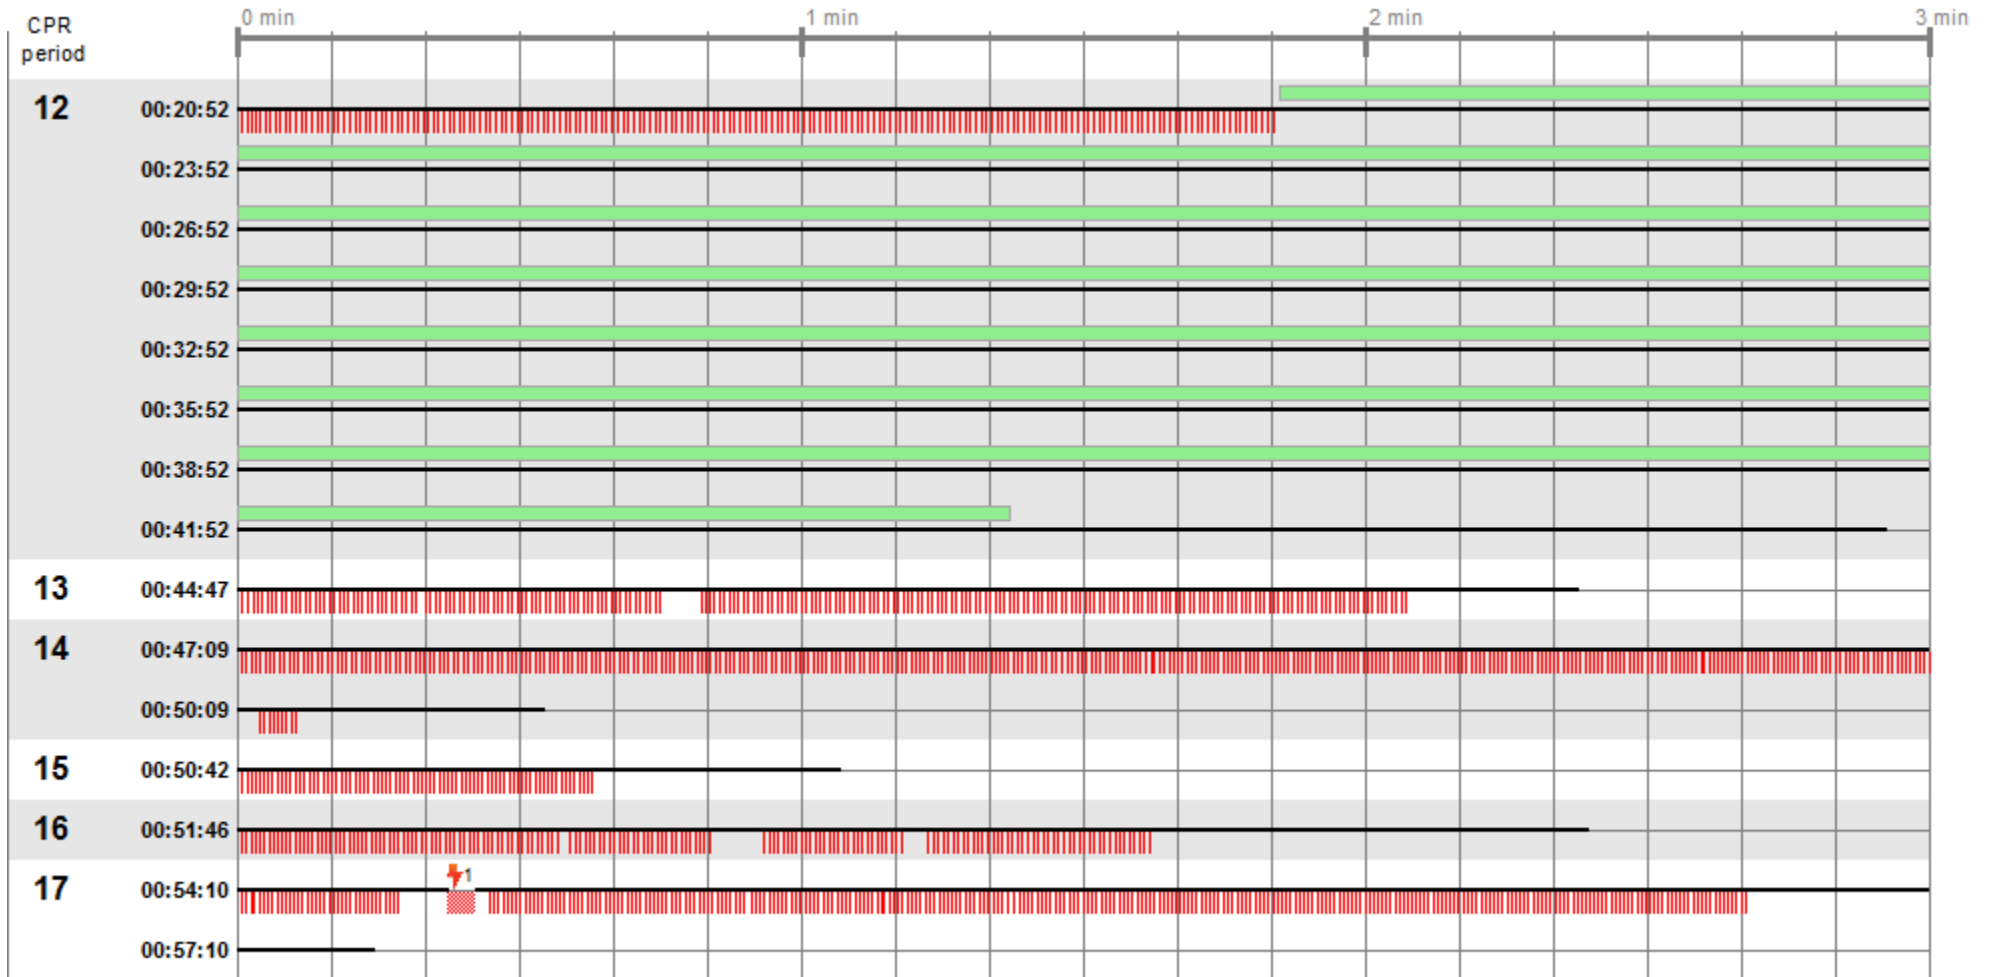

## CPR report




Device Type: LIFEPAK® 15  
 Power On: 1/18/2023 8:27:46 AM  
 CPR Annotations Edited: Yes  
 Device Configuration: 2D355R0402000R

Duration: 01:21:12  
 Incident ID: 23-01720  
 Statistical Parameters: 1000-0300-3000-05

\*Times have been adjusted by the system.

### CPR QUIK-VIEW

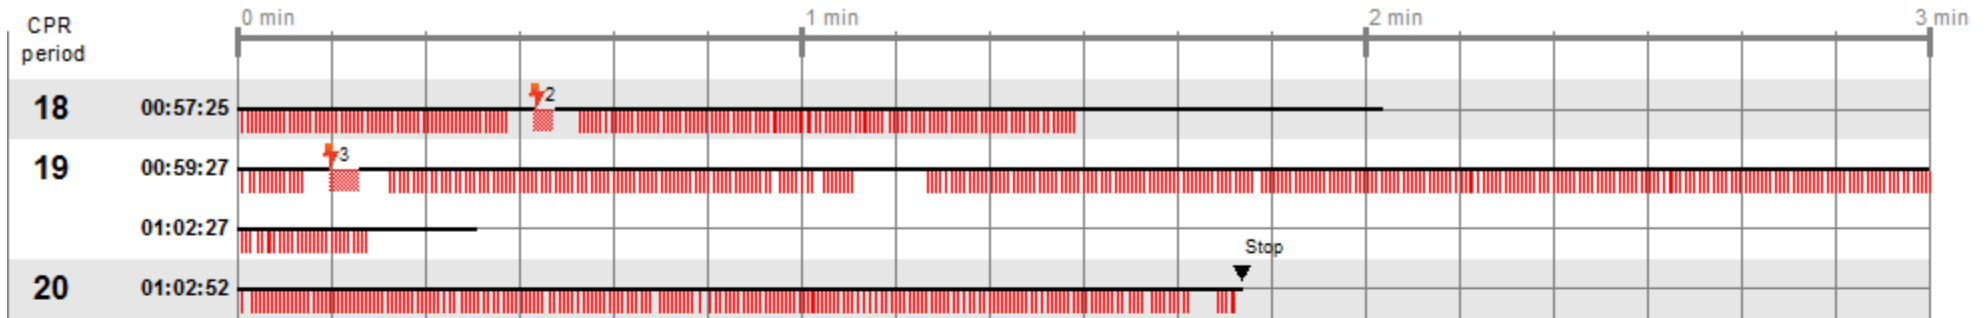

Shock	Time	Energy	Pre-shock CPR pause	Post-shock CPR pause
⚡1	54:33	200 J	0:00	0:00
⚡2	57:56	200 J	0:00	0:00
⚡3	59:36	200 J	0:00	0:00